



EDUS 39-802A-R1_a

R-410A

Engineering Data

VRV[®] III

RXYQ_PTJU

3 phase

208-230V

60Hz

DAIKIN AC (AMERICAS), INC.

RXYQ-P (3 ϕ , 208-230V 60Hz) Heat Pump

1. Specifications	2
2. Dimensions	5
3. Service Space	8
4. Piping Diagrams.....	9
5. Wiring Diagrams.....	11
6. Field Wiring	13
7. Electric Characteristics.....	15
8. Capacity Tables (Reference Data).....	17
8.1 Cooling Capacity (RXYQ-PTJU)	17
8.2 Heating Capacity (RXYQ-PTJU)	25
8.3 Capacity Correction Factor.....	41
9. Operation Limits	48
10. Sound Levels	49
11. Accessories	50

1. Specifications

Model Name		RXYQ72PTJU	RXYQ96PTJU	RXYQ120PTJU
Power Supply		3 Phase 60Hz 208V-230V	3 Phase 60Hz 208V-230V	3 Phase 60Hz 208V-230V
★1 Cooling Capacity	Btu / h	72,000	96,000	120,000
★2 Heating Capacity	Btu / h	81,000	108,000	135,000
Casing Color		Ivory White (5Y7.5/1)	Ivory White (5Y7.5/1)	Ivory White (5Y7.5/1)
Dimensions: (HxWxD)	in (mm)	66-1/8 x 36-5/8 x 30-1/8" (1680 x 930 x 765 mm)	66-1/8 x 36-5/8 x 30-1/8" (1680 x 930 x 765 mm)	66-1/8 x 36-5/8 x 30-1/8" (1680 x 930 x 765 mm)
Heat Exchanger		Cross Fin Coil	Cross Fin Coil	Cross Fin Coil
Comp.	Type	Hermetically Sealed Scroll Type	Hermetically Sealed Scroll Type	Hermetically Sealed Scroll Type
	Piston Displacement	m ³ /h	10.53+13.34	10.53+13.34
	Number of Revolutions	r.p.m	(2900, 6300)	2900, 6300
	Motor Output×Number of Units	kW	(4.7) × 1	(2.2+4.5) × 1
Starting Method		Soft Start	Soft Start	Soft Start
Fan	Type	Propellor Fan	Propellor Fan	Propellor Fan
	Motor Output	kW	(0.75) × 1	(0.75) × 1
	Air Flow Rate	cfm	6,530	6,530
	Drive		Direct Drive	Direct Drive
Connecting Pipes	Liquid Pipe	in (mm)	φ 3/8" (9.5 mm) C1220T (Brazing Connection)	φ 3/8" (9.5 mm) C1220T (Brazing Connection)
	Gas Pipe	in (mm)	φ 3/4" (19.1 mm) C1220T (Brazing Connection)	φ 7/8" (22.2 mm) C1220T (Brazing Connection)
	Discharge Gas Pipe	in (mm)	—	—
Mass	Lbs (kg)	560 lbs (254 kg)	560 lbs (254 kg)	560 lbs (254 kg)
★3 Sound Level (Reference Value)	dBA	58	58	60
Safety Devices		High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector	High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector	High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector
Defrost Method		Deicer	Deicer	Deicer
Capacity Control	%	20~100	14~100	14~100
Refrigerant	Refrigerant Name		R-410A	R-410A
	Charge	Lbs	18.1	19.8
	Control		Electronic Expansion Valve	Electronic Expansion Valve
Standard Accessories		Installation Manual, Operation Manual, Connection Pipes, Clamps	Installation Manual, Operation Manual, Connection Pipes, Clamps	Installation Manual, Operation Manual, Connection Pipes, Clamps
Drawing No.		4D058605	4D058606	4D058607

Notes:

- ★1 Indoor temp. : 80°FDB or 67°FWB / outdoor temp. : 95°FDB / Equivalent piping length : 25 ft (7.5 m), level difference : 0 ft.
- ★2 Indoor temp. : 70°FDB / outdoor temp. : 47°FDB or 43°FWB / Equivalent piping length : 25 ft (7.5 m), level difference : 0 ft.
- ★3 Anechoic chamber conversion value, measured under JISB8616 conditions. During actual operation, these values are normally somewhat higher as a result of ambient conditions.

Model Name		RXYQ144PTJU	RXYQ168PTJU	RXYQ192PTJU
Model (Independent Unit)		—	RXYQ72PTJU RXYQ96PTJU	RXYQ72PTJU RXYQ120PTJU
Power Supply		3 Phase 60Hz 208V-230V	3 Phase 60Hz 208V-230V	3 Phase 60Hz 208V-230V
★1 Cooling Capacity	Btu / h	144,000	168,000	192,000
★2 Heating Capacity	Btu / h	162,000	189,000	216,000
Casing Color		Ivory White (5Y7.5/1)	Ivory White (5Y7.5/1)	Ivory White (5Y7.5/1)
Dimensions: (HxWxD)	in (mm)	66-1/8 x 36-5/8 x 30-1/8" (1680 x 1300.2 x 765 mm)	66-1/8 x 36-5/8 x 30-1/8" (1680 x 930 x 765 mm) + 66-1/8 x 36-5/8 x 30-1/8" (1680 x 930 x 765 mm)	66-1/8 x 36-5/8 x 30-1/8" (1680 x 930 x 765 mm) + 66-1/8 x 36-5/8 x 30-1/8" (1680 x 930 x 765 mm)
Heat Exchanger		Cross Fin Coil	Cross Fin Coil	Cross Fin Coil
Comp.	Type	Hermetically Sealed Scroll Type	Hermetically Sealed Scroll Type	Hermetically Sealed Scroll Type
	Piston Displacement	m ³ /h	16.90+16.90	16.90 + (10.53+13.34)
	Number of Revolutions	r.p.m	7980, 7980	7980, (2900, 6300)
	Motor OutputxNumber of Units	kW	3.8+3.8	(4.7) × 1 + (2.2+4.5) × 1
	Starting Method		Direct on Line	Soft Start
Fan	Type	Propellor Fan	Propellor Fan	Propellor Fan
	Motor Output	kW	0.75 × 2	(0.75) × 1 + (0.75) × 1
	Air Flow Rate	cfm	8,299	6,530+6,530
	Drive		Direct Drive	Direct Drive
Connecting Pipes	Liquid Pipe	in (mm)	φ 1/2" (12.7 mm) C1220T (Brazeing Connection)	φ 5/8" (15.9mm) C1220T (Brazeing Connection) ★3
	High Pressure Equalizer Pipe	in (mm)	—	φ 3/4" (19.1 mm) C1220T (Brazeing Connection)
	Gas Pipe	in (mm)	φ 1-1/8" (28.6 mm) C1220T (Brazeing Connection)	φ 1-1/8" (28.6 mm) C1220T (Brazeing Connection) ★3
	Low Pressure Gas Pipe	in (mm)	—	φ 3/4" (19.1 mm) C1220T (Brazeing Connection)
Mass	Lbs (kg)	747 lbs (338.8 kg)	560+560 lbs (254 + 254 kg)	560+560 lbs (254 + 254 kg)
★4 Sound Level (Reference Value)	dBA	61	—	—
Safety Devices		High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector	High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector	High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector
Defrost Method		Deicer	Deicer	Deicer
Capacity Control	%	10~100	9~100	7~100
Refrigerant	Refrigerant Name	R-410A	R-410A	R-410A
	Charge	Lbs	24.5	18.1+19.8
	Control		Electronic Expansion Valve	Electronic Expansion Valve
Standard Accessories		Installation Manual, Operation Manual, Connection Pipes, Clamps	Installation Manual, Operation Manual, Connection Pipes, Clamps	Installation Manual, Operation Manual, Connection Pipes, Clamps
Drawing No.		4D058608	4D060126	4D060127

Notes:

- ★1 Indoor temp. : 80°FDB or 67°FWB / outdoor temp. : 95°FDB / Equivalent piping length : 25 ft (7.5 m), level difference : 0 ft.
- ★2 Indoor temp. : 70°FDB / outdoor temp. : 47°FDB or 43°FWB / Equivalent piping length : 25 ft (7.5 m), level difference : 0 ft.
- ★3 BHFP22P100U is necessary for the connection.
Concerning about the piping connection for each outdoor unit to the main line as shown above, use REFNET.
- ★4 Anechoic chamber conversion value, measured under JISB8616 conditions. During actual operation, these values are normally somewhat higher as a result of ambient conditions.


Model Name (Combination Unit)		RXYQ216PTJU		RXYQ240PTJU		
Model Name (Independent Unit)		RXYQ96PTJU RXYQ120PTJU		RXYQ120PTJU RXYQ120PTJU		
Power Supply		3 Phase 60Hz 208V-230V		3 Phase 60Hz 208V-230V		
★1 Cooling Capacity	Btu / h	216,000		240,000		
★2 Heating Capacity	Btu / h	243,000		270,000		
Casing Color		Ivory White (5Y7.5/1)		Ivory White (5Y7.5/1)		
Dimensions: (H×W×D)	in (mm)	66-1/8 × 36-5/8 × 30-1/8" (1680 × 930 × 765 mm) + 66-1/8 × 36-5/8 × 30-1/8" (1680 × 930 × 765 mm)		66-1/8 × 36-5/8 × 30-1/8" (1680 × 930 × 765 mm) + 66-1/8 × 36-5/8 × 30-1/8" (1680 × 930 × 765 mm)		
Heat Exchanger		Cross Fin Coil		Cross Fin Coil		
Comp.	Type	Hermetically Sealed Scroll Type		Hermetically Sealed Scroll Type		
	Piston Displacement	m ³ /h	(10.53+13.34) × 2		(10.53+13.34) × 2	
	Number of Revolutions	r.p.m	(2900, 6300) × 2		(2900, 6300) × 2	
	Motor Output×Number of Units	kW	(2.2+4.5) × 1 + (3.5+4.5) × 1		(3.5+4.5) × 2	
Starting Method		Soft Start		Soft Start		
Fan	Type	Propellor Fan		Propellor Fan		
	Motor Output	kW	(0.75) × 1 + (0.75) × 1		(0.75) × 1 + (0.75) × 1	
	Air Flow Rate	cfm	6,530+7,060		7,060+7,060	
	Drive	Direct Drive		Direct Drive		
Connecting Pipes	Liquid Pipe ★3	in (mm)	φ5/8" (15.9 mm) C1220T (Brazing Connection)		φ5/8" (15.9 mm) C1220T (Brazing Connection)	
	High Pressure Equalizer Pipe	in (mm)	φ 3/4" (19.1 mm) C1220T (Brazing Connection)		φ 3/4" (19.1 mm) C1220T (Brazing Connection)	
	Gas Pipe ★3	in (mm)	φ 1-1/8" (28.6 mm) C1220T (Brazing Connection)		φ 1-3/8" (34.9 mm) C1220T (Brazing Connection)	
	Low Pressure Equalizer Pipe	in (mm)	φ 3/4" (19.1 mm) C1220T (Brazing Connection)		φ 3/4" (19.1 mm) C1220T (Brazing Connection)	
Mass	Lbs (kg)	560+560 lbs (254 + 254 kg)		560+560 lbs (254 + 254 kg)		
Safety Devices		High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector		High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector		
Defrost Method		Deicer		Deicer		
Capacity Control	%	7~100		6~100		
Refrigerant	Refrigerant Name	R-410A		R-410A		
	Charge	Lbs	19.8+20.1		20.1+20.1	
	Control	Electronic Expansion Valve		Electronic Expansion Valve		
Standard Accessories		Installation Manual, Operation Manual, Connection Pipes, Clamps		Installation Manual, Operation Manual, Connection Pipes, Clamps		
Drawing No.		4D060128		4D060129		

Notes:

- ★1 Indoor temp. : 80°FDB or 67°FWB / outdoor temp. : 95°FDB / Equivalent piping length : 25 ft (7.5 m), level difference : 0 ft.
- ★2 Indoor temp. : 70°FDB / outdoor temp. : 47°FDB or 43°FWB / Equivalent piping length : 25 ft (7.5 m), level difference : 0 ft.
- ★3 BHFP22P100U is necessary for the connection.
Concerning about the piping connection for each outdoor unit to the main line as shown above, use REFNET.

2. Dimensions

RXYQ72, 96, 120PTJU






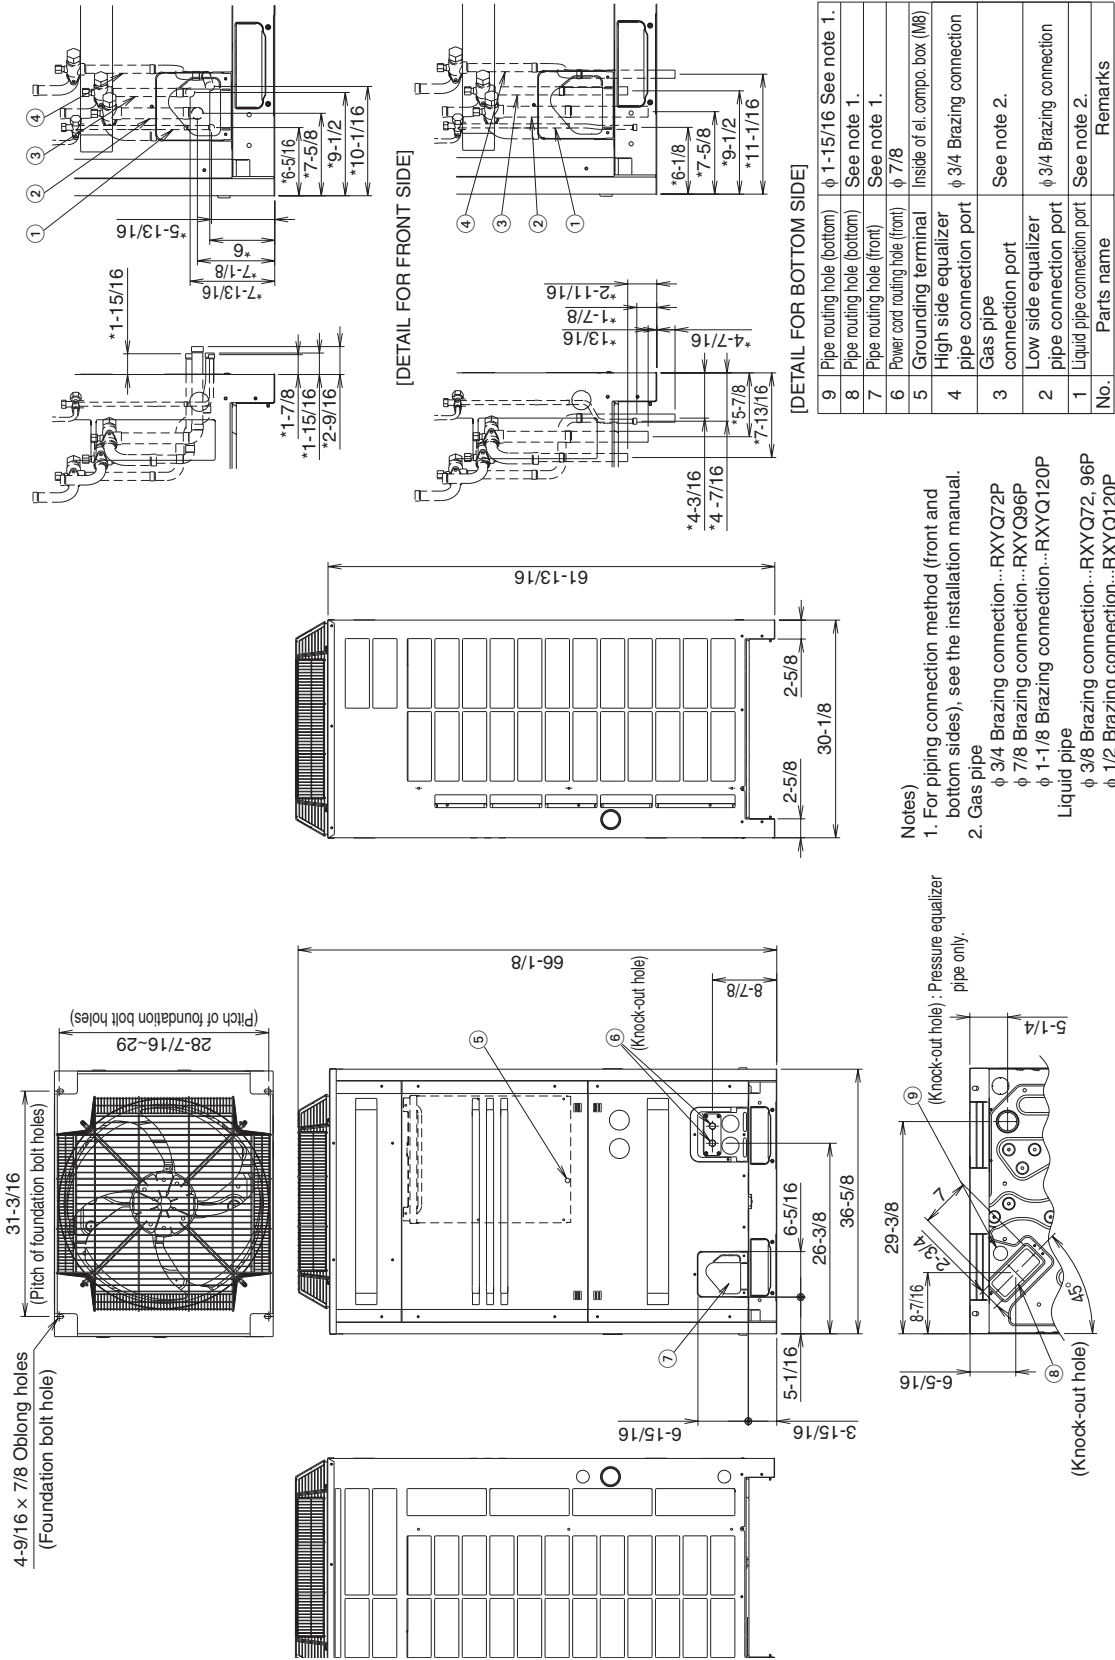


3D055616

RXYQ144PTJU

Notes)



1. For piping connection method (front and bottom sides), see the installation manual.
2. High and low pressure gas pipe
 φ 5/8 Brazing connection...REYQ72P
 φ 3/4 Brazing connection...REYQ96, 120P
 φ 7/8 Brazing connection...REYQ144PT, RXYQ144P
 Gas pipe
 φ 1-1/8 Brazing connection...RXYQ144PTJU
 Suction gas pipe
 φ 3/4 Brazing connection...REYQ72P
 φ 7/8 Brazing connection...REYQ96P
 φ 1-1/8 Brazing connection...REYQ120, 144PT
 Liquid pipe
 φ 3/8 Brazing connection...REYQ72, 96P
 φ 1/2 Brazing connection...REYQ120, 144PT, RXYQ144PTJU
3. * shows the dimensions after fixing the accessory pipes.

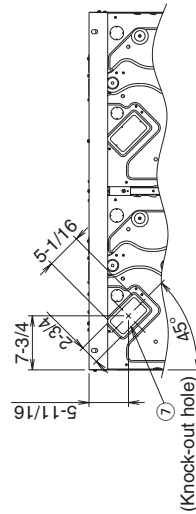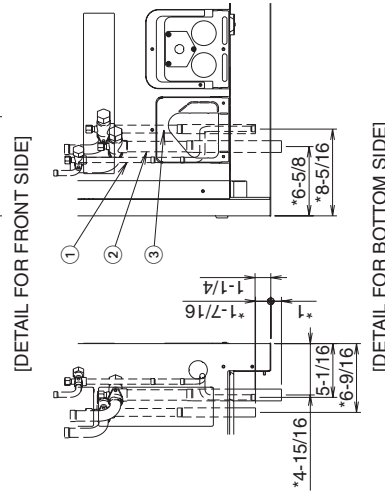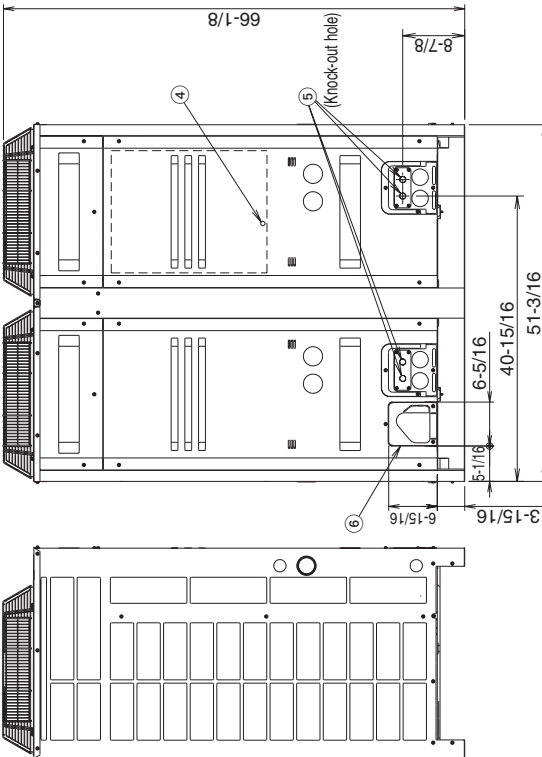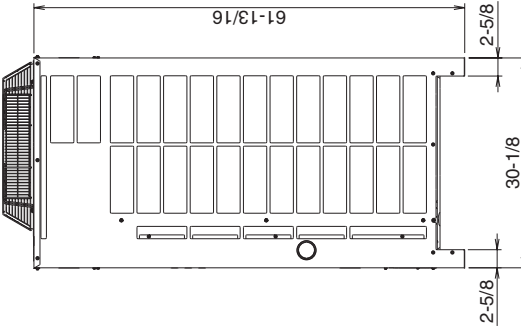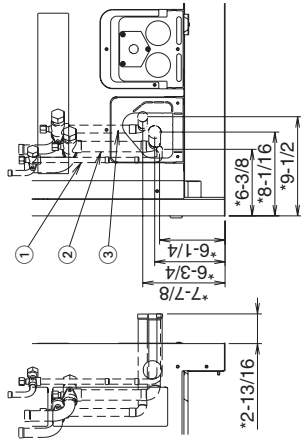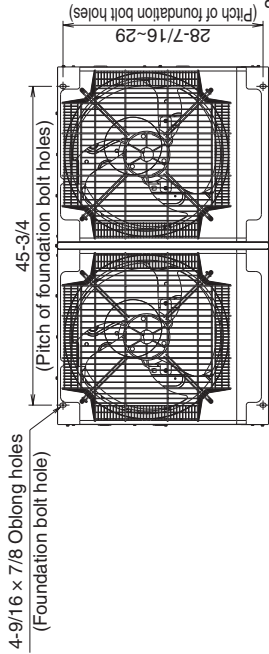

No.	Parts name	Remarks
7	Pipe routing hole (bottom)	See note 1.
6	Pipe routing hole (front)	See note 1.
5	Power cord routing hole (front)	φ 7/8
4	Grounding terminal	Inside of el. compo. box (M8)
3	High and low pressure gas pipe connection port	See note 2.
2	Suction gas pipe connection port	See note 2.
1	Liquid pipe connection port	See note 2.

3D058618A

RXYQ168, 192, 216, 240PTJU

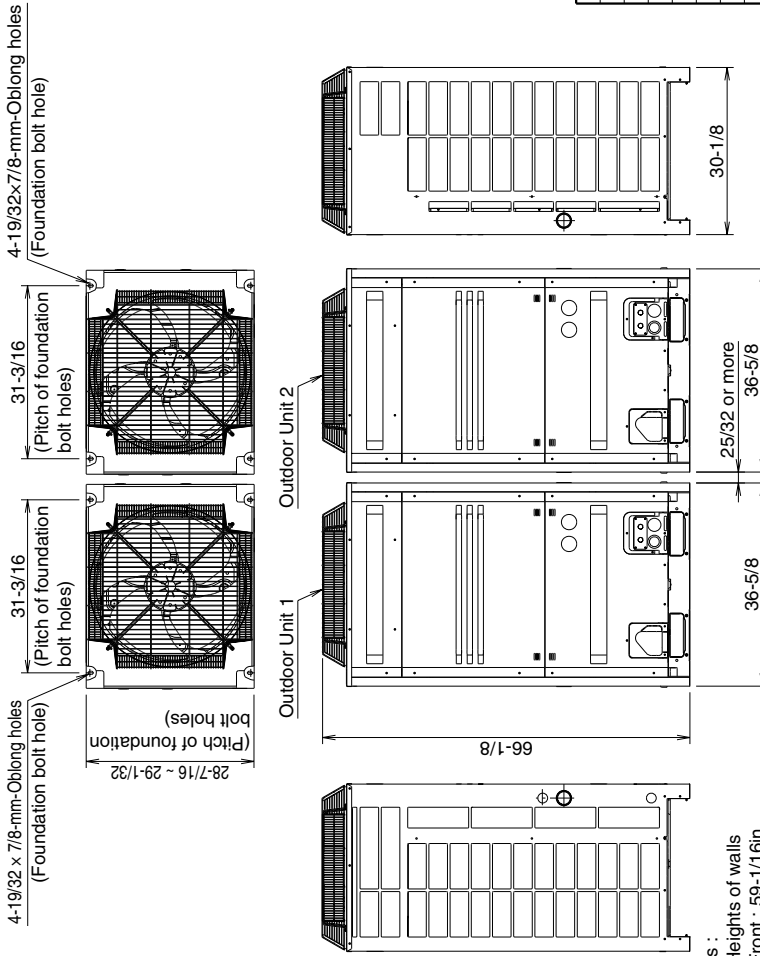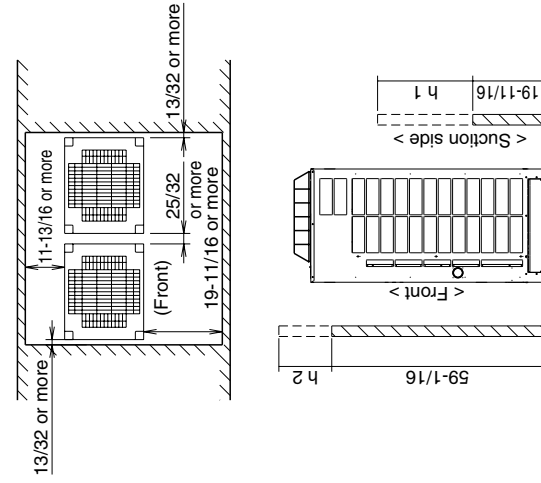


Model Name	Outdoor Unit 1	Outdoor Unit 2	Drawing No.
RXYQ144PYDN	RXYQ72PYDN	RXYQ72PYDN	3D058616
RXYQ168PYDN	RXYQ72PYDN	RXYQ96PYDN	3D058616
RXYQ192PYDN	RXYQ72PYDN	RXYQ120PYDN	3D058616
RXYQ216PYDN	RXYQ96PYDN	RXYQ120PYDN	3D058616
RXYQ240PYDN	RXYQ120PYDN	RXYQ120PYDN	3D058616
RXYQ168PTJU	RXYQ72PTJU	RXYQ96PTJU	3D058616
RXYQ192PTJU	RXYQ72PTJU	RXYQ120PTJU	3D058616
RXYQ240PTJU	RXYQ96PTJU	RXYQ120PTJU	3D058616
REYQ144PYDN	REMQ72PYDN	REMQ72PYDN	3D058617
REYQ168PYDN	REMQ72PYDN	REMQ96PYDN	3D058617
REYQ192PYDN	REMQ72PYDN	REMQ120PYDN	3D058617
REYQ240PYDN	REMQ96PYDN	REMQ120PYDN	3D058617
REYQ168PTJU	REMQ72PTJU	REMQ96PTJU	3D058617
REYQ192PTJU	REMQ72PTJU	REMQ120PTJU	3D058617
REYQ240PTJU	REMQ96PTJU	REMQ120PTJU	3D058617

- Notes :
1. Heights of walls
Front : 59-1/16in
Suction side : 19-11/16in
Side : Height unrestricted
 - The installation space shown in this figure is based on the condition of cooling operation at the outdoor air temperature of 95°F.
 - The installation space of suction side shown above must be expanded in the following case.
 - Design outdoor temperature becomes over 95°F.
 - Operating over Max. operating load (In case of causing a heavy heating load at indoor unit side)
 2. If the above wall heights are exceeded then h2/2 and h1/2 should be added to the front and suction side service spaces respectively as shown in the following figure.
 3. When installing the units the most appropriate pattern should be selected from those shown above in order to obtain the best fit in the space available always bearing in mind the need to leave enough room for a person to pass between units and wall and for the air to circulate freely. (If more units are to be installed than are catered for in the above patterns your layout should take account of the possibility of short circuits.)
 4. The units should be installed to leave sufficient space at the front for the on site refrigerant piping work to be carried out comfortably.

3D058617

3. Service Space

RXYQ72, 96, 120, 144, 168, 192, 216, 240PTJU

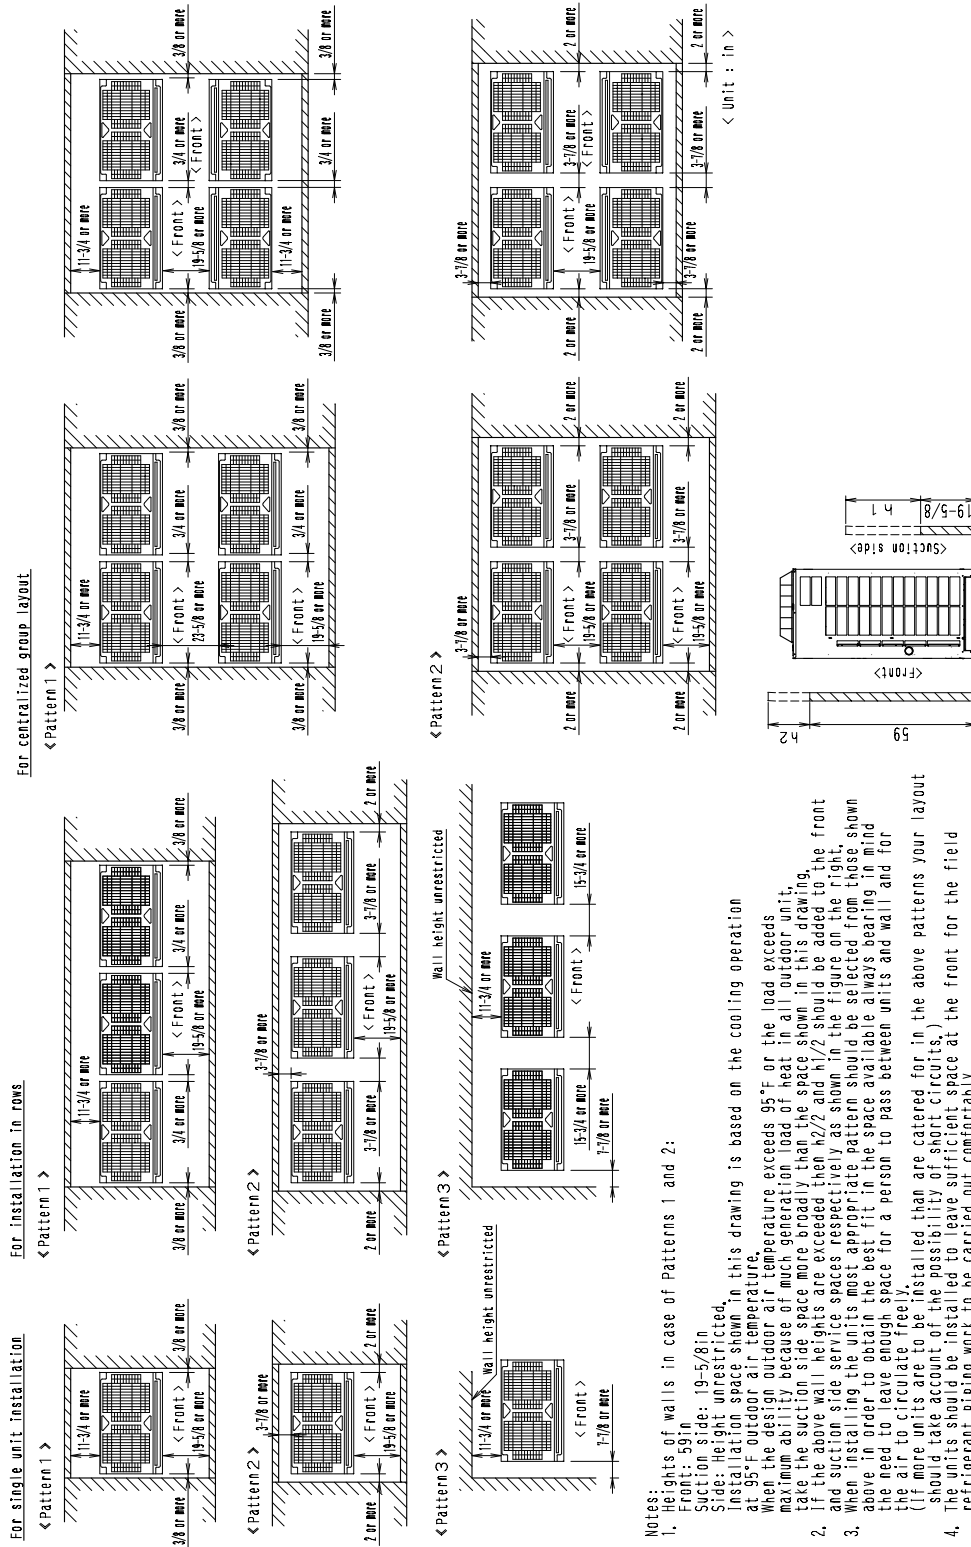


Notes:

1. Heights of walls in case of Patterns 1 and 2:
 Front: 59 in
 Suction side: 19-5/8 in
 Side: Height unrestricted
 Installation space shown in this drawing is based on the cooling operation at 95°F outdoor air temperature. When the design outdoor air temperature exceeds 95°F or the load exceeds maximum ability because of much generation load of heat in all outdoor unit, take the suction side space more broadly than the space shown in this drawing.
2. If the above wall heights are exceeded then h/2 and h/2 should be added to the front and suction side service spaces respectively as shown in the figure on the right.
3. When installing the units most appropriate pattern should be selected from those shown above in order to obtain the best fit in the space available always bearing in mind the need to leave enough space for a person to pass between units and wall and for the air to circulate freely.
 (If more units are to be installed than are catered for in the above patterns your layout should take account of the possibility of short circuits.)
4. The units should be installed to leave sufficient space at the front for the field refrigerant piping work to be carried out comfortably.

3D058620


4. Piping Diagrams

RXYQ72, 96, 120PTJU

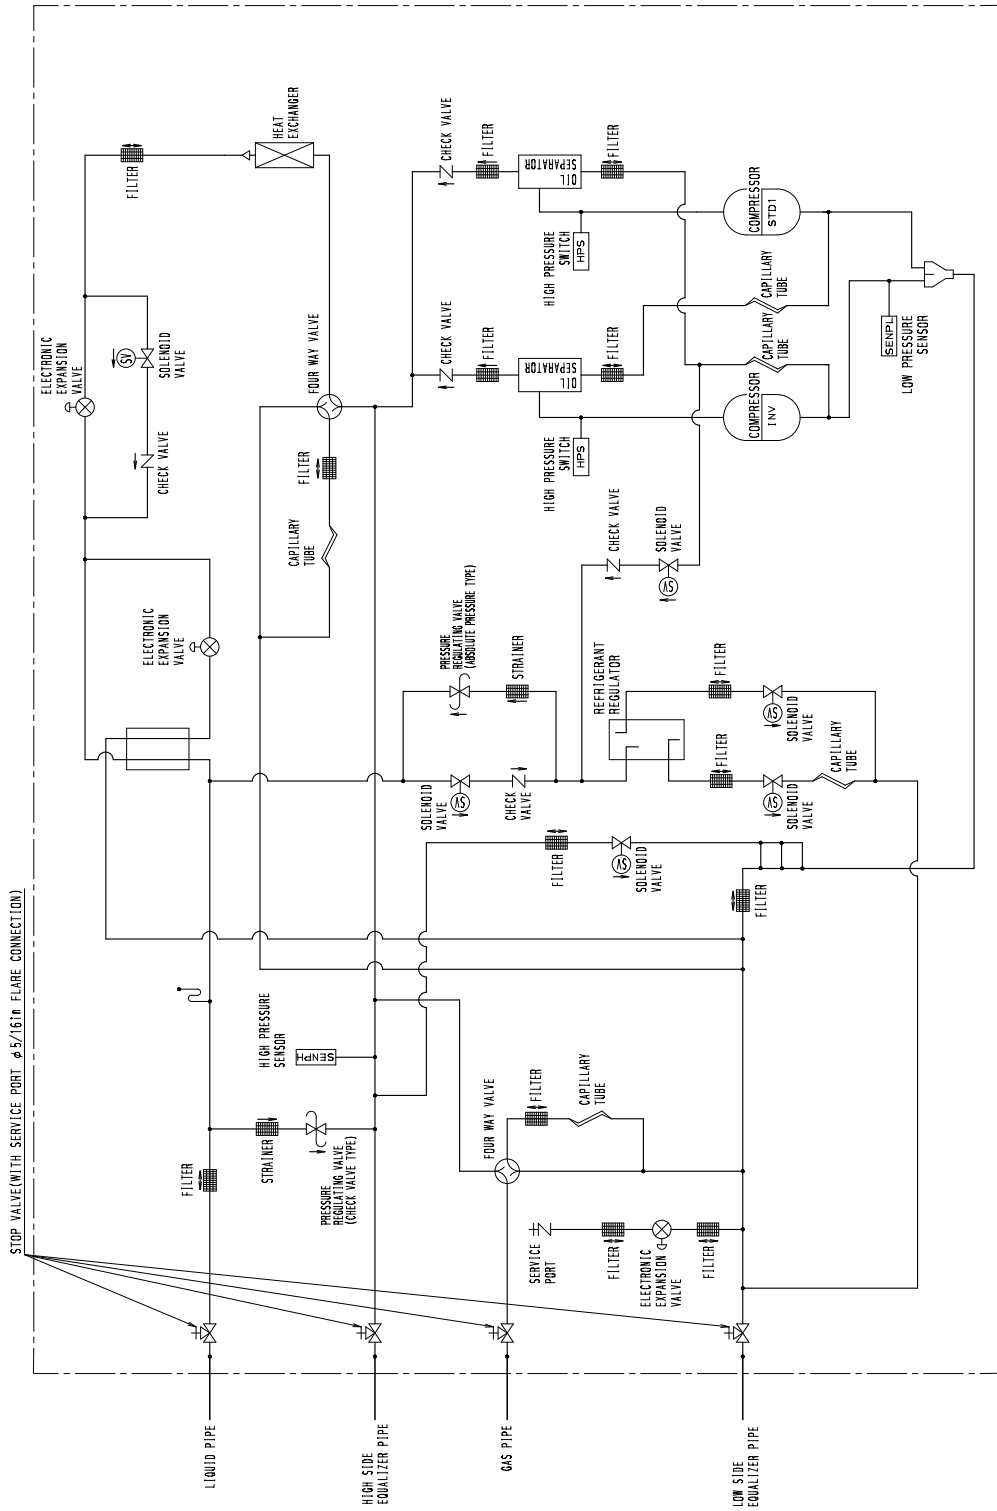

3D058636A



RXYQ144PTJU

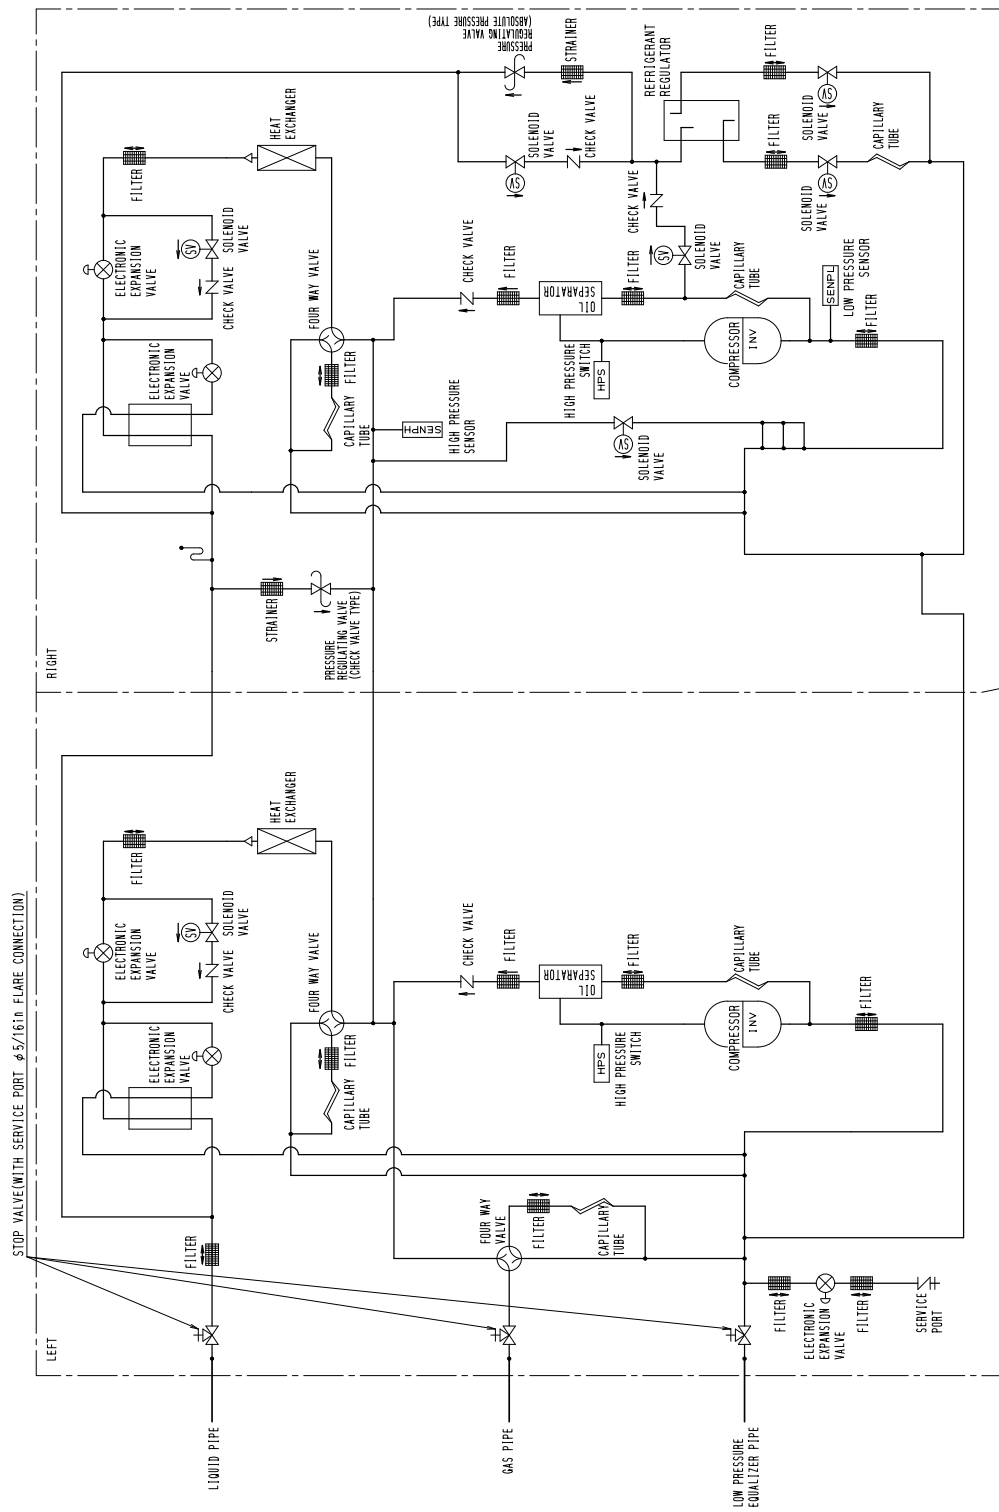

3D058640

5. Wiring Diagrams

RXYQ72, 96, 120PTJU

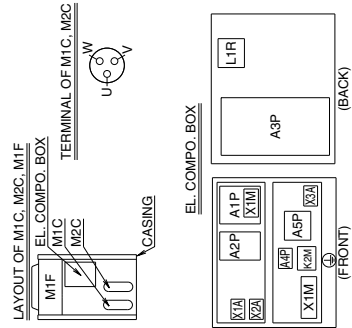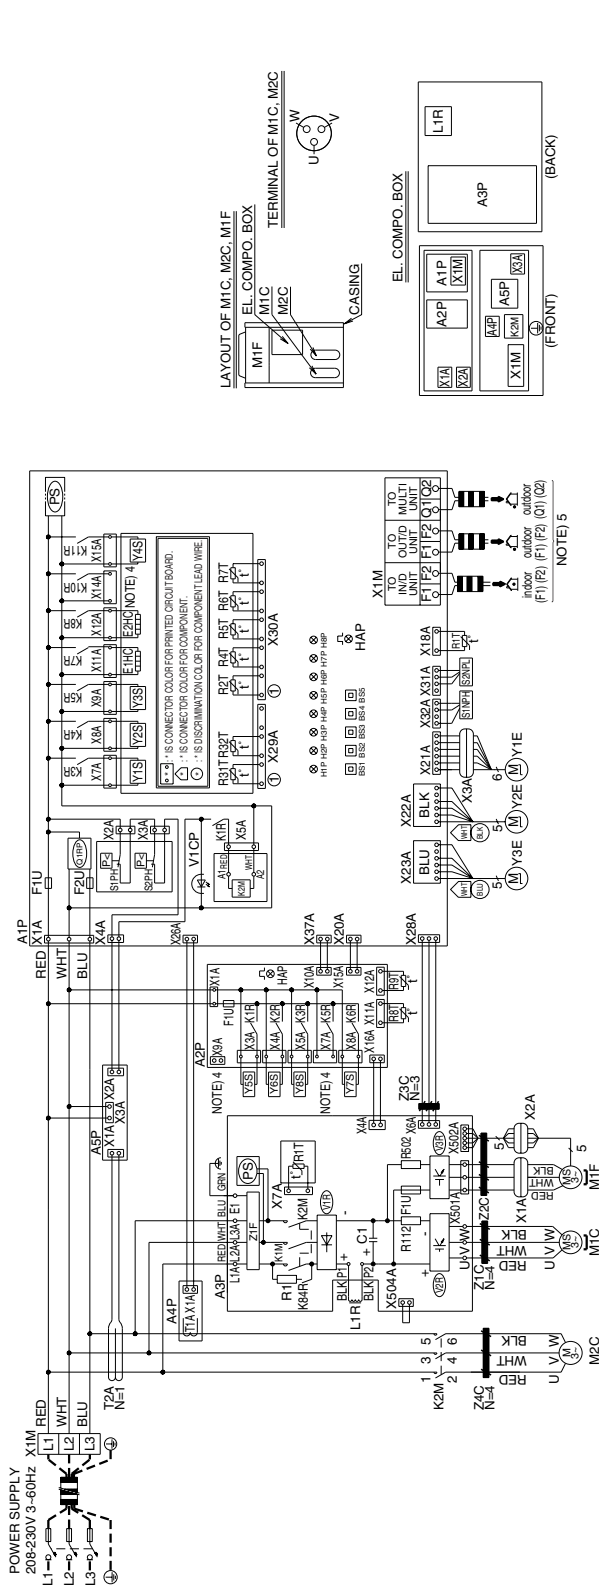


- NOTES)
- THIS WIRING DIAGRAM IS APPLIED ONLY TO THE OUTDOOR UNIT.
 - FIELD WIRING.
 - TERMINAL STRIP (SCREW) : TERMINAL -> : TERMINAL
 - PROTECTIVE EARTH (SCREW)
 - WHEN USING THE OPTIONAL ADAPTOR, REFER TO THE INSTALLATION MANUAL OF THE OPTIONAL ADAPTOR.
 - FOR CONNECTION WIRING TO INDOOR-OUTDOOR TRANSMISSION F1 · F2, OUTDOOR-OUTDOOR TRANSMISSION F1 · F2, OUTDOOR-MULTI TRANSMISSION Q1 · Q2, REFER TO THE INSTALLATION MANUAL
 - HOW TO USE BS1-5, REFER TO 'SERVICE PRECAUTION' LABEL ON EL. COMPO. BOX COVER.
 - WHEN OPERATING, DON'T SHORTCIRCUIT THE PROTECTIVE DEVICE (S1PH, S2PH).
 - COLORS BLK : BLACK RED : RED BLU : BLUE WHT : WHITE GRN : GREEN.

A1P	PRINTED CIRCUIT BOARD (MAIN)	K2R	MAGNETIC RELAY (Y6S) (ASP)	R1T	THERMISTOR (FIN) (ASP)	X1M	TERMINAL STRIP (CONTROL) (ATP)
A2P	PRINTED CIRCUIT BOARD (SUB)	K3R	MAGNETIC RELAY (Y7S) (ATP)	R2T	THERMISTOR (HEAT EXC. GAS) (ATP)	Y1E	ELECTRONIC EXPANSION VALVE (MAIN) (ATP)
A3P	PRINTED CIRCUIT BOARD (INT. FAN)	K4R	MAGNETIC RELAY (Y8S) (ASP)	R3T, R6T	THERMISTOR (MTC, M2C, DISCHARGE) (ATP)	Y2E	ELECTRONIC EXPANSION VALVE (CHARGE) (ATP)
A4P	PRINTED CIRCUIT BOARD (CURRENT SENSOR)	K5R	MAGNETIC RELAY (Y9S) (ATP)	R4T	THERMISTOR (HEAT EXC. DEGREE) (ATP)	Y3E	ELECTRONIC EXPANSION VALVE (SUB) (ATP)
BS1-5	PRINTED CIRCUIT BOARD (ELB)	K6R	MAGNETIC RELAY (Y7S) (ATP)	R5T	THERMISTOR (SUB-COOL. HEAT EXC. GAS) (ATP)	Y1S	SOLENOID VALVE (RM(T)G) (ATP)
CT	PUSH-BUTTON SWITCH	K7R	MAGNETIC RELAY (FOR OPTION) (ASP)	R6T	THERMISTOR (SUB-COOL. HEAT EXC. LIQUID) (ATP)	Y2S	SOLENOID VALVE (RWY VALVE) (PRE) (ATP)
ETC. E2HC	CHAMKCASE HEATER (ATP)	K8R	MAGNETIC RELAY (E2HC) (ATP)	R7T	THERMISTOR (HEAT EXC. LIQUID) (ATP)	Y3S	SOLENOID VALVE (RWY VALVE) (HEAT EXC.) (ATP)
F1U, F2U	FUSE (T: 3.15A, 250V) (ATP)	K9R	MAGNETIC RELAY (FOR OPTION) (ASP)	R8T	THERMISTOR (SUCTION) (ASP)	Y4S	SOLENOID VALVE (RM(T)U) (ATP)
F1U	FUSE (T: 3.15A, 250V) (ASP)	K10R	MAGNETIC RELAY (E2HC) (ATP)	SN1PH	PRESSURE SENSOR (HIGH) (ATP)	Y6S	SOLENOID VALVE (HOT GAS) (ASP)
H1P, 8P	PILOT LAMP (SERVICE MONITOR - ORANGE) (ATP)	K4R	MAGNETIC RELAY (CURRENT LIMITING) (ASP)	SN2PL	PRESSURE SENSOR (LOW) (ATP)	Y7S	SOLENOID VALVE (RM(T)G) (ASP)
HAP	PILOT LAMP (SERVICE MONITOR - LIGHT UP)	L1R	REACTOR (ASP)	S1R, S2PH	PRESSURE SWITCH (HIGH) (ATP)	Y8S	SOLENOID VALVE (RM(T)U) (ASP)
K2M	MAGNETIC RELAY (MTC) (ASP)	M1F	MOTOR (COMPRESSOR)	T1A	CURRENT SENSOR (ASP)	Z1C-4C	NOISE FILTER (FERRITE CORE)
K1R	MAGNETIC RELAY (K2M) (ATP)	M2C	MOTOR (FAN)	T2A	CURRENT SENSOR (ASP)	Z1F	NOISE FILTER (WITH SURGE ABSORBER) (ASP)
K1R	MAGNETIC RELAY (Y9S) (ASP)	PS	SWITCHING POWER SUPPLY (ATP, ASP)	VTOP	DIODE BRIDGE (ASP)		
		R1	PHASE REVERSAL DETECT CIRCUIT (ATP)	V1R	DIODE BRIDGE (ASP)		
		R11	RESISTOR CURRENT SENSOR (ASP)	V2R, V3R	POWER MODULE (ASP)		
		R12, R62P	RESISTOR CURRENT SENSOR (ASP)	X1A, X2A	CONNECTOR (MTF)		
		R1T	THERMISTOR (AIR) (ATP)	X3A	CONNECTOR (Y1E)		
				X1M	TERMINAL STRIP (POWER SUPPLY)		

3D058512C

RXYQ144PTJU

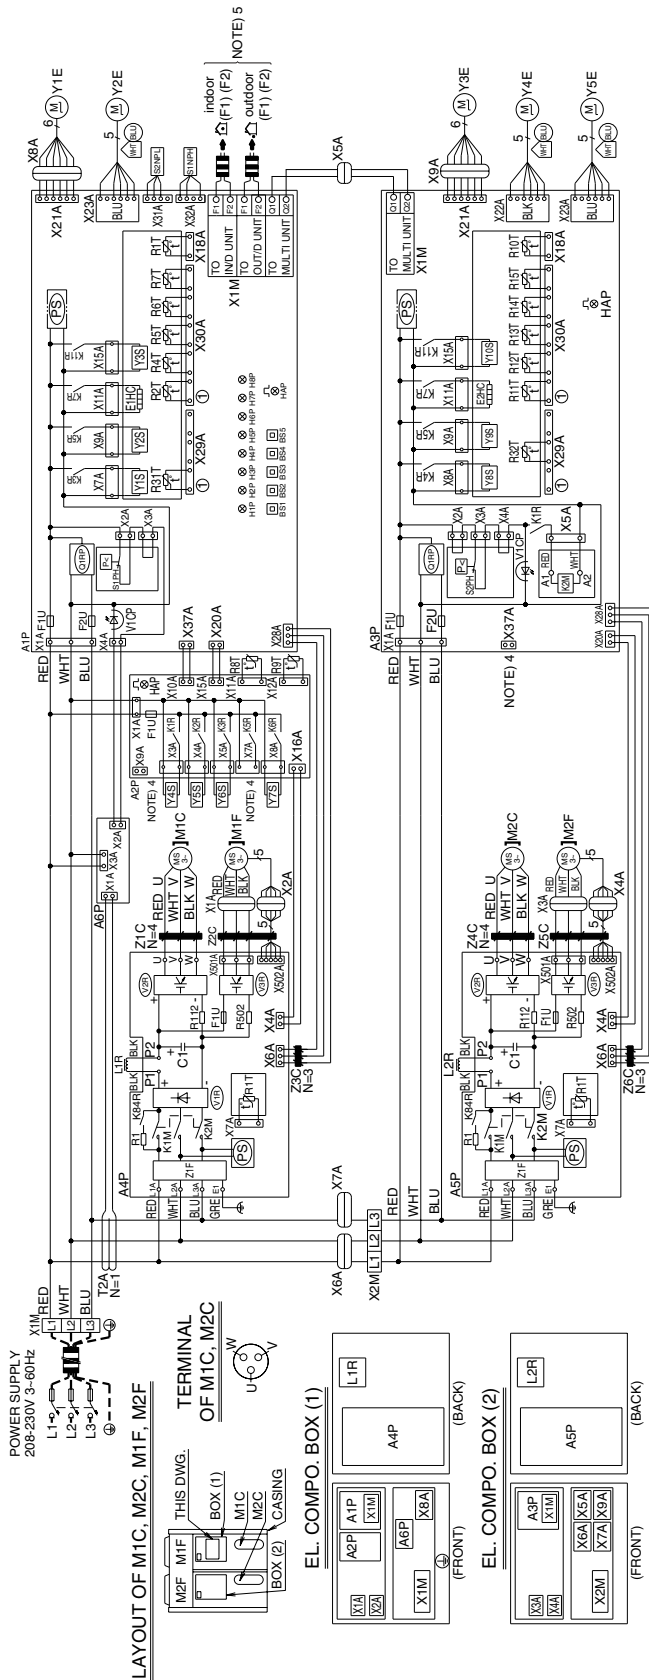

NOTES

- THIS WIRING DIAGRAM IS APPLIED ONLY TO THE OUTDOOR UNIT.
- FIELD WIRING.
- TERMINAL STRIP : CONNECTOR - : TERMINAL
- PROTECTIVE EARTH (SCREW)
- WHEN USING THE OPTIONAL ADAPTOR, REFER TO THE INSTALLATION MANUAL OF THE OPTIONAL ADAPTOR.
- FOR CONNECTION WIRING TO INDOOR-OUTDOOR TRANSMISSION F1 · F2, OUTDOOR-OUTDOOR TRANSMISSION F1 · F2, OUTDOOR-MULTI MANUAL.
- HOW TO USE BS1~5 AND DS1 · 2 SWITCH, REFER TO "SERVICE PRECAUTION" LABEL ON EL. COMPO. BOX COVER.
- WHEN OPERATING, DON'T SHORTCIRCUIT THE PROTECTION DEVICE (S1, 2PH).
- SYMBOLS INDICATE COLORS OF EACH PARTS AS SHOWN BELOW.
- IS CONNECTOR COLOR FOR PRINTED CIRCUIT BOARD.
- IS CONNECTOR COLOR FOR COMPONENT.
- IS IDENTIFICATION COLOR FOR COMPONENT LEAD WIRE.
- COLORS BLK : BLACK RED : RED BLU : BLUE WHT : WHITE.

A1P	PRINTED CIRCUIT BOARD (MAIN)	R1	RESISTOR (CURRENT SENSOR) (A4P) (A5P)	Y2S	SOLENOID VALVE (4 WAY VALVE-HEAT EXC. 1)
A2P	PRINTED CIRCUIT BOARD (SUB 1)	R112, R502	RESISTOR (A4P) (A5P)	Y3S	SOLENOID VALVE (RMTL)
A3P	PRINTED CIRCUIT BOARD (SUB 2)	R1T	THERMISTOR (FAN) (A1P)	Y4S	SOLENOID VALVE (HOT GAS)
A4P, A5P	PRINTED CIRCUIT BOARD (INV)	R2T	THERMISTOR (HEAT EXC. GAS 1) (A1P)	Y6S	SOLENOID VALVE (EV BYPASS 1)
BS1-5	PUSH BUTTON SWITCH (MODE, SET, RETURN, TEST, RESET)	R3T	THERMISTOR (MTC DISCHARGE) (A2P)	Y7S	SOLENOID VALVE (RMTT)
C1	CAPACITOR (A4P) (A5P)	R4T	THERMISTOR (HEAT EXC. DEICER 1) (A1P)	Y8S	SOLENOID VALVE (4 WAY VALVE-PIPE)
E1HC, E2HC	CRANKCASE HEATER (A1P) (A3P)	R5T	THERMISTOR (SUB COOL. HEAT EXC. GAS 1)	Y10S	SOLENOID VALVE (4 WAY VALVE-HEAT EXC. 2)
F1U, F2U	FUSE (T. 3.15A, 250V) (A1P) (A3P)	R6T	THERMISTOR (SUB COOL. HEAT EXC. LIQUID) (A1P)	Z1C-8C	SOLENOID VALVE (EV BYPASS 2)
F1U	FUSE (16A, DC450V) (A4P) (A5P)	R7T	THERMISTOR (HEAT EXC. LIQUID 1) (A1P)	Z1F	NOISE FILTER (WITH SURGE ABSORBER) (A4P) (A5P)
H1P-4P	PILOT LAMP (SERVICE MONITOR - ORANGE) (H2P) PREPARE, TEST.....FLICKERING MALFUNCTION DETECTION—LIGHT UP	R8T	THERMISTOR (LIQUID 1) (A2P)		
HAP	PILOT LAMP (SERVICE MONITOR-GREEN) (A1P, A2P, A3P)	R10T	THERMISTOR (SUCTION 2) (A3P)		
K1M, K2M	MAGNETIC RELAY (M1C) (M2C) (A4P) (A5P)	R12T	THERMISTOR (HEAT EXC. GAS 2) (A3P)		
K1R	MAGNETIC RELAY (Y4S) (A2P)	R14T	THERMISTOR (SUB COOL. HEAT EXC. GAS 2)	X7A	OPERATION OUTPUT (A2P)
K2R	MAGNETIC RELAY (Y5S) (A2P)	R16T	THERMISTOR (LIQUID 2) (A3P)	X9A	POWER SUPPLY (ADAPTOR) (A3P)
K3R	MAGNETIC RELAY (Y6S) (A2P)	R17T	THERMISTOR (HEAT EXC. LIQUID 2) (A3P)	X7A	POWER SUPPLY (ADAPTOR) (A3P)
K4R	MAGNETIC RELAY (Y8S) (A2P)	S1NPH	PRESSURE SENSOR (HIGH) (A1P)		
K5R	MAGNETIC RELAY (Y2S) (A1P)	S1NPL	PRESSURE SENSOR (LOW) (A1P)		
K6R	MAGNETIC RELAY (Y3S) (A1P)	S1PH, S2PH	PRESSURE SWITCH (HIGH) (A1P) (A3P)		
K7R	MAGNETIC RELAY (Y7S) (A2P)	T2A	SAFETY DEVICES (INPUT) (A1P) (A3P)		
K8R	MAGNETIC RELAY (Y5S) (A2P)	V1R	DIODE BRIDGE (A4P) (A5P)		
K9R	MAGNETIC RELAY (E1HC) (A1P)	V2R, V3R	POWER MODULE (A4P) (A5P)		
K10R	MAGNETIC RELAY (E2HC) (A3P)	X1A-X9A	CONNECTOR		
K11R	MAGNETIC RELAY (Y3S) (A3P)	X1M	TERMINAL STRIP (POWER SUPPLY)		
K64R	MAGNETIC RELAY (Y10S) (A3P)	X2M	TERMINAL STRIP (CONTROL) (A1P) (A3P)		
L1R, L2R	REACTOR (A4P) (A5P)	Y1E	ELECTRONIC EXPANSION VALVE (MAIN 1)		
M1C, M2C	MOTOR (COMPRESSOR)	Y2E	ELECTRONIC EXPANSION VALVE (SUBCOOL 1)		
M1F, M2F	MOTOR (FAN)	Y3E	ELECTRONIC EXPANSION VALVE (MAIN 2)		
PS	SWITCHING POWER SUPPLY (A1P, A3P, A4P, A5P)	Y4E	ELECTRONIC EXPANSION VALVE (CHARGE)		
OTR	PHASE REVERSAL DETECT CIRCUIT (A1P) (A3P)	Y5S	ELECTRONIC EXPANSION VALVE (SUBCOOL 2)		


3D060077A

6. Field Wiring

RXYQ72, 96, 120, 144PTJU

- 6) Unit shall be grounded in compliance with the applicable local and national codes.
- 7) Wiring shown are general points-of-connection guides only and are not intended for or to include all details for a specific installation.
- 8) Be sure to install the switch and the fuse to the power line of each equipment.
- 9) Install the main switch that can interrupt all the power sources in an integrated manner because this system consists of the equipment utilizing the multiple power sources.
- 10) If there exists the possibility of reversed phase, lose phase, momentary blackout or the power goes on and off while the product is operating, attach a reversed phase protection circuit locally.
Running the product in reversed phase may break the compressor and other parts.

- Notes
- 1) All wiring, components and materials to be procured on the site must comply with the applicable local and national codes.
 - 2) Use copper conductors only.
 - 3) As for details, see wiring diagram.
 - 4) Install ground fault circuit interrupter for safety.
 - 5) All field wiring and components must be provided by licensed electrician.

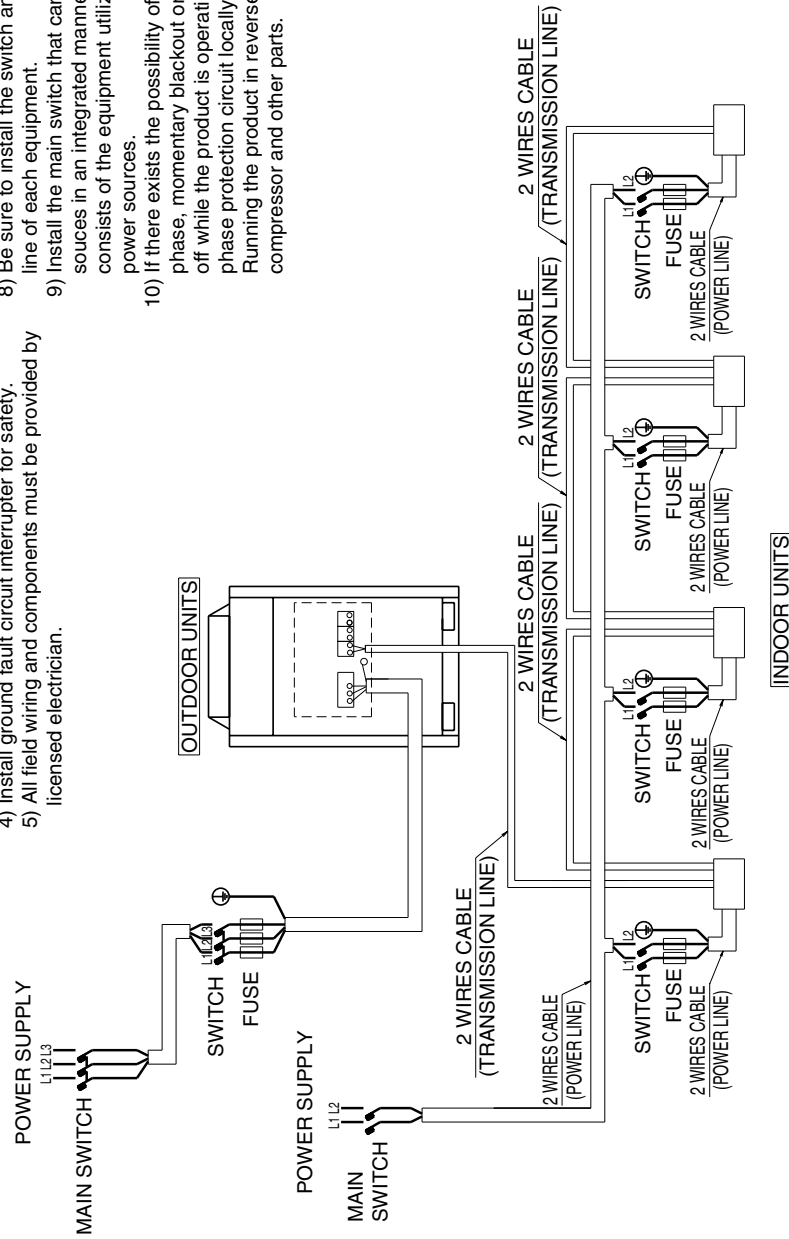


3D058621

RXYQ168, 192, 216, 240PTJU

- 6) Unit shall be grounded in compliance with the applicable local and national codes.
- 7) Wiring shown are general points-of-connection guides only and are not intended for or to include all details for a specific installation.
- 8) Be sure to install the switch and the fuse to the power line of each equipment.
- 9) Install the main switch that can interrupt all the power sources in an integrated manner, because this system consists of the equipment utilizing the multiple power sources.
- 10) The capacity of UNIT1 must be larger than UNIT2 when the power source is connected in series between the units.
- 11) If there exists the possibility of reversed phase, lose phase, momentary blackout or the power goes on and off while the product is operating, attach a reversed phase protection circuit locally. Running the product in reversed phase may break the compressor and other parts.

- Notes 1) All wiring, components and materials to be procured on the site must comply with the applicable local and national codes.
- 2) Use copper conductors only.
 - 3) As for details, see wiring diagram.
 - 4) Install ground fault circuit interrupter for safety.
 - 5) All field wiring and components must be provided by licensed electrician.

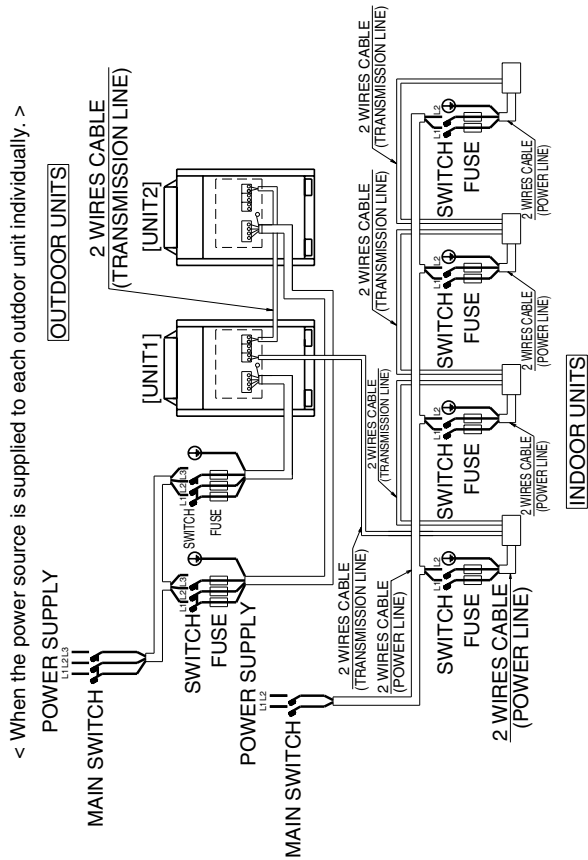


3D059672

7. Electric Characteristics

Model Name	Units				Power supply			Comp.		OFM	
	Hz	Volts	Min.	Max.	MCA	TOCA	MFA	MSC	RLA	KW	FLA
RXYQ72PTJU	60	208-230	187	253	36.1	54.5	40	131	14.2	0.75	1.2
RXYQ96PTJU	60	208-230	187	253	36.1	54.5	50	131	7.8+16.8	0.75	1.6
RXYQ120PTJU	60	208-230	187	253	41.3	54.5	60	132	12.2+16.8	0.75	2.0
RXYQ144PTJU	60	208-230	187	253	72.2	56.8	80	-	14.3+14.3	0.75 × 2	2.0+2.0

The relationship between the starting time and the starting current,

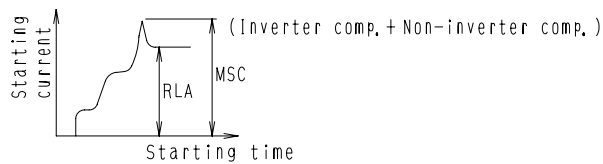

Notes:

1. RLA is based on the following conditions,
Indoor temp. 80°FDB/67°FWB
Outdoor temp. 95°FDB
2. TOCA means the total value of each OC set.
3. MSC means the Max. current during the starting of compressor.
4. Voltage range
Units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits.
5. Maximum allowable voltage variation between phases is 2%.
6. Select wire size based on the larger value of MCA or TOCA.
7. MFA is used to select the circuit breaker and the ground fault circuit interrupter (earth leakage circuit breaker).


Symbols:

- MCA :Min. Circuit Amps. (A)
TOCA :Total Over-current Amps. (A)
MFA :Max. Fuse Amps. (A)
MSC :Max. Starting current
RLA :Rated Load Amps. (A)
OFM :Outdoor Fan Motor
FLA :Full Load Amps. (A)
kW :Rated Motor Output(kW)

3D060211

Model Name			Units				Power supply				Comp.		OFM	
Combination Unit	Independent Unit		Hz	Volts	Min.	Max.	MCA	TOCA	MFA	MSC	RLA	KW	FLA	
RXYQ168PTJU	RXYQ72PTJU	RXYQ96PTJU	60	208-230	187	253	72.2	54.5+54.5	40+50	137	14.2+7.8+16.8	0.75+0.75	1.2+1.6	
RXYQ192PTJU	RXYQ72PTJU	RXYQ120PTJU	60	208-230	187	253	77.4	54.5+54.5	40+60	138	14.2+12.2+16.8	0.75+0.75	1.2+1.6	
RXYQ216PTJU	RXYQ96PTJU	RXYQ120PTJU	60	208-230	187	253	77.4	54.5+54.5	50+60	154	7.8+16.8+12.2+16.8	0.75+0.75	1.6+2.0	
RXYQ240PTJU	RXYQ120PTJU	RXYQ120PTJU	60	208-230	187	253	82.6	54.5+54.5	60+60	155	12.2+16.8+12.2+16.8	0.75+0.75	2.0+2.0	

The relationship between the starting time and the starting current,

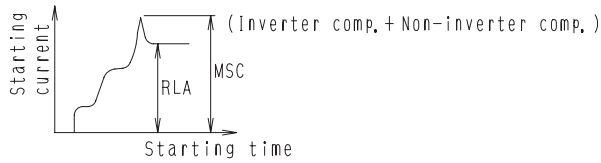

Notes:

1. RLA is based on the following conditions.
Indoor temp, 80°F DB/67.0°F WB
Outdoor temp, 95°F DB
2. TOCA means the total value of each OC set.
3. MSC means the Max. current during the starting of compressor.
4. Voltage range
Units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits.
5. Maximum allowable voltage variation between phases is 2%.
6. Select wire size based on the larger value of MCA or TOCA.
7. MFA is used to select the circuit breaker and the ground fault circuit interrupter (earth leakage circuit breaker).

Symbols:

- MCA :Min. Circuit Amps, (A)
- TOCA :Total Over-current Amps, (A)
- MFA :Max. Fuse Amps, (A)
- MSC :Max. Starting current
- RLA :Rated Load Amps, (A)
- OFM :Outdoor Fan Motor
- FLA :Full Load Amps, (A)
- kW :Rated Motor Output(kW)

3D060213

8. Capacity Tables (Reference Data)

8.1 Cooling Capacity (RXYQ-PTJU)

These tables are based on projection. Actual results may vary according to conditions of use.

RXYQ72PTJU

Cooling capacity

Combi- nation (%)	Outdoor air temp. (F/DB)		Indoor air temp. F/WB												Cooling capacity																										
	TC	PI	57				61				64				70				75																						
			TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW																			
90	50	30	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41
			1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41
			1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41
			1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41
			1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41
			1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41
			1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41
			1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41
			1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41
			1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41

Cooling capacity

Combi- nation (%)	Outdoor air temp. (F/DB)		Indoor air temp. F/WB												Cooling capacity																										
	TC	PI	57				61				64				70				75																						
			TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW																			
100	50	30	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41
			1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41
			1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41
			1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41
			1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41
			1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41
			1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41
			1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41
			1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41
			1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41	1.60	1.97	5.11	2.01	5.60	2.26	6.38	2.56	7.16	7.62	3.08	8.30	3.41

TC : Total capacity ; MBH
PI : Power input ; kW (Comp + Outdoor fan motor)
Note1 : The above table shows the average value of conditions which may occur.

RXYQ96PTJU

Cooling capacity	Indoor air temp. °F/WB											Cooling capacity			
	57		61		64		67		70		72		75		
	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC		PI	TC	PI
90	50	56.1	2.85	68.2	3.13	77.3	3.59	86.4	4.08	95.5	4.57	102	4.91	111	5.42
	54	58.1	2.80	68.2	3.19	77.3	3.67	86.4	4.16	95.5	4.65	102	4.91	111	5.42
	58	59.5	2.76	68.2	3.25	77.3	3.75	86.4	4.25	95.5	4.74	102	5.00	111	5.51
	62	61.1	2.71	68.2	3.31	77.3	3.83	86.4	4.34	95.5	4.83	102	5.09	111	5.60
	66	62.8	2.67	68.2	3.37	77.3	3.91	86.4	4.44	95.5	4.92	102	5.18	111	5.69
	70	64.6	2.62	68.2	3.44	77.3	3.99	86.4	4.54	95.5	5.01	102	5.27	111	5.78
	72	65.1	2.61	68.2	3.45	77.3	3.99	86.4	4.54	95.5	5.01	102	5.27	111	5.78
	75	66.1	2.59	68.2	3.47	77.3	3.99	86.4	4.54	95.5	5.01	102	5.27	111	5.78
	78	67.1	2.57	68.2	3.48	77.3	3.99	86.4	4.54	95.5	5.01	102	5.27	111	5.78
	81	68.1	2.55	68.2	3.49	77.3	3.99	86.4	4.54	95.5	5.01	102	5.27	111	5.78
80	50	56.1	2.85	68.2	3.13	77.3	3.59	86.4	4.08	95.5	4.57	102	4.91	111	5.42
	54	58.1	2.80	68.2	3.19	77.3	3.67	86.4	4.16	95.5	4.65	102	4.91	111	5.42
	58	59.5	2.76	68.2	3.25	77.3	3.75	86.4	4.25	95.5	4.74	102	5.00	111	5.51
	62	61.1	2.71	68.2	3.31	77.3	3.83	86.4	4.34	95.5	4.83	102	5.09	111	5.60
	66	62.8	2.67	68.2	3.37	77.3	3.91	86.4	4.44	95.5	4.92	102	5.18	111	5.69
	70	64.6	2.62	68.2	3.44	77.3	3.99	86.4	4.54	95.5	5.01	102	5.27	111	5.78
	72	65.1	2.61	68.2	3.45	77.3	3.99	86.4	4.54	95.5	5.01	102	5.27	111	5.78
	75	66.1	2.59	68.2	3.47	77.3	3.99	86.4	4.54	95.5	5.01	102	5.27	111	5.78
	78	67.1	2.57	68.2	3.48	77.3	3.99	86.4	4.54	95.5	5.01	102	5.27	111	5.78
	81	68.1	2.55	68.2	3.49	77.3	3.99	86.4	4.54	95.5	5.01	102	5.27	111	5.78
70	50	56.1	2.85	68.2	3.13	77.3	3.59	86.4	4.08	95.5	4.57	102	4.91	111	5.42
	54	58.1	2.80	68.2	3.19	77.3	3.67	86.4	4.16	95.5	4.65	102	4.91	111	5.42
	58	59.5	2.76	68.2	3.25	77.3	3.75	86.4	4.25	95.5	4.74	102	5.00	111	5.51
	62	61.1	2.71	68.2	3.31	77.3	3.83	86.4	4.34	95.5	4.83	102	5.09	111	5.60
	66	62.8	2.67	68.2	3.37	77.3	3.91	86.4	4.44	95.5	4.92	102	5.18	111	5.69
	70	64.6	2.62	68.2	3.44	77.3	3.99	86.4	4.54	95.5	5.01	102	5.27	111	5.78
	72	65.1	2.61	68.2	3.45	77.3	3.99	86.4	4.54	95.5	5.01	102	5.27	111	5.78
	75	66.1	2.59	68.2	3.47	77.3	3.99	86.4	4.54	95.5	5.01	102	5.27	111	5.78
	78	67.1	2.57	68.2	3.48	77.3	3.99	86.4	4.54	95.5	5.01	102	5.27	111	5.78
	81	68.1	2.55	68.2	3.49	77.3	3.99	86.4	4.54	95.5	5.01	102	5.27	111	5.78
60	50	56.1	2.85	68.2	3.13	77.3	3.59	86.4	4.08	95.5	4.57	102	4.91	111	5.42
	54	58.1	2.80	68.2	3.19	77.3	3.67	86.4	4.16	95.5	4.65	102	4.91	111	5.42
	58	59.5	2.76	68.2	3.25	77.3	3.75	86.4	4.25	95.5	4.74	102	5.00	111	5.51
	62	61.1	2.71	68.2	3.31	77.3	3.83	86.4	4.34	95.5	4.83	102	5.09	111	5.60
	66	62.8	2.67	68.2	3.37	77.3	3.91	86.4	4.44	95.5	4.92	102	5.18	111	5.69
	70	64.6	2.62	68.2	3.44	77.3	3.99	86.4	4.54	95.5	5.01	102	5.27	111	5.78
	72	65.1	2.61	68.2	3.45	77.3	3.99	86.4	4.54	95.5	5.01	102	5.27	111	5.78
	75	66.1	2.59	68.2	3.47	77.3	3.99	86.4	4.54	95.5	5.01	102	5.27	111	5.78
	78	67.1	2.57	68.2	3.48	77.3	3.99	86.4	4.54	95.5	5.01	102	5.27	111	5.78
	81	68.1	2.55	68.2	3.49	77.3	3.99	86.4	4.54	95.5	5.01	102	5.27	111	5.78

TC : Total capacity ; MBH
 PI : Power Input ; kW (Comp.+Outdoor fan motor)
 Note1 : The above table shows the average value of conditions which may occur.

RXYQ120PTJU

Cooling capacity	Indoor air temp. °F/WB												Cooling capacity	
	57		61		64		70		72		75			
Outdoor air temp. (°F/DB)	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
90	50	54	58	62	66	70	74	78	82	86	90	94	98	102
80	50	54	58	62	66	70	74	78	82	86	90	94	98	102
70	50	54	58	62	66	70	74	78	82	86	90	94	98	102
60	50	54	58	62	66	70	74	78	82	86	90	94	98	102
50	50	54	58	62	66	70	74	78	82	86	90	94	98	102
130	50	54	58	62	66	70	74	78	82	86	90	94	98	102
120	50	54	58	62	66	70	74	78	82	86	90	94	98	102
110	50	54	58	62	66	70	74	78	82	86	90	94	98	102
100	50	54	58	62	66	70	74	78	82	86	90	94	98	102

TC: Total capacity; MBH
 PI: Power Input; kW (Comp.+Outdoor fan motor)
 Note1: The above table shows the average value of conditions which may occur.

RXYQ144PTJU

Table with columns for Outdoor air temp., Indoor air temp., and Cooling capacity. Includes rows for 90, 80, 70, 60, and 50 degrees Fahrenheit outdoor air temperature. Sub-columns show TC, PI, MBH, and kW for various indoor air temperatures (57-75 F). A 'Cooling capacity' label is present at the top right.

Cooling capacity

Cooling capacity

Total capacity : MBH
Power Input : kW (Comp.+Outdoor fan motor)
Note1 : The above table shows the average value of conditions which may occur.

RIXQ168PTJU

Cooling capacity

Cooling capacity

Table with columns for Outdoor air temp. (50-103°F), Indoor air temp. (64-75°F), Comb. nat. (%), and Cooling capacity (TC, PI, MBH, kW). Rows are categorized by Comb. nat. (130, 120, 110, 100) and include values for TC and PI in MBH and kW.

Table with columns for Outdoor air temp. (50-103°F), Indoor air temp. (64-75°F), Comb. nat. (%), and Cooling capacity (TC, PI, MBH, kW). Rows are categorized by Comb. nat. (90, 80, 70, 60, 50) and include values for TC and PI in MBH and kW.

Total capacity: MBH
PI: Power Input; kW (Comp.+Outdoor fan motor)
Note: The above table shows the average value of conditions which may occur.

RXYQ192PTJU

Cooling capacity	Outdoor air temp. °F/°C	Indoor air temp. °F/°C											
		57		61		64		70		75			
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI		
90	50	112	483	136	584	185	681	173	793	191	867	203	831
	54	112	482	136	605	185	681	173	789	191	865	203	825
	58	112	501	136	630	185	725	173	825	191	920	221	110
	62	112	521	136	644	185	740	173	841	191	944	221	117
	66	112	532	136	657	185	757	173	863	191	102	203	112
80	72	112	537	136	665	185	785	173	917	191	106	203	116
	75	112	547	136	701	185	830	173	971	191	112	203	123
	79	112	586	136	754	185	930	173	105	191	121	203	133
	83	112	628	136	809	185	960	173	112	191	140	203	145
	87	112	672	136	867	185	1033	173	121	191	151	203	158
70	90	112	718	136	929	185	1111	173	134	191	165	203	165
	93	112	768	136	995	185	1197	173	144	191	176	203	176
	96	112	820	136	1065	185	1297	173	159	188	189	191	189
	99	112	875	136	1144	185	1366	173	160	185	176	181	176
	103	99.7	429	121	524	137	598	174	676	170	757	181	812
60	54	54	99.7	437	121	544	137	623	154	704	170	773	181
	58	58	99.7	453	121	566	137	635	154	735	170	806	181
	62	62	99.7	482	121	578	137	663	154	752	170	824	181
	66	66	99.7	471	121	578	137	663	154	752	170	824	181
	70	70	99.7	482	121	578	137	663	154	752	170	824	181
50	72	72	99.7	482	121	578	137	663	154	752	170	824	181
	75	75	99.7	509	121	607	137	701	154	785	170	861	181
	79	79	99.7	544	121	633	137	817	154	905	170	1011	181
	83	83	99.7	582	121	742	137	876	154	1021	170	1110	181
	87	87	99.7	621	121	794	137	939	154	1110	170	1261	181
40	90	90	99.7	642	121	849	137	1010	154	1113	170	1361	181
	93	93	99.7	663	121	849	137	1010	154	1113	170	1361	181
	96	96	99.7	707	121	908	137	1010	154	1113	170	1361	181
	99	99	99.7	754	121	970	137	1010	154	1113	170	1361	181
	103	103	99.7	806	121	1046	137	1010	154	1113	170	1361	181

TC : Total capacity ; MBH
 PI : Power Input ; kW (Comp.+Outdoor fan motor)

Note1 : The above table shows the average value of conditions which may occur.

RXYQ216PTJU

Combustion ratio (%)	Outdoor air temp. (F/DB)	Indoor air temp. F/WB													
		57		61		64		70		72		75			
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI		
90	50	126	5.78	153	7.10	174	8.15	194	9.24	215	10.4	229	11.1	249	12.3
	54	126	5.88	153	7.24	174	8.32	194	9.43	215	10.6	229	11.4	249	12.6
	58	126	6.01	153	7.54	174	8.67	194	9.83	215	10.8	229	11.6	249	12.8
	62	126	6.16	153	7.84	174	8.87	194	10.0	215	11.0	229	11.8	249	13.0
	66	126	6.33	153	8.14	174	9.06	194	10.2	215	11.2	229	12.0	249	13.2
	70	126	6.52	153	8.44	174	9.29	194	10.4	215	11.4	229	12.2	249	13.4
	72	126	6.73	153	8.74	174	9.53	194	10.6	215	11.6	229	12.4	249	13.6
	76	126	7.15	153	9.39	174	10.17	194	11.0	215	12.0	229	12.8	249	14.0
	80	126	7.61	153	10.01	174	10.71	194	11.5	215	12.5	229	13.3	249	14.4
	84	126	8.09	153	10.68	174	11.24	194	12.0	215	13.0	229	13.8	249	14.8
80	50	112	5.14	136	6.26	156	7.16	173	8.09	191	9.06	203	9.72	221	10.7
	54	112	5.23	136	6.51	156	7.30	173	8.26	191	9.25	203	9.91	221	11.0
	58	112	5.32	136	6.76	156	7.45	173	8.43	191	9.44	203	10.1	221	11.2
	62	112	5.42	136	7.01	156	7.60	173	8.61	191	9.64	203	10.3	221	11.4
	66	112	5.53	136	7.27	156	7.76	173	8.79	191	9.86	203	10.6	221	11.8
	70	112	5.63	136	7.52	156	7.93	173	8.99	191	10.3	203	11.2	221	12.2
	72	112	5.75	136	7.78	156	8.11	173	9.16	191	10.7	203	11.4	221	12.4
	76	112	5.99	136	8.29	156	8.45	173	9.31	191	11.0	203	11.6	221	12.6
	80	112	6.26	136	8.63	156	8.77	173	9.58	191	11.2	203	11.8	221	12.8
	84	112	6.51	136	8.99	156	9.11	173	10.06	191	12.2	203	13.3	221	15.1
70	50	98.1	4.53	119	5.45	135	6.21	151	6.97	167	7.60	178	8.20	194	9.20
	54	98.1	4.63	119	5.67	135	6.45	151	7.22	167	7.82	178	8.40	194	9.59
	58	98.1	4.73	119	5.89	135	6.69	151	7.47	167	8.09	178	8.69	194	9.80
	62	98.1	4.85	119	6.11	135	6.91	151	7.72	167	8.27	178	8.89	194	10.0
	66	98.1	4.97	119	6.34	135	7.15	151	7.97	167	8.56	178	9.08	194	10.2
	70	98.1	5.11	119	6.57	135	7.38	151	8.21	167	8.80	178	9.28	194	10.4
	72	98.1	5.25	119	6.81	135	7.61	151	8.45	167	9.02	178	9.48	194	10.6
	76	98.1	5.49	119	7.05	135	7.85	151	8.69	167	9.26	178	9.68	194	10.8
	80	98.1	5.74	119	7.29	135	8.09	151	8.93	167	9.49	178	9.88	194	11.0
	84	98.1	6.00	119	7.53	135	8.33	151	9.17	167	9.73	178	10.08	194	11.2
60	50	84.1	3.95	102	4.71	116	5.31	130	5.94	143	6.60	152	7.05	166	7.74
	54	84.1	4.01	102	4.87	116	5.40	130	6.05	143	6.72	152	7.16	166	7.80
	58	84.1	4.14	102	5.03	116	5.51	130	6.17	143	6.86	152	7.33	166	8.06
	62	84.1	4.27	102	5.19	116	5.62	130	6.29	143	6.99	152	7.48	166	8.23
	66	84.1	4.41	102	5.35	116	5.73	130	6.41	143	7.14	152	7.64	166	8.40
	70	84.1	4.56	102	5.51	116	5.84	130	6.53	143	7.27	152	7.79	166	8.57
	72	84.1	4.71	102	5.67	116	5.96	130	6.65	143	7.40	152	7.94	166	8.74
	76	84.1	4.87	102	5.83	116	6.08	130	6.77	143	7.52	152	8.07	166	8.91
	80	84.1	5.04	102	6.00	116	6.20	130	6.89	143	7.64	152	8.20	166	9.08
	84	84.1	5.21	102	6.17	116	6.32	130	7.01	143	7.76	152	8.33	166	9.25
50	50	70.1	3.40	85.2	3.99	95.6	4.56	108	5.13	119	5.66	127	6.16	138	6.66
	54	70.1	3.45	85.2	4.16	96.6	4.71	108	5.28	119	5.78	127	6.31	138	6.81
	58	70.1	3.50	85.2	4.32	97.6	4.86	108	5.41	119	5.91	127	6.46	138	6.96
	62	70.1	3.61	85.2	4.48	98.6	5.01	108	5.54	119	6.04	127	6.61	138	7.11
	66	70.1	3.73	85.2	4.64	99.6	5.16	108	5.67	119	6.17	127	6.76	138	7.26
	70	70.1	3.85	85.2	4.81	100.6	5.31	108	5.80	119	6.30	127	6.91	138	7.41
	72	70.1	3.97	85.2	4.97	101.6	5.46	108	5.93	119	6.43	127	7.06	138	7.56
	76	70.1	4.11	85.2	5.14	102.6	5.61	108	6.06	119	6.56	127	7.21	138	7.71
	80	70.1	4.25	85.2	5.31	103.6	5.76	108	6.19	119	6.69	127	7.36	138	7.86
	84	70.1	4.40	85.2	5.48	104.6	5.91	108	6.32	119	6.82	127	7.51	138	8.01

TC : Total capacity ; MBH

PI : Power Input ; kW (Comp.+Outdoor fan motor)

Notes : The above table shows the average value of conditions which may occur.

RYQ240PTJU

Combi- nation (%)	Outdoor air temp. (F/DB)	Indoor air temp. F/WB												Cooling capacity				
		57			61			64			70			72			75	
		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI
90	50	54	58	62	66	70	72	75	78	80	82	84	86	88	90	92	94	96
	50	54	58	62	66	70	72	75	78	80	82	84	86	88	90	92	94	96
	50	54	58	62	66	70	72	75	78	80	82	84	86	88	90	92	94	96
	50	54	58	62	66	70	72	75	78	80	82	84	86	88	90	92	94	96
	50	54	58	62	66	70	72	75	78	80	82	84	86	88	90	92	94	96
	50	54	58	62	66	70	72	75	78	80	82	84	86	88	90	92	94	96
	50	54	58	62	66	70	72	75	78	80	82	84	86	88	90	92	94	96
	50	54	58	62	66	70	72	75	78	80	82	84	86	88	90	92	94	96
	50	54	58	62	66	70	72	75	78	80	82	84	86	88	90	92	94	96
	50	54	58	62	66	70	72	75	78	80	82	84	86	88	90	92	94	96
50	54	58	62	66	70	72	75	78	80	82	84	86	88	90	92	94	96	

Combi- nation (%)	Outdoor air temp. (F/DB)	Indoor air temp. F/WB												Cooling capacity				
		57			61			64			70			72			75	
		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI
130	50	54	58	62	66	70	72	75	78	80	82	84	86	88	90	92	94	96
	50	54	58	62	66	70	72	75	78	80	82	84	86	88	90	92	94	96
	50	54	58	62	66	70	72	75	78	80	82	84	86	88	90	92	94	96
	50	54	58	62	66	70	72	75	78	80	82	84	86	88	90	92	94	96
	50	54	58	62	66	70	72	75	78	80	82	84	86	88	90	92	94	96
	50	54	58	62	66	70	72	75	78	80	82	84	86	88	90	92	94	96
	50	54	58	62	66	70	72	75	78	80	82	84	86	88	90	92	94	96
	50	54	58	62	66	70	72	75	78	80	82	84	86	88	90	92	94	96
	50	54	58	62	66	70	72	75	78	80	82	84	86	88	90	92	94	96
	50	54	58	62	66	70	72	75	78	80	82	84	86	88	90	92	94	96

TC: Total capacity; MBH
 PI: Power Input; kW (Comp.+Outdoor fan motor)
 Note: The above table shows the average value of conditions which may occur.

8.2 Heating Capacity (RXYQ-PTJU)

RXYQ72PTJU

Combit-nation (%)	Outdoor air temp. (F/D) (F/WB)	Indoor air temp. F/DB												Heating capacity				
		61				65				70					75			
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI		TC	PI	TC	PI
100	4.0	57.2	6.18	57.0	6.44	56.9	6.60	56.8	6.72	58.6	6.84	58.2	7.02	56.6	6.96	56.4	7.14	
	5.5	57.2	6.18	57.0	6.44	56.9	6.60	56.8	6.72	58.6	6.84	58.2	7.02	56.6	6.96	56.4	7.14	
	7.0	58.9	6.31	58.7	6.57	58.5	6.83	58.3	7.10	60.2	7.22	60.0	7.48	59.8	7.60	59.6	7.86	
	8.5	60.6	6.46	60.4	6.72	60.2	6.98	60.0	7.24	61.9	7.36	61.7	7.62	61.5	7.88	61.3	8.14	
	10.0	62.3	6.60	62.1	6.86	61.9	7.12	61.7	7.38	63.6	7.50	63.4	7.76	63.2	8.02	63.0	8.28	
	11.5	64.0	6.75	63.8	7.02	63.6	7.28	63.4	7.54	65.3	7.66	65.1	7.92	64.9	8.18	64.7	8.44	
	13.0	65.7	6.90	65.5	7.17	65.3	7.43	65.1	7.69	67.6	7.81	67.4	8.07	67.2	8.33	67.0	8.59	
	14.5	67.4	7.05	67.2	7.32	67.0	7.58	66.8	7.84	69.9	7.96	69.7	8.22	69.5	8.48	69.3	8.74	
	16.0	69.1	7.20	68.9	7.47	68.7	7.73	68.5	8.00	72.0	8.12	71.8	8.38	71.6	8.64	71.4	8.90	
	17.5	70.8	7.35	70.6	7.62	70.4	7.88	70.2	8.14	74.1	8.26	73.9	8.54	73.7	8.80	73.5	9.06	
19.0	72.5	7.50	72.3	7.77	72.1	8.03	71.9	8.29	76.2	8.34	76.0	8.62	75.8	8.90	75.6	9.14		
20.5	74.2	7.65	74.0	7.92	73.8	8.18	73.6	8.44	78.3	8.42	78.1	8.70	77.9	8.96	77.7	9.22		
22.0	75.9	7.80	75.7	8.07	75.5	8.33	75.3	8.59	80.4	8.50	80.2	8.78	79.8	9.04	79.6	9.30		
23.5	77.6	7.95	77.4	8.22	77.2	8.48	77.0	8.74	82.5	8.58	82.3	8.86	82.1	9.12	81.9	9.38		
25.0	79.3	8.10	79.1	8.37	78.9	8.63	78.7	8.89	84.6	8.66	84.4	8.94	84.2	9.20	84.0	9.46		
26.5	81.0	8.25	80.8	8.52	80.6	8.78	80.4	9.04	86.7	8.74	86.5	9.02	86.3	9.28	86.1	9.54		
28.0	82.7	8.40	82.5	8.67	82.3	8.93	82.1	9.19	88.8	8.82	88.6	9.10	88.4	9.38	88.2	9.62		
29.5	84.4	8.55	84.2	8.82	84.0	9.08	83.8	9.34	90.9	8.90	90.7	9.18	90.5	9.46	90.3	9.70		
31.0	86.1	8.70	85.9	8.97	85.7	9.23	85.5	9.49	93.0	8.98	92.8	9.26	92.6	9.54	92.4	9.78		
32.5	87.8	8.85	87.6	9.12	87.4	9.38	87.2	9.64	95.1	9.06	94.9	9.34	94.7	9.62	94.5	9.86		
34.0	89.5	9.00	89.3	9.27	89.1	9.53	88.9	9.79	97.2	9.14	97.0	9.42	96.8	9.70	96.6	9.94		
35.5	91.2	9.15	91.0	9.42	90.8	9.68	90.6	9.94	99.3	9.22	99.1	9.50	98.9	9.78	98.7	10.02		
37.0	92.9	9.30	92.7	9.57	92.5	9.83	92.3	10.09	101.4	9.30	101.2	9.58	101.0	9.86	100.8	10.10		
38.5	94.6	9.45	94.4	9.72	94.2	9.98	94.0	10.24	103.5	9.38	103.3	9.66	103.1	9.94	102.9	10.18		
40.0	96.3	9.60	96.1	9.87	95.9	10.13	95.7	10.39	105.6	9.46	105.4	9.74	105.2	10.02	105.0	10.26		
41.5	98.0	9.75	97.8	10.02	97.6	10.28	97.4	10.54	107.7	9.54	107.5	9.82	107.3	10.10	107.1	10.34		
43.0	99.7	9.90	99.5	10.17	99.3	10.43	99.1	10.69	109.8	9.62	109.6	9.90	109.4	10.18	109.2	10.42		
44.5	101.4	10.05	101.2	10.32	101.0	10.52	100.8	10.84	111.9	9.70	111.7	10.18	111.5	10.26	111.3	10.44		
46.0	103.1	10.20	102.9	10.47	102.7	10.67	102.5	11.00	114.0	9.78	113.8	10.26	113.6	10.34	113.4	10.52		
47.5	104.8	10.35	104.6	10.62	104.4	10.82	104.2	11.15	116.1	9.86	115.9	10.34	115.7	10.42	115.5	10.60		
49.0	106.5	10.50	106.3	10.77	106.1	10.97	105.9	11.30	118.2	9.94	118.0	10.42	117.8	10.50	117.6	10.68		
50.5	108.2	10.65	108.0	10.92	107.8	11.12	107.6	11.45	120.3	10.02	120.1	10.50	119.9	10.58	119.7	10.76		
52.0	109.9	10.80	109.7	11.07	109.5	11.27	109.3	11.60	122.4	10.10	122.2	10.58	122.0	10.66	121.8	10.84		
53.5	111.6	11.00	111.4	11.22	111.2	11.42	111.0	11.75	124.5	10.18	124.3	10.66	124.1	10.74	123.9	10.92		
55.0	113.3	11.15	113.1	11.37	112.9	11.57	112.7	11.90	126.6	10.26	126.4	10.74	126.2	10.82	126.0	11.00		
56.5	115.0	11.30	114.8	11.52	114.6	11.72	114.4	12.05	128.7	10.34	128.5	10.82	128.3	10.90	128.1	11.08		
58.0	116.7	11.45	116.5	11.67	116.3	11.87	116.1	12.20	130.8	10.42	130.6	10.90	130.4	10.98	130.2	11.16		
59.5	118.4	11.60	118.2	11.82	118.0	12.02	117.8	12.35	132.9	10.50	132.7	10.98	132.5	11.06	132.3	11.24		
61.0	120.1	11.75	119.9	11.97	119.7	12.17	119.5	12.50	135.0	10.58	134.8	11.06	134.6	11.14	134.4	11.32		

Combit-nation (%)	Outdoor air temp. (F/D) (F/WB)	Indoor air temp. F/DB												Heating capacity				
		61				65				70					75			
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI		TC	PI	TC	PI
130	4.0	57.2	6.18	57.0	6.44	56.9	6.60	56.8	6.72	58.6	6.84	58.2	7.02	56.6	6.96	56.4	7.14	
	5.5	57.2	6.18	57.0	6.44	56.9	6.60	56.8	6.72	58.6	6.84	58.2	7.02	56.6	6.96	56.4	7.14	
	7.0	58.9	6.31	58.7	6.57	58.5	6.83	58.3	7.10	60.2	7.22	60.0	7.48	59.8	7.60	59.6	7.86	
	8.5	60.6	6.46	60.4	6.72	60.2	6.98	60.0	7.24	61.9	7.36	61.7	7.62	61.5	7.88	61.3	8.14	
	10.0	62.3	6.60	62.1	6.86	61.9	7.12	61.7	7.38	63.6	7.50	63.4	7.76	63.2	8.02	63.0	8.28	
	11.5	64.0	6.75	63.8	7.02	63.6	7.28	63.4	7.54	65.3	7.66	65.1	7.92	64.9	8.18	64.7	8.44	
	13.0	65.7	6.90	65.5	7.17	65.3	7.43	65.1	7.69	67.6	7.81	67.4	8.07	67.2	8.33	67.0	8.59	
	14.5	67.4	7.05	67.2	7.32	67.0	7.58	66.8	7.84	69.9	7.96	69.7	8.22	69.5	8.48	69.3	8.74	
	16.0	69.1	7.20	68.9	7.47	68.7	7.73	68.5	8.00	72.0	8.12	71.8	8.38	71.6	8.64	71.4	8.90	
	17.5	70.8	7.35	70.6	7.62	70.4	7.88	70.2	8.14	74.1	8.26	73.9	8.54	73.7	8.80	73.5	9.06	
19.0	72.5	7.50	72.3	7.77	72.1	8.03	71.9	8.29	76.2	8.34	76.0	8.62	75.8	8.90	75.6	9.14		
20.5	74.2	7.65	74.0	7.92	73.8	8.18	73.6	8.44	78.3	8.42	78.1	8.70	77.9	8.96	77.7	9.22		
22.0	75.9	7.80	75.7	8.07	75.5	8.33	75.3	8.59	80.4	8.50	80.2	8.78	79.8	9.04	79.6	9.30		
23.5	77.6	7.95	77.4	8.22	77.2	8.48	77.0	8.74	82.5	8.58	82.3	8.86	82.1	9.12	81.9	9.38		
25.0	79.3	8.10	79.1	8.37	78.9	8.63	78.7	8.89	84.6	8.66	84.4	8.94	84.2	9.20	84.0	9.46		
26.5	81.0	8.25	80.8	8.52	80.6	8.78	80.4	9.04	86.7	8.74	86.5	9.10	86.3	9.28	86.1	9.54		
28.0	82.7	8.40	82.5	8.67	82.3	8.93	82.1	9.19	88.8	8.82	88.6	9.18	88.4	9.38	88.2	9.62		
29.5	84.4	8.55	84.2	8.82	84.0	9.08	83.8	9.34	90.9	8.90	90.7	9.26	90.5	9.46	90.3	9.70		
31.0	86.1	8.70	85.9	8.97	85.7	9.23	85.5	9.49	93.0	8.98	92.8	9.34	92.6	9.54	92.4	9.78		
32.5	87.8	8.85	87.6	9.12	87.4	9.38	87.2	9.64	95.1	9.06	94.9	9.42	94.7	9.62	94.5	9.90		
34.0	89.5	9.00	89.3	9.27	89.1	9.53	88.9	9.79	97.2	9.14	97.0	9.50	96.8	9.70	96.6	9.98		
35.5	91.2	9.15	91.0	9.42	90.8	9.68	90.6	9.94	99.3	9.22	99.1	9.58	98.9	9.78	98.7	10.06		
37.0	92.9	9.30	92.7	9.57	92.5	9.83	92.3	10.09	101.4	9.30	101.2	9.66	101.0	9.86	100.8	10.14		
38.5	94.6	9.45	94.4	9.72	94.2	9.98	94.0	10.24	103.5	9.38	103.3	9.74	103.1	9.94	102.9	10.22		
40.0	96.3	9.60	96.1	9.87	95.9	10.13	95.7	10.39	105.6	9.46	105.4	9.82	105.2	10.02	105.0	10.30		
41.5	98.0	9.75	97.8	10.02	97.6	10.28	97.4	10.54	107.7	9.54	107.5	9.90	107.3	10.10	107.1	10.38		
43.0	99.7	9.90	99.5	10.17	99.3	10.43	99.1	10.69	109.8	9.62	109.6	9.98	109.4	10.18	109.2	10.46		
44.5	101.4	10.05	101.2	10.32	101.0	10.52	100.8	10.84	111.9	9.70	111.7	10.06	111.5	10.26	111.3	10.54		
46.0	103.1	10.20	102.9	10.47	102.7	10.67	102.5	11.00	114.0	9.78	113.8	10.14	113.6	10.34	113.4	10.62		
47.5	104.8	10.35	104.6	10.62	104.4	10.82	104.2	11.15	116.1	9.86	115.9	10.22	115.7	10.42	115.5	10.70		
49.0	106.5	10.50	106.3	10.77	106.1	10.97	105.9	11.30	118.2	9.94	118.0	10.30	117.8	10.50	117.6	10.78		
50.5	108.2	10.65	108.0</															

Heating capacity

Combi-radiation (%)	Outdoor air temp. (F/Delta)	Indoor air Temp. F/DB												
		61			65			70			75			
		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	
70	-3.64	-4.0	56.1	7.87	53.1	7.37	50.4	6.91	48.6	6.61	46.8	6.31	44.1	5.88
	-1.84	-2.2	56.7	7.70	53.1	7.09	50.4	6.65	48.6	6.37	46.8	6.08	44.1	5.67
	5.5	5.0	56.7	6.68	53.1	6.17	50.4	5.80	48.6	5.55	46.8	5.31	44.1	4.96
	9.5	8.5	56.7	6.28	53.1	5.81	50.4	5.46	48.6	5.23	46.8	5.01	44.1	4.68
	13.0	12.0	56.7	5.93	53.1	5.48	50.4	5.16	48.6	4.95	46.8	4.74	44.1	4.43
	15.0	14.0	56.7	5.74	53.1	5.31	50.4	5.00	48.6	4.80	46.8	4.60	44.1	4.30
	17.0	15.5	56.7	5.61	53.1	5.20	50.4	4.89	48.6	4.69	46.8	4.50	44.1	4.21
	19.0	18.0	56.7	5.40	53.1	5.01	50.4	4.72	48.6	4.53	46.8	4.34	44.1	4.07
	22.0	20.0	56.7	5.25	53.1	4.87	50.4	4.59	48.6	4.41	46.8	4.22	44.1	3.96
	30.0	28.0	56.7	4.72	53.1	4.39	50.4	4.14	48.6	3.98	46.8	3.82	44.1	3.58
	35.0	32.0	56.7	4.50	53.1	4.18	50.4	3.95	48.6	3.80	46.8	3.64	44.1	3.42
	39.0	36.0	56.7	4.29	53.1	3.99	50.4	3.78	48.6	3.63	46.8	3.49	44.1	3.28
44.0	40.0	56.7	4.11	53.1	3.83	50.4	3.62	48.6	3.48	46.8	3.35	44.1	3.15	
47.0	43.0	56.7	3.98	53.1	3.71	50.4	3.51	48.6	3.38	46.8	3.25	44.1	3.06	
51.0	47.0	56.7	3.83	53.1	3.57	50.4	3.38	48.6	3.25	46.8	3.13	44.1	2.94	
54.0	50.0	56.7	3.72	53.1	3.47	50.4	3.28	48.6	3.16	46.8	3.04	44.1	2.87	
57.0	53.0	56.7	3.62	53.1	3.37	50.4	3.20	48.6	3.08	46.8	2.96	44.1	2.79	
60.0	56.0	56.7	3.52	53.1	3.29	50.4	3.12	48.6	3.00	46.8	2.89	44.1	2.72	
60	-3.64	-4.0	47.2	6.38	44.2	5.90	42.0	5.55	40.5	5.32	39.0	5.09	36.8	4.75
	-1.84	-2.2	47.2	6.15	44.2	5.69	42.0	5.35	40.5	5.13	39.0	4.91	36.8	4.59
	5.5	5.0	47.2	5.37	44.2	4.98	42.0	4.69	40.5	4.50	39.0	4.32	36.8	4.04
	9.5	8.5	47.2	5.06	44.2	4.70	42.0	4.43	40.5	4.25	39.0	4.08	36.8	3.82
	13.0	12.0	47.2	4.79	44.2	4.45	42.0	4.20	40.5	4.03	39.0	3.87	36.8	3.63
	15.0	14.0	47.2	4.65	44.2	4.32	42.0	4.08	40.5	3.92	39.0	3.76	36.8	3.53
	17.0	15.5	47.2	4.55	44.2	4.22	42.0	3.99	40.5	3.83	39.0	3.68	36.8	3.46
	19.0	18.0	47.2	4.39	44.2	4.08	42.0	3.85	40.5	3.71	39.0	3.56	36.8	3.34
	22.0	20.0	47.2	4.27	44.2	3.97	42.0	3.75	40.5	3.61	39.0	3.47	36.8	3.26
	26.0	24.0	47.2	4.05	44.2	3.77	42.0	3.57	40.5	3.43	39.0	3.30	36.8	3.11
	30.0	28.0	47.2	3.86	44.2	3.60	42.0	3.40	40.5	3.28	39.0	3.15	36.8	2.97
	35.0	32.0	47.2	3.68	44.2	3.43	42.0	3.25	40.5	3.13	39.0	3.02	36.8	2.84
39.0	36.0	47.2	3.52	44.2	3.29	42.0	3.12	40.5	3.00	39.0	2.89	36.8	2.73	
44.0	40.0	47.2	3.38	44.2	3.16	42.0	2.99	40.5	2.89	39.0	2.78	36.8	2.62	
47.0	43.0	47.2	3.28	44.2	3.07	42.0	2.91	40.5	2.81	39.0	2.70	36.8	2.55	
51.0	47.0	47.2	3.16	44.2	2.95	42.0	2.80	40.5	2.71	39.0	2.61	36.8	2.46	
54.0	50.0	47.2	3.07	44.2	2.88	42.0	2.73	40.5	2.64	39.0	2.54	36.8	2.40	
57.0	53.0	47.2	2.99	44.2	2.80	42.0	2.66	40.5	2.57	39.0	2.48	36.8	2.34	
60.0	56.0	47.2	2.92	44.2	2.73	42.0	2.60	40.5	2.51	39.0	2.42	36.8	2.29	
50	-3.64	-4.0	47.2	6.38	44.2	5.90	42.0	5.55	40.5	5.32	39.0	5.09	36.8	4.75
	-1.84	-2.2	47.2	6.15	44.2	5.69	42.0	5.35	40.5	5.13	39.0	4.91	36.8	4.59
	5.5	5.0	47.2	5.37	44.2	4.98	42.0	4.69	40.5	4.50	39.0	4.32	36.8	4.04
	9.5	8.5	47.2	5.06	44.2	4.70	42.0	4.43	40.5	4.25	39.0	4.08	36.8	3.82
	13.0	12.0	47.2	4.79	44.2	4.45	42.0	4.20	40.5	4.03	39.0	3.87	36.8	3.63
	15.0	14.0	47.2	4.65	44.2	4.32	42.0	4.08	40.5	3.92	39.0	3.76	36.8	3.53
	17.0	15.5	47.2	4.55	44.2	4.22	42.0	3.99	40.5	3.83	39.0	3.68	36.8	3.46
	19.0	18.0	47.2	4.39	44.2	4.08	42.0	3.85	40.5	3.71	39.0	3.56	36.8	3.34
	22.0	20.0	47.2	4.27	44.2	3.97	42.0	3.75	40.5	3.61	39.0	3.47	36.8	3.26
	26.0	24.0	47.2	4.05	44.2	3.77	42.0	3.57	40.5	3.43	39.0	3.30	36.8	3.11
	30.0	28.0	47.2	3.86	44.2	3.60	42.0	3.40	40.5	3.28	39.0	3.15	36.8	2.97
	35.0	32.0	47.2	3.68	44.2	3.43	42.0	3.25	40.5	3.13	39.0	3.02	36.8	2.84
39.0	36.0	47.2	3.52	44.2	3.29	42.0	3.12	40.5	3.00	39.0	2.89	36.8	2.73	
44.0	40.0	47.2	3.38	44.2	3.16	42.0	2.99	40.5	2.89	39.0	2.78	36.8	2.62	
47.0	43.0	47.2	3.28	44.2	3.07	42.0	2.91	40.5	2.81	39.0	2.70	36.8	2.55	
51.0	47.0	47.2	3.16	44.2	2.95	42.0	2.80	40.5	2.71	39.0	2.61	36.8	2.46	
54.0	50.0	47.2	3.07	44.2	2.88	42.0	2.73	40.5	2.64	39.0	2.54	36.8	2.40	
57.0	53.0	47.2	2.99	44.2	2.80	42.0	2.66	40.5	2.57	39.0	2.48	36.8	2.34	
60.0	56.0	47.2	2.92	44.2	2.73	42.0	2.60	40.5	2.51	39.0	2.42	36.8	2.29	

TC : Total capacity ; MBH

PI : Power Input ; kW (Comp.+Outdoor fan motor)

Note1 : is shown as reference.

When selecting the unit models, avoid the Outdoor air temperature range shown by

Note 2 : The above table shows the average value of conditions which may occur.

RXYQ96PTJU

Combit-nation (%)	Outdoor air temp. (F/DB) (F/WB)	Indoor air temp. F/DB												Heating capacity														
		61			65			68			70				72			75										
		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH					
100	-3.64	-4.0	71.9	9.04	71.7	9.40	71.5	9.67	71.4	9.86	71.3	10.0	71.2	10.3	71.1	10.6	70.9	10.8	70.8	70.8	10.9	70.9	11.2	10.9	71.4	9.82		
	-1.84	-2.2	73.1	9.14	72.9	9.50	72.8	9.77	72.7	9.96	72.6	10.1	72.4	10.4	72.3	10.6	72.1	10.9	72.1	11.2	10.9	72.1	11.2	11.2	11.2	78.4	10.7	
	9.5	5.0	79.1	8.60	78.9	8.93	78.7	10.2	78.6	10.3	78.5	10.5	78.3	10.8	78.2	11.0	78.1	11.2	78.1	11.2	11.2	11.2	11.2	11.2	78.4	10.7		
	15.0	10.0	84.0	8.02	83.8	8.32	83.6	9.6	83.5	9.7	83.4	10.0	83.2	10.3	83.1	10.5	82.9	10.8	82.8	11.0	10.9	82.8	11.2	11.2	78.4	10.7		
	20.0	15.0	88.8	7.44	88.6	7.74	88.4	9.0	88.3	9.1	88.2	9.4	88.0	9.7	87.9	10.0	87.7	10.3	87.6	10.5	87.5	10.8	87.4	11.0	87.2	10.9	78.4	10.7
	25.0	20.0	93.6	6.86	93.4	7.16	93.2	8.7	93.1	8.8	93.0	9.1	92.8	9.4	92.7	9.7	92.5	10.0	92.4	10.3	92.3	10.5	92.2	10.8	92.0	10.9	78.4	10.7
	30.0	25.0	98.4	6.28	98.2	6.58	98.0	8.4	97.9	8.5	97.8	8.8	97.6	9.1	97.5	9.4	97.3	9.7	97.2	10.0	97.1	10.3	97.0	10.5	96.8	10.6	78.4	10.7
	35.0	30.0	103.0	5.70	102.8	6.00	102.6	7.9	102.5	8.0	102.4	8.3	102.2	8.6	102.1	8.9	101.9	9.2	101.8	9.5	101.7	9.8	101.6	10.1	101.4	10.2	78.4	10.7
	40.0	35.0	107.6	5.12	107.4	5.42	107.2	7.3	107.1	7.4	107.0	7.7	106.8	8.0	106.7	8.3	106.5	8.6	106.4	8.9	106.3	9.2	106.2	9.5	106.0	9.4	78.4	10.7
	45.0	40.0	112.2	4.54	112.0	4.84	111.8	6.7	111.7	6.8	111.6	7.1	111.4	7.4	111.3	7.7	111.1	8.0	111.0	8.3	110.9	8.6	110.8	8.9	110.6	8.8	78.4	10.7
	50.0	45.0	116.8	3.96	116.6	4.26	116.4	6.1	116.3	6.2	116.2	6.5	116.0	6.8	115.9	7.1	115.7	7.4	115.6	7.7	115.5	8.0	115.4	8.3	115.2	8.2	78.4	10.7
	55.0	50.0	121.4	3.38	121.2	3.68	121.0	5.5	120.9	5.6	120.8	5.9	120.6	6.2	120.5	6.5	120.3	6.8	120.2	7.1	120.1	7.4	120.0	7.7	119.8	7.6	78.4	10.7
60.0	55.0	126.0	2.80	125.8	3.10	125.6	4.9	125.5	5.0	125.4	5.3	125.2	5.6	125.1	5.9	124.9	6.2	124.8	6.5	124.7	6.8	124.6	7.1	124.4	7.0	78.4	10.7	

Combit-nation (%)	Outdoor air temp. (F/DB) (F/WB)	Indoor air temp. F/DB												Heating capacity													
		61			65			68			70				72			75									
		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH				
130	-3.64	-4.0	73.0	7.41	72.7	7.71	72.3	8.22	72.2	8.46	72.0	8.82	71.7	9.18	71.5	9.54	71.3	9.90	71.1	10.26	70.9	10.62	70.7	10.98	70.5	11.34	6.93
	-1.84	-2.2	74.6	6.84	74.3	7.15	74.0	7.66	73.8	8.06	73.5	8.48	73.3	8.90	73.0	9.32	72.7	9.68	72.4	10.04	72.1	10.40	71.8	10.76	71.5	11.10	6.93
	9.5	5.0	80.2	6.28	79.9	6.60	79.6	7.52	79.4	7.94	79.2	8.36	78.9	8.78	78.7	9.22	78.4	9.64	78.1	10.00	77.8	10.36	77.5	10.72	77.2	11.16	6.93
	15.0	10.0	85.4	5.70	85.1	6.02	84.8	6.94	84.6	7.36	84.3	7.78	84.0	8.20	83.7	8.62	83.4	9.04	83.1	9.46	82.8	9.88	82.5	10.30	82.2	11.10	6.93
	20.0	15.0	90.6	5.12	90.3	5.44	90.0	6.36	89.8	6.78	89.5	7.20	89.2	7.62	88.9	8.04	88.6	8.46	88.3	8.90	88.0	9.34	87.7	9.78	87.4	10.74	6.93
	25.0	20.0	95.8	4.54	95.5	4.86	95.2	5.78	95.0	6.20	94.7	6.62	94.4	7.04	94.1	7.46	93.8	7.88	93.5	8.30	93.2	8.72	92.9	9.16	92.6	10.44	6.93
	30.0	25.0	101.0	3.96	100.7	4.28	100.4	5.20	100.2	5.62	99.9	6.04	99.6	6.46	99.3	6.88	99.0	7.30	98.7	7.72	98.4	8.14	98.1	8.56	97.8	9.70	6.93
	35.0	30.0	106.0	3.38	105.7	3.70	105.4	4.62	105.2	5.04	104.9	5.46	104.6	5.88	104.3	6.30	104.0	6.72	103.7	7.14	103.4	7.56	103.1	7.98	102.8	9.10	6.93
	40.0	35.0	111.0	2.80	110.7	3.12	110.4	4.04	110.2	4.46	109.9	4.88	109.6	5.30	109.3	5.72	109.0	6.14	108.7	6.56	108.4	6.98	108.1	7.40	107.8	8.60	6.93
	45.0	40.0	116.0	2.22	115.7	2.54	115.4	3.46	115.2	3.88	114.9	4.30	114.6	4.72	114.3	5.14	114.0	5.56	113.7	5.98	113.4	6.40	113.1	6.82	112.8	8.10	6.93
	50.0	45.0	121.0	1.64	120.7	1.96	120.4	2.88	120.2	3.30	119.9	3.72	119.6	4.14	119.3	4.56	119.0	4.98	118.7	5.40	118.4	5.82	118.1	6.24	117.8	7.60	6.93
	55.0	50.0	126.0	1.06	125.7	1.38	125.4	2.30	125.2	2.72	124.9	3.14	124.6	3.56	124.3	3.98	124.0	4.40	123.7	4.82	123.4	5.24	123.1	5.66	122.8	7.00	6.93
60.0	55.0	131.0	0.48	130.7	0.80	130.4	1.72	130.2	2.14	129.9	2.56	129.6	2.98	129.3	3.40	129.0	3.82	128.7	4.24	128.4	4.66	128.1	5.08	127.8	6.20	6.93	

TC: Total capacity; MBH
 PI: Power Input; kW (Comp.+Outdoor fan motor)
 Note 1: [] is shown as reference.
 Note 2: The above table shows the average value of conditions which may occur.

Heating capacity

Combi- ration (%)	Outdoor air temp. (F/WB)	Indoor air Temp. F/DB														
		61			65			68			70			75		
		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH
	-3.64	-4.0	70.8	10.9	70.7	11.2	67.2	10.5	64.8	10.1	62.4	9.60	58.8	8.93		
	-1.84	-2.2	72.1	11.0	70.8	11.0	67.2	10.3	64.8	9.84	62.4	9.39	58.8	8.74		
	5.5	5.0	75.6	10.8	70.8	9.94	67.2	9.33	64.8	8.93	62.4	8.53	58.8	7.95		
	9.5	8.5	75.6	10.2	70.8	9.43	67.2	8.85	64.8	8.48	62.4	8.11	58.8	7.56		
	13.0	12.0	75.6	9.67	70.8	8.93	67.2	8.39	64.8	8.03	62.4	7.69	58.8	7.18		
	15.0	14.0	75.6	9.36	70.8	8.65	67.2	8.13	64.8	7.79	62.4	7.45	58.8	6.96		
	17.0	15.5	75.6	9.13	70.8	8.44	67.2	7.93	64.8	7.60	62.4	7.28	58.8	6.80		
	19.0	18.0	75.6	8.76	70.8	8.10	67.2	7.62	64.8	7.31	62.4	7.00	58.8	6.54		
	22.0	20.0	75.6	8.47	70.8	7.84	67.2	7.38	64.8	7.07	62.4	6.78	58.8	6.34		
	30.0	28.0	75.6	7.92	70.8	7.33	67.2	6.91	64.8	6.63	62.4	6.36	58.8	5.95		
	35.0	32.0	75.6	7.40	70.8	6.86	67.2	6.47	64.8	6.21	62.4	5.96	58.8	5.59		
	39.0	36.0	75.6	6.47	70.8	6.01	67.2	5.68	64.8	5.46	62.4	5.25	58.8	4.93		
	44.0	40.0	75.6	6.06	70.8	5.64	67.2	5.33	64.8	5.13	62.4	4.93	58.8	4.63		
	47.0	43.0	75.6	5.77	70.8	5.37	67.2	5.08	64.8	4.89	62.4	4.71	58.8	4.43		
	51.0	47.0	75.6	5.41	70.8	5.05	67.2	4.78	64.8	4.60	62.4	4.43	58.8	4.17		
	54.0	50.0	75.6	5.17	70.8	4.82	67.2	4.57	64.8	4.40	62.4	4.24	58.8	3.99		
	57.0	53.0	75.6	4.93	70.8	4.61	67.2	4.37	64.8	4.21	62.4	4.06	58.8	3.83		
	60.0	56.0	75.6	4.72	70.8	4.41	67.2	4.18	64.8	4.04	62.4	3.89	58.8	3.67		
	-3.64	-4.0	63.0	9.71	59.0	8.97	56.0	8.43	54.0	8.07	52.0	7.72	49.0	7.21		
	-1.84	-2.2	63.0	9.50	59.0	8.78	56.0	8.25	54.0	7.90	52.0	7.56	49.0	7.06		
	5.5	5.0	63.0	8.63	59.0	7.98	56.0	7.51	54.0	7.20	52.0	6.90	49.0	6.45		
	9.5	8.5	63.0	8.20	59.0	7.59	56.0	7.15	54.0	6.86	52.0	6.57	49.0	6.15		
	13.0	12.0	63.0	7.77	59.0	7.20	56.0	6.79	54.0	6.51	52.0	6.25	49.0	5.85		
	15.0	14.0	63.0	7.54	59.0	6.99	56.0	6.59	54.0	6.32	52.0	6.06	49.0	5.68		
	17.0	15.5	63.0	7.36	59.0	6.83	56.0	6.44	54.0	6.18	52.0	5.93	49.0	5.56		
	19.0	18.0	63.0	7.07	59.0	6.57	56.0	6.19	54.0	5.95	52.0	5.71	49.0	5.36		
	22.0	20.0	63.0	6.85	59.0	6.36	56.0	6.01	54.0	5.77	52.0	5.54	49.0	5.20		
	26.0	24.0	63.0	6.42	59.0	5.97	56.0	5.64	54.0	5.42	52.0	5.21	49.0	4.89		
	30.0	28.0	63.0	6.02	59.0	5.61	56.0	5.30	54.0	5.10	52.0	4.90	49.0	4.61		
	35.0	32.0	63.0	5.65	59.0	5.26	56.0	4.98	54.0	4.79	52.0	4.61	49.0	4.34		
	39.0	36.0	63.0	5.30	59.0	4.94	56.0	4.68	54.0	4.51	52.0	4.34	49.0	4.09		
	44.0	40.0	63.0	4.98	59.0	4.65	56.0	4.41	54.0	4.25	52.0	4.09	49.0	3.86		
	47.0	43.0	63.0	4.75	59.0	4.44	56.0	4.21	54.0	4.06	52.0	3.92	49.0	3.70		
	51.0	47.0	63.0	4.47	59.0	4.19	56.0	3.98	54.0	3.84	52.0	3.70	49.0	3.49		
	54.0	50.0	63.0	4.28	59.0	4.01	56.0	3.81	54.0	3.68	52.0	3.55	49.0	3.35		
	57.0	53.0	63.0	4.10	59.0	3.84	56.0	3.65	54.0	3.53	52.0	3.40	49.0	3.22		
	60.0	56.0	63.0	3.92	59.0	3.68	56.0	3.50	54.0	3.39	52.0	3.27	49.0	3.10		

TC : Total capacity ; MBH

PI : Power Input ; kW (Comp.+Outdoor fan motor)

Note1 : is shown as reference.

When selecting the unit models, avoid the Outdoor air temperature range shown by

Note 2: The above table shows the average value of conditions which may occur.

RIXQ120PTJU

Heating capacity

Combit- nation (%)	Outdoor air temp. (F/D B)	Indoor air temp. F/D B											
		61			65			70			75		
		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH
100	-3.64	-4.0	7.72	7.63	8.17	8.57	76.7	76.6	8.83	76.4	8.0	76.2	8.50
	-1.84	-2.2	7.86	7.78	8.31	8.71	78.1	77.9	8.97	77.8	8.1	77.6	8.62
	0.5	0.5	8.46	8.38	8.91	9.21	84.3	84.1	9.52	84.0	8.7	83.8	9.17
	5.5	5.5	8.89	8.81	9.34	9.64	87.9	87.7	9.82	87.6	9.0	87.4	9.45
	13.0	12.0	9.24	9.16	9.69	9.99	91.3	91.1	10.1	91.0	9.3	90.8	9.81
	15.0	14.0	9.48	9.40	9.93	10.23	94.0	93.8	10.4	94.0	9.6	93.8	10.0
	17.0	15.5	9.67	9.59	10.14	10.44	96.1	95.9	10.6	96.1	9.9	95.9	10.4
	19.0	18.0	9.89	9.81	10.31	10.61	99.4	99.2	10.8	99.4	10.2	99.2	10.7
	22.0	20.0	10.3	10.2	10.71	11.01	102	102	11.1	102	10.5	102	11.1
	26.0	24.0	10.9	10.8	11.28	11.58	108	108	11.7	108	11.1	108	11.8
	30.0	28.0	11.5	11.4	11.9	12.2	114	114	12.3	114	11.7	114	12.4
	35.0	32.0	12.2	12.1	12.6	12.9	121	121	12.9	121	12.3	121	12.9
40.0	36.0	13.0	12.9	13.4	13.7	128	128	13.6	128	13.0	128	13.6	
45.0	40.0	13.8	13.7	14.2	14.5	134	134	14.2	134	13.7	134	14.3	
47.0	43.0	14.0	13.9	14.4	14.7	136	136	14.4	136	13.9	136	14.5	
51.0	47.0	15.1	14.9	15.4	15.7	142	142	15.1	142	14.5	142	15.1	
51.0	47.0	15.1	14.9	15.4	15.7	142	142	15.1	142	14.5	142	15.1	
54.0	50.0	15.7	15.5	16.0	16.3	147	147	15.7	147	15.1	147	15.7	
57.0	53.0	16.6	16.4	17.0	17.3	153	153	16.6	153	16.0	153	16.6	
60.0	56.0	17.3	17.1	17.7	18.0	159	159	17.3	159	16.7	159	17.3	
-1.84	-2.2	7.81	7.73	8.26	8.56	77.7	77.5	8.96	77.4	8.1	77.2	8.59	
5.5	5.0	8.44	8.36	8.89	9.19	84.1	83.9	9.52	83.8	8.7	83.6	9.15	
13.0	12.0	8.87	8.79	9.32	9.62	87.8	87.6	9.88	87.5	9.0	87.3	9.43	
15.0	14.0	9.11	9.03	9.56	9.86	90.6	90.4	10.1	90.5	9.3	90.3	9.76	
17.0	15.5	9.36	9.28	9.81	10.11	93.5	93.3	10.4	93.4	9.6	93.2	10.1	
19.0	18.0	9.60	9.52	10.05	10.35	96.4	96.2	10.7	96.3	9.9	96.1	10.4	
22.0	20.0	10.0	9.92	10.45	10.75	99.3	99.1	11.1	99.2	10.3	99.0	10.8	
26.0	24.0	10.6	10.5	11.0	11.3	104	104	11.6	104	10.9	104	11.5	
30.0	28.0	11.2	11.1	11.6	11.9	110	110	12.1	110	11.5	110	12.1	
35.0	32.0	11.9	11.8	12.3	12.6	116	116	12.8	116	12.1	116	12.7	
40.0	36.0	12.7	12.6	13.1	13.4	122	122	13.5	122	12.8	122	13.4	
45.0	40.0	13.5	13.4	13.9	14.2	128	128	14.2	128	13.4	128	14.0	
47.0	43.0	13.7	13.6	14.1	14.4	130	130	14.4	130	13.6	130	14.1	
51.0	47.0	14.8	14.6	15.1	15.4	137	137	15.1	137	14.1	137	14.7	
54.0	50.0	15.6	15.4	15.9	16.2	142	142	15.6	142	14.7	142	15.3	
57.0	53.0	16.5	16.3	16.8	17.1	148	148	16.5	148	15.4	148	16.0	
60.0	56.0	17.2	17.0	17.5	17.8	154	154	17.2	154	16.1	154	16.7	
-3.64	-4.0	7.63	8.17	8.57	76.7	76.6	8.83	76.4	8.0	76.2	8.50		
-1.84	-2.2	7.77	8.31	8.71	78.1	77.9	8.97	77.8	8.1	77.6	8.62		
5.5	5.0	8.40	8.32	8.85	87.5	87.3	9.52	87.2	8.7	87.0	9.15		
13.0	12.0	8.83	8.75	9.28	91.2	91.0	9.98	91.0	9.0	90.8	9.43		
15.0	14.0	9.07	8.99	9.52	94.0	93.8	10.2	94.0	9.3	93.8	9.76		
17.0	15.5	9.32	9.24	9.69	96.9	96.7	10.5	96.8	9.6	96.6	10.1		
19.0	18.0	9.56	9.48	9.93	99.8	99.6	10.8	99.8	10.0	99.6	10.5		
22.0	20.0	10.0	9.92	10.35	10.65	102.7	102.5	11.1	102.6	10.3	102.4	10.8	
26.0	24.0	10.6	10.5	11.0	11.3	107	107	11.6	107	10.9	107	11.5	
30.0	28.0	11.2	11.1	11.6	11.9	112	112	12.1	112	11.5	112	12.1	
35.0	32.0	11.9	11.8	12.3	12.6	118	118	12.8	118	12.1	118	12.7	
40.0	36.0	12.7	12.6	13.1	13.4	124	124	13.5	124	12.8	124	13.4	
45.0	40.0	13.5	13.4	13.9	14.2	129	129	14.2	129	13.4	129	14.0	
47.0	43.0	13.7	13.6	14.1	14.4	131	131	14.4	131	13.6	131	14.1	
51.0	47.0	14.8	14.6	15.1	15.4	138	138	15.1	138	14.1	138	14.7	
54.0	50.0	15.6	15.4	15.9	16.2	143	143	15.6	143	14.7	143	15.3	
57.0	53.0	16.5	16.3	16.8	17.1	148	148	16.5	148	15.4	148	16.0	
60.0	56.0	17.2	17.0	17.5	17.8	154	154	17.2	154	16.1	154	16.7	
-3.64	-4.0	7.33	7.87	8.27	77.3	77.1	8.56	77.0	7.7	76.8	8.19		
-1.84	-2.2	7.47	8.01	8.41	78.7	78.5	8.70	78.4	7.9	78.2	8.34		
5.5	5.0	8.10	8.02	8.55	86.9	86.7	9.26	86.6	8.4	86.4	8.89		
13.0	12.0	8.53	8.45	8.98	90.6	90.4	9.61	90.5	8.7	90.3	9.16		
15.0	14.0	8.77	8.69	9.14	93.4	93.2	9.90	93.3	9.0	93.1	9.47		
17.0	15.5	9.02	8.94	9.29	96.3	96.1	10.1	96.2	9.2	96.0	9.70		
19.0	18.0	9.26	9.18	9.53	99.2	99.0	10.4	99.1	9.5	98.9	10.0		
22.0	20.0	9.7	9.62	10.0	103	103	10.8	103	10.0	102	10.5		
26.0	24.0	10.3	10.2	10.6	108	108	11.3	108	10.5	107	11.0		
30.0	28.0	10.9	10.8	11.2	113	113	11.8	113	11.0	112	11.5		
35.0	32.0	11.6	11.5	11.9	118	118	12.3	118	11.6	117	12.1		
40.0	36.0	12.4	12.3	12.7	124	124	13.0	124	12.3	123	12.8		
45.0	40.0	13.2	13.1	13.5	129	129	13.7	129	13.0	128	13.4		
47.0	43.0	13.4	13.3	13.7	131	131	13.9	131	13.2	130	13.6		
51.0	47.0	14.5	14.3	14.7	138	138	14.6	138	13.9	137	14.2		
54.0	50.0	15.3	15.1	15.5	144	144	15.4	144	14.6	143	14.8		
57.0	53.0	16.2	16.0	16.4	149	149	16.2	149	15.4	149	15.5		
60.0	56.0	17.0	16.8	17.2	155	155	17.0	155	16.1	154	16.2		
-3.64	-4.0	7.33	7.87	8.27	77.3	77.1	8.56	77.0	7.7	76.8	8.19		
-1.84	-2.2	7.47	8.01	8.41	78.7	78.5	8.70	78.4	7.9	78.2	8.34		
5.5	5.0	8.10	8.02	8.55	86.9	86.7	9.26	86.6	8.4	86.4	8.89		
13.0	12.0	8.53	8.45	8.98	90.6	90.4	9.61	90.5	8.7	90.3	9.16		
15.0	14.0	8.77	8.69	9.14	93.4	93.2	9.90	93.3	9.0	93.1	9.47		
17.0	15.5	9.02	8.94	9.29	96.3	96.1	10.1	96.2	9.2	96.0	9.70		
19.0	18.0	9.26	9.18	9.53	99.2	99.0	10.4	99.1	9.5	98.9	10.0		
22.0	20.0	9.7	9.62	10.0	103	103	10.8	103	10.0	102	10.5		
26.0	24.0	10.3	10.2	10.6	108	108	11.3	108	10.5	107	11.0		
30.0	28.0	10.9	10.8	11.2	113	113	11.8	113	11.0	112	11.5		
35.0	32.0	11.6	11.5	11.9	118	118	12.3	118	11.6	117	12.1		
40.0	36.0	12.4	12.3	12.7	124	124	13.0	124	12.3	123	12.8		
45.0	40.0	13.2	13.1	13.5	129	129	13.7	129	13.0	128	13.4		
47.0	43.0	13.4	13.3	13.7	131	131	13.9	131	13.2	130	13.6		
51.0	47.0	14.5	14.3	14.7	138	138	14.6	138	13.9	137	14.2		
54.0	50.0	15.3	15.1	15.5	144	144	15.4	144	14.6	143	14.8		
57.0	53.0	16.2	16.0	16.4	149	149	16.2	149	15.4	149	15.5		
60.0	56.0	17.0	16.8	17.2	155	155	17.0	155	16.1	154	16.2		
-3.64	-4.0	7.33	7.87	8.27	77.3	77.1	8.56	77.0	7.7	76.8	8.19		
-1.84	-2.2	7.47	8.01	8.41	78.7	78.5	8.70	78.4	7.9	78.2	8.34		
5.5	5.0	8.10	8.02	8.55	86.9	86.7	9.26	86.6	8.4	86.4	8.89		
13.0	12.0	8.53	8.45	8.98	90.6	90.4	9.61	90.5	8.7	90.3	9.16		
15.0	14.0	8.77	8.69	9.14	93.4	93.2	9.90	93.3	9.0	93.1	9.47		
17.0	15.5	9.02	8.94	9.29	96.3	96.1	10.1	96.2	9.2	96.0	9.70		
19.0	18.0	9.26	9.18	9.53	99.2	99.0	10.4	99.1	9.5	98.9	10.0		
22.0	20.0	9.7	9.62	10.0	103	103	10.8	103	10.0	102	10.5		
26.0	24.0	10.3	10.2	10.6	108	108	11.3	108	10.5	107	11.0		
30.0	28.0	10.9	10.8	11.2	113	113	11.8	113	11.0	112	11.5		
35.0	32.0	11.6	11.5	11.9	118	118	12.3	118	11.6	117	12.1		

Heating capacity

Combi-radiation (%)	Outdoor air temp. (F/WB)	Indoor air Temp. F/DB												
		61			65			70			75			
		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	
70	-3.64	-4.0	75.9	10.2	75.7	10.5	75.5	10.8	75.3	11.0	75.3	11.2	75.2	11.5
	-1.84	-2.2	77.2	10.3	77.0	10.6	76.8	10.9	76.7	11.1	76.6	11.3	76.5	11.6
	9.5	5.0	83.5	10.7	83.3	11.1	83.1	11.3	83.0	11.5	82.9	11.7	82.8	11.9
	13.0	8.5	87.1	11.0	86.9	11.3	86.6	11.5	86.6	11.7	86.5	11.8	86.8	12.0
	15.0	14.0	93.4	11.2	90.8	11.5	90.6	11.7	90.5	11.9	90.4	12.0	89.8	11.3
	17.0	15.5	95.3	11.4	93.2	11.6	93.1	11.8	93.0	12.0	91.0	11.8	89.8	11.0
	19.0	18.0	98.6	11.6	96.4	11.9	94.9	11.9	94.5	12.0	91.0	11.8	89.8	10.7
	22.0	20.0	101	11.7	101	12.0	98.0	12.0	94.5	11.5	91.0	11.0	85.8	10.3
	30.0	28.0	107	12.0	103	11.6	103	10.9	94.5	10.4	91.0	10.6	85.8	9.30
	35.0	32.0	110	10.9	103	10.0	98.0	10.1	94.5	9.72	91.0	9.30	85.8	8.70
	44.0	40.0	110	10.1	103	9.38	98.0	8.44	94.5	8.08	91.0	8.14	85.8	8.14
	47.0	43.0	110	8.97	103	8.76	98.0	8.27	94.5	7.94	91.0	7.62	85.8	7.14
51.0	47.0	110	8.39	103	8.33	98.0	7.87	94.5	7.56	91.0	7.26	85.8	6.81	
54.0	50.0	110	7.99	103	7.80	98.0	7.03	94.5	6.76	91.0	6.50	85.8	6.11	
57.0	53.0	110	7.61	103	7.43	98.0	7.03	94.5	6.76	91.0	6.50	85.8	6.11	
60.0	56.0	110	7.26	103	7.09	98.0	6.71	94.5	6.46	91.0	6.21	85.8	5.84	
60	-3.64	-4.0	75.4	11.0	75.2	11.3	75.1	11.6	75.0	11.7	74.9	11.9	73.5	11.8
	-1.84	-2.2	76.7	11.1	76.6	11.4	76.4	11.6	76.4	11.8	76.3	12.0	73.5	11.5
	9.5	5.0	83.0	11.5	82.8	11.8	82.7	12.0	81.0	11.8	78.0	11.2	73.5	10.5
	13.0	8.5	86.6	11.7	86.4	12.0	84.0	11.7	81.0	11.2	78.0	10.7	73.5	9.96
	15.0	14.0	93.0	12.0	88.5	11.8	84.0	11.0	81.0	10.6	78.0	10.1	73.5	9.45
	17.0	15.5	94.5	12.0	88.5	11.4	84.0	10.7	81.0	10.2	78.0	9.81	73.5	9.16
	19.0	18.0	94.5	11.5	88.5	10.7	84.0	10.4	81.0	10.0	78.0	9.58	73.5	8.95
	22.0	20.0	94.5	11.1	88.5	10.3	84.0	9.70	81.0	9.30	78.0	9.20	73.5	8.60
	30.0	28.0	94.5	9.71	88.5	9.64	84.0	9.08	81.0	8.71	78.0	8.35	73.5	8.34
	35.0	32.0	94.5	9.08	88.5	8.43	84.0	8.50	81.0	8.16	78.0	7.83	73.5	7.34
	39.0	36.0	94.5	8.48	88.5	7.89	84.0	7.95	81.0	7.64	78.0	7.34	73.5	6.88
	44.0	40.0	94.5	7.94	88.5	7.39	84.0	7.45	81.0	7.16	78.0	6.88	73.5	6.46
47.0	43.0	94.5	7.56	88.5	7.04	84.0	6.99	81.0	6.72	78.0	6.46	73.5	6.07	
51.0	47.0	94.5	7.09	88.5	6.61	84.0	6.66	81.0	6.41	78.0	6.17	73.5	5.80	
54.0	50.0	94.5	6.76	88.5	6.31	84.0	6.26	81.0	6.03	78.0	5.80	73.5	5.46	
57.0	53.0	94.5	6.45	88.5	6.03	84.0	5.98	81.0	5.76	78.0	5.55	73.5	5.23	
60.0	56.0	94.5	6.17	88.5	5.77	84.0	5.72	81.0	5.51	78.0	5.31	73.5	5.01	
50	-3.64	-4.0	75.0	11.8	73.7	11.8	70.0	11.1	67.5	10.7	65.0	10.2	61.3	9.51
	-1.84	-2.2	76.3	11.9	73.7	11.6	70.0	10.9	67.5	10.4	65.0	9.98	61.3	9.32
	9.5	5.0	78.7	11.4	73.7	10.5	70.0	9.90	67.5	9.49	65.0	9.09	61.3	8.50
	13.0	8.5	78.7	10.8	73.7	10.00	70.0	9.41	67.5	9.03	65.0	8.65	61.3	8.10
	15.0	14.0	78.7	10.2	73.7	9.48	70.0	8.94	67.5	8.58	65.0	8.22	61.3	7.70
	17.0	15.5	78.7	9.92	73.7	9.20	70.0	8.67	67.5	8.32	65.0	7.88	61.3	7.48
	19.0	18.0	78.7	9.68	73.7	8.98	70.0	8.47	67.5	8.13	65.0	7.80	61.3	7.31
	22.0	20.0	78.7	9.01	73.7	8.64	70.0	8.15	67.5	7.83	65.0	7.51	61.3	7.04
	30.0	28.0	78.7	8.44	73.7	7.85	70.0	7.90	67.5	7.59	65.0	7.28	61.3	6.83
	35.0	32.0	78.7	7.91	73.7	7.36	70.0	7.41	67.5	7.13	65.0	6.85	61.3	6.43
	39.0	36.0	78.7	7.41	73.7	6.91	70.0	6.96	67.5	6.70	65.0	6.44	61.3	6.05
	44.0	40.0	78.7	6.95	73.7	6.48	70.0	6.54	67.5	6.29	65.0	6.05	61.3	5.70
47.0	43.0	78.7	6.52	73.7	6.09	70.0	6.14	67.5	5.92	65.0	5.69	61.3	5.36	
51.0	47.0	78.7	6.23	73.7	5.82	70.0	5.78	67.5	5.57	65.0	5.36	61.3	5.06	
54.0	50.0	78.7	5.86	73.7	5.48	70.0	5.21	67.5	5.02	65.0	5.13	61.3	4.84	
57.0	53.0	78.7	5.60	73.7	5.25	70.0	4.98	67.5	4.81	65.0	4.84	61.3	4.58	
60.0	56.0	78.7	5.36	73.7	5.02	70.0	4.78	67.5	4.61	65.0	4.45	61.3	4.39	

TC : Total capacity ; MBH

PI : Power Input ; kW (Comp.+Outdoor fan motor)

Note1 : is shown as reference.

When selecting the unit models, avoid the Outdoor air temperature range shown by

Note 2 : The above table shows the average value of conditions which may occur.

RXYQ144PTJU

Combustion			Outdoor air temp.		Indoor air temp. F/DB													
					61		65		70		72		75					
					TC	PI	TC	PI	TC	PI	TC	PI	TC	PI				
100	100 (%)	(F/WB)	-3.64	-4.0	92.7	89.7	92.3	89.3	92.1	89.1	91.9	88.9	91.7	88.7	91.5	88.5	91.3	88.3
		(F/DB)	-1.84	-2.2	94.3	91.5	93.3	90.5	93.7	90.7	93.5	90.5	91.9	88.9	91.7	88.7	91.5	88.5
		5.5	5.5	106	106	106	106	106	106	106	106	106	106	106	106	106	106	106
		9.5	9.5	106	106	106	106	106	106	106	106	106	106	106	106	106	106	106
		13.0	13.0	106	106	106	106	106	106	106	106	106	106	106	106	106	106	106
		17.0	17.0	106	106	106	106	106	106	106	106	106	106	106	106	106	106	106
		21.0	21.0	106	106	106	106	106	106	106	106	106	106	106	106	106	106	106
		25.0	25.0	106	106	106	106	106	106	106	106	106	106	106	106	106	106	106
		30.0	30.0	106	106	106	106	106	106	106	106	106	106	106	106	106	106	106
		35.0	35.0	106	106	106	106	106	106	106	106	106	106	106	106	106	106	106

Combustion			Outdoor air temp.		Indoor air temp. F/DB													
					61		65		70		72		75					
					TC	PI	TC	PI	TC	PI	TC	PI	TC	PI				
130	100 (%)	(F/WB)	-3.64	-4.0	83.8	80.8	83.4	80.4	83.0	80.0	82.6	79.6	82.2	79.2	81.8	78.8	81.4	78.4
		(F/DB)	-1.84	-2.2	85.4	82.4	85.0	82.0	84.6	81.6	84.2	81.2	83.8	80.8	83.4	80.4	83.0	80.0
		5.5	5.5	106	106	106	106	106	106	106	106	106	106	106	106	106	106	106
		9.5	9.5	106	106	106	106	106	106	106	106	106	106	106	106	106	106	106
		13.0	13.0	106	106	106	106	106	106	106	106	106	106	106	106	106	106	106
		17.0	17.0	106	106	106	106	106	106	106	106	106	106	106	106	106	106	106
		21.0	21.0	106	106	106	106	106	106	106	106	106	106	106	106	106	106	106
		25.0	25.0	106	106	106	106	106	106	106	106	106	106	106	106	106	106	106
		30.0	30.0	106	106	106	106	106	106	106	106	106	106	106	106	106	106	106
		35.0	35.0	106	106	106	106	106	106	106	106	106	106	106	106	106	106	106

Combustion			Outdoor air temp.		Indoor air temp. F/DB													
					61		65		70		72		75					
					TC	PI	TC	PI	TC	PI	TC	PI	TC	PI				
120	90 (%)	(F/WB)	-3.64	-4.0	83.8	80.8	83.4	80.4	83.0	80.0	82.6	79.6	82.2	79.2	81.8	78.8	81.4	78.4
		(F/DB)	-1.84	-2.2	85.4	82.4	85.0	82.0	84.6	81.6	84.2	81.2	83.8	80.8	83.4	80.4	83.0	80.0
		5.5	5.5	106	106	106	106	106	106	106	106	106	106	106	106	106	106	106
		9.5	9.5	106	106	106	106	106	106	106	106	106	106	106	106	106	106	106
		13.0	13.0	106	106	106	106	106	106	106	106	106	106	106	106	106	106	106
		17.0	17.0	106	106	106	106	106	106	106	106	106	106	106	106	106	106	106
		21.0	21.0	106	106	106	106	106	106	106	106	106	106	106	106	106	106	106
		25.0	25.0	106	106	106	106	106	106	106	106	106	106	106	106	106	106	106
		30.0	30.0	106	106	106	106	106	106	106	106	106	106	106	106	106	106	106
		35.0	35.0	106	106	106	106	106	106	106	106	106	106	106	106	106	106	106

Combustion			Outdoor air temp.		Indoor air temp. F/DB													
					61		65		70		72		75					
					TC	PI	TC	PI	TC	PI	TC	PI	TC	PI				
110	80 (%)	(F/WB)	-3.64	-4.0	83.8	80.8	83.4	80.4	83.0	80.0	82.6	79.6	82.2	79.2	81.8	78.8	81.4	78.4
		(F/DB)	-1.84	-2.2	85.4	82.4	85.0	82.0	84.6	81.6	84.2	81.2	83.8	80.8	83.4	80.4	83.0	80.0
		5.5	5.5	106	106	106	106	106	106	106	106	106	106	106	106	106	106	106
		9.5	9.5	106	106	106	106	106	106	106	106	106	106	106	106	106	106	106
		13.0	13.0	106	106	106	106	106	106	106	106	106	106	106	106	106	106	106
		17.0	17.0	106	106	106	106	106	106	106	106	106	106	106	106	106	106	106
		21.0	21.0	106	106	106	106	106	106	106	106	106	106	106	106	106	106	106
		25.0	25.0	106	106	106	106	106	106	106	106	106	106	106	106	106	106	106
		30.0	30.0	106	106	106	106	106	106	106	106	106	106	106	106	106	106	106
		35.0	35.0	106	106	106	106	106	106	106	106	106	106	106	106	106	106	106

TC: Total capacity; MBH

PI: Power Input; kW (Comp.+Outdoor fan motor)

Note 1: is shown as reference.

Note 2: The above table shows the average value of conditions which may occur.

Heating capacity

Combi-radiation (%)	Outdoor air temp. (F/WB)	Indoor air Temp. F/DB																				
		61			65			68			70			72			75					
		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH			
70	-3.64	-4.0	91.0	11.9	90.8	12.4	90.6	12.7	90.5	12.9	90.2	13.1	90.2	13.5	90.4	13.7	90.2	14.0	90.2	14.3		
	-1.84	-2.2	92.6	12.1	92.4	12.5	92.2	12.8	92.1	13.0	92.0	13.3	91.9	13.5	91.8	13.7	91.7	14.0	91.7	14.3	91.6	
	9.5	5.0	100	12.6	99.9	13.0	99.7	13.3	99.6	13.5	99.3	13.7	99.3	14.0	99.3	14.3	99.3	14.6	99.3	14.9	99.3	
	13.0	12.0	109	13.1	109	13.5	109	13.8	109	14.0	109	14.1	109	14.1	109	14.1	109	14.1	109	14.1	109	
	15.0	14.0	112	13.3	112	13.7	112	13.9	112	14.1	112	14.1	112	14.1	112	14.1	112	14.1	112	14.1	112	
	17.0	15.5	114	13.4	114	13.8	114	14.0	113	14.1	113	14.1	113	14.1	113	14.1	113	14.1	113	14.1	113	
	19.0	18.0	118	13.6	118	13.9	118	14.1	118	14.1	118	14.1	118	14.1	118	14.1	118	14.1	118	14.1	118	
	22.0	20.0	122	13.8	121	14.1	118	14.1	118	14.1	118	14.1	118	14.1	118	14.1	118	14.1	118	14.1	118	
	30.0	28.0	132	13.7	124	12.7	118	11.9	11.4	11.4	11.4	11.4	11.4	11.4	11.4	11.4	11.4	11.4	11.4	11.4	11.4	
	35.0	32.0	132	12.8	124	11.8	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	
	44.0	40.0	132	11.1	124	10.3	11.8	9.72	11.3	9.33	10.9	8.95	10.3	8.40	10.3	8.40	10.3	8.40	10.3	8.40	10.3	8.40
	47.0	43.0	132	10.5	124	9.80	11.8	9.25	11.3	8.89	10.9	8.53	10.3	8.00	10.3	8.00	10.3	8.00	10.3	8.00	10.3	8.00
51.0	47.0	132	9.86	124	9.17	11.8	8.67	11.3	8.33	10.9	8.00	10.3	7.52	10.3	7.52	10.3	7.52	10.3	7.52	10.3	7.52	
54.0	50.0	132	9.39	124	8.74	11.8	8.26	11.3	7.95	10.9	7.64	10.3	7.18	10.3	7.18	10.3	7.18	10.3	7.18	10.3	7.18	
57.0	53.0	132	8.95	124	8.33	11.8	7.88	11.3	7.59	10.9	7.30	10.3	6.86	10.3	6.86	10.3	6.86	10.3	6.86	10.3	6.86	
60.0	56.0	132	8.53	124	7.95	11.8	7.45	11.3	7.25	10.9	7.00	10.3	6.57	10.3	6.57	10.3	6.57	10.3	6.57	10.3	6.57	
60	-3.64	-4.0	89.9	13.9	89.3	13.3	89.1	13.6	89.0	13.8	88.9	14.0	88.9	14.2	88.9	14.4	88.9	14.6	88.9	14.8	88.9	
	-1.84	-2.2	92.1	13.0	91.9	13.4	91.7	13.7	91.6	13.9	91.5	14.1	91.5	14.3	91.5	14.5	91.5	14.7	91.5	14.9	91.5	
	9.5	5.0	98.6	13.5	98.4	13.8	98.3	14.1	97.2	13.8	98.6	13.2	98.2	12.3	98.2	12.3	98.2	12.3	98.2	12.3	98.2	
	13.0	12.0	109	14.0	106	13.8	101	13.7	97.2	13.1	93.6	12.6	88.2	11.7	88.2	11.1	88.2	11.1	88.2	11.1	88.2	
	15.0	14.0	112	14.1	106	13.4	101	12.6	97.2	12.4	93.6	11.5	88.2	10.8	88.2	10.2	88.2	10.2	88.2	10.2	88.2	
	17.0	15.5	113	14.1	106	13.1	101	12.3	97.2	11.8	93.6	11.3	88.2	10.5	88.2	10.1	88.2	10.1	88.2	10.1	88.2	
	19.0	18.0	113	13.5	106	12.5	101	11.8	97.2	11.3	93.6	10.8	88.2	10.1	88.2	10.1	88.2	10.1	88.2	10.1	88.2	
	22.0	20.0	113	13.1	106	12.1	101	11.4	97.2	10.9	93.6	10.5	88.2	9.80	88.2	9.80	88.2	9.80	88.2	9.80	88.2	
	30.0	28.0	113	11.4	106	10.6	101	10.7	97.2	10.2	93.6	9.20	88.2	8.62	88.2	8.62	88.2	8.62	88.2	8.62	88.2	
	35.0	32.0	113	10.7	106	9.91	101	9.35	97.2	8.98	93.6	8.62	88.2	8.09	88.2	8.09	88.2	8.09	88.2	8.09	88.2	
	39.0	36.0	113	9.97	106	9.27	101	8.76	97.2	8.42	93.6	8.09	88.2	7.60	88.2	7.60	88.2	7.60	88.2	7.60	88.2	
	44.0	40.0	113	9.33	106	8.69	101	8.21	97.2	7.90	93.6	7.59	88.2	7.14	88.2	7.14	88.2	7.14	88.2	7.14	88.2	
47.0	43.0	113	8.88	106	8.28	101	7.83	97.2	7.54	93.6	7.25	88.2	6.82	88.2	6.82	88.2	6.82	88.2	6.82	88.2		
51.0	47.0	113	8.33	106	7.77	101	7.36	97.2	7.09	93.6	6.82	88.2	6.42	88.2	6.42	88.2	6.42	88.2	6.42	88.2		
54.0	50.0	113	7.95	106	7.42	101	7.03	97.2	6.77	93.6	6.52	88.2	6.15	88.2	6.15	88.2	6.15	88.2	6.15	88.2		
57.0	53.0	113	7.59	106	7.09	101	6.72	97.2	6.48	93.6	6.24	88.2	5.89	88.2	5.89	88.2	5.89	88.2	5.89	88.2		
60.0	56.0	113	7.25	106	6.78	101	6.43	97.2	6.20	93.6	5.98	88.2	5.64	88.2	5.64	88.2	5.64	88.2	5.64	88.2		
50	-3.64	-4.0	89.9	13.9	88.5	13.9	84.0	13.1	81.0	12.5	78.0	12.0	73.5	11.2	73.5	11.0	73.5	11.0	73.5	11.0	73.5	
	-1.84	-2.2	91.6	14.0	88.5	13.6	84.0	12.8	81.0	12.3	78.0	11.7	73.5	11.0	73.5	11.0	73.5	11.0	73.5	11.0	73.5	
	9.5	5.0	94.5	13.4	88.5	12.4	84.0	11.6	81.0	11.2	78.0	10.7	73.5	9.99	73.5	9.99	73.5	9.99	73.5	9.99	73.5	
	13.0	12.0	94.5	12.7	88.5	11.8	84.0	11.1	81.0	10.6	78.0	10.2	73.5	9.52	73.5	9.52	73.5	9.52	73.5	9.52	73.5	
	15.0	14.0	94.5	12.0	88.5	11.1	84.0	10.5	81.0	10.1	78.0	9.66	73.5	9.05	73.5	9.05	73.5	9.05	73.5	9.05	73.5	
	17.0	15.5	94.5	11.7	88.5	10.8	84.0	10.2	81.0	9.78	78.0	9.38	73.5	8.79	73.5	8.79	73.5	8.79	73.5	8.79	73.5	
	19.0	18.0	94.5	11.4	88.5	10.6	84.0	9.96	81.0	9.56	78.0	9.17	73.5	8.60	73.5	8.60	73.5	8.60	73.5	8.60	73.5	
	22.0	20.0	94.5	10.9	88.5	10.2	84.0	9.58	81.0	9.20	78.0	8.83	73.5	8.28	73.5	8.28	73.5	8.28	73.5	8.28	73.5	
	26.0	24.0	94.5	10.6	88.5	9.83	84.0	9.28	81.0	8.92	78.0	8.56	73.5	8.03	73.5	8.03	73.5	8.03	73.5	8.03	73.5	
	30.0	28.0	94.5	9.30	88.5	8.65	84.0	8.71	81.0	8.38	78.0	8.05	73.5	7.56	73.5	7.56	73.5	7.56	73.5	7.56	73.5	
	35.0	32.0	94.5	8.71	88.5	8.12	84.0	8.18	81.0	7.87	78.0	7.56	73.5	7.11	73.5	7.11	73.5	7.11	73.5	7.11	73.5	
	39.0	36.0	94.5	8.17	88.5	7.62	84.0	7.68	81.0	7.40	78.0	7.11	73.5	6.69	73.5	6.69	73.5	6.69	73.5	6.69	73.5	
44.0	40.0	94.5	7.67	88.5	7.16	84.0	7.22	81.0	6.96	78.0	6.50	73.5	6.31	73.5	6.31	73.5	6.31	73.5	6.31	73.5		
47.0	43.0	94.5	7.32	88.5	6.84	84.0	6.49	81.0	6.26	78.0	6.03	73.5	5.95	73.5	5.95	73.5	5.95	73.5	5.95	73.5		
51.0	47.0	94.5	6.89	88.5	6.44	84.0	6.12	81.0	5.90	78.0	5.69	73.5	5.38	73.5	5.38	73.5	5.38	73.5	5.38	73.5		
54.0	50.0	94.5	6.58	88.5	6.17	84.0	5.86	81.0	5.66	78.0	5.46	73.5	5.16	73.5	5.16	73.5	5.16	73.5	5.16	73.5		
57.0	53.0	94.5	6.30	88.5	5.91	84.0	5.61	81.0	5.42	78.0	5.23	73.5	4.95	73.5	4.95	73.5	4.95	73.5	4.95	73.5		
60.0	56.0	94.5	6.03	88.5	5.66	84.0	5.39	81.0	5.20	78.0	5.02	73.5	4.76	73.5	4.76	73.5	4.76	73.5	4.76	73.5		

TC : Total capacity ; MBH
 PI : Power Input ; kW (Comp.+Outdoor fan motor)
 Note1 : is shown as reference.
 Note 2 :The above table shows the average value of conditions which may occur.

RXYQ168PTJU

Combit-nation (%)	Outdoor air temp. (F/WB)	Indoor air temp. F/DB												Heating capacity																																																																																																																																																																																																																																																																																																																																																																																																																																								
		61			65			70			75			TC	PI																																																																																																																																																																																																																																																																																																																																																																																																																																							
		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH																																																																																																																																																																																																																																																																																																																																																																																																																																									
100	-3.64	128	130	132	134	136	138	140	142	144	146	148	150	152	154	156	158	160	162	164	166	168	170	172	174	176	178	180	182	184	186	188	190	192	194	196	198	200	202	204	206	208	210	212	214	216	218	220	222	224	226	228	230	232	234	236	238	240	242	244	246	248	250	252	254	256	258	260	262	264	266	268	270	272	274	276	278	280	282	284	286	288	290	292	294	296	298	300	302	304	306	308	310	312	314	316	318	320	322	324	326	328	330	332	334	336	338	340	342	344	346	348	350	352	354	356	358	360	362	364	366	368	370	372	374	376	378	380	382	384	386	388	390	392	394	396	398	400	402	404	406	408	410	412	414	416	418	420	422	424	426	428	430	432	434	436	438	440	442	444	446	448	450	452	454	456	458	460	462	464	466	468	470	472	474	476	478	480	482	484	486	488	490	492	494	496	498	500	502	504	506	508	510	512	514	516	518	520	522	524	526	528	530	532	534	536	538	540	542	544	546	548	550	552	554	556	558	560	562	564	566	568	570	572	574	576	578	580	582	584	586	588	590	592	594	596	598	600	602	604	606	608	610	612	614	616	618	620	622	624	626	628	630	632	634	636	638	640	642	644	646	648	650	652	654	656	658	660	662	664	666	668	670	672	674	676	678	680	682	684	686	688	690	692	694	696	698	700	702	704	706	708	710	712	714	716	718	720	722	724	726	728	730	732	734	736	738	740	742	744	746	748	750	752	754	756	758	760	762	764	766	768	770	772	774	776	778	780	782	784	786	788	790	792	794	796	798	800	802	804	806	808	810	812	814	816	818	820	822	824	826	828	830	832	834	836	838	840	842	844	846	848	850	852	854	856	858	860	862	864	866	868	870	872	874	876	878	880	882	884	886	888	890	892	894	896	898	900	902	904	906	908	910	912	914	916	918	920	922	924	926	928	930	932	934	936	938	940	942	944	946	948	950	952	954	956	958	960	962	964	966	968	970	972	974	976	978	980	982	984	986	988	990	992	994	996	998	1000

Combit-nation (%)	Outdoor air temp. (F/WB)	Indoor air temp. F/DB												Heating capacity																																																																																																																																																																																																																																																																																																																																																																																																																																								
		61			65			70			75			TC	PI																																																																																																																																																																																																																																																																																																																																																																																																																																							
		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH																																																																																																																																																																																																																																																																																																																																																																																																																																									
130	-3.64	128	130	132	134	136	138	140	142	144	146	148	150	152	154	156	158	160	162	164	166	168	170	172	174	176	178	180	182	184	186	188	190	192	194	196	198	200	202	204	206	208	210	212	214	216	218	220	222	224	226	228	230	232	234	236	238	240	242	244	246	248	250	252	254	256	258	260	262	264	266	268	270	272	274	276	278	280	282	284	286	288	290	292	294	296	298	300	302	304	306	308	310	312	314	316	318	320	322	324	326	328	330	332	334	336	338	340	342	344	346	348	350	352	354	356	358	360	362	364	366	368	370	372	374	376	378	380	382	384	386	388	390	392	394	396	398	400	402	404	406	408	410	412	414	416	418	420	422	424	426	428	430	432	434	436	438	440	442	444	446	448	450	452	454	456	458	460	462	464	466	468	470	472	474	476	478	480	482	484	486	488	490	492	494	496	498	500	502	504	506	508	510	512	514	516	518	520	522	524	526	528	530	532	534	536	538	540	542	544	546	548	550	552	554	556	558	560	562	564	566	568	570	572	574	576	578	580	582	584	586	588	590	592	594	596	598	600	602	604	606	608	610	612	614	616	618	620	622	624	626	628	630	632	634	636	638	640	642	644	646	648	650	652	654	656	658	660	662	664	666	668	670	672	674	676	678	680	682	684	686	688	690	692	694	696	698	700	702	704	706	708	710	712	714	716	718	720	722	724	726	728	730	732	734	736	738	740	742	744	746	748	750	752	754	756	758	760	762	764	766	768	770	772	774	776	778	780	782	784	786	788	790	792	794	796	798	800	802	804	806	808	810	812	814	816	818	820	822	824	826	828	830	832	834	836	838	840	842	844	846	848	850	852	854	856	858	860	862	864	866	868	870	872	874	876	878	880	882	884	886	888	890	892	894	896	898	900	902	904	906	908	910	912	914	916	918	920	922	924	926	928	930	932	934	936	938	940	942	944	946	948	950	952	954	956	958	960	962	964	966	968	970	972	974	976	978	980	982	984	986	988	990	992	994	996	998	1000

TC : Total capacity ; MBH
 PI : Power Input ; kW (Comp.+Outdoor fan motor)
 Note 1 : is shown as reference.
 Note 2 : The above table shows the average value of conditions which may occur.

Heating capacity

Combi-ratton (%)	Outdoor air temp. (F/DB)	Indoor air Temp. F/DB											
		61			65			70			75		
		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH
70	-3.64	-4.0	125	17.7	18.2	125	18.5	125	18.7	125	19.0	120	18.2
	-1.84	-2.2	128	17.9	18.3	127	18.6	127	18.9	127	19.1	120	17.8
	0.5	0.5	134	18.4	19.1	131	19.1	132	19.2	132	19.5	120	16.2
	5.5	8.5	138	18.7	19.4	137	19.4	137	19.5	137	19.7	120	15.2
	13.0	14.0	151	19.0	19.5	145	19.5	145	19.6	145	19.7	120	14.5
	15.0	14.0	154	19.1	19.5	145	19.5	145	19.6	145	19.7	120	14.1
	17.0	15.5	154	18.6	18.6	145	17.2	137	16.1	132	15.4	127	14.7
	19.0	18.0	154	17.9	17.9	145	16.5	132	15.5	132	14.8	127	14.1
	22.0	20.0	154	17.2	17.2	145	15.9	132	14.9	132	14.3	127	13.7
	26.0	24.0	154	16.1	16.1	145	14.9	132	14.0	132	13.4	127	12.8
	30.0	28.0	154	15.0	15.0	145	13.9	132	13.0	132	12.5	127	12.0
	35.0	32.0	154	14.0	14.0	145	12.9	132	12.2	132	11.7	127	11.2
39.0	36.0	154	13.0	13.0	145	12.1	132	11.5	132	11.5	127	11.0	
44.0	40.0	154	12.0	12.0	145	11.4	132	10.9	132	10.9	127	10.8	
49.0	45.0	154	11.5	11.5	145	10.7	132	10.1	132	9.72	127	9.96	
54.0	47.0	154	11.6	11.6	145	10.7	132	10.1	132	9.72	127	9.96	
51.0	47.0	154	10.8	10.8	145	10.1	132	9.51	132	9.15	127	8.79	
54.0	50.0	154	10.3	10.3	145	9.60	132	9.07	132	8.73	127	8.89	
57.0	53.0	154	9.83	9.83	145	9.16	132	8.66	132	8.34	127	8.02	
60.0	56.0	154	9.38	9.38	145	8.74	132	8.28	132	7.97	127	7.67	
60	-3.64	-4.0	125	18.7	19.0	118	17.8	113	17.0	109	16.2	103	15.1
	-1.84	-2.2	127	18.9	19.2	124	18.6	118	17.4	113	16.6	109	15.9
	5.5	5.0	132	18.2	18.2	124	18.6	118	17.4	113	16.6	109	15.9
	9.5	8.5	132	17.3	17.3	124	18.6	118	17.4	113	16.6	109	15.9
	15.0	14.0	132	16.8	16.8	124	18.6	118	17.4	113	16.6	109	15.9
	17.0	15.5	132	15.8	15.8	124	14.6	118	13.7	113	13.0	109	12.6
	19.0	18.0	132	14.8	14.8	124	14.3	118	13.4	113	12.8	109	12.3
	22.0	20.0	132	14.3	14.3	124	13.2	118	12.9	113	12.3	109	11.8
	26.0	24.0	132	13.4	13.4	124	12.4	118	11.7	113	11.2	109	11.5
	30.0	28.0	132	12.5	12.5	124	11.6	118	10.9	113	10.5	109	11.1
	35.0	32.0	132	11.7	11.7	124	10.9	118	10.2	113	9.84	109	9.44
	39.0	36.0	132	10.9	10.9	124	10.2	118	9.60	113	9.23	109	8.86
44.0	40.0	132	10.2	10.2	124	9.56	118	9.50	113	9.50	109	9.50	
49.0	45.0	132	9.15	9.15	124	8.53	118	8.08	113	7.76	109	7.49	
51.0	47.0	132	8.73	8.73	124	8.15	118	7.72	113	7.44	109	7.16	
54.0	50.0	132	8.34	8.34	124	7.79	118	7.38	113	7.12	109	6.86	
57.0	53.0	132	7.97	7.97	124	7.45	118	7.07	113	6.82	109	6.57	
60.0	56.0	132	7.52	7.52	124	7.12	118	6.74	113	6.47	109	6.20	
50	-3.64	-4.0	110	16.4	16.4	103	15.2	98.0	14.2	94.5	13.6	91.0	85.8
	-1.84	-2.2	110	16.1	16.1	103	14.8	98.0	13.9	94.5	13.4	91.0	85.8
	5.5	5.0	110	14.6	14.6	103	13.5	98.0	12.7	94.5	12.2	91.0	85.8
	9.5	8.5	110	13.9	13.9	103	12.8	98.0	12.1	94.5	11.6	91.0	85.8
	13.0	12.0	110	13.1	13.1	103	12.2	98.0	11.5	94.5	11.0	91.0	85.8
	17.0	15.5	110	12.4	12.4	103	11.5	98.0	10.9	94.5	10.4	91.0	85.8
	19.0	18.0	110	12.0	12.0	103	11.1	98.0	10.5	94.5	10.1	91.0	85.8
	22.0	20.0	110	11.6	11.6	103	10.8	98.0	10.1	94.5	9.75	91.0	93.6
	26.0	24.0	110	10.9	10.9	103	10.1	98.0	9.53	94.5	9.17	88.0	85.8
	30.0	28.0	110	10.2	10.2	103	9.47	98.0	8.95	94.5	8.62	91.0	82.8
	35.0	32.0	110	9.54	9.54	103	8.89	98.0	8.41	94.5	8.10	91.0	79.9
	39.0	36.0	110	8.95	8.95	103	8.35	98.0	7.91	94.5	7.62	91.0	73.4
44.0	40.0	110	8.41	8.41	103	7.86	98.0	7.45	94.5	7.18	91.0	69.1	
49.0	45.0	110	7.93	7.93	103	7.51	98.0	7.12	94.5	6.87	91.0	65.2	
54.0	50.0	110	7.46	7.46	103	7.07	98.0	6.72	94.5	6.49	91.0	61.0	
57.0	53.0	110	7.02	7.02	103	6.71	98.0	6.43	94.5	6.21	91.0	56.9	
60.0	56.0	110	6.63	6.63	103	6.22	98.0	6.17	94.5	5.96	91.0	52.8	

TC : Total capacity ; MBH
 PI : Power Input ; kW (Comp.+Outdoor fan motor)
 Note1 : is shown as reference
 Note 2 : The above table shows the average value of outdoor air temperature range shown by

RXYQ192PTJU

Combit-nation (%)	Outdoor air temp. (F/WB)	Indoor air temp. F/DB												Heating capacity
		61			65			70			75			
		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	
100	-3.64	4.0	132	14.0	132	14.8	131	15.4	131	15.7	131	16.1	131	16.7
	-1.84	-2.2	134	14.2	134	15.0	134	15.6	133	15.9	133	16.3	133	16.9
	0.5	5.5	135	14.5	135	15.3	135	15.9	134	16.2	134	16.6	134	17.2
	9.5	9.5	136	14.8	136	15.6	136	16.2	135	16.5	135	16.9	135	17.5
	13.0	12.0	137	15.0	137	15.8	137	16.4	136	17.3	136	17.7	136	18.3
	15.0	14.0	138	15.2	138	16.0	138	16.6	137	17.5	137	17.9	137	18.9
	17.0	15.5	139	15.4	139	16.2	139	16.8	138	17.7	138	18.1	138	19.4
	19.0	18.0	140	15.6	140	16.4	140	17.0	139	17.9	139	18.3	139	19.9
	22.0	20.0	141	15.8	141	16.6	141	17.2	140	18.1	140	18.6	140	20.4
	30.0	28.0	142	16.0	142	16.8	142	17.4	141	18.3	141	18.8	141	20.9
90	-3.64	-4.0	131	15.2	131	15.9	131	16.4	131	16.8	130	17.1	130	17.7
	-1.84	-2.2	133	15.4	133	16.1	133	16.6	133	17.0	133	17.3	132	17.8
	0.5	5.0	134	15.6	134	16.3	134	16.8	133	17.2	133	17.5	133	18.3
	9.5	9.5	135	15.8	135	16.5	135	17.0	134	17.4	134	17.7	134	18.8
	13.0	12.0	136	16.0	136	16.7	136	17.2	135	17.6	135	17.9	134	19.3
	15.0	14.0	137	16.2	137	16.9	137	17.4	136	17.8	136	18.1	135	19.8
	17.0	15.5	138	16.4	138	17.1	138	17.6	137	18.0	137	18.3	136	20.3
	19.0	18.0	139	16.6	139	17.3	139	17.8	138	18.2	138	18.5	137	20.8
	22.0	20.0	140	16.8	140	17.5	140	18.0	139	18.4	139	18.7	138	21.3
	30.0	28.0	141	17.0	141	17.7	141	18.2	140	18.6	140	18.9	139	21.8
80	-3.64	-4.0	131	15.2	131	15.9	131	16.4	131	16.8	130	17.1	130	17.7
	-1.84	-2.2	133	15.4	133	16.1	133	16.6	133	17.0	133	17.3	132	17.8
	0.5	5.0	134	15.6	134	16.3	134	16.8	133	17.2	133	17.5	133	18.3
	9.5	9.5	135	15.8	135	16.5	135	17.0	134	17.4	134	17.7	134	18.8
	13.0	12.0	136	16.0	136	16.7	136	17.2	135	17.6	135	17.9	134	19.3
	15.0	14.0	137	16.2	137	16.9	137	17.4	136	17.8	136	18.1	135	19.8
	17.0	15.5	138	16.4	138	17.1	138	17.6	137	18.0	137	18.3	136	20.3
	19.0	18.0	139	16.6	139	17.3	139	17.8	138	18.2	138	18.5	137	20.8
	22.0	20.0	140	16.8	140	17.5	140	18.0	139	18.4	139	18.7	138	21.3
	30.0	28.0	141	17.0	141	17.7	141	18.2	140	18.6	140	18.9	139	21.8

Combit-nation (%)	Outdoor air temp. (F/WB)	Indoor air temp. F/DB												Heating capacity
		61			65			70			75			
		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	
130	-3.64	4.0	134	10.4	134	11.4	134	12.6	133	13.1	132	13.9	133	14.7
	-1.84	-2.2	135	10.7	135	11.6	135	12.9	134	13.4	134	14.1	134	14.9
	0.5	5.0	136	11.0	136	12.0	136	13.2	135	13.7	135	14.4	135	15.2
	9.5	9.5	137	11.3	137	12.3	137	13.5	136	14.0	136	14.7	136	15.5
	13.0	12.0	138	11.6	138	12.6	138	13.8	137	14.3	137	15.0	137	15.8
	15.0	14.0	139	11.9	139	12.9	139	14.1	138	14.6	138	15.3	138	16.1
	17.0	15.5	140	12.2	140	13.2	140	14.4	139	14.9	139	15.6	139	16.4
	19.0	18.0	141	12.5	141	13.5	141	14.7	140	15.2	140	15.9	140	16.7
	22.0	20.0	142	12.8	142	13.8	142	15.0	141	15.5	141	16.2	141	17.0
	30.0	28.0	143	13.1	143	14.1	143	15.3	142	15.8	142	16.5	142	17.3
120	-3.64	-4.0	133	12.5	133	13.2	132	13.7	132	14.1	132	14.8	132	15.5
	-1.84	-2.2	134	12.8	134	13.5	134	14.0	134	14.3	134	15.0	134	15.7
	0.5	5.0	135	13.1	135	13.8	135	14.3	135	14.6	135	15.3	135	16.0
	9.5	9.5	136	13.4	136	14.1	136	14.6	136	14.9	136	15.6	136	16.3
	13.0	12.0	137	13.7	137	14.4	137	14.9	137	15.2	137	15.9	137	16.6
	15.0	14.0	138	14.0	138	14.7	138	15.2	138	15.5	138	16.2	138	16.9
	17.0	15.5	139	14.3	139	15.0	139	15.5	139	15.8	139	16.5	139	17.2
	19.0	18.0	140	14.6	140	15.3	140	15.8	140	16.1	140	16.8	140	17.5
	22.0	20.0	141	14.9	141	15.6	141	16.1	141	16.4	141	17.1	141	17.8
	30.0	28.0	142	15.2	142	15.9	142	16.4	142	16.7	142	17.4	142	18.1
110	-3.64	-4.0	132	13.6	132	14.3	132	14.7	131	15.1	131	15.8	131	16.5
	-1.84	-2.2	133	13.9	133	14.6	133	14.9	134	15.3	133	16.0	133	16.7
	0.5	5.0	134	14.2	134	14.9	134	15.2	134	15.6	134	16.3	134	17.0
	9.5	9.5	135	14.5	135	15.2	135	15.5	135	15.9	135	16.6	135	17.3
	13.0	12.0	136	14.8	136	15.5	136	15.8	136	16.2	136	16.9	136	17.6
	15.0	14.0	137	15.1	137	15.8	137	16.1	137	16.5	137	17.2	137	17.9
	17.0	15.5	138	15.4	138	16.1	138	16.4	138	16.8	138	17.5	138	18.2
	19.0	18.0	139	15.7	139	16.4	139	16.7	139	17.1	139	17.8	139	18.5
	22.0	20.0	140	16.0	140	16.7	140	17.0	140	17.4	140	18.1	140	18.8
	30.0	28.0	141	16.3	141	17.0	141	17.3	141	17.7	141	18.4	141	19.1

TC: Total capacity; MBH
 PI: Power Input; kW (Comp.+Outdoor fan motor)

Note 1: is shown as reference.

Note 2: The above table shows the average value of conditions which may occur.

Heating capacity

Combi-radiation (%)	Outdoor air temp. (F/DB)	Indoor air Temp. F/DB														
		61		65		68		70		72		75				
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI			
70	-3.64	-4.0	129	18.9	129	19.3	129	19.7	129	19.9	125	19.2	118	17.9	118	17.5
	-1.84	-2.2	132	19.0	131	19.5	131	19.8	130	19.7	125	18.8	118	17.5	118	17.5
	5.5	5.0	142	19.6	142	19.9	134	18.7	130	17.9	125	17.1	118	15.9	15.1	15.1
	9.5	8.5	149	18.9	142	19.9	134	16.7	130	17.0	125	16.2	118	15.1	15.1	15.1
	13.0	12.0	156	14.3	143	19.3	149	16.7	130	16.0	125	15.2	118	13.9	13.9	13.9
	15.0	14.0	161	18.7	142	17.3	134	16.3	130	15.6	125	14.9	118	13.9	13.9	13.9
	17.0	15.5	151	18.3	142	16.9	134	15.9	130	15.2	125	14.6	118	13.9	13.9	13.9
	19.0	18.0	151	17.5	142	16.2	134	15.2	130	14.6	125	14.0	118	13.1	13.1	13.1
	22.0	20.0	151	16.9	142	15.7	134	14.8	130	14.1	125	13.6	118	12.7	12.7	12.7
	26.0	24.0	151	15.8	142	14.7	134	13.8	130	13.3	125	12.7	118	11.9	11.9	11.9
	30.0	28.0	151	14.8	142	13.7	134	12.9	130	12.4	125	11.9	11.8	11.2	11.2	11.2
	35.0	32.0	151	13.8	142	12.8	134	12.1	130	11.6	125	11.2	11.8	10.5	10.5	10.5
39.0	36.0	151	12.9	142	12.0	134	11.4	130	10.9	125	10.5	11.8	9.85	9.85	9.85	
44.0	40.0	151	12.1	142	11.2	134	10.7	130	10.3	125	9.86	11.8	8.87	8.87	8.87	
47.0	45.0	151	11.4	142	10.7	134	10.2	130	9.8	125	8.86	11.8	8.36	8.36	8.36	
51.0	47.0	151	10.8	142	10.1	134	9.56	130	9.21	125	8.86	11.8	8.36	8.36	8.36	
54.0	50.0	151	10.3	142	9.64	134	9.14	130	8.81	125	8.48	11.8	7.99	7.99	7.99	
57.0	53.0	151	9.87	142	9.22	134	8.74	130	8.43	125	8.12	11.8	7.66	7.66	7.66	
60.0	56.0	151	9.43	142	8.82	134	8.37	130	8.07	125	7.78	11.8	7.34	7.34	7.34	
60	-3.64	-4.0	126	19.4	118	17.9	112	16.9	108	16.1	104	15.4	98.0	14.4	14.4	14.4
	-1.84	-2.2	126	19.0	118	17.6	112	16.5	108	15.8	104	15.1	98.0	14.1	14.1	14.1
	5.5	5.0	126	17.3	118	16.0	112	15.0	108	14.4	104	13.8	98.0	12.9	12.9	12.9
	9.5	8.5	126	16.4	118	15.2	112	14.3	108	13.7	104	13.1	98.0	12.3	12.3	12.3
	13.0	12.0	126	15.5	118	14.4	112	13.5	108	13.0	104	12.5	98.0	11.7	11.7	11.7
	17.0	15.5	126	14.7	118	13.7	112	12.9	108	12.9	104	11.9	98.0	11.1	11.1	11.1
	19.0	18.0	126	14.1	118	13.1	112	12.4	108	11.9	104	11.4	98.0	10.7	10.7	10.7
	22.0	20.0	126	13.7	118	12.7	112	12.0	108	11.5	104	11.1	98.0	10.4	10.4	10.4
	26.0	24.0	126	12.8	118	11.9	112	11.3	108	10.8	104	10.4	98.0	9.79	9.79	9.79
	30.0	28.0	126	12.0	118	11.2	112	10.6	108	10.2	104	9.80	98.0	9.22	9.22	9.22
	35.0	32.0	126	11.3	118	10.5	112	9.96	108	9.59	104	9.22	98.0	8.68	8.68	8.68
	39.0	36.0	126	10.6	118	9.89	112	9.37	108	9.02	104	8.68	98.0	8.18	8.18	8.18
44.0	40.0	126	9.95	118	9.30	112	8.81	108	8.50	104	8.18	98.0	7.72	7.72	7.72	
47.0	45.0	126	9.50	118	8.87	112	8.43	108	8.13	104	7.63	98.0	7.39	7.39	7.39	
51.0	47.0	126	8.97	118	8.43	112	7.82	108	7.55	104	7.09	98.0	6.79	6.79	6.79	
54.0	50.0	126	8.55	118	8.02	112	7.42	108	7.16	104	6.67	98.0	6.44	6.44	6.44	
57.0	53.0	126	8.19	118	7.68	112	7.01	108	6.77	104	6.34	98.0	6.19	6.19	6.19	
60.0	56.0	126	7.85	118	7.37	112	6.67	108	6.44	104	6.04	98.0	5.94	5.94	5.94	
50	-3.64	-4.0	126	19.4	118	17.9	112	16.9	108	16.1	104	15.4	98.0	14.4	14.4	14.4
	-1.84	-2.2	126	19.0	118	17.6	112	16.5	108	15.8	104	15.1	98.0	14.1	14.1	14.1
	5.5	5.0	126	17.3	118	16.0	112	15.0	108	14.4	104	13.8	98.0	12.9	12.9	12.9
	9.5	8.5	126	16.4	118	15.2	112	14.3	108	13.7	104	13.1	98.0	12.3	12.3	12.3
	13.0	12.0	126	15.5	118	14.4	112	13.5	108	13.0	104	12.5	98.0	11.7	11.7	11.7
	17.0	15.5	126	14.7	118	13.7	112	12.9	108	12.9	104	11.9	98.0	11.1	11.1	11.1
	19.0	18.0	126	14.1	118	13.1	112	12.4	108	11.9	104	11.4	98.0	10.7	10.7	10.7
	22.0	20.0	126	13.7	118	12.7	112	12.0	108	11.5	104	11.1	98.0	10.4	10.4	10.4
	26.0	24.0	126	12.8	118	11.9	112	11.3	108	10.8	104	10.4	98.0	9.79	9.79	9.79
	30.0	28.0	126	12.0	118	11.2	112	10.6	108	10.2	104	9.80	98.0	9.22	9.22	9.22
	35.0	32.0	126	11.3	118	10.5	112	9.96	108	9.59	104	9.22	98.0	8.68	8.68	8.68
	39.0	36.0	126	10.6	118	9.89	112	9.37	108	9.02	104	8.68	98.0	8.18	8.18	8.18
44.0	40.0	126	9.95	118	9.30	112	8.81	108	8.50	104	8.18	98.0	7.72	7.72	7.72	
47.0	45.0	126	9.50	118	8.87	112	8.43	108	8.13	104	7.63	98.0	7.39	7.39	7.39	
51.0	47.0	126	9.02	118	8.43	112	7.82	108	7.55	104	7.09	98.0	6.79	6.79	6.79	
54.0	50.0	126	8.55	118	8.02	112	7.42	108	7.16	104	6.67	98.0	6.44	6.44	6.44	
57.0	53.0	126	8.19	118	7.68	112	7.01	108	6.77	104	6.34	98.0	6.19	6.19	6.19	
60.0	56.0	126	7.85	118	7.37	112	6.67	108	6.44	104	6.04	98.0	5.94	5.94	5.94	

TC : Total capacity ; MBH

PI : Power Input ; kW (Comp.+Outdoor fan motor)

Note1 : is shown as reference

Note 2 : The above table shows the average value of conditions which may occur.

RXYQ216PTJU

Combit-nation (%)	Outdoor air temp. (F/WB)	Indoor air temp. F/DB												Heating capacity						
		61				65				70					75					
		TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW		TC	PI	MBH	KW		
100	-3.64	-4.0	151	13.4	150	15.5	150	16.1	149	16.6	149	17.4	148	18.0	148	18.5	148	18.9	148	19.6
	-1.84	-2.2	154	13.7	153	14.6	153	15.1	152	15.7	152	16.3	151	16.3	151	16.7	151	17.1	151	17.6
	0.5	0.9	157	14.1	156	15.0	156	15.5	155	16.1	155	16.7	154	16.9	154	17.3	154	17.7	154	18.1
	2.0	2.4	160	14.5	159	15.4	159	15.9	158	16.5	158	17.1	157	17.3	157	17.7	157	18.1	157	18.5
	3.5	3.9	163	14.9	162	15.8	162	16.3	161	16.9	161	17.5	160	17.7	160	18.1	160	18.5	160	18.9
	5.0	5.4	166	15.3	165	16.2	165	16.7	164	17.3	164	17.9	163	18.1	163	18.5	163	18.9	163	19.3
	6.5	6.9	169	15.7	168	16.6	168	17.1	167	17.7	167	18.3	166	18.5	166	18.9	166	19.3	166	19.7
	8.0	8.4	172	16.1	171	17.0	171	17.5	170	18.1	170	18.7	169	18.9	169	19.3	169	19.7	169	20.1
	9.5	9.9	175	16.5	174	17.4	174	17.9	173	18.5	173	19.1	172	19.3	172	19.7	172	20.1	172	20.5
	11.0	11.4	178	16.9	177	17.8	177	18.3	176	18.9	176	19.5	175	19.7	175	20.1	175	20.5	175	20.9
90	-3.64	-4.0	149	13.1	148	14.0	148	14.5	147	15.1	147	15.7	146	15.9	146	16.3	146	16.7	146	17.1
	-1.84	-2.2	152	13.4	151	14.3	151	14.8	150	15.4	150	16.0	149	16.2	149	16.6	149	17.0	149	17.4
	0.5	0.9	155	13.7	154	14.6	154	15.1	153	15.7	153	16.3	152	16.5	152	16.9	152	17.3	152	17.7
	2.0	2.4	158	14.1	157	15.0	157	15.5	156	16.1	156	16.7	155	16.9	155	17.3	155	17.7	155	18.1
	3.5	3.9	161	14.5	160	15.4	160	15.9	159	16.5	159	17.1	158	17.3	158	17.7	158	18.1	158	18.5
	5.0	5.4	164	14.9	163	15.8	163	16.3	162	16.9	162	17.5	161	17.7	161	18.1	161	18.5	161	18.9
	6.5	6.9	167	15.3	166	16.2	166	16.7	165	17.3	165	17.9	164	18.1	164	18.5	164	18.9	164	19.3
	8.0	8.4	170	15.7	169	16.6	169	17.1	168	17.7	168	18.3	167	18.5	167	18.9	167	19.3	167	19.7
	9.5	9.9	173	16.1	172	17.0	172	17.5	171	18.1	171	18.7	170	18.9	170	19.3	170	19.7	170	20.1
	11.0	11.4	176	16.5	175	17.4	175	17.9	174	18.5	174	19.1	173	19.3	173	19.7	173	20.1	173	20.5
80	-3.64	-4.0	147	12.8	146	13.7	146	14.2	145	14.8	145	15.4	144	15.6	144	16.0	144	16.4	144	16.8
	-1.84	-2.2	150	13.1	149	14.0	149	14.5	148	15.1	148	15.7	147	15.9	147	16.3	147	16.7	147	17.1
	0.5	0.9	153	13.4	152	14.3	152	14.8	151	15.4	151	16.0	150	16.2	150	16.6	150	17.0	150	17.4
	2.0	2.4	156	13.7	155	14.6	155	15.1	154	15.7	154	16.3	153	16.5	153	16.9	153	17.3	153	17.7
	3.5	3.9	159	14.1	158	15.0	158	15.5	157	16.1	157	16.7	156	16.9	156	17.3	156	17.7	156	18.1
	5.0	5.4	162	14.5	161	15.4	161	15.9	160	16.5	160	17.1	159	17.3	159	17.7	159	18.1	159	18.5
	6.5	6.9	165	14.9	164	15.8	164	16.3	163	16.9	163	17.5	162	17.7	162	18.1	162	18.5	162	18.9
	8.0	8.4	168	15.3	167	16.2	167	16.7	166	17.3	166	17.9	165	18.1	165	18.5	165	18.9	165	19.3
	9.5	9.9	171	15.7	170	16.6	170	17.1	169	17.7	169	18.3	168	18.5	168	18.9	168	19.3	168	19.7
	11.0	11.4	174	16.1	173	17.0	173	17.5	172	18.1	172	18.7	171	18.9	171	19.3	171	19.7	171	20.1

Combit-nation (%)	Outdoor air temp. (F/WB)	Indoor air temp. F/DB												Heating capacity						
		61				65				70					75					
		TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW		TC	PI	MBH	KW		
130	-3.64	-4.0	151	13.4	150	15.5	150	16.1	149	16.6	149	17.4	148	18.0	148	18.5	148	18.9	148	19.6
	-1.84	-2.2	154	13.7	153	14.6	153	15.1	152	15.7	152	16.3	151	16.3	151	16.7	151	17.1	151	17.6
	0.5	0.9	157	14.1	156	15.0	156	15.5	155	16.1	155	16.7	154	16.9	154	17.3	154	17.7	154	18.1
	2.0	2.4	160	14.5	159	15.4	159	15.9	158	16.5	158	17.1	157	17.3	157	17.7	157	18.1	157	18.5
	3.5	3.9	163	14.9	162	15.8	162	16.3	161	16.9	161	17.5	160	17.7	160	18.1	160	18.5	160	18.9
	5.0	5.4	166	15.3	165	16.2	165	16.7	164	17.3	164	17.9	163	18.1	163	18.5	163	18.9	163	19.3
	6.5	6.9	169	15.7	168	16.6	168	17.1	167	17.7	167	18.3	166	18.5	166	18.9	166	19.3	166	19.7
	8.0	8.4	172	16.1	171	17.0	171	17.5	170	18.1	170	18.7	169	18.9	169	19.3	169	19.7	169	20.1
	9.5	9.9	175	16.5	174	17.4	174	17.9	173	18.5	173	19.1	172	19.3	172	19.7	172	20.1	172	20.5
	11.0	11.4	178	16.9	177	17.8	177	18.3	176	18.9	176	19.5	175	19.7	175	20.1	175	20.5	175	20.9
120	-3.64	-4.0	149	13.1	148	14.0	148	14.5	147	15.1	147	15.7	146	15.9	146	16.3	146	16.7	146	17.1
	-1.84	-2.2	152	13.4	151	14.3	151	14.8	150	15.4	150	16.0	149	16.2	149	16.6	149	17.0	149	17.4
	0.5	0.9	155	13.7	154	14.6	154	15.1	153	15.7	153	16.3	152	16.5	152	16.9	152	17.3	152	17.7
	2.0	2.4	158	14.1	157	15.0	157	15.5	156	16.1	156	16.7	155	16.9	155	17.3	155	17.7	155	18.1
	3.5	3.9	161	14.5	160	15.4	160	15.9	159	16.5	159	17.1	158	17.3	158	17.7	158	18.1	158	18.5
	5.0	5.4	164	14.9	163	15.8	163	16.3	162	16.9	162	17.5	161	17.7	161	18.1	161	18.5	161	18.9
	6.5	6.9	167	15.3	166	16.2	166	16.7	165	17.3	165	17.9	164	18.1	164	18.5	164	18.9	164	19.3
	8.0	8.4	170	15.7	169	16.6	169	17.1	168	17.7	168	18.3	167	18.5	167	18.9	167	19.3	167	19.7
	9.5	9.9	173	16.1	172	17.0	172	17.5	171	18.1	171	18.7	170	18.9	170	19.3	170	19.7	170	20.1
	11.0	11.4	176	16.5	175	17.4	175	17.9	174	18.5	174	19.1	173	19.3	173	19.7	173	20.1	173	20.5
110	-3.64	-4.0	147	12.8	146	13.7	146	14.2	145	14.8	145	15.4	144	15.6	144	16.0	144	16.4	144	16.8
	-1.84	-2.2	150	13.1	149	14.0	149	14.5	148	15.1	148	15.7	147	15.9	147	16.3	147	16.7	147	17.1
	0.5	0.9	153	13.4	152	14.3	152	14.8	151	15.4	151	16.0	150	16.2	150	16.6	150	17.0	150	17.4
	2.0	2.4	156	13.7	155	14.6	155	15.1	154	15.7	154	16.3	153	16.5	153	16.9	153	17.3	153	17.7
	3.5	3.9	159	14.1	158	15.0	158	15.5	157	16.1	157	16.7	156	16.9	156	17.3	156	17.7	156	18.1
	5.0	5.4	162	14.5	161	15.4	161	15.9	160	16.5	160	17.1	159	17.3	159	17.7	159	18.1	159	18.5
	6.5	6.9	165	14.9	164	15.8	164	16.3	163	16.9	163	17.5	162	17.7	162	18.1	162	18.5	162	18.9
	8.0	8.4	168	15.3	167	16.2	167	16.7	166	17.3	166	17.9	165	18.1	165	18.5	165	18.9	165	19.3
	9.5	9.9	171	15.7	170	16.6	170	17.1	169	17.7	169	18.3	168	18.5	168	18.9	168	19.3	168	19.7
	11.0	11.4	174	16.1	173	17.0	173	17.5	172	18.1	172	18.7	171	18.9	171	19.3	171	19.7	171	20.1

TC: Total capacity; MBH

PI: Power Input; kW (Comp.+Outdoor fan motor)

Note 1: is shown as reference.

Note 2: The above table shows the average value of conditions which may occur.

Heating capacity

Combi- ration (%)	Outdoor air temp. (F/DB)	Indoor air Temp. F/DB												
		61		65		68		70		72		75		
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	
70	-3.64	-4.0	147	20.7	147	21.3	146	21.8	146	22.1	146	22.4	146	22.9
	-1.84	-2.2	150	20.9	149	21.5	149	22.0	149	22.3	149	22.6	149	23.0
	0.5	0.5	152	21.6	151	22.2	151	22.6	151	22.9	151	23.2	151	23.6
	13.0	12.0	176	22.4	176	22.9	176	23.3	176	23.7	176	24.1	176	24.5
	15.0	14.0	182	22.7	181	23.2	176	23.7	176	24.1	176	24.5	176	24.9
	17.0	15.5	185	22.8	184	23.3	176	23.8	176	24.2	176	24.6	176	25.0
	19.0	18.0	191	23.1	186	23.6	176	24.1	176	24.5	176	24.9	176	25.3
	22.0	20.0	197	23.3	186	23.8	176	24.3	176	24.7	176	25.1	176	25.5
	26.0	24.0	198	23.4	186	24.0	176	24.4	176	24.8	176	25.2	176	25.6
	30.0	28.0	198	23.5	186	24.1	176	24.5	176	24.9	176	25.3	176	25.7
	35.0	32.0	198	23.6	186	24.2	176	24.6	176	25.0	176	25.4	176	25.8
	40.0	36.0	198	23.7	186	24.3	176	24.7	176	25.1	176	25.5	176	25.9
44.0	40.0	198	23.8	186	24.4	176	24.8	176	25.2	176	25.6	176	26.0	
47.0	43.0	198	23.9	186	24.5	176	24.9	176	25.3	176	25.7	176	26.1	
51.0	47.0	198	24.0	186	24.6	176	25.0	176	25.4	176	25.8	176	26.2	
54.0	50.0	198	24.1	186	24.7	176	25.1	176	25.5	176	25.9	176	26.3	
57.0	53.0	198	24.2	186	24.8	176	25.2	176	25.6	176	26.0	176	26.4	
60.0	56.0	198	24.3	186	24.9	176	25.3	176	25.7	176	26.1	176	26.5	
60	-3.64	-4.0	146	22.1	146	22.7	146	23.1	146	23.3	146	23.6	146	24.0
	-1.84	-2.2	149	22.3	148	22.8	148	23.2	146	23.2	146	23.5	146	23.9
	0.5	0.5	151	22.9	150	23.1	151	23.5	149	23.5	149	23.8	149	24.2
	13.0	12.0	182	23.3	182	23.8	182	24.2	182	24.6	182	25.0	182	25.4
	15.0	14.0	170	21.7	159	20.1	151	18.9	146	18.9	146	19.3	146	19.7
	17.0	15.5	170	21.2	159	19.6	151	18.4	146	17.6	146	18.0	146	18.4
	19.0	18.0	170	20.3	159	18.8	151	17.7	146	16.9	146	17.3	146	17.7
	22.0	20.0	170	19.6	159	18.2	151	17.1	146	16.4	146	16.8	146	17.2
	26.0	24.0	170	18.3	159	17.0	151	16.0	146	15.4	146	15.8	146	16.2
	30.0	28.0	170	17.1	159	15.9	151	15.0	146	14.4	146	14.8	146	15.2
	35.0	32.0	170	16.0	159	14.9	151	14.0	146	13.5	146	13.9	146	14.3
	39.0	36.0	170	15.0	159	13.9	151	13.1	146	12.6	146	13.0	146	13.4
44.0	40.0	170	14.0	159	13.0	151	12.2	146	11.9	146	12.3	146	12.7	
47.0	43.0	170	13.5	159	12.5	151	11.7	146	11.0	146	11.4	146	11.8	
51.0	47.0	170	12.5	159	11.7	151	11.0	146	10.3	146	10.7	146	11.1	
54.0	50.0	170	11.9	159	11.1	151	10.5	146	10.2	146	10.6	146	11.0	
57.0	53.0	170	11.4	159	10.6	151	10.1	146	9.72	146	10.1	146	10.5	
60.0	56.0	170	10.9	159	10.2	151	9.65	146	9.31	146	9.65	146	10.0	
50	-3.64	-4.0	142	22.6	133	20.9	126	19.6	122	18.8	117	18.0	110	16.8
	-1.84	-2.2	142	22.1	133	20.4	126	19.2	122	18.4	117	17.6	110	16.4
	0.5	0.5	142	20.0	133	18.5	126	17.5	122	16.7	117	16.0	110	15.0
	13.0	12.0	142	19.0	133	17.6	126	16.6	122	15.9	117	15.3	110	14.3
	15.0	14.0	142	18.0	133	16.7	126	15.7	122	15.1	117	14.5	110	13.6
	17.0	15.5	142	17.5	133	16.2	126	15.2	122	14.7	117	14.0	110	13.1
	19.0	18.0	142	16.4	133	15.2	126	14.4	122	13.8	117	13.2	110	12.6
	22.0	20.0	142	15.9	133	14.8	126	13.9	122	13.4	117	12.8	110	12.0
	26.0	24.0	142	14.9	133	13.8	126	13.1	122	12.6	117	12.1	110	11.3
	30.0	28.0	142	13.9	133	13.0	126	12.3	122	11.8	117	11.3	110	10.7
	35.0	32.0	142	13.1	133	12.2	126	11.5	122	11.1	117	10.7	110	10.0
	39.0	36.0	142	12.3	133	11.4	126	10.8	122	10.4	117	10.0	110	9.46
44.0	40.0	142	11.5	133	10.7	126	10.2	122	9.82	117	9.46	110	8.92	
47.0	43.0	142	11.0	133	10.3	126	9.74	122	9.38	117	9.03	110	8.54	
51.0	47.0	142	10.5	133	9.8	126	9.26	122	8.91	117	8.61	110	8.17	
54.0	50.0	142	9.87	133	9.25	126	8.79	122	8.48	117	8.18	110	7.74	
57.0	53.0	142	9.45	133	8.86	126	8.42	122	8.14	117	7.85	110	7.43	
60.0	56.0	142	9.05	133	8.49	126	8.08	122	7.81	117	7.54	110	7.14	

TC : Total capacity ; MBH
 PI : Power Input ; kW (Comp.+Outdoor fan motor)
 Note1 : is shown as reference
 Note 2 : The above table shows the average value of outdoor air temperature range shown by


Heating capacity

Combi- ration (%)	Outdoor air temp. (F/DB)	Indoor air Temp. F/DB															
		61			65			70			75						
		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH				
70	-3.64	-4.0	152	20.5	21.2	151	21.7	151	22.1	150	23.2	150	23.5	150	23.8	147	23.6
	-1.84	-2.2	154	20.7	21.4	154	21.9	154	22.1	154	22.3	153	22.5	153	22.5	147	23.1
	0.5	0.5	157	21.6	22.6	156	22.6	156	22.7	156	22.8	156	22.8	156	22.8	147	23.1
	1.0	1.0	159	22.1	23.6	157	23.1	157	23.2	157	23.3	157	23.3	157	23.3	147	23.1
	1.5	1.5	162	22.5	25.0	161	23.5	161	23.6	161	23.7	161	23.7	161	23.7	147	23.1
	1.7	1.7	164	22.7	26.3	163	23.7	163	23.8	163	23.9	163	23.9	163	23.9	147	23.1
	1.9	1.9	167	22.9	27.6	166	23.9	166	24.1	166	24.1	166	24.1	166	24.1	147	23.1
	2.0	2.0	169	23.2	28.9	169	24.1	169	24.1	169	24.1	169	24.1	169	24.1	147	23.1
	2.2	2.2	171	23.4	30.2	171	24.3	171	24.3	171	24.3	171	24.3	171	24.3	147	23.1
	2.4	2.4	173	23.6	31.5	173	24.5	173	24.5	173	24.5	173	24.5	173	24.5	147	23.1
	2.6	2.6	175	23.8	32.8	175	24.7	175	24.7	175	24.7	175	24.7	175	24.7	147	23.1
	2.8	2.8	177	24.0	34.1	177	24.9	177	24.9	177	24.9	177	24.9	177	24.9	147	23.1
3.0	3.0	179	24.2	35.4	179	25.1	179	25.1	179	25.1	179	25.1	179	25.1	147	23.1	
3.2	3.2	181	24.4	36.7	181	25.3	181	25.3	181	25.3	181	25.3	181	25.3	147	23.1	
3.4	3.4	183	24.6	38.0	183	25.5	183	25.5	183	25.5	183	25.5	183	25.5	147	23.1	
3.6	3.6	185	24.8	39.3	185	25.7	185	25.7	185	25.7	185	25.7	185	25.7	147	23.1	
3.8	3.8	187	25.0	40.6	187	25.9	187	25.9	187	25.9	187	25.9	187	25.9	147	23.1	
4.0	4.0	189	25.2	41.9	189	26.1	189	26.1	189	26.1	189	26.1	189	26.1	147	23.1	
4.2	4.2	191	25.4	43.2	191	26.3	191	26.3	191	26.3	191	26.3	191	26.3	147	23.1	
4.4	4.4	193	25.6	44.5	193	26.5	193	26.5	193	26.5	193	26.5	193	26.5	147	23.1	
4.6	4.6	195	25.8	45.8	195	26.7	195	26.7	195	26.7	195	26.7	195	26.7	147	23.1	
4.8	4.8	197	26.0	47.1	197	26.9	197	26.9	197	26.9	197	26.9	197	26.9	147	23.1	
5.0	5.0	199	26.2	48.4	199	27.1	199	27.1	199	27.1	199	27.1	199	27.1	147	23.1	
5.2	5.2	201	26.4	49.7	201	27.3	201	27.3	201	27.3	201	27.3	201	27.3	147	23.1	
5.4	5.4	203	26.6	51.0	203	27.5	203	27.5	203	27.5	203	27.5	203	27.5	147	23.1	
5.6	5.6	205	26.8	52.3	205	27.7	205	27.7	205	27.7	205	27.7	205	27.7	147	23.1	
5.8	5.8	207	27.0	53.6	207	27.9	207	27.9	207	27.9	207	27.9	207	27.9	147	23.1	
6.0	6.0	209	27.2	54.9	209	28.1	209	28.1	209	28.1	209	28.1	209	28.1	147	23.1	
6.2	6.2	211	27.4	56.2	211	28.3	211	28.3	211	28.3	211	28.3	211	28.3	147	23.1	
6.4	6.4	213	27.6	57.5	213	28.5	213	28.5	213	28.5	213	28.5	213	28.5	147	23.1	
6.6	6.6	215	27.8	58.8	215	28.7	215	28.7	215	28.7	215	28.7	215	28.7	147	23.1	
6.8	6.8	217	28.0	60.1	217	28.9	217	28.9	217	28.9	217	28.9	217	28.9	147	23.1	
7.0	7.0	219	28.2	61.4	219	29.1	219	29.1	219	29.1	219	29.1	219	29.1	147	23.1	
7.2	7.2	221	28.4	62.7	221	29.3	221	29.3	221	29.3	221	29.3	221	29.3	147	23.1	
7.4	7.4	223	28.6	64.0	223	29.5	223	29.5	223	29.5	223	29.5	223	29.5	147	23.1	
7.6	7.6	225	28.8	65.3	225	29.7	225	29.7	225	29.7	225	29.7	225	29.7	147	23.1	
7.8	7.8	227	29.0	66.6	227	29.9	227	29.9	227	29.9	227	29.9	227	29.9	147	23.1	
8.0	8.0	229	29.2	67.9	229	30.1	229	30.1	229	30.1	229	30.1	229	30.1	147	23.1	
8.2	8.2	231	29.4	69.2	231	30.3	231	30.3	231	30.3	231	30.3	231	30.3	147	23.1	
8.4	8.4	233	29.6	70.5	233	30.5	233	30.5	233	30.5	233	30.5	233	30.5	147	23.1	
8.6	8.6	235	29.8	71.8	235	30.7	235	30.7	235	30.7	235	30.7	235	30.7	147	23.1	
8.8	8.8	237	30.0	73.1	237	30.9	237	30.9	237	30.9	237	30.9	237	30.9	147	23.1	
9.0	9.0	239	30.2	74.4	239	31.1	239	31.1	239	31.1	239	31.1	239	31.1	147	23.1	
9.2	9.2	241	30.4	75.7	241	31.3	241	31.3	241	31.3	241	31.3	241	31.3	147	23.1	
9.4	9.4	243	30.6	77.0	243	31.5	243	31.5	243	31.5	243	31.5	243	31.5	147	23.1	
9.6	9.6	245	30.8	78.3	245	31.7	245	31.7	245	31.7	245	31.7	245	31.7	147	23.1	
9.8	9.8	247	31.0	79.6	247	31.9	247	31.9	247	31.9	247	31.9	247	31.9	147	23.1	
10.0	10.0	249	31.2	80.9	249	32.1	249	32.1	249	32.1	249	32.1	249	32.1	147	23.1	
10.2	10.2	251	31.4	82.2	251	32.3	251	32.3	251	32.3	251	32.3	251	32.3	147	23.1	
10.4	10.4	253	31.6	83.5	253	32.5	253	32.5	253	32.5	253	32.5	253	32.5	147	23.1	
10.6	10.6	255	31.8	84.8	255	32.7	255	32.7	255	32.7	255	32.7	255	32.7	147	23.1	
10.8	10.8	257	32.0	86.1	257	32.9	257	32.9	257	32.9	257	32.9	257	32.9	147	23.1	
11.0	11.0	259	32.2	87.4	259	33.1	259	33.1	259	33.1	259	33.1	259	33.1	147	23.1	
11.2	11.2	261	32.4	88.7	261	33.3	261	33.3	261	33.3	261	33.3	261	33.3	147	23.1	
11.4	11.4	263	32.6	90.0	263	33.5	263	33.5	263	33.5	263	33.5	263	33.5	147	23.1	
11.6	11.6	265	32.8	91.3	265	33.7	265	33.7	265	33.7	265	33.7	265	33.7	147	23.1	
11.8	11.8	267	33.0	92.6	267	33.9	267	33.9	267	33.9	267	33.9	267	33.9	147	23.1	
12.0	12.0	269	33.2	93.9	269	34.1	269	34.1	269	34.1	269	34.1	269	34.1	147	23.1	
12.2	12.2	271	33.4	95.2	271	34.3	271	34.3	271	34.3	271	34.3	271	34.3	147	23.1	
12.4	12.4	273	33.6	96.5	273	34.5	273	34.5	273	34.5	273	34.5	273	34.5	147	23.1	
12.6	12.6	275	33.8	97.8	275	34.7	275	34.7	275	34.7	275	34.7	275	34.7	147	23.1	
12.8	12.8	277	34.0	99.1	277	34.9	277	34.9	277	34.9	277	34.9	277	34.9	147	23.1	
13.0	13.0	279	34.2	100.4	279	35.1	279	35.1	279	35.1	279	35.1	279	35.1	147	23.1	
13.2	13.2	281	34.4	101.7	281	35.3	281	35.3	281	35.3	281	35.3	281	35.3	147	23.1	
13.4	13.4	283	34.6	103.0	283	35.5	283	35.5	283	35.5	283	35.5	283	35.5	147	23.1	
13.6	13.6	285	34.8	104.3	285	35.7	285	35.7	285	35.7	285	35.7	285	35.7	147	23.1	
13.8	13.8	287	35.0	105.6	287	35.9	287	35.9	287	35.9	287	35.9	287	35.9	147	23.1	
14.0	14.0	289	35.2	106.9	289	36.1	289	36.1	289	36.1	289	36.1	289	36.1	147	23.1	
14.2	14.2	291	35.4	108.2	291	36.3	291	36.3	291	36.3	291	36.3	291	36.3	147	23.1	
14.4	14.4	293	35.6	109.5	293	36.5	293	36.5	293	36.5	293	36.5	293	36.5	147	23.1	
14.6	14.6	295	35.8	110.8	295	36.7	295	36.7	295	36.7	295	36.7	295	36.7	147	23.1	


8.3 Capacity Correction Factor

RXYQ72PTJU

1. Rate of change in cooling capacity

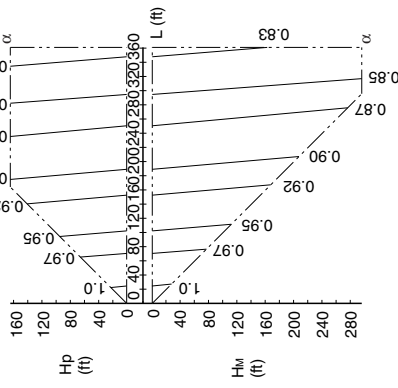

2. Rate of change in heating capacity

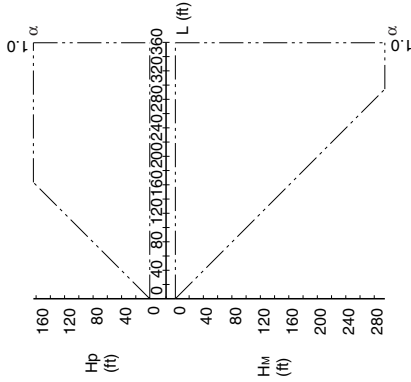

[Explanation of symbols]
 Hp : Level difference (ft) between indoor and outdoor units where indoor unit in inferior position
 Hw : Level difference (ft) between indoor and outdoor units where indoor unit in superior position
 L : Equivalent pipe length (ft)
 α : Rate of change in cooling/heating Capacity

[Diameter of the main pipes (standard size)]

Model	gas	liquid
RXYQ72PYDN	φ 3/4	φ 3/8
RXYQ72PTJU	φ 3/4	φ 3/8

[Temper grade and Thickness]

Temper grade	□ Type		1/2H Type
	φ 3/8	φ 1/2	φ 3/4 φ 7/8
Outer diameter	0.80	0.80	0.80 0.80
Minimum Wall Thickness	0.80	0.80	0.80 0.80

Notes]

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
- Method of calculating A/C (cooling/heating) capacity:
 The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.
 Calculating A/C capacity of outdoor units

- Condition: Indoor unit combination ratio does not exceed 100%.

$$\left[\frac{\text{Maximum A/C capacity of outdoor units}}{\text{Maximum A/C capacity of indoor units}} \right] = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the 100% combination}}{\text{A/C capacity of indoor unit}}$$
 - Capacity change rate due to piping length to the farthest indoor unit
- Condition: Indoor unit combination ratio exceeds 100%.

$$\left[\frac{\text{Maximum A/C capacity of outdoor units}}{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the combination}} \right] = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the combination}}{\text{A/C capacity of indoor unit}}$$
 - Capacity change rate due to piping length to the farthest indoor unit

- When overall equivalent pipe length is 295.3ft or more, the diameter of the main gas and liquid pipes (outdoor unit-branch sections) must be increased.
 When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.
 [Diameter of above case]

Model	gas	liquid
RXYQ72PYDN	φ 7/8	φ 1/2
RXYQ72PTJU	φ 7/8	φ 1/2


- Read cooling/heating capacity rate of change in the above figures based on the following equivalent length.

$$\text{Overall equivalent length} = (\text{Equivalent length to main pipe}) \times \text{Correction factor} + (\text{Equivalent length after branching})$$

Choose a correction factor from the following table.

- When cooling capacity is calculated : gas pipe size
- When heating capacity is calculated : liquid pipe size

Rate of change (object piping)	Correction factor	
	Standard size	Size increase
Cooling (gas pipe)	1.0	0.5
Heating (liquid pipe)	1.0	0.2

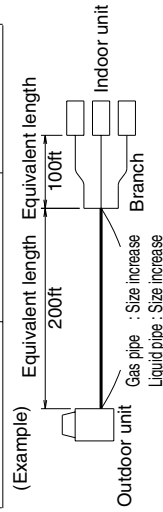

In the above case


(Cooling) Overall equivalent length = 200ft × 0.5 + 100ft = 200ft
 (Heating) Overall equivalent length = 200ft × 0.2 + 100ft = 140ft

The rate of change in cooling capacity when Hp = 0ft is thus approximately 0.86
 heating capacity when Hp = 0ft is thus approximately 1.0


3D058623

RXYQ96PTJU

1. Rate of change in cooling capacity

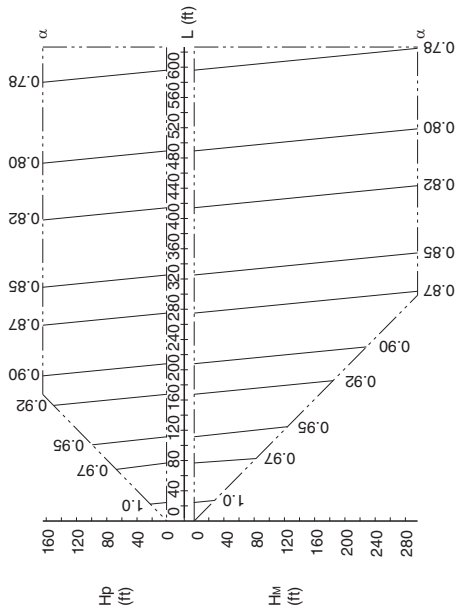

2. Rate of change in heating capacity

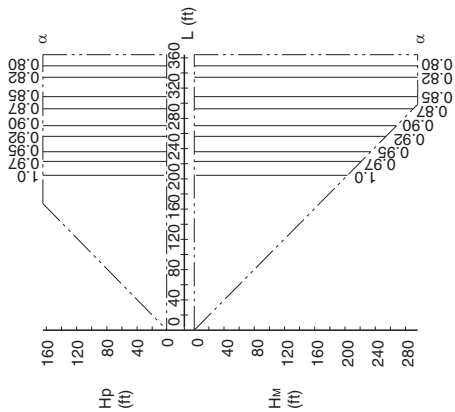

[Explanation of symbols]
 Hp : Level difference (ft) between indoor and outdoor units where indoor unit in inferior position
 Hm : Level difference (ft) between indoor and outdoor units where indoor unit in superior position
 L : Equivalent pipe length (ft)
 α : Rate of change in cooling/heating Capacity

[Diameter of the main pipes (standard size)]

Model	gas	liquid
RXYQ96PYDN	φ 7/8	φ 3/8
RXYQ96PTJU	φ 7/8	φ 3/8

[Temper grade and Thickness]

Temper grade	□ Type		1/2H Type
	φ 3/8	φ 1/2	φ 7/8
Outer diameter	φ 3/8	φ 1/2	φ 7/8
Minimum Wall Thickness	0.80	0.80	0.80

[Notes]

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
- Method of calculating A/C (cooling/heating) capacity:
 The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.
 Calculating A/C capacity of outdoor units

⑦ Condition: Indoor unit combination ratio does not exceed 100%.

[Maximum A/C capacity of outdoor units] = [A/C capacity of outdoor units obtained from capacity characteristic table at the 100% combination]

× [Capacity change rate due to piping length to the farthest indoor unit]

? Condition: Indoor unit combination ratio exceeds 100%.

[Maximum A/C capacity of outdoor units] = [A/C capacity of outdoor units obtained from capacity characteristic table at the combination]

× [Capacity change rate due to piping length to the farthest indoor unit]

- When overall equivalent pipe length is 295.3ft or more, the diameter of the main gas and liquid pipes (outdoor unit-branch sections) must be increased. When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.
 [Diameter of above case]

Model	gas	liquid
RXYQ96PYDN	φ 1	φ 1/2
RXYQ96PTJU	φ 1	φ 1/2

- Read cooling/heating capacity rate of change in the above figures based on the following equivalent length.


Overall equivalent length = (Equivalent length to main pipe) × Correction factor + (Equivalent length after branching)

Choose a correction factor from the following table.

- When cooling capacity is calculated : gas pipe size
- When heating capacity is calculated : liquid pipe size

Rate of change (object piping)	Correction factor	
	Standard size	Size increase
Cooling (gas pipe)	1.0	0.5
Heating (liquid pipe)	1.0	0.2

(Example) Equivalent length Equivalent length

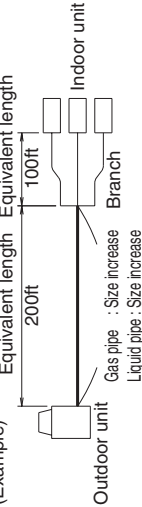

In the above case


(Cooling) Overall equivalent length = 200ft × 0.5 + 100ft = 200ft
 (Heating) Overall equivalent length = 200ft × 0.2 + 100ft = 140ft

The rate of change in cooling capacity when Hp = 0ft is thus approximately 0.87
 heating capacity when Hp = 0ft is thus approximately 1.00


3D058624

RXYQ120, 144PTJU

2. Rate of change in heating capacity

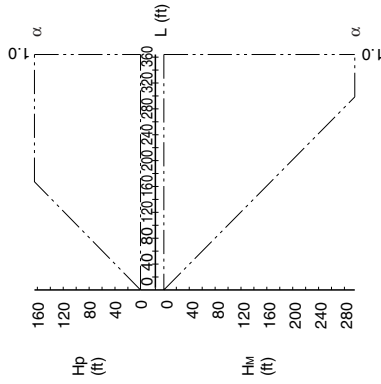

1. Rate of change in cooling capacity

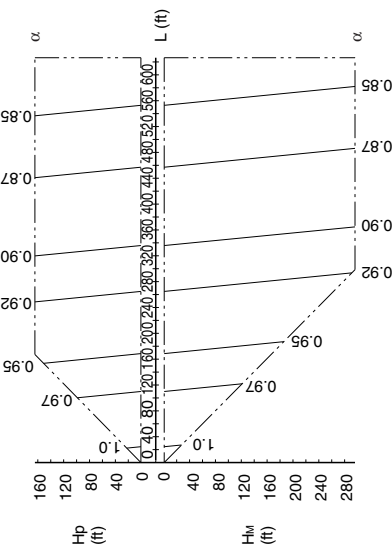

[Explanation of symbols]
 Hp : Level difference (ft) between indoor and outdoor units where indoor unit in inferior position
 Hm : Level difference (ft) between indoor and outdoor units where indoor unit in superior position
 L : Equivalent pipe length (ft)
 α : Rate of change in cooling/heating Capacity

[Diameter of the main pipes (standard size)]

Model	gas	liquid
RXYQ120, 144PYDN	φ 1-1/8	φ 1/2
RXYQ120, 144PTJU		
RXYQ240PYDN	φ 1-3/8	φ 5/8
RXYQ240PTJU		

[Temper grade and Thickness]

Temper grade	□ Type		1/2H Type	
	φ 1/2	φ 5/8	φ 3/4	φ 1-1/8
Outer diameter				
Minimum Wall Thickness	0.80	0.99	0.80	0.99
			0.80	1.21

[Notes]

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figure.
- With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
- Method of calculating A/C (cooling/heating) capacity:
 The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.
 Calculating A/C capacity of outdoor units

- Condition: Indoor unit combination ratio does not exceed 100%.

$$\left[\frac{\text{Maximum A/C capacity of outdoor units}}{\text{Maximum A/C capacity of outdoor units}} \right] = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the 100% combination}}{\text{Capacity change rate due to piping length to the farthest indoor unit}}$$
- Condition: Indoor unit combination ratio exceeds 100%.

$$\left[\frac{\text{Maximum A/C capacity of outdoor units}}{\text{Maximum A/C capacity of outdoor units}} \right] = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the combination farthest indoor unit}}{\text{Capacity change rate due to piping length to the farthest indoor unit}}$$

- When overall equivalent pipe length is 295.0ft or more, the diameter of the main gas and liquid pipes (outdoor unit-branch sections) must be increased. When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.
 [Diameter of above case]

Model	gas	liquid
RXYQ120, 144PYDN		φ 5/8
RXYQ120, 144PTJU	Not	
RXYQ240PYDN	Increased	
RXYQ240PTJU		φ 3/4


Overall equivalent length =
 (Equivalent length to main pipe) × Correction factor + (Equivalent length after branching)

Choose a correction factor from the following table.

- When cooling capacity is calculated : gas pipe size
- When heating capacity is calculated : liquid pipe size

Rate of change (object piping)	Correction factor	
	Standard size	Size increase
Cooling (gas pipe)	1.0	240
Heating (liquid pipe)	1.0	0.3

(Example) In case of RXYQ240PYDN

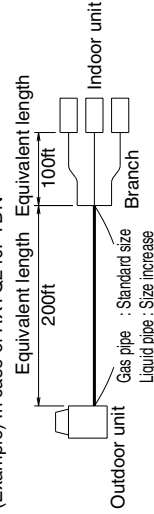


In the above case

(Cooling) Overall equivalent length = 200ft × 1.0 + 100ft = 300ft
 (Heating) Overall equivalent length = 200ft × 0.4 + 100ft = 180ft


The rate of change in cooling capacity when Hp = 0ft is thus approximately 0.88 heating capacity when Hp = 0ft is thus approximately 1.0

RXYQ168PTJU

1. Rate of change in cooling capacity

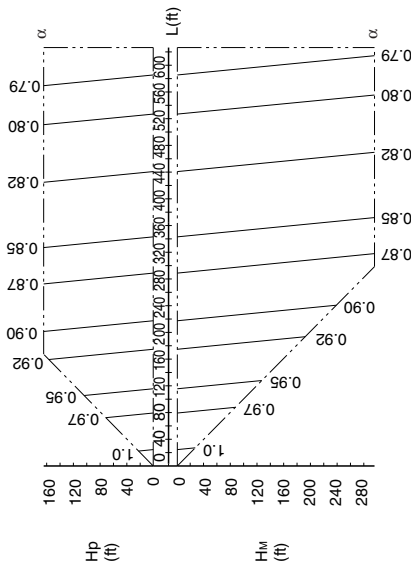

2. Rate of change in heating capacity

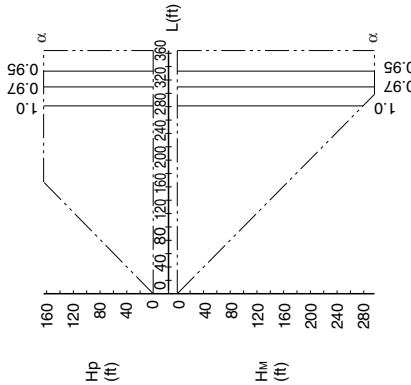

[Explanation of symbols]

- Hp : Level difference (ft) between indoor and outdoor units where indoor unit in inferior position
- Hm : Level difference (ft) between indoor and outdoor units where indoor unit in superior position
- L : Equivalent pipe length (ft)
- α : Rate of change in cooling/heating Capacity

[Diameter of the main pipes (standard size)]

Model	gas	liquid
RXYQ168PYDN	ϕ 1-1/8	ϕ 1/2
RXYQ168PTJU	ϕ 1-1/8	ϕ 1/2

[Temper grade and Thickness]

Temper grade	<input type="checkbox"/> Type	1/2H Type
Outer diameter	ϕ 1/2	ϕ 5/8
Minimum Wall Thickness	0.80	0.99
		1.10

[Notes]

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
- Method of calculating A/C (cooling/heating) capacity:
The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.

Calculating A/C capacity of outdoor units

- Condition: Indoor unit combination ratio does not exceed 100%.
 $\text{Maximum A/C capacity of outdoor units} = \text{A/C capacity of outdoor units obtained from capacity characteristic table at the 100\% combination}$
 $\times \text{Capacity change rate due to piping length to the farthest indoor unit}$
- Condition: Indoor unit combination ratio exceeds 100%.
 $\text{Maximum A/C capacity of outdoor units} = \text{A/C capacity of outdoor units obtained from capacity characteristic table at the combination}$
 $\times \text{Capacity change rate due to piping length to the farthest indoor unit}$

- When overall equivalent pipe length is 295.0ft or more, the diameter of the main gas and liquid pipes (outdoor unit-branch sections) must be increased.
When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.

[Diameter of above case]

Model	gas	liquid
RXYQ168PYDN	ϕ 1-1/4	ϕ 5/8
RXYQ168PTJU	ϕ 1-1/4	ϕ 5/8

- Read cooling/heating capacity rate of change in the above figures based on the following equivalent length.


Overall equivalent length = (Equivalent length to main pipe) \times Correction factor + (Equivalent length after branching)

Choose a correction factor from the following table.

- When cooling capacity is calculated : gas pipe size
- When heating capacity is calculated : liquid pipe size

Rate of change (object piping)	Correction factor	
	Standard size	Size increase
Cooling (gas pipe)	1.0	0.5
Heating (liquid pipe)	1.0	0.3

(Example) Equivalent length

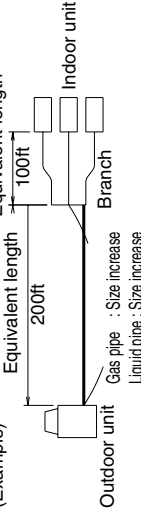


In the above case

- (Cooling) Overall equivalent length = 200ft \times 0.5 + 100ft = 200ft
- (Heating) Overall equivalent length = 200ft \times 0.3 + 100ft = 160ft


The rate of change in cooling capacity when Hp = 0ft is thus approximately 0.88 heating capacity when Hp = 0ft is thus approximately 1.0

RXYQ192PTJU

1. Rate of change in cooling capacity

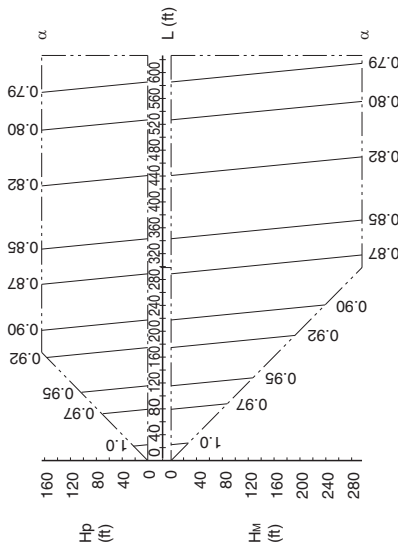

2. Rate of change in heating capacity

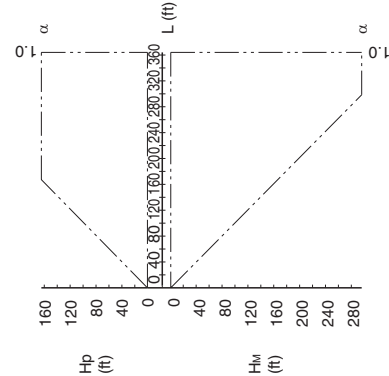

[Explanation of symbols]
 Hp : Level difference (m) between indoor and outdoor units where indoor unit in inferior position
 Hm : Level difference (m) between indoor and outdoor units where indoor unit in superior position
 L : Equivalent pipe length (m)
 α : Rate of change in cooling/heating Capacity

[Diameter of the main pipes (standard size)]

Model	gas	liquid
RXYQ192PYDN	φ 1-1/8	φ 5/8
RXYQ192PTJU	φ 1-1/8	φ 5/8

[Temper grade and Thickness]

Temper grade	Type		1/2H Type	
	φ 5/8	φ 3/4	φ 7/8	φ 1-1/8
Outer diameter	0.99	0.80	0.80	0.99
Minimum Wall Thickness	0.99	0.80	0.80	1.10

[Notes]

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
- Method of calculating A/C (cooling/heating) capacity:
 The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.
 Calculating A/C capacity of outdoor units
 ? Condition: Indoor unit combination ratio does not exceed 100%.
 [Maximum A/C capacity of outdoor units] = A/C capacity of outdoor units obtained from capacity characteristic table at the 100% combination
 × Capacity change rate due to piping length to the farthest indoor unit
 ? Condition: Indoor unit combination ratio exceeds 100%.
 [Maximum A/C capacity of outdoor units] = A/C capacity of outdoor units obtained from capacity characteristic table at the combination
 × Capacity change rate due to piping length to the farthest indoor unit

- When overall equivalent pipe length is 295.3ft or more, the diameter of the main gas and liquid pipes (outdoor unit-branch sections) must be increased.
 When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.
 [Diameter of above case]


Model	gas	liquid
RXYQ192PYDN	φ 1-1/4	φ 3/4
RXYQ192PTJU	φ 1-1/4	φ 3/4

- Read cooling/heating capacity rate of change in the above figures based on the following equivalent length.

Overall equivalent length = [Equivalent length to main pipe] × Correction factor + [Equivalent length after branching]

Choose a correction factor from the following table.
 □ When cooling capacity is calculated : gas pipe size
 □ When heating capacity is calculated : liquid pipe size

Rate of change (object piping)	Correction factor	
	Standard size	Size increase
Cooling (gas pipe)	1.0	0.5
Heating (liquid pipe)	1.0	0.4

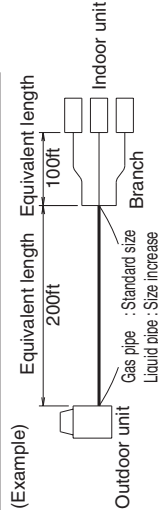


In the above case
 (Cooling) Overall equivalent length = 200ft × 1.0 + 100ft = 300ft
 (Heating) Overall equivalent length = 200ft × 0.4 + 100ft = 180ft

The rate of change in cooling capacity when Hp = 0ft is thus approximately 0.83
 heating capacity when Hp = 0ft is thus approximately 1.0


3D059676

RXYQ216PTJU

1. Rate of change in cooling capacity

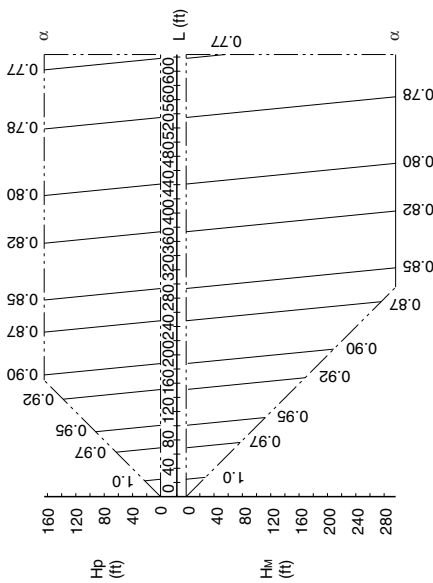

2. Rate of change in heating capacity

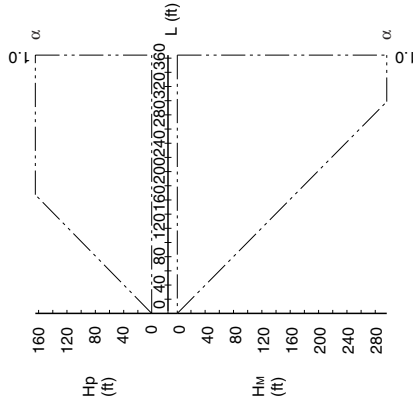

[Explanation of symbols]

- Hp : Level difference (ft) between indoor and outdoor units where indoor unit in inferior position
- Hm : Level difference (ft) between indoor and outdoor units where indoor unit in superior position
- L : Equivalent pipe length (ft)
- α : Rate of change in cooling/heating Capacity

[Diameter of the main pipes (standard size)]

Model	gas	liquid
RXYQ216PYDN	φ 1-1/8	φ 5/8
RXYQ216PTJU	φ 1-1/8	φ 5/8

[Temper grade and Thickness]

Temper grade	□ Type	1/2H Type
Outer diameter	φ 5/8	φ 3/4
Minimum Wall Thickness	0.99	0.80
		1.10

[Notes]

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
- Method of calculating A/C (cooling/heating) capacity: The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.
Calculating A/C capacity of outdoor units

- Condition: Indoor unit combination ratio does not exceed 100%.
[Maximum A/C capacity of outdoor units] = A/C capacity of outdoor units obtained from capacity characteristic table at the 100% combination
- Capacity change rate due to piping length to the farthest indoor unit
- Condition: Indoor unit combination ratio exceeds 100%.
[Maximum A/C capacity of outdoor units] = A/C capacity of outdoor units obtained from capacity characteristic table at the combination
- Capacity change rate due to piping length to the farthest indoor unit

- When overall equivalent pipe length is 295.0ft or more, the diameter of the main gas and liquid pipes (outdoor unit-branch sections) must be increased. When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.
[Diameter of above case]

Model	gas	liquid
RXYQ216PYDN	φ 1-1/4	φ 3/4
RXYQ216PTJU	φ 1-1/4	φ 3/4

- Read cooling/heating capacity rate of change in the above figures based on the following equivalent length.


Overall equivalent length = (Equivalent length to main pipe) × Correction factor + (Equivalent length after branching)

Choose a correction factor from the following table.

- When cooling capacity is calculated : gas pipe size
- When heating capacity is calculated : liquid pipe size

Rate of change (object piping)	Correction factor	
	Standard size	Size increase
Cooling (gas pipe)	1.0	0.5
Heating (liquid pipe)	1.0	0.4

(Example) Equivalent length Equivalent length

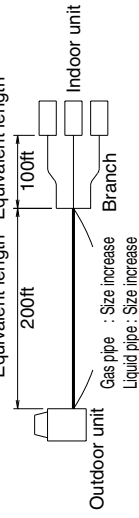


In the above case
(Cooling) Overall equivalent length = 200ft × 0.5 + 100ft = 200ft
(Heating) Overall equivalent length = 200ft × 0.4 + 100ft = 180ft

The rate of change in cooling capacity when Hp = 0ft is thus approximately 0.86 heating capacity when Hp = 0ft is thus approximately 1.0


3D059678

RXYQ240PTJU

2. Rate of change in heating capacity

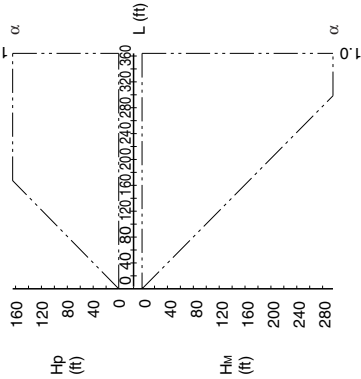

1. Rate of change in cooling capacity

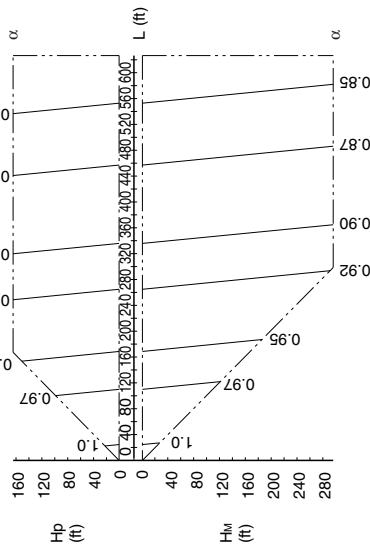

[Explanation of symbols]
 Hp : Level difference (ft) between indoor and outdoor units where indoor unit in inferior position
 Hm : Level difference (ft) between indoor and outdoor units where indoor unit in superior position
 L : Equivalent pipe length (ft)
 α : Rate of change in cooling/heating Capacity

[Diameter of the main pipes (standard size)]

Model	gas	liquid
RXYQ120, 144PYDN	φ 1-1/8	φ 1/2
RXYQ120, 144PTJU	φ 1-1/8	φ 1/2
RXYQ240PYDN	φ 1-3/8	φ 5/8
RXYQ240PTJU	φ 1-3/8	φ 5/8

[Temper grade and Thickness]

Temper grade	□ Type		1/2H Type	
	φ 1/2	φ 5/8	φ 3/4	φ 1-1/8
Outer diameter	φ 1/2	φ 5/8	φ 3/4	φ 1-1/8
Minimum Wall Thickness	0.80	0.99	0.80	0.99
			0.80	1.21

[Notes]

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
- Method of calculating A/C (cooling/heating) capacity:
 The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.

Calculating A/C capacity of outdoor units.

- Condition: Indoor unit combination ratio does not exceed 100%.

$$[\text{Maximum A/C capacity of outdoor units}] = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the 100\% combination}}{\times \text{Capacity change rate due to piping length to the farthest indoor unit}}$$

- Condition: Indoor unit combination ratio exceeds 100%.

$$[\text{Maximum A/C capacity of outdoor units}] = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the combination}}{\times \text{Capacity change rate due to piping length to the farthest indoor unit}}$$

- When overall equivalent pipe length is 295.3ft or more, the diameter of the main gas and liquid pipes (outdoor unit-branch sections) must be increased.
 When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.

[Diameter of above case]

Model	gas	liquid
RXYQ120, 144PYDN		φ 5/8
RXYQ120, 144PTJU	Not	φ 5/8
RXYQ240PYDN	Increased	
RXYQ240PTJU	Increased	φ 3/4

- Read cooling/heating capacity rate of change in the above figures based on the following equivalent length.


$$\text{Overall equivalent length} = (\text{Equivalent length to main pipe}) \times \text{Correction factor} + (\text{Equivalent length after branching})$$

Choose a correction factor from the following table.

- When cooling capacity is calculated : gas pipe size
- When heating capacity is calculated : liquid pipe size

Rate of change (object piping)	Correction factor	
	Standard size	Size increase
Cooling (gas pipe)	1.0	240
Heating (liquid pipe)	1.0	0.3

(Example) In case of RXYQ240PYDN

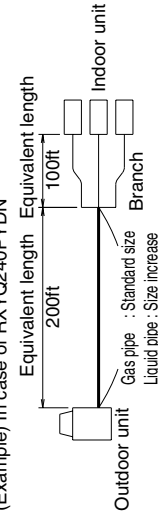


In the above case

(Cooling) Overall equivalent length = 200ft × 1.0 + 100ft = 300ft
 (Heating) Overall equivalent length = 200ft × 0.4 + 100ft = 180ft

The rate of change in cooling capacity when Hp = 0ft is thus approximately 0.88 heating capacity when Hp = 0ft is thus approximately 1.0

9. Operation Limits

RXYQ72, 96, 120, 144, 168, 192, 216, 240PTJU

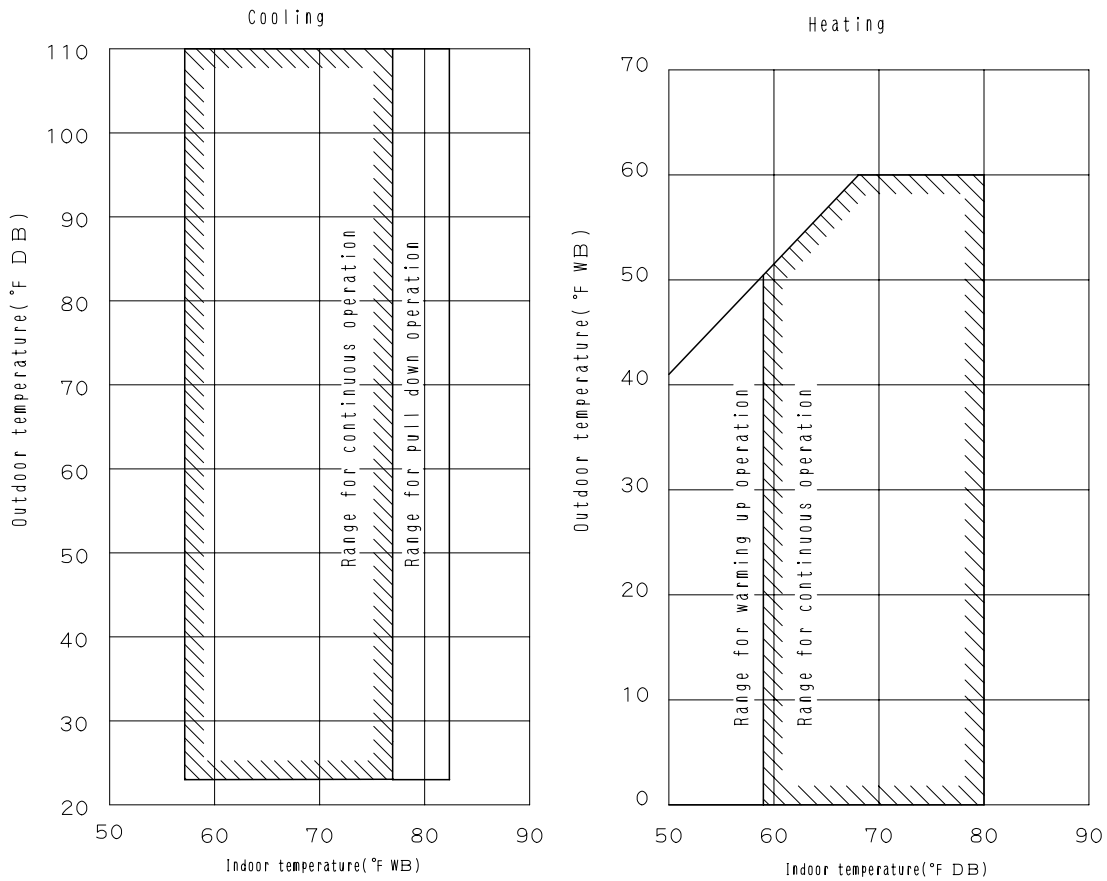

3D043026C


Notes:

- These figures assume the following operating conditions :
- Indoor and outdoor units :
- Equivalent pipe length : 25ft
- Level difference : 0ft

10. Sound Levels

Overall

Model	Power Supply	dBA
RXYQ72PTJU	60Hz/208V-230V	58
RXYQ96PTJU	60Hz/208V-230V	58
RXYQ120PTJU	60Hz/208V-230V	60
RXYQ144PTJU	60Hz/208V-230V	62
RXYQ168PTJU	60Hz/208V-230V	61
RXYQ192PTJU	60Hz/208V-230V	62
RXYQ216PTJU	60Hz/208V-230V	62
RXYQ240PTJU	60Hz/208V-230V	63

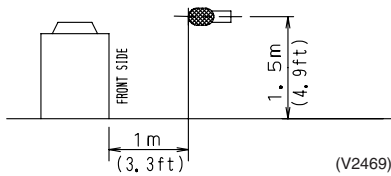

Note:


Sound level:

Anechoic chamber conversion value, measured at a point 3.3ft in front of the unit at a height of 4.9ft.


During actual operation, these values are normally somewhat higher as a result of ambient conditions.

Octave Band Level


RXYQ72PTJU

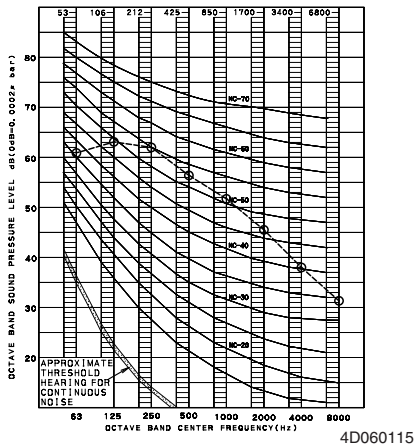


RXYQ96PTJU

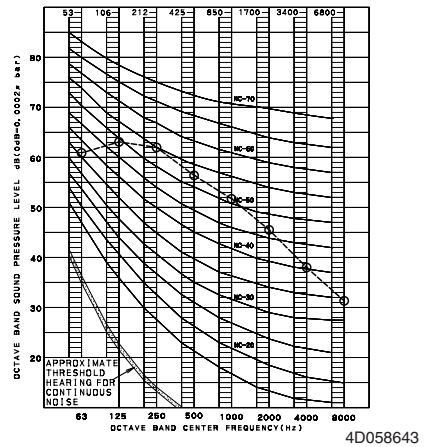

RXYQ120PTJU

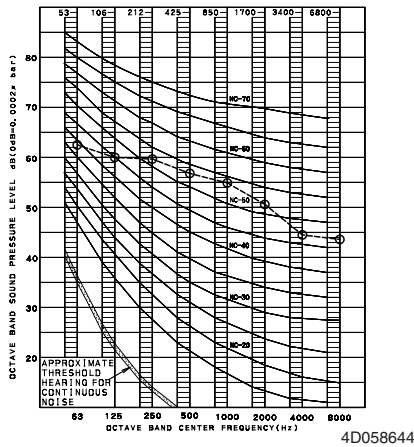



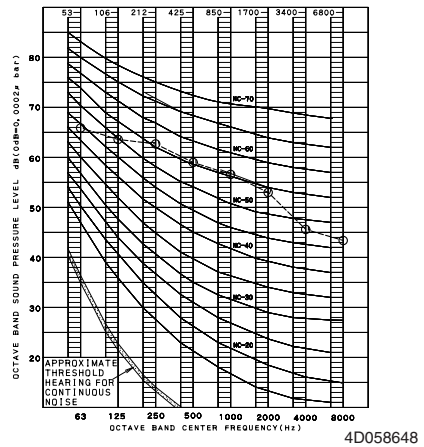



RXYQ144PTJU

















11. Accessories

Standard Accessories

RXYQ72, 96, 120, 144PTJU

Name	Clamp (1)	Clamp (2)	Clamp (3)	Vinyl tube	Conduit mounting plate		Manuals, etc.
Quantity	8 pcs. (RXYQ144PTJU is 9 pcs.)	2 pcs. RXYQ144PTJU is 3 pcs.	1 pc. RXYQ144PTJU is 0 pc.	4 pcs.	2 pcs.	2 pcs.	1 pc. about each item
Shape	 (Small)		 (Large)				<ul style="list-style-type: none"> • Operation manual • Installation manual • "REQUEST FOR THE INDICATON" label (Installation records)

Name		Liquid side accessory pipe (1)	Liquid side accessory pipe (2)	Gas side accessory pipe (1)				Gas side accessory pipe (2)	
Quantity	72P type	1 pc.	1 pc.	1 pc.	/			/	
	96P type			1 pc.	/			/	
	120P/144P type			1 pc.	1 pc.	1 pc.	1 pc.	1 pc.	1 pc.
Shape				 φ3/4	 φ7/8	 φ1	 φ1-1/8	 φ7/8	 φ1

Name		High side equalizer accessory pipe (1)	High side equalizer accessory pipe (2)	Low side equalizer accessory pipe (1)	Low side equalizer accessory pipe (2)	L type accessory joint (1)	L type accessory joint (2)
Quantity	72P type	1 pc.	1 pc.	1 pc.	1 pc.	1 pc.	2 pcs.
	96P type						
	120P/144P type						
Shape			 φ3/4	 O.D φ1	 I.D φ1	 φ1	 φ3/4

Optional Accessories (For Unit)

RXYQ72~240PTJU

Series			VRV III			
Optional accessories	Models		RXYQ72PYDN RXYQ72PTJU RXYQ96PYDN RXYQ96PTJU	RXYQ120PYDN RXYQ120PTJU RXYQ144PTJU	RXYQ144PYDN RXYQ168PYDN RXYQ168PTJU	RXYQ192PYDN RXYQ192PTJU RXYQ216PYDN RXYQ216PTJU RXYQ240PYDN RXYQ240PTJU
	Distributive piping	Refnet header	Model	KHRP26M22H (Max. 4 branch) KHRP26M33H (Max. 8 branch)	KHRP26M22H (Max. 4 branch) KHRP26M33H (Max. 8 branch) KHRP26M72H (Max. 8 branch)	
		Refnet joint	Model	KHRP26A22T KHRP26A33T	KHRP26A22T KHRP26A33T KHRP26M72TU	
Outdoor unit multi connection piping kit	Model		—			BHFP22P100U

3D060089A



- Daikin Industries, Ltd.'s products are manufactured for export to numerous countries throughout the world. Daikin Industries, Ltd. does not have control over which products are exported to and used in a particular country. Prior to purchase, please therefore confirm with your local authorized importer, distributor and/or retailer whether this product conforms to the applicable standards, and is suitable for use, in the region where the product will be used. This statement does not purport to exclude, restrict or modify the application of any local legislation.
- Ask a qualified installer or contractor to install this product. Do not try to install the product yourself. Improper installation can result in water or refrigerant leakage, electrical shock, fire or explosion.
- Use only those parts and accessories supplied or specified by Daikin. Ask a qualified installer or contractor to install those parts and accessories. Use of unauthorized parts and accessories or improper installation of parts and accessories can result in water or refrigerant leakage, electrical shock, fire or explosion.
- Read the User's Manual carefully before using this product. The User's Manual provides important safety instructions and warnings. Be sure to follow these instructions and warnings.

If you have any inquiries, please contact your local importer, distributor and/or retailer.



© 2004 Daikin Industries, Limited.

Daikin®, Daikin AC™, Absolute Comfort™, VRV® and REFNET™ are trademarks pending or registered trademarks of Daikin Industries, Limited. All rights reserved. LonWorks® and LON® are registered trademarks of Echelon Corporation. BACnet® is a Data Communication Protocol for Building Automation and Control Networks, developed under the auspices of the American Society of Heating, Refrigerating and Air-Conditioning Engineers (ASHRAE).



JMI-0107



JQA-1452

About ISO9001

ISO 9001 is a plant certification system defined by the International Organization for Standardization (ISO) relating to quality assurance. ISO 9001 certification covers quality assurance aspects related to the "design, development, manufacture, installation, and supplementary service" of products manufactured at the plant.



EC99J2044



JQA-E-90108

About ISO 14001

ISO 14001 is the standard defined by the International Organization for Standardization (ISO) relating to environmental management systems. Our group has been acknowledged by an internationally accredited compliance organisation as having an appropriate programme of environmental protection procedures and activities to meet the requirements of ISO 14001.

Dealer

DAIKIN AC (AMERICAS), INC.
 1645 Wallace Drive, Suite 110
 Carrollton, TX75006
 info@daikinac.com
 www.daikinac.com

©All rights reserved

● Specifications, designs and other content appearing in this brochure are current as of Aug. 2009 but subject to change without notice.