



EDUS 39-802A-R2_a

R-410A

Engineering Data

VRV[®] III

REYQ_PTJU

3 phase

208-230V

60Hz

DAIKIN AC (AMERICAS), INC.

REYQ-P (3 ϕ 208-230V 60Hz) Heat Recovery

1. Specifications	2
2. Dimensions	5
3. Service Space	8
4. Piping Diagrams	9
5. Wiring Diagrams	13
6. Field Wiring	17
7. Electric Characteristics	19
8. Capacity Tables (Reference Data)	21
8.1 Cooling Capacity (REYQ-PTJU)	21
8.2 Heating Capacity (REYQ-PTJU)	29
8.3 Capacity Correction Factor	45
9. Operation Limits	53
10. Sound Levels	54
11. Accessories	55

1. Specifications

Model Name		REYQ72PTJU	REYQ96PTJU	REYQ120PTJU
Power Supply		3 Phase 60Hz 208V-230V	3 Phase 60Hz 208V-230V	3 Phase 60Hz 208V-230V
★1 Cooling Capacity	Btu / h	72,000	96,000	120,000
★2 Heating Capacity	Btu / h	81,000	108,000	135,000
Casing Color		Ivory White (5Y7.5/1)	Ivory White (5Y7.5/1)	Ivory White (5Y7.5/1)
Dimensions: (HxWxD)	in (mm)	66-1/8 x 51-3/16 x 30-1/8" (1680 x 1300.2 x 765 mm)	66-1/8 x 51-3/16 x 30-1/8" (1680 x 1300.2 x 765 mm)	66-1/8 x 51-3/16 x 30-1/8" (1680 x 1300.2 x 765 mm)
Heat Exchanger		Cross Fin Coil	Cross Fin Coil	Cross Fin Coil
Comp.	Type	Hermetically Sealed Scroll Type	Hermetically Sealed Scroll Type	Hermetically Sealed Scroll Type
	Piston Displacement	m ³ /h	7.88+10.53	13.34+10.53
	Number of Revolutions	r.p.m	3720, 2900	6300, 2900
	Motor Output×Number of Units	kW	(1.0+4.5) × 1	(2.2+4.5) × 1
Starting Method		Soft Start	Soft Start	Soft Start
Fan	Type	Propeller Fan	Propeller Fan	Propeller Fan
	Motor Output	kW	(0.35) × 2	(0.35) × 2
	Air Flow Rate	cfm	6,700	6,700
	Drive		Direct Drive	Direct Drive
Connecting Pipes	Liquid Pipe	in (mm)	φ 3/8" (9.5 mm) C1220T (Brazing Connection)	φ 1/2" (12.7 mm) C1220T (Brazing Connection)
	Suction Gas Pipe	in (mm)	φ 3/4" (19.1 mm) C1220T (Brazing Connection)	φ 7/8" (22.2 mm) C1220T (Brazing Connection)
	High and Low Pressure Gas Pipe	in (mm)	φ 5/8" (15.8 mm) C1220T (Brazing Connection)	φ 3/4" (19.1 mm) C1220T (Brazing Connection)
Mass	Lbs (kg)	730 (331 kg)	730 (331 kg)	730 (331 kg)
★3 Sound Level (Reference Value)	dBA	58	58	60
Safety Devices		High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector	High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector	High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector
Defrost Method		Deicer	Deicer	Deicer
Capacity Control	%	20~100	14~100	14~100
Refrigerant	Refrigerant Name		R-410A	R-410A
	Charge	Lbs	22.7	23.4
	Control		Electronic Expansion Valve	Electronic Expansion Valve
Standard Accessories		Installation Manual, Operation Manual, Connection Pipes, Clamps	Installation Manual, Operation Manual, Connection Pipes, Clamps	Installation Manual, Operation Manual, Connection Pipes, Clamps
Drawing No.		4D058609	4D058610	4D058611

Notes:

- ★1 Indoor temp. : 80°FDB or 67°FWB / outdoor temp. : 95°FDB / Equivalent piping length : 25 ft (7.5 m), evel difference: 0 ft.
- ★2 Indoor temp. : 70°FDB / outdoor temp. : 47°FDB or 43°FWB / Equivalent piping length : 25 ft (7.5 m), evel difference: 0 ft.
- ★3 Anechoic chamber conversion value, measured under JISB8616 conditions. During actual operation, these values are normally somewhat higher as a result of ambient conditions.

Model Name (Combination Unit)		REYQ144PTJU	REYQ168PTJU	REYQ192PTJU
Model Name (Independent Unit)		—	REM72PTJU REM96PTJU	REM72PTJU REM120PTJU
Power Supply		3 Phase 60Hz 208V-230V	3 Phase 60Hz 208V-230V	3 Phase 60Hz 208V-230V
★1 Cooling Capacity	Btu / h	144,000	168,000	192,000
★2 Heating Capacity	Btu / h	162,000	189,000	216,000
Casing Color		Ivory White (5Y7.5/1)	Ivory White (5Y7.5/1)	Ivory White (5Y7.5/1)
Dimensions: (HxWxD)	in (mm)	66-1/8 × 51-3/16 × 30-1/8" (1680 × 1300 × 765 mm)	66-1/8 × 36-5/8 × 30-1/8" (1680 × 930 × 765 mm) + 66-1/8 × 36-5/8 × 30-1/8" (1680 × 930 × 765 mm)	66-1/8 × 36-5/8 × 30-1/8" (1680 × 930 × 765 mm) + 66-1/8 × 36-5/8 × 30-1/8" (1680 × 930 × 765 mm)
Heat Exchanger		Cross Fin Coil	Cross Fin Coil	Cross Fin Coil
Comp.	Type	Hermetically Sealed Scroll Type	Hermetically Sealed Scroll Type	Hermetically Sealed Scroll Type
	Piston Displacement	m ³ /h	16.90+16.90	16.90 + (10.53+13.34)
	Number of Revolutions	r.p.m	7980, 7980	7980, (2900, 6300)
	Motor Output×Number of Units	kW	(3.8+3.8) × 1	(4.7) × 1 + (2.2+4.5) × 1
	Starting Method		Direct on Line	Soft Start
Fan	Type	Propeller Fan	Propeller Fan	Propeller Fan
	Motor Output	kW	0.75 × 2	(0.75) × 1 + (0.75) × 1
	Air Flow Rate	cfm	8,299	6,350+6,530
	Drive		Direct Drive	Direct Drive3
Connecting Pipes	Liquid Pipe	in (mm)	φ1/2" (12.7 mm) C1220T (Brazeing Connection) ★3	φ5/8" (15.9 mm) C1220T (Brazeing Connection) ★3
	Suction Gas Pipe	in (mm)	φ 1-1/8" (28.6 mm) C1220T (Brazeing Connection) ★3	φ 1-1/8" (28.6 mm) C1220T (Brazeing Connection) ★3
	High and Low Pressure Gas Pipe	in (mm)	φ 7/8" (22.2 mm) C1220T (Brazeing Connection) ★3	φ 1-1/8" (28.6 mm) C1220T (Brazeing Connection) ★3
	Pressure Equalizer Tube	in (mm)	—	φ 3/4" (19.1 mm) C1220T (Brazeing Connection)
Mass	Lbs (kg)	747 lbs (229 kg)	450+560 lbs (204 + 254 kg)	450+560 lbs (204 + 254 kg)
★4 Sound Level (Reference Value)	dBA	61	—	—
Safety Devices		High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector	High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector	High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector
Defrost Method		Deicer	Deicer	Deicer
Capacity Control	%	10~100	9~100	7~100
Refrigerant	Refrigerant Name	R-410A	R-410A	R-410A
	Charge	Lbs	24.5	18.1+19.8
	Control		Electronic Expansion Valve	Electronic Expansion Valve
Standard Accessories		Installation Manual, Operation Manual, Connection Pipes, Clamps	Installation Manual, Operation Manual, Connection Pipes, Clamps	Installation Manual, Operation Manual, Connection Pipes, Clamps
Drawing No.		4D058612	4D060122	4D060123

Notes:

- ★1 Indoor temp. : 80°FDB or 67°FWB / outdoor temp. : 95°FDB / Equivalent piping length : 25 ft (7.5 m), level difference: 0 ft.
- ★2 Indoor temp. : 70°FDB / outdoor temp. : 47°FDB or 43°FWB / Equivalent piping length : 25 ft (7.5 m), level difference: 0 ft.
- ★3 BHFP26P90U is necessary for the connection.
Concerning about the piping connection for each outdoor unit to the main line as shown above, use REFNET.
- ★4 Anechoic chamber conversion value, measured under JISB8616 conditions. During actual operation, these values are normally somewhat higher as a result of ambient conditions.

Model Name (Combination Unit)		REYQ216PTJU		REYQ240PTJU		
Model Name (Independent Unit)		REM96PTJU REM9120PTJU		REM120PTJU REM9120PTJU		
Power Supply		3 Phase 60Hz 208V-230V		3 Phase 60Hz 208V-230V		
★1 Cooling Capacity	Btu / h	216,000		240,000		
★2 Heating Capacity	Btu / h	243,000		270,000		
Casing Color		Ivory White (5Y7.5/1)		Ivory White (5Y7.5/1)		
Dimensions: (H×W×D)	in (mm)	66-1/8 × 36-5/8 × 30-1/8" (1680 × 930 × 765 mm) + 66-1/8 × 36-5/8 × 30-1/8" (1680 × 930 × 765 mm)		66-1/8 × 36-5/8 × 30-1/8" (1680 × 930 × 765 mm) + 66-1/8 × 36-5/8 × 30-1/8" (1680 × 930 × 765 mm)		
Heat Exchanger		Cross Fin Coil		Cross Fin Coil		
Comp.	Type	Hermetically Sealed Scroll Type		Hermetically Sealed Scroll Type		
	Piston Displacement	m ³ /h	(10.53+13.34) × 2		(10.53+13.34) × 2	
	Number of Revolutions	r.p.m	(2900, 6300) × 2		(2900, 6300) × 2	
	Motor Output×Number of Units	kW	(2.2+4.5) × 1 + (3.5+4.5) × 1		(3.5+4.5) × 2	
Starting Method		Soft Start		Soft Start		
Fan	Type	Propeller Fan		Propeller Fan		
	Motor Output	kW	(0.75) × 1 + (0.75) × 1		(0.75) × 1 + (0.75) × 1	
	Air Flow Rate	cfm	6,530+7,060		7,060+7,060	
	Drive	Direct Drive		Direct Drive		
Connecting Pipes	Liquid Pipe ★3	in (mm)	φ5/8" (15.9 mm) C1220T (Brazing Connection)		φ5/8" (15.9 mm) C1220T (Brazing Connection)	
	Suction Gas Pipe ★3	in (mm)	φ 1-1/8" (28.6 mm) C1220T (Brazing Connection)		φ 1-3/8" (34.9 mm) C1220T (Brazing Connection)	
	High and Low Pressure Gas Pipe ★3	in (mm)	φ 1-1/8" (28.6 mm) C1220T (Brazing Connection)		φ 1-1/8" (28.6 mm) C1220T (Brazing Connection)	
	Pressure Equalizer Tube	in (mm)	φ 3/4" (19.1 mm) C1220T (Brazing Connection)		φ 3/4" (19.1 mm) C1220T (Brazing Connection)	
Mass	Lbs (kg)	560+560 lbs (254 + 254 kg)		560+560 lbs (254 + 254 kg)		
Safety Devices		High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector		High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector		
Defrost Method		Deicer		Deicer		
Capacity Control	%	7~100		6~100		
Refrigerant	Refrigerant Name	R-410A		R-410A		
	Charge	Lbs	19.8+20.1		20.1+20.1	
	Control	Electronic Expansion Valve		Electronic Expansion Valve		
Standard Accessories		Installation Manual, Operation Manual, Connection Pipes, Clamps		Installation Manual, Operation Manual, Connection Pipes, Clamps		
Drawing No.		4D060124		4D060125		






Notes:

- ★1 Indoor temp. : 80°FDB or 67°FWB / outdoor temp. : 95°FDB / Equivalent piping length : 25 ft (7.5 m), evel difference: 0 ft.
★2 Indoor temp. : 70°FDB / outdoor temp. : 47°FDB or 43°FWB / Equivalent piping length : 25 ft (7.5 m), evel difference: 0 ft.
★3 BHFP26P90U is necessary for the connection.
Concerning about the piping connection for each outdoor unit to the main line as shown above, use REFNET.

2. Dimensions

REYQ72, 96, 120, 144PTJU

- Notes)
1. For piping connection method (front and bottom sides), see the installation manual.
 2. High and low pressure gas pipe
 φ 5/8 Brazing connection...REYQ72P
 φ 3/4 Brazing connection...REYQ96, 120P
 φ 7/8 Brazing connection...REYQ144PT
 Gas pipe
 φ 1-1/8 Brazing connection...RXVQ72PT
 Suction gas pipe
 φ 3/4 Brazing connection...REYQ72P
 φ 7/8 Brazing connection...REYQ96P
 φ 1-1/8 Brazing connection...REYQ120, 144PT
 Liquid pipe
 φ 3/8 Brazing connection...REYQ72, 96P
 φ 1/2 Brazing connection...REYQ120, 144PT, RXYQ144PT
 3. *shows the dimensions after fixing the accessory pipes.

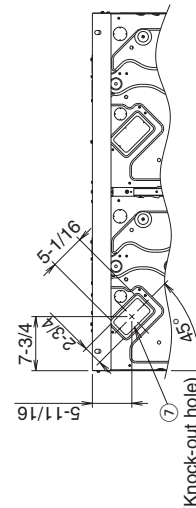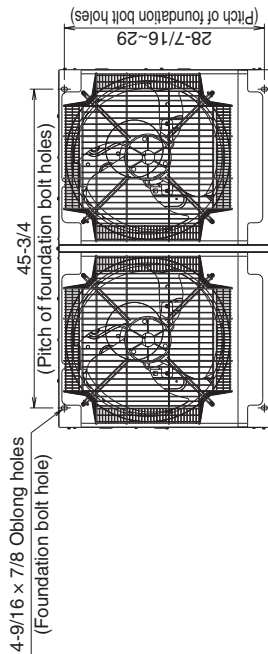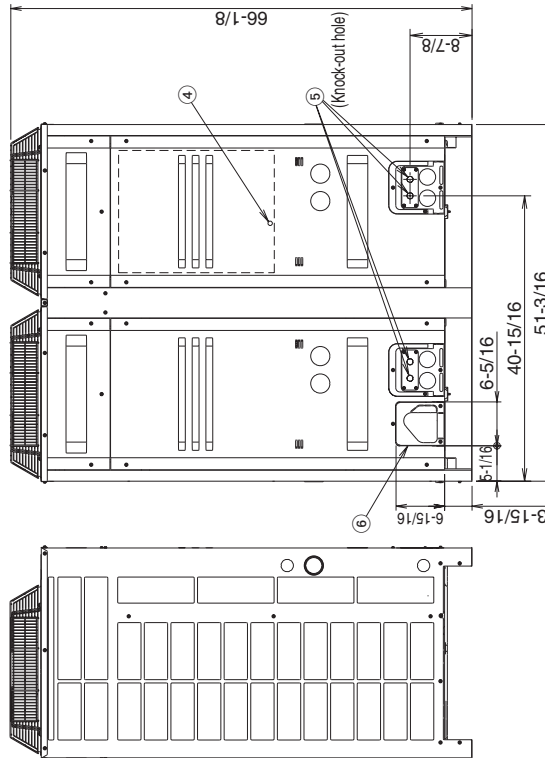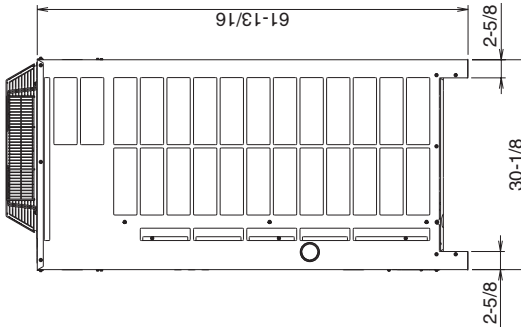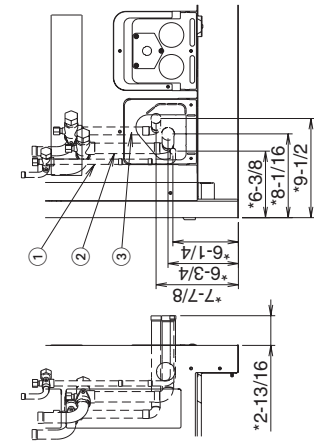

7	Pipe routing hole (bottom)	See note 1.
6	Pipe routing hole (front)	See note 1.
5	Power cord routing hole (front)	φ 7/8
4	Grounding terminal	Inside of el. compo. box (M8)
3	High and low pressure gas pipe connection port	See note 2.
2	Suction gas pipe connection port	See note 2.
1	Liquid pipe connection port	See note 2.
No.	Parts name	Remarks

3D058618A

REM72, 96, 120PTJU

Notes

1. For piping connection method (front and bottom sides), see the installation manual.

2. High and low pressure gas pipe

φ 3/4 Brazing connection...REM72P

φ 3/4 Brazing connection...REM96, 120P

Suction gas pipe

φ 3/4 Brazing connection...REM72P


φ 7/8 Brazing connection...REM96P

φ 1-1/8 Brazing connection...REM120P



Liquid pipe

φ 3/8 Brazing connection...REM72, 96P

φ 1/2 Brazing connection...REM120P

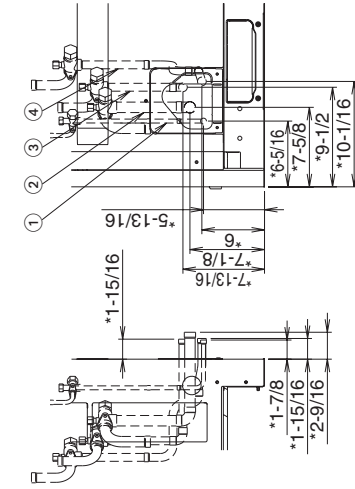



[DETAIL FOR FRONT SIDE]

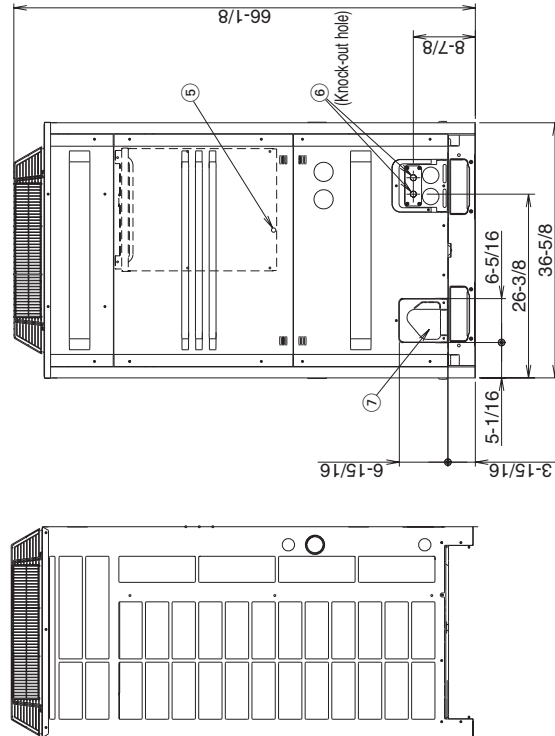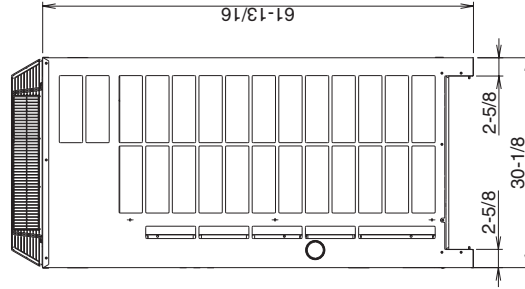


[DETAIL FOR BOTTOM SIDE]

9	Pipe routing hole (bottom)	φ 1-15/16	See note 1.
8	Pipe routing hole (bottom)		See note 1.
7	Pipe routing hole (front)		See note 1.
6	Power cord routing hole (front)	φ 7/8	
5	Grounding terminal		Inside of el. compo. box (M8)
4	Pressure equalizer pipe connection port		φ 3/4 Brazing connection
3	High and low pressure gas pipe connection port		See note 2.
2	Suction gas pipe connection port		See note 2.
1	Liquid pipe connection port		See note 2.
No.	Parts name		Remarks

3D058617

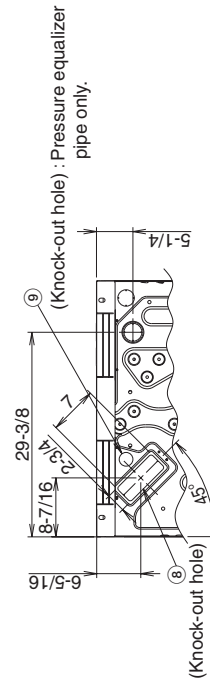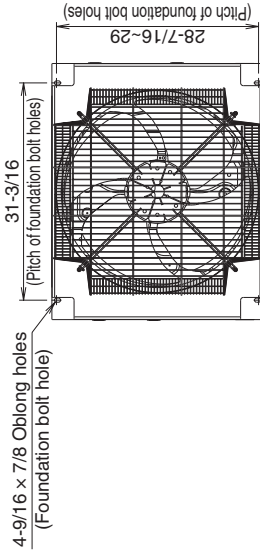

REYQ168, 192, 216, 240PTJU

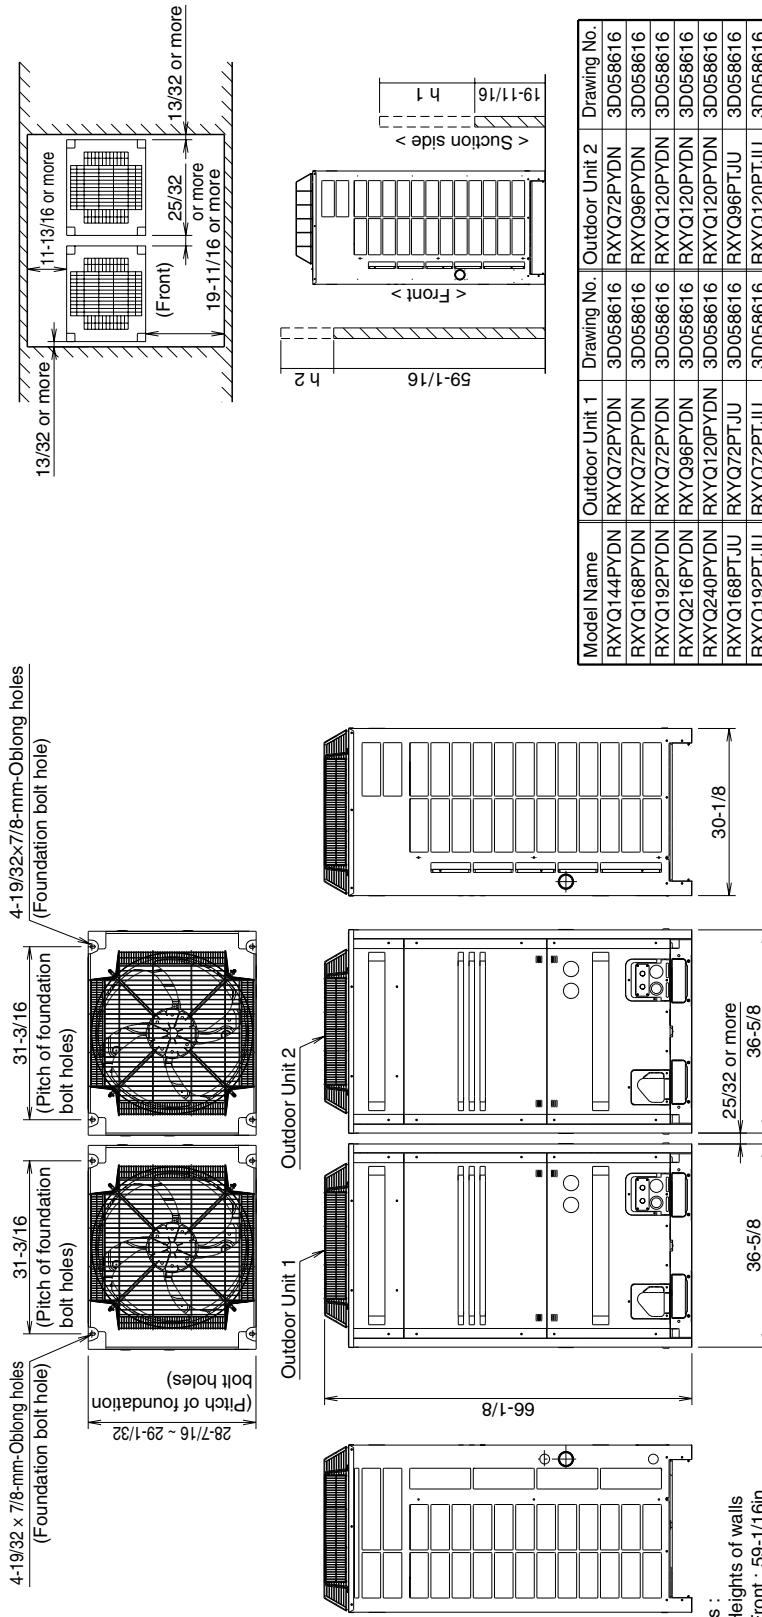


Model Name	Outdoor Unit 1	Outdoor Unit 2	Drawing No.
RXYQ144PYDN	RXYQ72PYDN	RXYQ72PYDN	3D058616
RXYQ168PYDN	RXYQ72PYDN	RXYQ96PYDN	3D058616
RXYQ192PYDN	RXYQ72PYDN	RXYQ120PYDN	3D058616
RXYQ216PYDN	RXYQ96PYDN	RXYQ120PYDN	3D058616
RXYQ240PYDN	RXYQ120PYDN	RXYQ120PYDN	3D058616
RXYQ168PTJU	RXYQ72PTJU	RXYQ96PTJU	3D058616
RXYQ192PTJU	RXYQ72PTJU	RXYQ120PTJU	3D058616
RXYQ240PTJU	RXYQ96PTJU	RXYQ120PTJU	3D058616
REYQ144PYDN	REMQ72PYDN	REMQ72PYDN	3D058617
REYQ168PYDN	REMQ72PYDN	REMQ96PYDN	3D058617
REYQ216PYDN	REMQ96PYDN	REMQ120PYDN	3D058617
REYQ240PYDN	REMQ120PYDN	REMQ120PYDN	3D058617
REYQ168PTJU	REMQ72PTJU	REMQ96PTJU	3D058617
REYQ192PTJU	REMQ72PTJU	REMQ120PTJU	3D058617
REYQ216PTJU	REMQ96PTJU	REMQ120PTJU	3D058617
REYQ240PTJU	REMQ120PTJU	REMQ120PTJU	3D058617

- Notes :
1. Heights of walls
Front : 59'-1/16in
Suction side : 19'-11/16in
Side : Height unrestricted
 - The installation space shown in this figure is based on the condition of cooling operation at the outdoor air temperature of 95°F.
 - The installation space of suction side shown above must be expanded in the following case.
 - Design outdoor temperature becomes over 95°F.
 - Operating over Max. operating load (In case of causing a heavy heating load at indoor unit side)
 2. If the above wall heights are exceeded then h2/2 and h1/2 should be added to the front and suction side service spaces respectively as shown in the following figure.
 3. When installing the units the most appropriate pattern should be selected from those shown above in order to obtain the best fit in the space available always bearing in mind the need to leave enough room for a person to pass between units and wall and for the air to circulate freely. (If more units are to be installed than are catered for in the above patterns your layout should take account of the possibility of short circuits.)
 4. The units should be installed to leave sufficient space at the front for the on site refrigerant piping work to be carried out comfortably.

3D058617

3. Service Space

REYQ72, 96, 120, 144, 168, 192, 216, 240PTJU

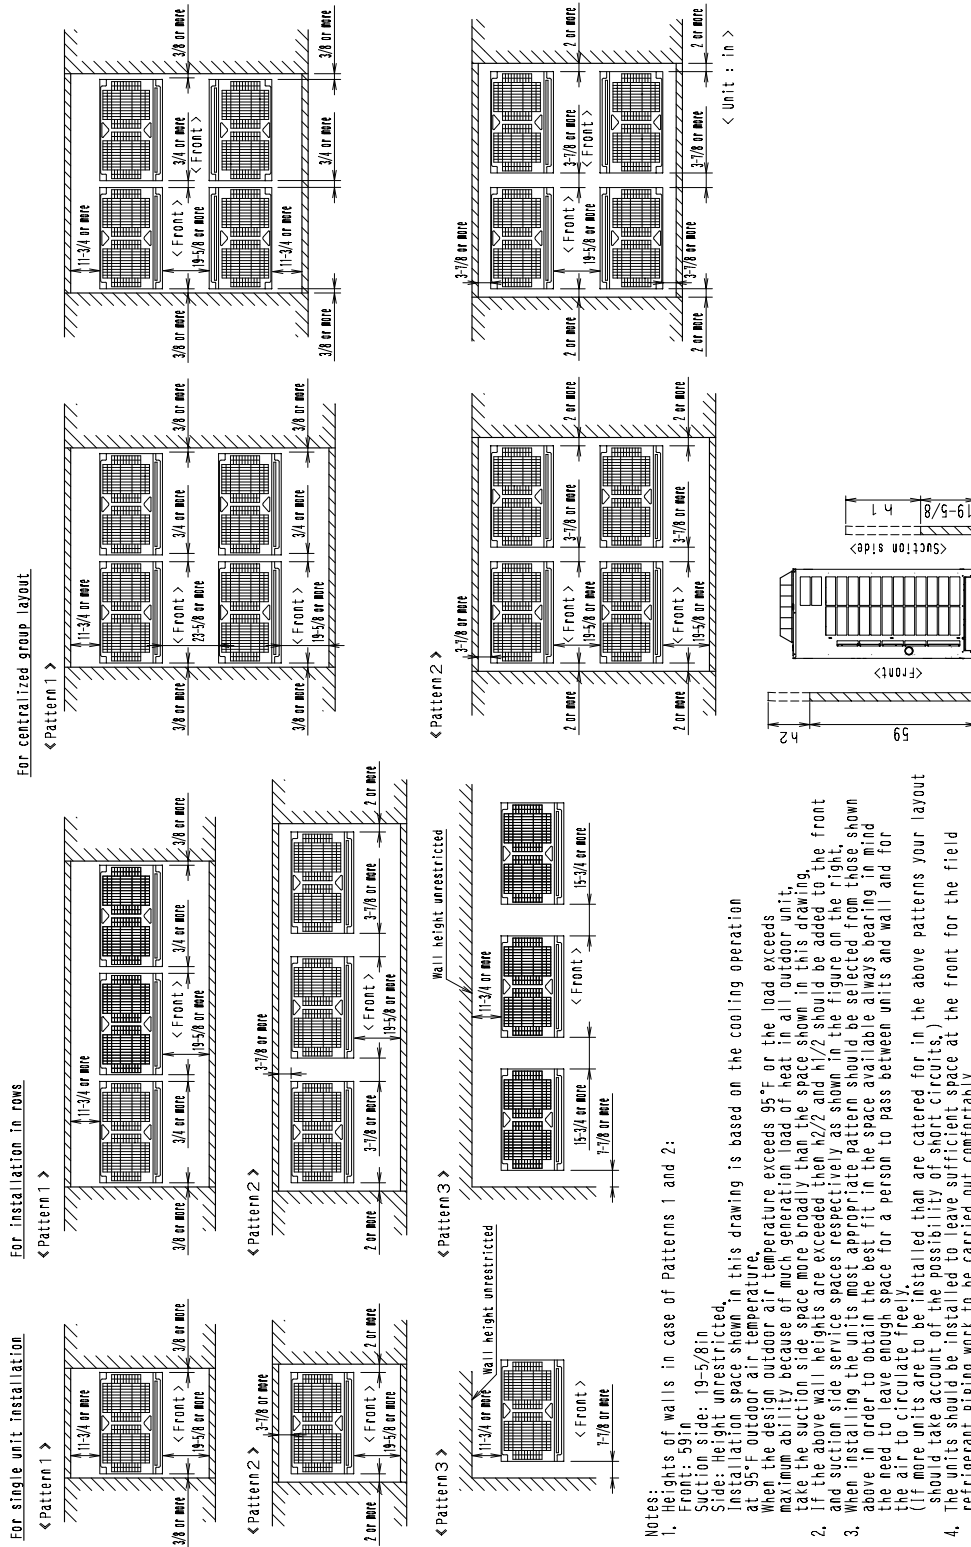


- Notes:
1. Heights of walls in case of Patterns 1 and 2:
 Front: 59 in
 Suction side: 19-5/8 in
 Side: Height unrestricted
 Installation space shown in this drawing is based on the cooling operation at 95°F outdoor air temperature. When the design outdoor air temperature exceeds 95°F or the load exceeds maximum ability because of much generation load of heat in all outdoor unit, take the suction side space more broadly than the space shown in this drawing.
 2. If the above wall heights are exceeded then h/2 and h/2 should be added to the front and suction side service spaces respectively as shown in the figure on the right.
 3. When installing the units most appropriate pattern should be selected from those shown above in order to obtain the best fit in the space available always bearing in mind the need to leave enough space for a person to pass between units and wall and for the air to circulate freely.
 (If more units are to be installed than are catered for in the above patterns your layout should take account of the possibility of short circuits.)
 4. The units should be installed to leave sufficient space at the front for the field refrigerant piping work to be carried out comfortably.

3D058620

4. Piping Diagrams


REYQ72, 96, 120PTJU

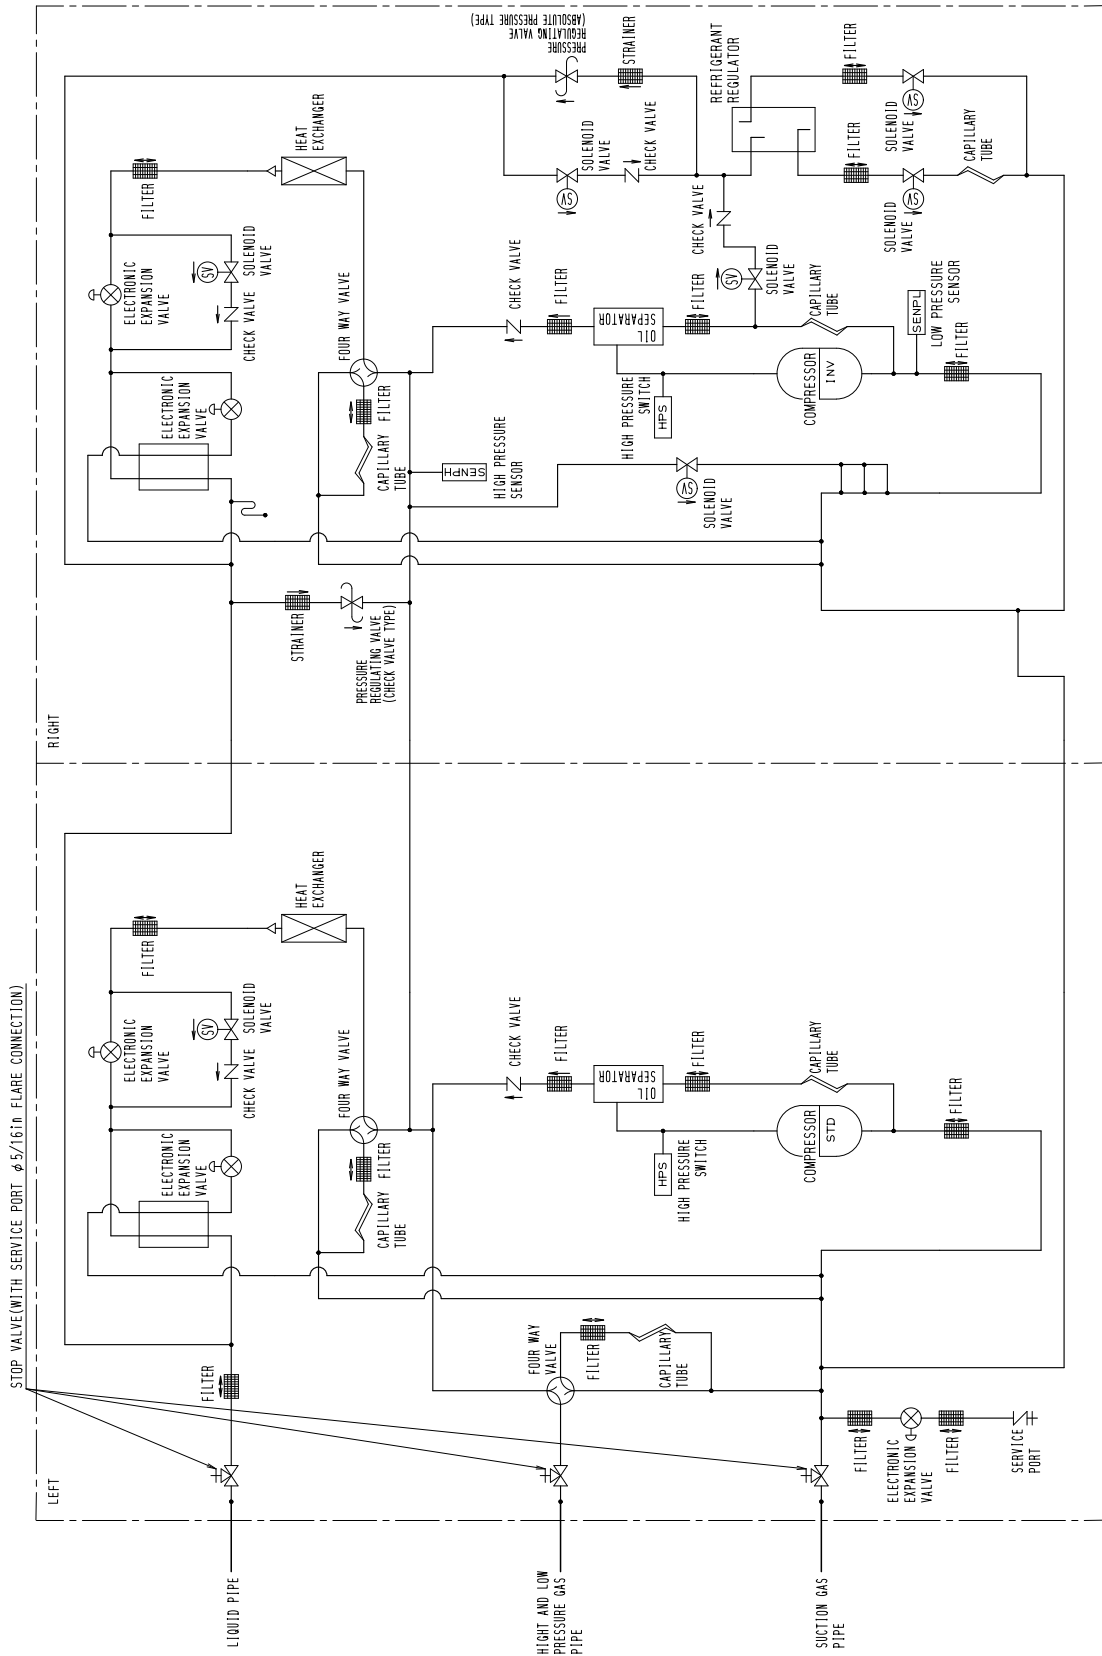


3D058639A

REYQ144PTJU

3D058640

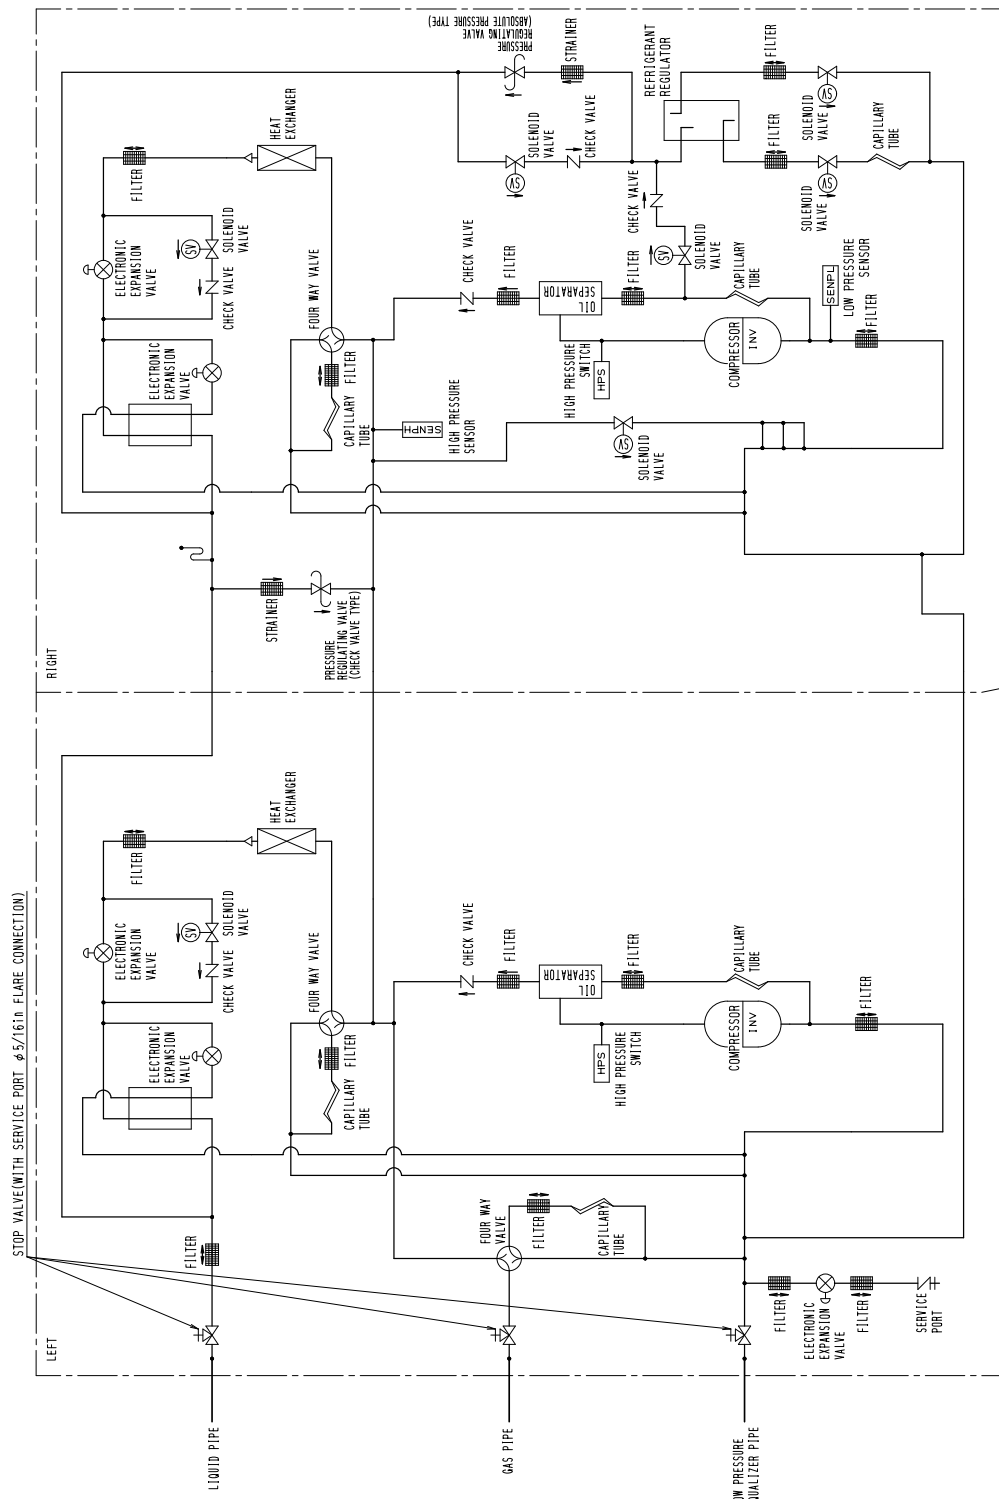


REM72PTJU

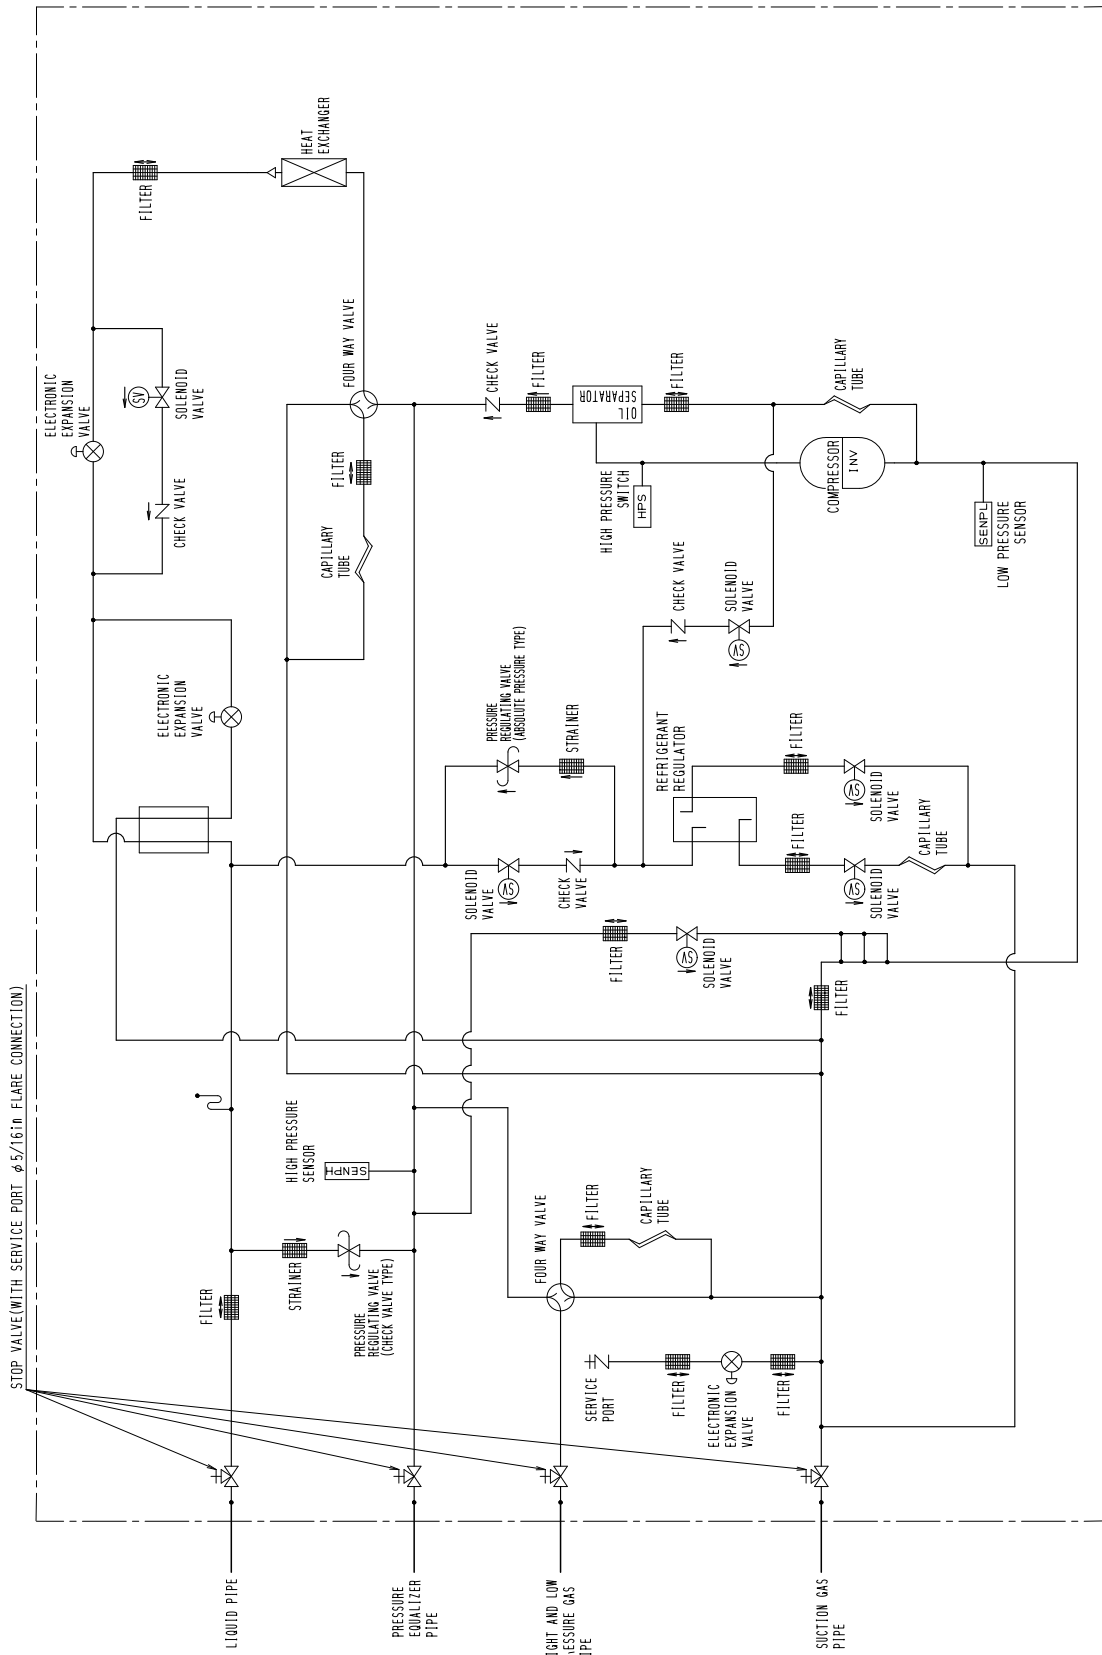

3D058637A



REM96, 120PTJU

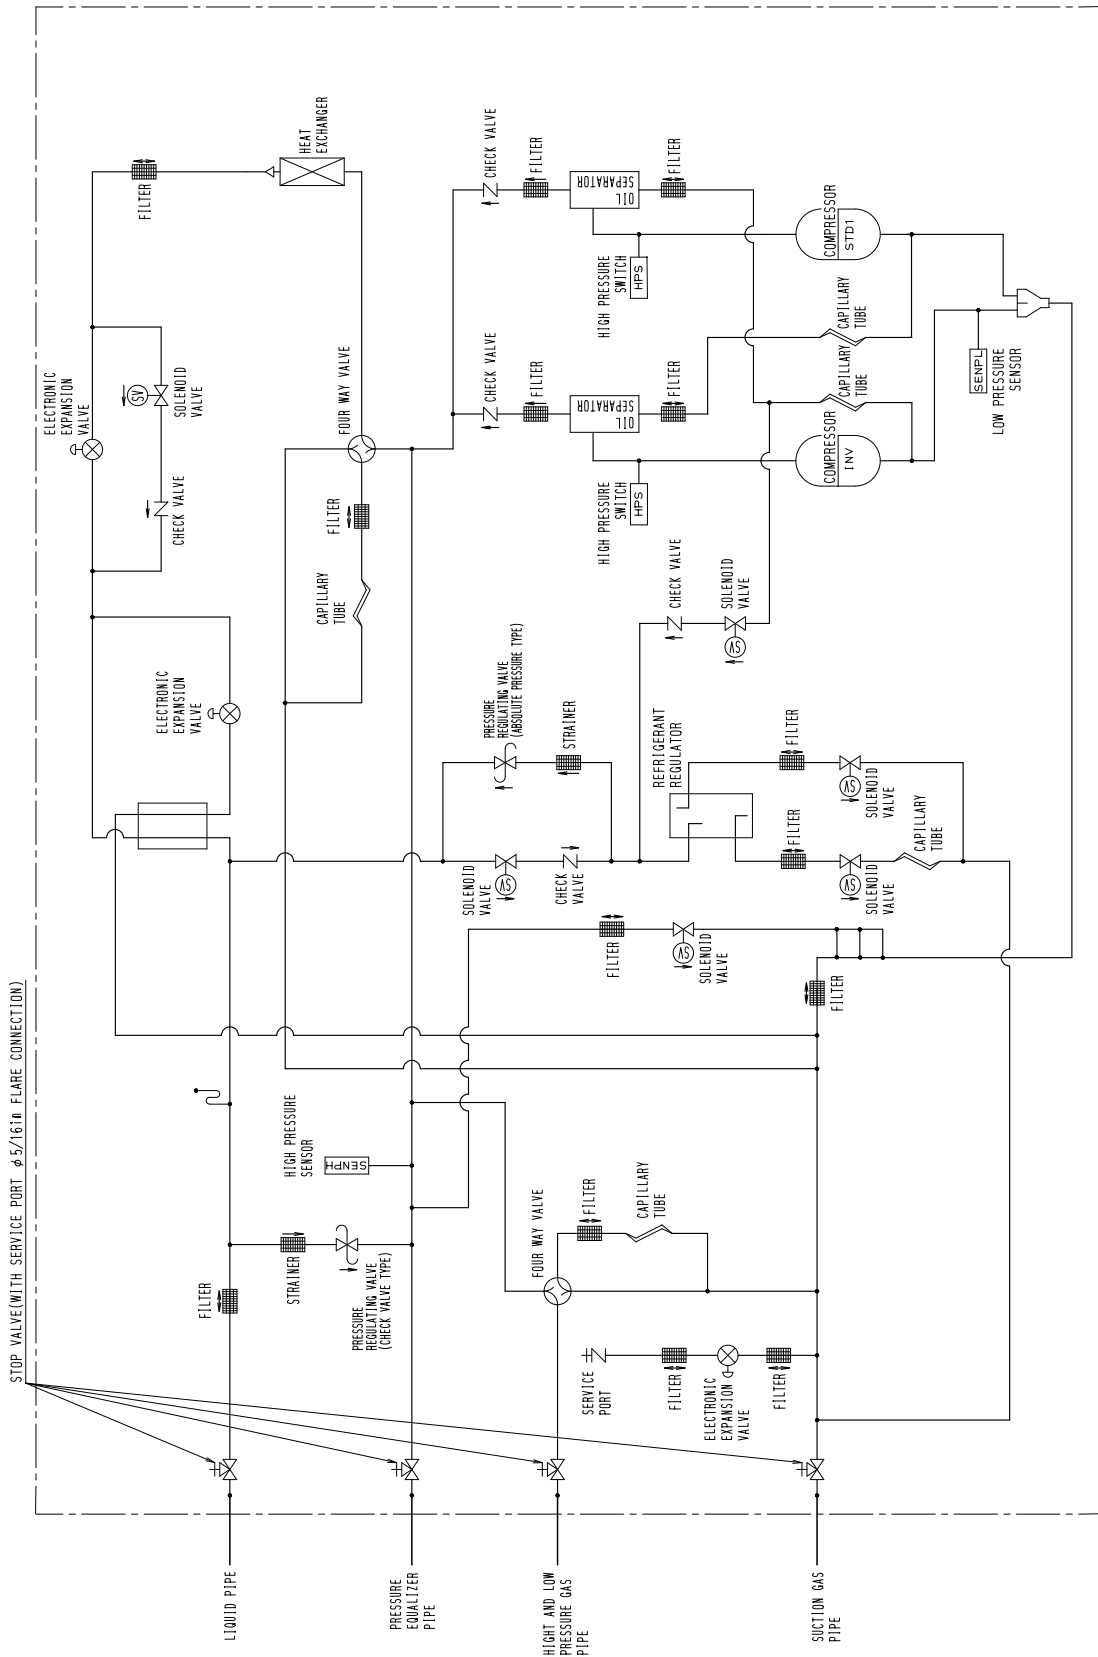

3D058638A

5. Wiring Diagrams


REYQ72, 96, 120PTJU

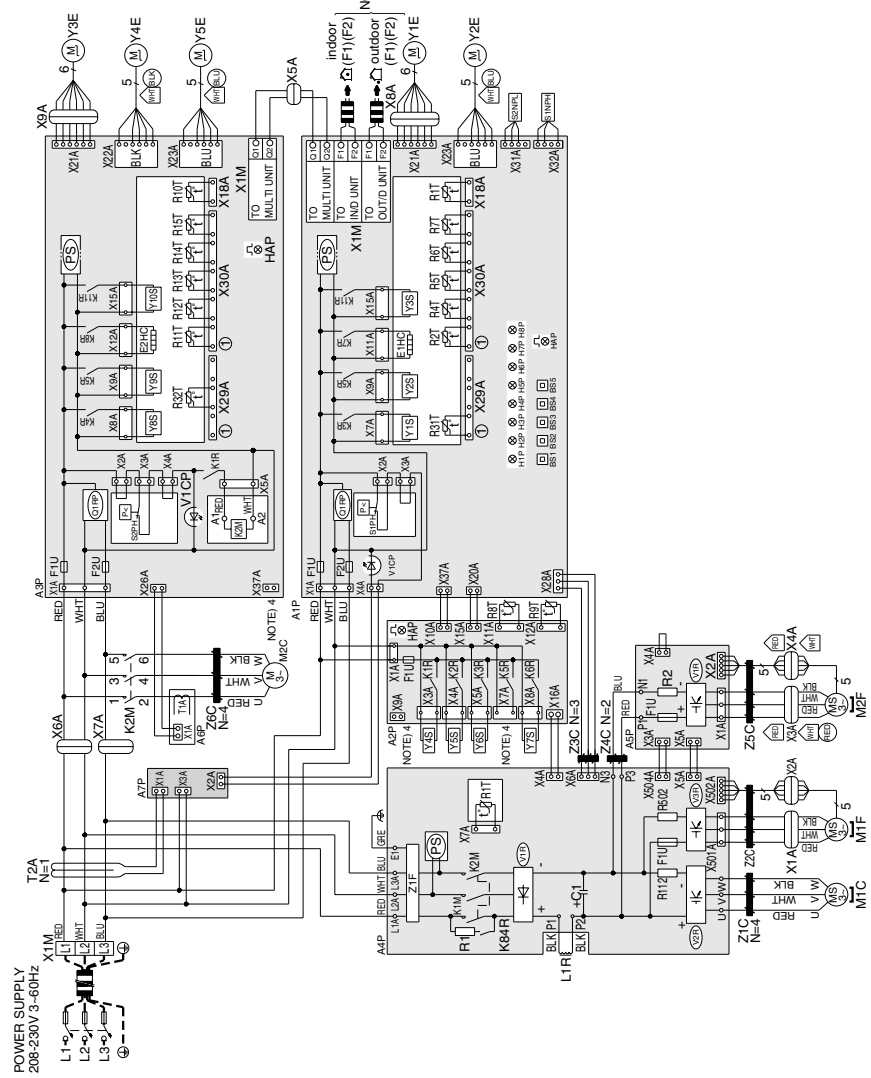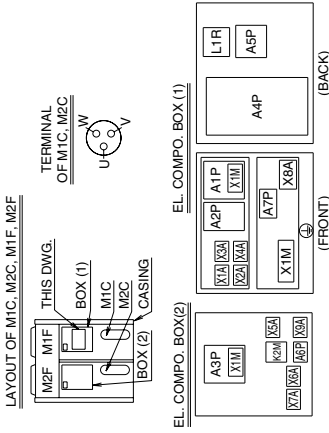

- NOTES)
1. THIS WIRING DIAGRAM IS APPLIED ONLY TO THE OUTDOOR UNIT.
 2. : TERMINAL STRIP : CONNECTOR : TERMINAL
 3. : FIELD WIRING
 4. : PROTECTIVE EARTH (SCREW)
 5. WHEN USING THE OPTIONAL ADAPTOR, REFER TO THE INSTALLATION MANUAL OF THE OPTIONAL ADAPTOR. FOR CONNECTION WIRING TO INDOOR-OUTDOOR TRANSMISSION F1 · F2, OUTDOOR-MULTI TRANSMISSION Q1 · Q2, REFER TO THE INSTALLATION MANUAL.
 6. HOW TO USE BS1-5 AND DS1 · 2 SWITCH, REFER TO "SERVICE PRECAUTION" LABEL ON EL. COMPO. BOX COVER.
 7. WHEN OPERATING, DON'T SHORTCIRCUIT THE PROTECTION DEVICE (S1, 2PH).
 8. , , SYMBOLS INDICATE COLORS OF EACH PARTS AS SHOWN BELOW.
 - : IS CONNECTOR COLOR FOR PRINTED CIRCUIT BOARD.
 - : * IS CONNECTOR COLOR FOR COMPONENT.
 - : IS IDENTIFICATION COLOR FOR COMPONENT LEAD WIRE.
 9. COLORS BLK : BLACK RED : RED BLU : BLUE WHT : WHITE.

A1P	PRINTED CIRCUIT BOARD (MAIN)	K1M	MAGNETIC RELAY (A4P)	R12T	THERMISTOR (HEAT EXC. DEICER 2) (A3P)	Y4E	ELECTRONIC EXPANSION VALVE (CHARGE) (A3P)
A2P	PRINTED CIRCUIT BOARD (SUB)	K2M	MAGNETIC CONTACTOR (M1C) (A4P)	R13T	THERMISTOR (SUB COOL. HEAT EXC. GAS 2) (A3P)	Y5E	ELECTRONIC EXPANSION VALVE (SUBCOOL. 2) (A3P)
A3P	PRINTED CIRCUIT BOARD (MAIN)	K2M	MAGNETIC RELAY (M2C)	R14T	PHASE REVERSAL DETECT CIRCUIT (A1P) (A3P)	Y1S	SOLENOID VALVE (RMTG) (A1P)
A4P	PRINTED CIRCUIT BOARD (INV. FAN)	K1R	MAGNETIC RELAY (Y4S) (A2P)	R15T	RESISTOR (CURRENT LIMITING) (A4P)	Y2S	SOLENOID VALVE (4 WAY VALVE) HEAT EXC. 1 (A1P)
A6P	PRINTED CIRCUIT BOARD (FAN)	K1R	MAGNETIC RELAY (K2M) (A3P)	R1	RESISTOR (CURRENT SENSOR) (A5P)	Y3S	SOLENOID VALVE (RMTLU) (A1P)
A7P	PRINTED CIRCUIT BOARD (CURRENT SENSOR)	K2R	MAGNETIC RELAY (Y5S) (A2P)	R2	RESISTOR (CURRENT SENSOR) (A4P)	Y4S	SOLENOID VALVE (HOT GAS) (A2P)
BS1-5	PUSH BUTTON SWITCH (MODE. SET, RETURN, TEST, RESET) (A1P)	K3R	MAGNETIC RELAY (Y5S) (A2P)	R02	RESISTOR (CURRENT SENSOR) (A4P)	Y5S	SOLENOID VALVE (EV BYPASS 1) (A2P)
C1	CAPACITOR	K4R	MAGNETIC RELAY (Y6S) (A2P)	R1T	THERMISTOR (FAN) (A1P)	Y7S	SOLENOID VALVE (RMTT) (A3P)
EHC	CRANKCASE HEATER (A1P)	K5R	MAGNETIC RELAY (Y2S) (A1P)	R1T	THERMISTOR (FAN) (A1P)	Y7S	SOLENOID VALVE (RMTT) (A3P)
EHC	CRANKCASE HEATER (A3P)	K5R	MAGNETIC RELAY (FOR OPTION) (A2P)	R2T	THERMISTOR (HEAT EXC. GAS 1) (A1P)	Y6S	SOLENOID VALVE (4 WAY VALVE) (PPE) (A3P)
F1U	FUSE (T. 3.15A, 250V) (A1P) (A3P)	K6R	MAGNETIC RELAY (Y7S) (A2P)	R2T	THERMISTOR (M2C DISCHARGE) (A3P)	Y6S	SOLENOID VALVE (4 WAY VALVE) HEAT EXC. 2 (A3P)
F1U	FUSE (T. 3.15A, 250V) (A2P)	K7R	MAGNETIC RELAY (E1HC) (A1P)	R4T	THERMISTOR (HEAT EXC. DEICER 1) (A3P)	Y10S	SOLENOID VALVE (EV BYPASS 2) (A3P)
F1U	FUSE (16A, DC480V) (A4P) (A5P)	K8R	MAGNETIC RELAY (E2HC) (A1P)	R6T	THERMISTOR (SUB COOL. HEAT EXC. GAS 1) (A1P)	Z1C-RC	NOISE FILTER (FERRITE CORE)
H1P-4P	PLOT LAMP (SERVICE MONITOR - ORANGE) (A1P) [H1P] PREPARE TEST.....FLUCKERING MALFUNCTION DETECTION - LIGHT UP	K11R	MAGNETIC RELAY (Y3S) (A3P)	R7T	THERMISTOR (HEAT EXC. LIQUID 1) (A1P) X1A-X9A CONNECTOR	Z1F	NOISE FILTER (WITH SURRE ABSORBER) (A4P)
HAP	PLOT LAMP (SERVICE MONITOR) (A2P) (A3P) [H1C, M2C] MOTOR (COMPRESSOR)	L1R	MAGNETIC RELAY (CURRENT LIMITING) (A4P)	R8T	THERMISTOR (SUCTION 1) (A2P)		
		L2R	MAGNETIC RELAY (SUCTION 2) (A2P)	R10T	THERMISTOR (SUCTION 2) (A2P)		
		R11T	THERMISTOR (HEAT EXC. GAS 2) (A3P)	Y3E	ELECTRONIC EXPANSION VALVE (MAIN 2) (A3P)	X7A	POWER SUPPLY (ADAPTOR) (A2P)
						X7A	POWER SUPPLY (ADAPTOR) (A2P)

REYQ144PTJU

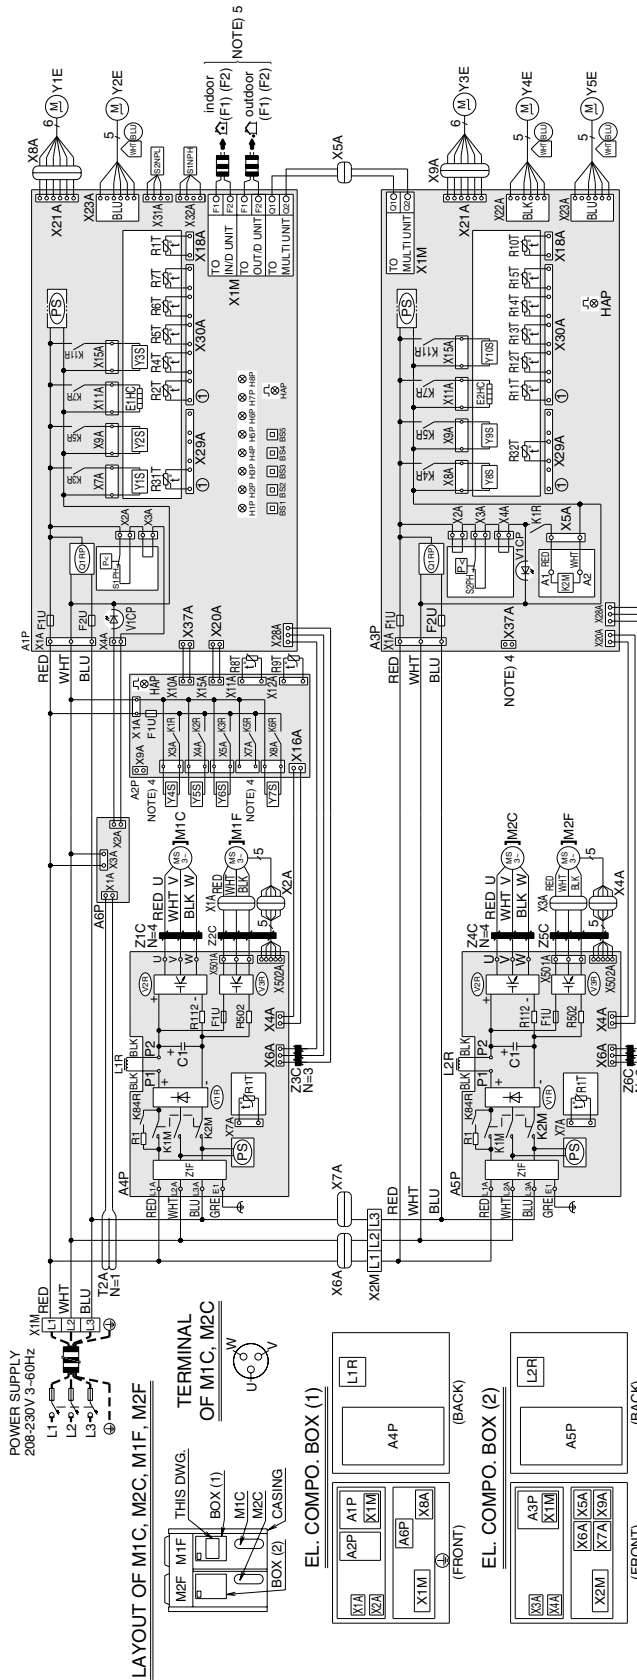

NOTES


- THIS WIRING DIAGRAM IS APPLIED ONLY TO THE OUTDOOR UNIT.
- FIELD WIRING.
- TERMINAL STRIP: CONNECTOR - : TERMINAL
 ⊕ : PROTECTIVE EARTH (SCREW)
- WHEN USING THE OPTIONAL ADAPTOR, REFER TO THE INSTALLATION MANUAL OF THE OPTIONAL ADAPTOR.
- FOR CONNECTION WIRING TO INDOOR-OUTDOOR TRANSMISSION F1 · F2, OUTDOOR-OUTDOOR TRANSMISSION F1 · F2, OUTDOOR-MULTI TRANSMISSION Q1 · Q2, REFER TO THE INSTALLATION MANUAL.
- HOW TO USE BS1~5 AND DS1 · 2 SWITCH, REFER TO "SERVICE PRECAUTION" LABEL ON EL. COMPO. BOX COVER.
- WHEN OPERATING DON'T SHORTCIRCUIT THE PROTECTION DEVICE (S1, 2PH).
- SYMBOLS INDICATE COLORS OF EACH PARTS AS SHOWN BELOW.
 * IS CONNECTOR COLOR FOR PRINTED CIRCUIT BOARD.
 * IS CONNECTOR COLOR FOR COMPONENT.
 * IS IDENTIFICATION COLOR FOR COMPONENT LEAD WIRE.
- COLORS BLK : BLACK RED : RED BLU : BLUE WHT : WHITE.

A1P	PRINTED CIRCUIT BOARD (MAIN)	R1	RESISTOR (CURRENT SENSOR) (A4P) (A5P)	Y2S	SOLENOID VALVE (4 WAY VALVE-HEAT EXC. 1)
A2P	PRINTED CIRCUIT BOARD (SUB 1)	R11, R502	RESISTOR (A4P) (A5P)	Y3S	SOLENOID VALVE (RMTL)
A3P	PRINTED CIRCUIT BOARD (SUB 2)	R11	THERMISTOR (AIR) (A1P)	Y4S	SOLENOID VALVE (EV BYPASS 1)
A4P, A5P	PRINTED CIRCUIT BOARD (INV)	R21	THERMISTOR (FIN) (A4P) (A5P)	Y5S	SOLENOID VALVE (EV BYPASS 1)
A6P	PRINTED CIRCUIT BOARD (ELB)	R31	THERMISTOR (HEAT EXC. GAS 1) (A1P)	Y6S	SOLENOID VALVE (RMT)
BS1~5	PUSH BUTTON SWITCH (MODE SET, RETURN, TEST, RESET)	R31T	THERMISTOR (MTC DISCHARGE) (A1P)	Y7S	SOLENOID VALVE (RMT)
C1	CAPACITOR (A4P) (A5P)	R41	THERMISTOR (M2C DISCHARGE) (A2P)	Y8S	SOLENOID VALVE (4 WAY VALVE-PIPE)
EHC, E2HC	CRANKCASE HEATER (A1P) (A3P)	R51	THERMISTOR (HEAT EXC. DEICER 1) (A1P)	Y10S	SOLENOID VALVE (4 WAY VALVE-HEAT EXC. 2)
F1U, F2U	FUSE (T, 3.15A, 250V) (A1P) (A3P)	R61	THERMISTOR (SUB COOL HEAT EXC. LIQUID) (A1P)	Z1C-8C	NOISE FILTER (FERRITE CORE)
FU	FUSE (T, 3.15A, 250V) (A2P)	R71	THERMISTOR (HEAT EXC. LIQUID 1) (A1P)	Z1F	NOISE FILTER (WITH SURGE ABSORBER) (A4P) (A5P)
F1P-4P	FUSE (T, 4A, DC450V) (A4P) (A5P)	R81	THERMISTOR (SUCTION 1) (A2P)		
K1M, K2M	PILOT LAMP (SERVICE MONITOR - ORANGE) (R2P) PREPARE, TEST.....FLICKERING	R91T	THERMISTOR (LIQUID 1) (A2P)		
K1R	PILOT LAMP (SERVICE MONITOR - GREEN) (A1P, A2P, A3P) MALFUNCTION DETECTION---LIGHT UP	R10T	THERMISTOR (SUCTION 2) (A3P)		
K2R	MAGNETIC RELAY (M1C) (M2C) (A4P) (A5P)	R11T	THERMISTOR (HEAT EXC. GAS 2) (A3P)		
K3R	MAGNETIC RELAY (Y4S) (A1P)	R12T	THERMISTOR (HEAT EXC. DEICER 2) (A3P)		
K4R	MAGNETIC RELAY (Y5S) (A2P)	R13T	THERMISTOR (SUB COOL HEAT EXC. GAS 2)		
K5R	MAGNETIC RELAY (Y6S) (A1P)	R14T	THERMISTOR (LIQUID 2) (A3P)		
K6R	MAGNETIC RELAY (FOR OPTION) (A2P)	R15T	THERMISTOR (HEAT EXC. LIQUID 2) (A3P)		
K7R	MAGNETIC RELAY (Y7S) (A2P)	S2PH	PRESSURE SENSOR (HIGH) (A1P)		
K8R	MAGNETIC RELAY (E-HC) (A1P)	S2PHL	PRESSURE SENSOR (LOW) (A1P)		
K11R	MAGNETIC RELAY (Y10S) (A3P)	S1PH, S2PH	PRESSURE SWITCH (HIGH) (A1P) (A3P)		
K12R	MAGNETIC RELAY (Y11S) (A1P)	T2A	CURRENT SENSOR (A4P)		
K13R	MAGNETIC RELAY (Y12S) (A2P)	V1CP	SAFETY DEVICES INPUT (A1P) (A3P)		
K14R	MAGNETIC RELAY (E-HC) (A3P)	V1R	DIODE BRIDGE (A4P) (A5P)		
K15R	MAGNETIC RELAY (Y13S) (A1P)	V2R, V3R	POWER MODULE (A4P) (A5P)		
K16R	MAGNETIC RELAY (Y14S) (A2P)	X1A~X3A	CONNECTOR		
M1C, M2C	MOTOR (COMPRESSOR)	X1M	TERMINAL STRIP (POWER SUPPLY)		
M1F, M2F	MOTOR (FAN)	X2M	TERMINAL STRIP (CONTROL) (A1P) (A3P)		
ORP	SWITCHING POWER SUPPLY (A1P, A3P, A4P, A5P)	Y1E	ELECTRONIC EXPANSION VALVE (MAIN 1)		
		Y2E	ELECTRONIC EXPANSION VALVE (SUBCOOL 1)		
		Y3E	ELECTRONIC EXPANSION VALVE (MAIN 2)		
		Y4E	ELECTRONIC EXPANSION VALVE (CHARGE)		
		Y5E	ELECTRONIC EXPANSION VALVE (SUBCOOL 2)		
		Y1S	SOLENOID VALVE (RMTG)		

3D060077A

REM72PTJU



3D058614

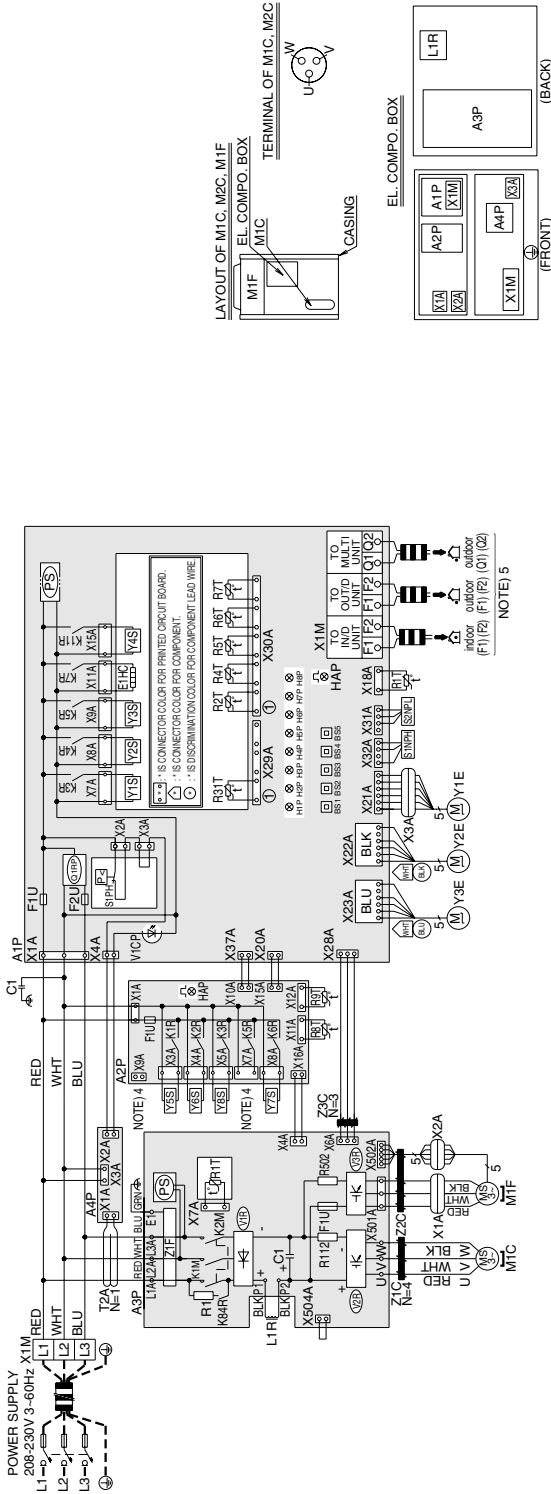

- NOTES)**
1. THIS WIRING DIAGRAM IS APPLIED ONLY TO THE OUTDOOR UNIT.
 2. : FIELD WIRING.
 3. : TERMINAL STRIP : CONNECTOR : TERMINAL
 4. WHEN USING THE OPTIONAL ADAPTOR, REFER TO THE INSTALLATION MANUAL OF THE OPTIONAL ADAPTOR.
 5. FOR CONNECTION WIRING TO INDOOR/OUTDOOR TRANSMISSION F1 · F2, OUTDOOR-OUTDOOR TRANSMISSION F1 · F2, OUTDOOR-MULTI TRANSMISSION Q1 · Q2, REFER TO THE INSTALLATION MANUAL.
 6. HOW TO USE BS1-5, REFER TO "SERVICE PRECAUTION" LABEL ON EL. COMPO. BOX COVER.
 7. WHEN OPERATING, DON'T SHORTCIRCUIT THE PROTECTION DEVICE (S1PH, S2PH).
 8. COLORS BLK · BLACK RED · RED BLU · BLUE WHT · WHITE GRN · GREEN.

A1P	PRINTED CIRCUIT BOARD (MAIN)	K3R	MAGNETIC RELAY (Y1S) (A1P)	R2T	THERMISTOR (HEAT EXC. GAS) (A1P)	X1M	TERMINAL STRIP (CONTROL) (A1P)
A2P	PRINTED CIRCUIT BOARD (SUB)	K3R	MAGNETIC RELAY (Y8S) (A2P)	R31T	THERMISTOR (MIC. M2C DISCHARGE) (A1P)	Y1E	ELECTRONIC EXPANSION VALVE (MAIN) (A1P)
A3P	PRINTED CIRCUIT BOARD (INV. FAN)	K4R	MAGNETIC RELAY (Y3S) (A1P)	R4T	THERMISTOR (HEAT EXC. DEICER) (A1P)	Y2E	ELECTRONIC EXPANSION VALVE (CHARGE) (A1P)
A4P	PRINTED CIRCUIT BOARD (ELB)	K5R	MAGNETIC RELAY (Y3S) (A1P)	R5T	THERMISTOR (SUB COOL. HEAT EXC. GAS) (A1P)	Y3S	ELECTRONIC EXPANSION VALVE (SUBCOOL) (A1P)
BS1-5	PUSH-BUTTON SWITCH (MODE. SET, RETURN, TEST, RESET) (A1P)	K6R	MAGNETIC RELAY (FOR OPTION) (A3P)	R6T	THERMISTOR (SUB COOL. HEAT EXC. LIQUID) (A1P)	Y1S	SOLENOID VALVE (RMTG) (A1P)
C1	CAPACITOR	K7R	MAGNETIC RELAY (Y7S) (A2P)	R7T	THERMISTOR (HEAT EXC. LIQUID) (A1P)	Y2S	SOLENOID VALVE (RMTG) (A1P)
E1HC	CRANKCASE HEATER (A1P)	K7R	MAGNETIC RELAY (E1HC) (A1P)	R8T	THERMISTOR (LIQUID) (A2P)	Y3S	SOLENOID VALVE (4 WAY VALVE) (HEX EXC.) (A1P)
F1U, F2U	FUSE (T. 3.15A, 250V) (A1P)	K84R	MAGNETIC RELAY (CURRENT LIMITING) (A3P)	R9T	THERMISTOR (PRESSURE SENSOR (HIGH) (A1P)	Y4S	SOLENOID VALVE (RMTL) (A1P)
F1U	FUSE (T. 3.15A, 250V) (A2P)	L1R	REACTOR (A3P)	S2NPL	PRESSURE SENSOR (LOW) (A1P)	Y5S	SOLENOID VALVE (HOT GAS) (A2P)
F1U	FUSE (16A, DC-650V) (A3P)	M1C	MOTOR (COMPRESSOR)	S1PH	PRESSURE SWITCH (HIGH) (A1P)	Y7S	SOLENOID VALVE (RMTG) (A2P)
H1P-3P	PILOT LAMP (SERVICE MONITOR) (ORANGE) (A1P)	M1F	MOTOR (FAN)	T2A	CURRENT SENSOR (A1P)	Y8S	SOLENOID VALVE (RMTT) (A2P)
H1P	PILOT LAMP (PREPARE TEST) (FLOXERING)	O1PH	SWITCHING POWER SUPPLY (A1P, A3P)	V1CP	SAFETY DEVICES INPUT (A1P)	Z1C-3C	SOLENOID VALVE (4 WAY VALVE) (HEX EXC.) (A1P)
HAP	PILOT LAMP (SERVICE MONITOR-GREEN) (A1P) (A2P)	R1	PHASE REVERSE DETECT CIRCUIT (A1P)	V1R	POWER MODULE (A3P)	Z1F	NOISE FILTER (WITH SURGE ABSORBER) (A3P)
K1M, K2M	MAGNETIC RELAY (M1C) (A3P)	R11, R92	RESISTOR (A3P)	X1A, X2A	CONNECTOR FOR OPTIONAL PARTS	X7A	OPERATION OUTPUT (A2P)
K1R	MAGNETIC RELAY (Y2S) (A2P)	R1T	THERMISTOR (AIR) (A1P)	X3A	CONNECTOR (Y1E)	X9A	POWER SUPPLY (ADAPTOR) (A2P)
K2R	MAGNETIC RELAY (Y6S) (A2P)	R1T	THERMISTOR (FIN) (A3P)	X1M	TERMINAL STRIP (POWER SUPPLY)		

REM96, 120PTJU

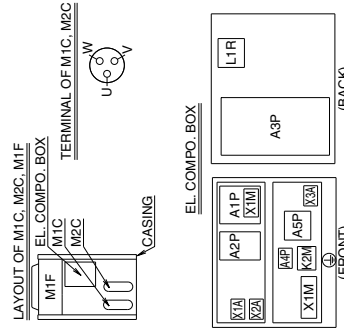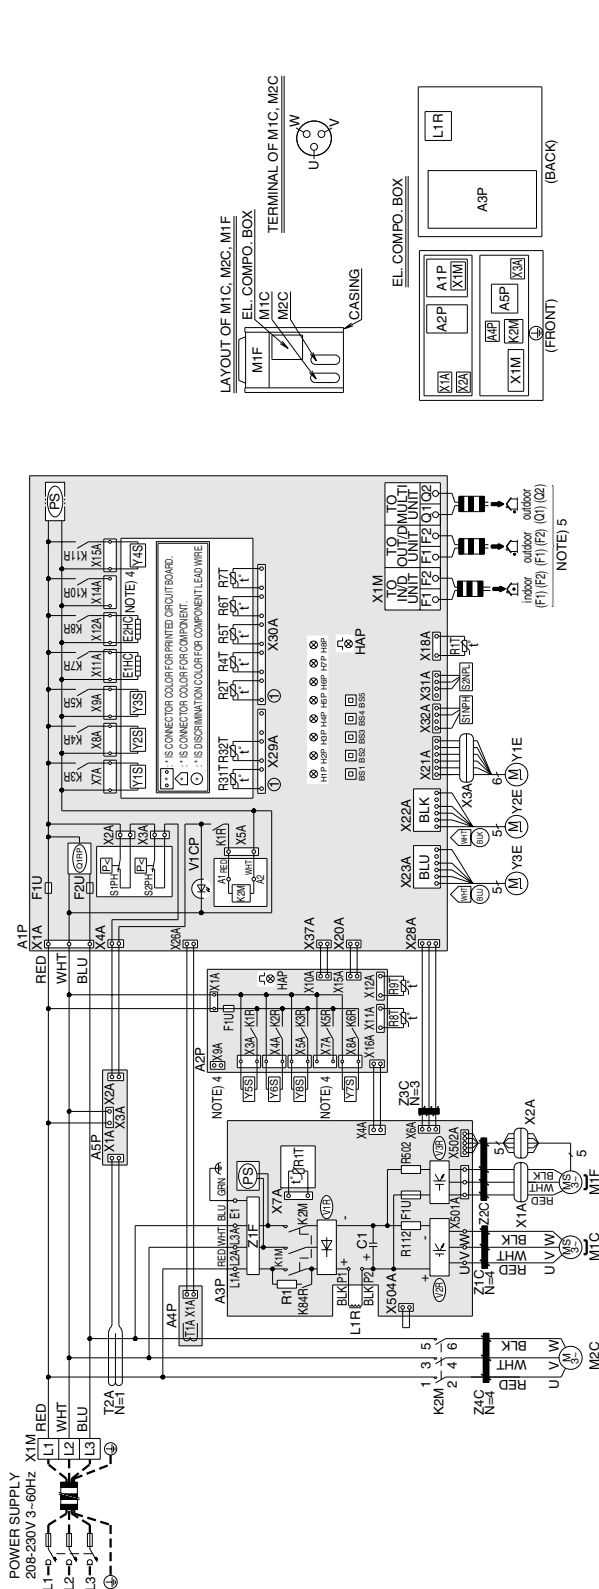

NOTES

- THIS WIRING DIAGRAM IS APPLIED ONLY TO THE OUTDOOR UNIT.
- FIELD WIRING.
- TERMINAL STRIP (SCREW) : CONNECTOR (SCREW) -> : TERMINAL (SCREW)
- WHEN USING THE OPTIONAL ADAPTOR, REFER TO THE INSTALLATION MANUAL OF THE OPTIONAL ADAPTOR.
- FOR CONNECTION WIRING TO INDOOR-OUTDOOR TRANSMISSION F1 · F2, OUTDOOR-OUTDOOR TRANSMISSION Q1 · Q2, REFER TO THE INSTALLATION MANUAL.
- HOW TO USE BS1-5, REFER TO "SERVICE PRECAUTION" LABEL ON EL. COMPO. BOX COVER.
- WHEN OPERATING, DON'T SHORTCIRCUIT THE PROTECTION DEVICE (S1PH, S2PH).
- COLORS BLK : BLACK RED : RED BLU : BLUE WHT : WHITE GRN : GREEN.


PRINTED CIRCUIT BOARD (MAIN)	K2R	MAGNETIC RELAY (YSS) (ASP)	R1T	THERMISTOR (FAN) (ASP)	X1M	TERMINAL STRIP (CONTROL) (A1P)
PRINTED CIRCUIT BOARD (SUB)	K3R	MAGNETIC RELAY (Y1S) (A1P)	R2T	THERMISTOR (HEAT EXC. GAS) (A1P)	Y1E	ELECTRONIC EXPANSION VALVE (MAIN) (A1P)
PRINTED CIRCUIT BOARD (INN. FAN)	K3R	MAGNETIC RELAY (Y2S) (ASP)	R3T	THERMISTOR (MTC DISCHARGE) (A1P)	Y2E	ELECTRONIC EXPANSION VALVE (CHARGE) (A1P)
PRINTED CIRCUIT BOARD (CURRENT SENSOR)	K4R	MAGNETIC RELAY (Y3S) (A1P)	R4T	THERMISTOR (HEAT EXC. DIEGET) (A1P)	Y3E	ELECTRONIC EXPANSION VALVE (SUBCOOL) (A1P)
PRINTED CIRCUIT BOARD (ELB)	K3R	MAGNETIC RELAY (Y4S) (A1P)	R5T	THERMISTOR (SUB COOL. HEAT EXC. GAS) (A1P)	Y4S	SOLENOID VALVE (RMT1G) (A1P)
BS1-5	K3R	MAGNETIC RELAY (FOR OPTION) (A2P)	R6T	THERMISTOR (SUB COOL. HEAT EXC. LIQUID) (A1P)	Y2S	SOLENOID VALVE (RWAY VALVE) (PRE) (A1P)
MODE. SET. RETURN, TEST, RESET) (A1P)	K3R	MAGNETIC RELAY (Y5S) (A1P)	R7T	THERMISTOR (HEAT EXC. LIQUID) (A1P)	Y4S	SOLENOID VALVE (RMT1L) (A1P)
C1	K7R	MAGNETIC RELAY (Y6S) (A1P)	R8T	THERMISTOR (SUCTION) (A2P)	Y4S	SOLENOID VALVE (RMT1L) (A1P)
ELC. 2PH CRANKCASE HEATER (A1P)	K8R	MAGNETIC RELAY (Y7S) (A1P)	R9T	THERMISTOR (LIQUID) (A2P)	Y6S	SOLENOID VALVE (HOT GAS) (A2P)
F1U, F2U FUSE (T. 3.15A, 250V) (A1P)	K10R	MAGNETIC RELAY (Y8S) (A1P)	S1NPH	PRESSURE SENSOR (HIGH) (A1P)	Y6S	SOLENOID VALVE (EV BYPASS) (A2P)
F1U FUSE (T. 3.15A, 250V) (A2P)	K11R	MAGNETIC RELAY (Y9S) (A1P)	S2NPL	PRESSURE SENSOR (LOW) (A1P)	Y7S	SOLENOID VALVE (RMT1L) (A2P)
F1U FUSE (T. 3.15A, 250V) (A2P)	K8R	MAGNETIC RELAY (CURRENT LIMITING) (A2P)	S1PH, S2PH	PRESSURE SWITCH (HIGH) (A1P)	Y6S	SOLENOID VALVE (RMT1L) (A2P)
H1P-8P PROTECTIVE DEVICE (A1P)	L1R	REACTOR (ASP)	T1A <th>CURRENT SENSOR (ASP)</th> <th>Z1C-4C</th> <th>NOISE FILTER (FERRITE CORE)</th>	CURRENT SENSOR (ASP)	Z1C-4C	NOISE FILTER (FERRITE CORE)
ELC. 2PH SERVICE MONITOR, CRANKCASE HEATER (A1P)	L2R	MAGNETIC RELAY (Y10S) (A1P)	T2A <th>CURRENT SENSOR (ASP)</th> <th>Z1F</th> <th>NOISE FILTER WITH SURGE ABSORBER (ASP)</th>	CURRENT SENSOR (ASP)	Z1F	NOISE FILTER WITH SURGE ABSORBER (ASP)
MAGNETIC RELAY (FOR OPTION) (A2P)	M1F	MOTOR (FAN)	V1CP	SAFETY DEVICES INPUT (A1P)		
PILOT LAMP (SERVICE MONITORING) (A1P) (A2P)	M1F	SWITCHING POWER SUPPLY (A1P, A2P)	V1TR	DIODE BRIDGE (A3P)		
PHASE REVERSAL DETECT CIRCUIT (A1P)	O1RP	PHASE REVERSAL DETECT CIRCUIT (A1P)	V2R, V3R	POWER MODULE (A3P)		
MAGNETIC RELAY (MTC) (A3P)	R1	MAGNETIC RELAY (MTC) (A3P)	X1A, X2A	CONNECTOR (M1F)		
MAGNETIC RELAY (K2M) (A1P)	R12, R92	RESISTOR (CURRENT SENSOR) (A3P)	X3A	CONNECTOR (Y1E)		
MAGNETIC RELAY (Y5S) (A2P)	R1T	THERMISTOR (AIR) (A1P)	X1M	TERMINAL STRIP (POWER SUPPLY)		

3D058512C

6. Field Wiring

REYQ72, 96, 120, 144PTJU

- Notes 1) All wiring, components and materials to be procured on the site must comply with the applicable local and national codes.
- 2) Use copper conductors only.
- 3) As for details, see wiring diagram.
- 4) Install ground fault circuit interrupter for safety.
- 5) All field wiring and components must be provided by licensed electrician.
- 6) Unit shall be grounded in compliance with the applicable local and national codes.
- 7) Wiring shown are general points-of-connection guides only and are not intended for or to include all details for a specific installation.
- 8) Be sure to install the switch and the fuse to the power line of each equipment.
- 9) Install the main switch that can interrupt all the power sources in an integrated manner because this system consists of the equipment utilizing the multiple power sources.
- 10) If there exists the possibility of reversed phase, lose phase, momentary blackout or the power goes on and off while the product is operating, attach a reversed phase protection circuit locally. Running the product in reversed phase may break the compressor and other parts.

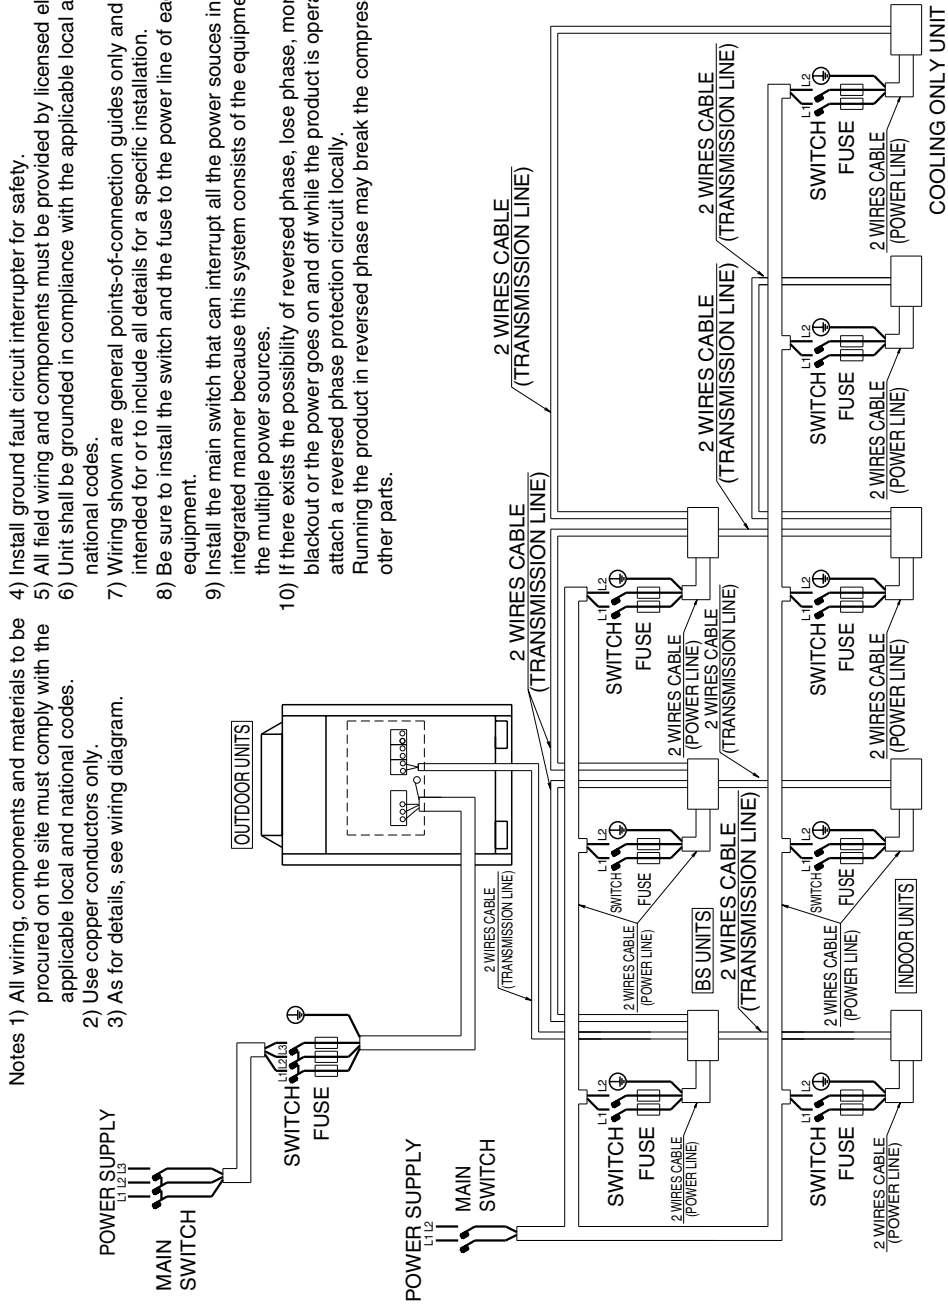

3D058622

REYQ168, 192, 216, 240PTJU


3D059671

- 6) Unit shall be grounded in compliance with the applicable local and national codes.
- 7) Wiring shown are general points-of-connection guides only and are not intended for or to include all details for a specific installation.
- 8) Be sure to install the switch and the fuse to the power line of each equipment.
- 9) Install the main switch that can interrupt all the power sources in an integrated manner because this system consists of the equipment utilizing the multiple power sources.
- 10) The capacity of UNIT1 must be larger than UNIT2 when the power source is connected in series between the units.
- 11) If there exists the possibility of reversed phase, lose phase, momentary blackout or the power goes on and off while the product is operating, attach a reversed phase protection circuit locally.

Running the product in reversed phase may break the compressor and other parts.

- Notes 1) All wiring, components and materials to be procured on the site must comply with the applicable local and national codes.
- 2) Use copper conductors only.
- 3) As for details, see wiring diagram.
- 4) Install ground fault circuit interrupter for safety.
- 5) All field wiring and components must be provided by licensed electrician.


< When the power source is supplied to each outdoor unit individually. >

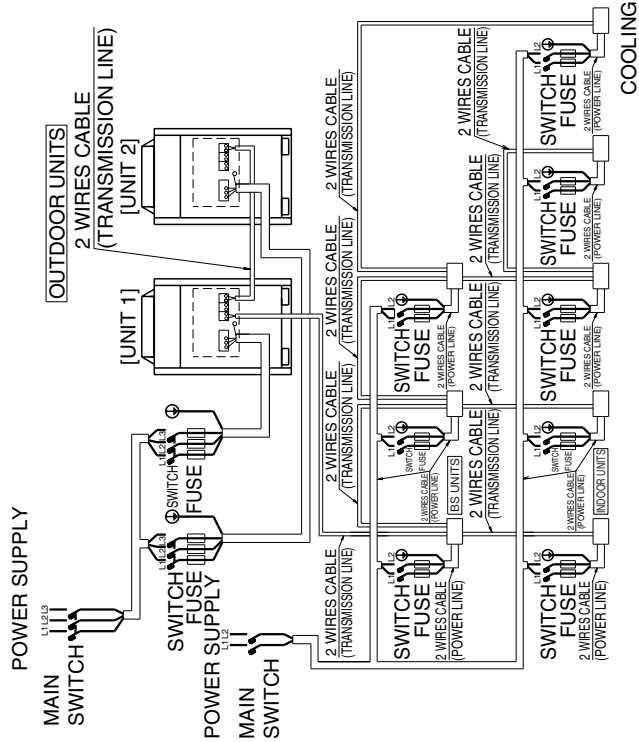

7. Electric Characteristics

Model Name	Units				Power supply			Comp.		OFM	
	Hz	Volts	Min.	Max.	MCA	TOCA	MFA	MSC	RLA	KW	FLA
REYQ72PTJU	60	208-230	187	253	36.1	53.8	40	131	4.8+14.0	0.35×2	1.2+1.2
REYQ96PTJU	60	208-230	187	253	43.8	53.8	45	131	8.4+14.0	0.35×2	1.2+1.2
REYQ120PTJU	60	208-230	187	253	44.2	54.3	50	131	12.0+13.6	0.35×2	1.4+1.4
REYQ144PTJU	60	208-230	187	253	72.2	56.8	80	-	14.3+14.3	0.75×2	2.0+2.0

The relationship between the starting time and the starting current.

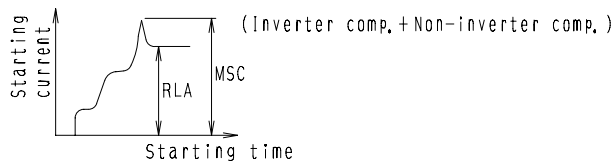

Notes:

1. RLA is based on the following conditions.
Indoor temp, 80°FDB/67°FWB
Outdoor temp, 95°FDB
2. TOCA means the total value of each DC set.
3. MSC means the Max. current during the starting of compressor.
4. Voltage range
Units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits.
5. Maximum allowable voltage variation between phases is 2%.
6. Select wire size based on the larger value of MCA or TOCA.
7. MFA is used to select the circuit breaker and the ground fault circuit interrupter (earth leakage circuit breaker).


Symbols:

- MCA :Min. Circuit Amps, (A)
TOCA :Total Over-current Amps, (A)
MFA :Max. Fuse Amps, (A)
MSC :Max. Starting current
RLA :Rated Load Amps, (A)
OFM :Outdoor Fan Motor
FLA :Full Load Amps, (A)
kW :Rated Motor Output(kw)

3D060212

Model Name			Units				Power supply			Comp.		DFM	
Combination Unit	Independent Unit		Hz	Volts	Min.	Max.	MCA	TOCA	MFA	MSC	RLA	KW	FLA
REYQ168PTJU	REM072PTJU	REM096PTJU	60	208-230	187	253	64.9	29.5+54.5	40+50	137	14.2+7.8+16.8	0.75+0.75	1.2+1.6
REYQ192PTJU	REM072PTJU	REM0120PTJU	60	208-230	187	253	70.1	29.5+54.5	40+60	138	14.2+12.2+16.8	0.75+0.75	1.2+1.6
REYQ216PTJU	REM096PTJU	REM0120PTJU	60	208-230	187	253	77.4	54.5+54.5	50+60	154	7.8+16.8+12.2+16.8	0.75+0.75	1.6+2.0
REYQ240PTJU	REM0120PTJU	REM0120PTJU	60	208-230	187	253	82.6	54.5+54.5	60+60	155	12.2+16.8+12.2+16.8	0.75+0.75	2.0+2.0

The relationship between the starting time and the starting current.

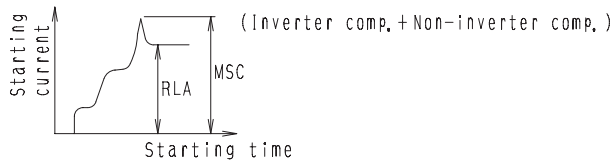

Notes:

1. RLA is based on the following conditions,
Indoor temp, 80°F DB/67.0°F WB
Outdoor temp, 95°F DB
2. TOCA means the total value of each OC set,
3. MSC means the Max. current during the starting of compressor.
4. Voltage range
Units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits.
5. Maximum allowable voltage variation between phases is 2%.
6. Select wire size based on the larger value of MCA or TOCA.
7. MFA is used to select the circuit breaker and the ground fault circuit interrupter (earth leakage circuit breaker).

Symbols:

- MCA :Min. Circuit Amps, (A)
- TOCA :Total Over-current Amps, (A)
- MFA :Max. Fuse Amps, (A)
- MSC :Max. Starting current
- RLA :Rated Load Amps, (A)
- DFM :Outdoor Fan Motor
- FLA :Full Load Amps, (A)
- kW :Rated Motor Output(kW)

3D060213

8. Capacity Tables (Reference Data)

8.1 Cooling Capacity (REYQ-PTJU)

These tables are based on projection. Actual results may vary according to conditions of use.

REYQ72PTJU

Outdoor air temp. (F/DB)	Indoor air temp. (F/WB)												Cooling capacity	
	57			61			64			70				PI
	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH		
50	42.0	1.57	51.1	1.93	58.0	2.22	67.8	3.11	71.6	3.82	83.0	4.81	90	
54	42.0	1.60	51.1	1.97	58.0	2.26	64.8	2.56	71.6	3.28	83.0	4.41	90	
58	42.0	1.63	51.1	2.01	58.0	2.30	61.6	2.62	71.6	3.04	83.0	4.00	90	
62	42.0	1.66	51.1	2.05	58.0	2.34	58.4	2.36	71.6	2.80	83.0	3.59	90	
66	42.0	1.69	51.1	2.09	58.0	2.38	55.2	2.08	71.6	2.56	83.0	3.18	90	
70	42.0	1.73	51.1	2.14	58.0	2.42	52.0	1.80	71.6	2.32	83.0	2.77	90	
72	42.0	1.75	51.1	2.16	58.0	2.44	48.8	1.52	71.6	2.08	83.0	2.36	90	
74	42.0	1.78	51.1	2.18	58.0	2.46	45.6	1.24	71.6	1.84	83.0	1.95	90	
76	42.0	1.81	51.1	2.21	58.0	2.48	42.4	0.96	71.6	1.60	83.0	1.54	90	
78	42.0	1.84	51.1	2.24	58.0	2.50	39.2	0.68	71.6	1.36	83.0	1.13	90	
80	42.0	1.87	51.1	2.27	58.0	2.52	36.0	0.40	71.6	1.12	83.0	0.72	90	
82	42.0	1.90	51.1	2.30	58.0	2.54	32.8	0.12	71.6	0.88	83.0	0.31	90	
84	42.0	1.93	51.1	2.33	58.0	2.56	29.6	-0.16	71.6	0.64	83.0	-0.10	90	
86	42.0	1.96	51.1	2.36	58.0	2.58	26.4	-0.44	71.6	0.40	83.0	-0.51	90	
88	42.0	1.99	51.1	2.39	58.0	2.60	23.2	-0.72	71.6	0.16	83.0	-0.92	90	
90	42.0	2.02	51.1	2.42	58.0	2.62	20.0	-1.00	71.6	-0.08	83.0	-1.33	90	
92	42.0	2.05	51.1	2.45	58.0	2.64	16.8	-1.28	71.6	-0.32	83.0	-1.74	90	
94	42.0	2.08	51.1	2.48	58.0	2.66	13.6	-1.56	71.6	-0.56	83.0	-2.15	90	
96	42.0	2.11	51.1	2.51	58.0	2.68	10.4	-1.84	71.6	-0.80	83.0	-2.56	90	
98	42.0	2.14	51.1	2.54	58.0	2.70	7.2	-2.12	71.6	-1.04	83.0	-2.97	90	
100	42.0	2.17	51.1	2.57	58.0	2.72	4.0	-2.40	71.6	-1.28	83.0	-3.38	90	

Outdoor air temp. (F/DB)	Indoor air temp. (F/WB)												Cooling capacity	
	57			61			64			70				PI
	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH		
50	60.7	3.33	73.9	3.50	82.5	4.35	90.7	5.19	98.4	6.04	106.1	6.89	1130	
54	60.7	3.38	73.9	3.55	82.5	4.40	90.7	5.24	98.4	6.09	106.1	6.94	1130	
58	60.7	3.43	73.9	3.60	82.5	4.45	90.7	5.29	98.4	6.14	106.1	7.00	1130	
62	60.7	3.48	73.9	3.65	82.5	4.50	90.7	5.34	98.4	6.19	106.1	7.05	1130	
66	60.7	3.53	73.9	3.70	82.5	4.55	90.7	5.39	98.4	6.24	106.1	7.10	1130	
70	60.7	3.58	73.9	3.75	82.5	4.60	90.7	5.44	98.4	6.29	106.1	7.15	1130	
72	60.7	3.60	73.9	3.77	82.5	4.62	90.7	5.46	98.4	6.31	106.1	7.17	1130	
74	60.7	3.62	73.9	3.79	82.5	4.64	90.7	5.48	98.4	6.33	106.1	7.19	1130	
76	60.7	3.64	73.9	3.81	82.5	4.66	90.7	5.50	98.4	6.35	106.1	7.21	1130	
78	60.7	3.66	73.9	3.83	82.5	4.68	90.7	5.52	98.4	6.37	106.1	7.23	1130	
80	60.7	3.68	73.9	3.85	82.5	4.70	90.7	5.54	98.4	6.39	106.1	7.25	1130	
82	60.7	3.70	73.9	3.87	82.5	4.72	90.7	5.56	98.4	6.41	106.1	7.27	1130	
84	60.7	3.72	73.9	3.89	82.5	4.74	90.7	5.58	98.4	6.43	106.1	7.29	1130	
86	60.7	3.74	73.9	3.91	82.5	4.76	90.7	5.60	98.4	6.45	106.1	7.31	1130	
88	60.7	3.76	73.9	3.93	82.5	4.78	90.7	5.62	98.4	6.47	106.1	7.33	1130	
90	60.7	3.78	73.9	3.95	82.5	4.80	90.7	5.64	98.4	6.49	106.1	7.35	1130	
92	60.7	3.80	73.9	3.97	82.5	4.82	90.7	5.66	98.4	6.51	106.1	7.37	1130	
94	60.7	3.82	73.9	3.99	82.5	4.84	90.7	5.68	98.4	6.53	106.1	7.39	1130	
96	60.7	3.84	73.9	4.01	82.5	4.86	90.7	5.70	98.4	6.55	106.1	7.41	1130	
98	60.7	3.86	73.9	4.03	82.5	4.88	90.7	5.72	98.4	6.57	106.1	7.43	1130	
100	60.7	3.88	73.9	4.05	82.5	4.90	90.7	5.74	98.4	6.59	106.1	7.45	1130	

Outdoor air temp. (F/DB)	Indoor air temp. (F/WB)												Cooling capacity	
	57			61			64			70				PI
	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH		
50	51.4	1.84	62.5	2.41	70.9	3.28	80.7	4.16	88.4	5.04	96.1	5.92	110	
54	51.4	1.87	62.5	2.44	70.9	3.31	80.7	4.19	88.4	5.07	96.1	5.95	110	
58	51.4	1.90	62.5	2.47	70.9	3.34	80.7	4.22	88.4	5.10	96.1	5.98	110	
62	51.4	1.93	62.5	2.50	70.9	3.37	80.7	4.25	88.4	5.13	96.1	6.01	110	
66	51.4	1.96	62.5	2.53	70.9	3.40	80.7	4.28	88.4	5.16	96.1	6.04	110	
70	51.4	1.99	62.5	2.56	70.9	3.43	80.7	4.31	88.4	5.19	96.1	6.07	110	
72	51.4	2.02	62.5	2.59	70.9	3.46	80.7	4.34	88.4	5.22	96.1	6.10	110	
74	51.4	2.05	62.5	2.62	70.9	3.49	80.7	4.37	88.4	5.25	96.1	6.13	110	
76	51.4	2.08	62.5	2.65	70.9	3.52	80.7	4.40	88.4	5.28	96.1	6.16	110	
78	51.4	2.11	62.5	2.68	70.9	3.55	80.7	4.43	88.4	5.31	96.1	6.19	110	
80	51.4	2.14	62.5	2.71	70.9	3.58	80.7	4.46	88.4	5.34	96.1	6.22	110	
82	51.4	2.17	62.5	2.74	70.9	3.61	80.7	4.49	88.4	5.37	96.1	6.25	110	
84	51.4	2.20	62.5	2.77	70.9	3.64	80.7	4.52	88.4	5.40	96.1	6.28	110	
86	51.4	2.23	62.5	2.80	70.9	3.67	80.7	4.55	88.4	5.43	96.1	6.31	110	
88	51.4	2.26	62.5	2.83	70.9	3.70	80.7	4.58	88.4	5.46	96.1	6.34	110	
90	51.4	2.29	62.5	2.86	70.9	3.73	80.7	4.61	88.4	5.49	96.1	6.37	110	
92	51.4	2.32	62.5	2.89	70.9	3.76	80.7	4.64	88.4	5.52	96.1	6.40	110	
94	51.4	2.35	62.5	2.92	70.9	3.79	80.7	4.67	88.4	5.55	96.1	6.43	110	
96	51.4	2.38	62.5	2.95	70.9	3.82	80.7	4.70	88.4	5.58	96.1	6.46	110	
98	51.4	2.41	62.5	2.98	70.9	3.85	80.7	4.73	88.4	5.61	96.1	6.49	110	
100	51.4	2.44	62.5	3.01	70.9	3.88	80.7	4.76	88.4	5.64	96.1	6.52	110	

TC : Total capacity ; MBH
 PI : Power Input ; kW (Comp.+Outdoor fan motor)
 Note1 : The above table shows the average value of conditions which may occur.

REYQ96PTJU

Outdoor air temp. °F/°C	Indoor air temp. °F/°C												Cooling capacity						
	57			61			64			70				72			75		
	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH		TC	PI	MBH	TC	PI	MBH
90	50	56.1	2.49	68.2	3.06	77.3	3.51	86.4	3.98	95.5	4.47	102	4.80	111	5.30				
	54	56.1	2.53	68.2	3.12	77.3	3.58	86.4	4.06	95.5	4.56	102	4.90	111	5.41				
	58	56.1	2.58	68.2	3.19	77.3	3.65	86.4	4.15	95.5	4.66	102	5.01	111	5.52				
	62	56.1	2.63	68.2	3.26	77.3	3.72	86.4	4.24	95.5	4.76	102	5.12	111	5.63				
	66	56.1	2.69	68.2	3.32	77.3	3.79	86.4	4.33	95.5	4.86	102	5.23	111	5.74				
	70	56.1	2.74	68.2	3.39	77.3	3.86	86.4	4.43	95.5	4.95	102	5.32	111	5.85				
	72	56.1	2.77	68.2	3.43	77.3	3.90	86.4	4.47	95.5	4.99	102	5.36	111	5.89				
	74	56.1	2.80	68.2	3.47	77.3	3.94	86.4	4.51	95.5	5.03	102	5.40	111	5.93				
	76	56.1	2.83	68.2	3.51	77.3	4.02	86.4	4.60	95.5	5.12	102	5.49	111	6.02				
	78	56.1	2.86	68.2	3.55	77.3	4.06	86.4	4.64	95.5	5.16	102	5.53	111	6.06				
80	50	56.1	2.82	68.2	3.48	77.3	3.93	86.4	4.48	95.5	4.98	102	5.38	111	5.90				
	54	56.1	2.86	68.2	3.52	77.3	3.97	86.4	4.52	95.5	5.02	102	5.42	111	5.94				
	58	56.1	2.90	68.2	3.56	77.3	4.01	86.4	4.56	95.5	5.06	102	5.46	111	5.98				
	62	56.1	2.94	68.2	3.60	77.3	4.05	86.4	4.60	95.5	5.10	102	5.50	111	6.02				
	66	56.1	2.98	68.2	3.64	77.3	4.09	86.4	4.64	95.5	5.14	102	5.54	111	6.06				
	70	56.1	3.02	68.2	3.68	77.3	4.13	86.4	4.68	95.5	5.18	102	5.58	111	6.10				
	72	56.1	3.06	68.2	3.72	77.3	4.17	86.4	4.72	95.5	5.22	102	5.62	111	6.14				
	74	56.1	3.10	68.2	3.76	77.3	4.21	86.4	4.76	95.5	5.26	102	5.66	111	6.18				
	76	56.1	3.14	68.2	3.80	77.3	4.25	86.4	4.80	95.5	5.30	102	5.70	111	6.22				
	78	56.1	3.18	68.2	3.84	77.3	4.29	86.4	4.84	95.5	5.34	102	5.74	111	6.26				
70	50	56.1	3.00	68.2	3.60	77.3	4.00	86.4	4.40	95.5	5.00	102	5.50	111	6.00				
	54	56.1	3.04	68.2	3.64	77.3	4.04	86.4	4.44	95.5	5.04	102	5.54	111	6.04				
	58	56.1	3.08	68.2	3.68	77.3	4.08	86.4	4.48	95.5	5.08	102	5.58	111	6.08				
	62	56.1	3.12	68.2	3.72	77.3	4.12	86.4	4.52	95.5	5.12	102	5.62	111	6.12				
	66	56.1	3.16	68.2	3.76	77.3	4.16	86.4	4.56	95.5	5.16	102	5.66	111	6.16				
	70	56.1	3.20	68.2	3.80	77.3	4.20	86.4	4.60	95.5	5.20	102	5.70	111	6.20				
	72	56.1	3.24	68.2	3.84	77.3	4.24	86.4	4.64	95.5	5.24	102	5.74	111	6.24				
	74	56.1	3.28	68.2	3.88	77.3	4.28	86.4	4.68	95.5	5.28	102	5.78	111	6.28				
	76	56.1	3.32	68.2	3.92	77.3	4.32	86.4	4.72	95.5	5.32	102	5.82	111	6.32				
	78	56.1	3.36	68.2	3.96	77.3	4.36	86.4	4.76	95.5	5.36	102	5.86	111	6.36				
60	50	56.1	3.12	68.2	3.72	77.3	4.12	86.4	4.52	95.5	5.12	102	5.62	111	6.12				
	54	56.1	3.16	68.2	3.76	77.3	4.16	86.4	4.56	95.5	5.16	102	5.66	111	6.16				
	58	56.1	3.20	68.2	3.80	77.3	4.20	86.4	4.60	95.5	5.20	102	5.70	111	6.20				
	62	56.1	3.24	68.2	3.84	77.3	4.24	86.4	4.64	95.5	5.24	102	5.74	111	6.24				
	66	56.1	3.28	68.2	3.88	77.3	4.28	86.4	4.68	95.5	5.28	102	5.78	111	6.28				
	70	56.1	3.32	68.2	3.92	77.3	4.32	86.4	4.72	95.5	5.32	102	5.82	111	6.32				
	72	56.1	3.36	68.2	3.96	77.3	4.36	86.4	4.76	95.5	5.36	102	5.86	111	6.36				
	74	56.1	3.40	68.2	4.00	77.3	4.40	86.4	4.80	95.5	5.40	102	5.90	111	6.40				
	76	56.1	3.44	68.2	4.04	77.3	4.44	86.4	4.84	95.5	5.44	102	5.94	111	6.44				
	78	56.1	3.48	68.2	4.08	77.3	4.48	86.4	4.88	95.5	5.48	102	5.98	111	6.48				
50	50	56.1	3.00	68.2	3.60	77.3	4.00	86.4	4.40	95.5	5.00	102	5.50	111	6.00				
	54	56.1	3.04	68.2	3.64	77.3	4.04	86.4	4.44	95.5	5.04	102	5.54	111	6.04				
	58	56.1	3.08	68.2	3.68	77.3	4.08	86.4	4.48	95.5	5.08	102	5.58	111	6.08				
	62	56.1	3.12	68.2	3.72	77.3	4.12	86.4	4.52	95.5	5.12	102	5.62	111	6.12				
	66	56.1	3.16	68.2	3.76	77.3	4.16	86.4	4.56	95.5	5.16	102	5.66	111	6.16				
	70	56.1	3.20	68.2	3.80	77.3	4.20	86.4	4.60	95.5	5.20	102	5.70	111	6.20				
	72	56.1	3.24	68.2	3.84	77.3	4.24	86.4	4.64	95.5	5.24	102	5.74	111	6.24				
	74	56.1	3.28	68.2	3.88	77.3	4.28	86.4	4.68	95.5	5.28	102	5.78	111	6.28				
	76	56.1	3.32	68.2	3.92	77.3	4.32	86.4	4.72	95.5	5.32	102	5.82	111	6.32				
	78	56.1	3.36	68.2	3.96	77.3	4.36	86.4	4.76	95.5	5.36	102	5.86	111	6.36				

TC : Total capacity ; MBH
 PI : Power Input ; kW (Comp.+Outdoor fan motor)
 Note1 : The above table shows the average value of conditions which may occur.

REYQ120PTJU

Outdoor air temp. °F/°C	Indoor air temp. °F/°C												Cooling capacity						
	57			61			64			70				72			75		
	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH		TC	PI	MBH	TC	PI	MBH
90	50	70.1	3.23	85.2	3.97	96.8	4.56	108	5.17	119	5.80	127	6.22	138	6.87	148	7.38	159	7.91
	54	70.1	3.29	85.2	4.01	96.6	4.65	108	5.27	119	5.92	127	6.35	138	7.02	148	7.55	159	8.08
	58	70.1	3.32	85.2	4.05	96.6	4.68	108	5.31	119	6.04	127	6.63	138	7.22	148	7.76	159	8.29
	62	70.1	3.36	85.2	4.10	96.6	4.73	108	5.37	119	6.12	127	6.71	138	7.30	148	7.83	159	8.36
	66	70.1	3.40	85.2	4.15	96.6	4.78	108	5.43	119	6.21	127	6.79	138	7.37	148	7.90	159	8.43
	70	70.1	3.45	85.2	4.20	96.6	4.83	108	5.49	119	6.26	127	6.84	138	7.42	148	7.95	159	8.50
	74	70.1	3.50	85.2	4.25	96.6	4.88	108	5.55	119	6.32	127	6.89	138	7.47	148	7.99	159	8.56
	78	70.1	3.55	85.2	4.30	96.6	4.93	108	5.61	119	6.39	127	6.94	138	7.52	148	8.04	159	8.61
	82	70.1	3.60	85.2	4.35	96.6	4.98	108	5.68	119	6.45	127	6.99	138	7.57	148	8.09	159	8.66
	86	70.1	3.65	85.2	4.40	96.6	5.03	108	5.75	119	6.52	127	7.04	138	7.62	148	8.14	159	8.71
	90	70.1	3.70	85.2	4.45	96.6	5.08	108	5.82	119	6.59	127	7.09	138	7.67	148	8.19	159	8.76
	94	70.1	3.75	85.2	4.50	96.6	5.13	108	5.89	119	6.66	127	7.14	138	7.72	148	8.24	159	8.81
98	70.1	3.80	85.2	4.55	96.6	5.18	108	5.96	119	6.73	127	7.19	138	7.77	148	8.29	159	8.86	
102	70.1	3.85	85.2	4.60	96.6	5.23	108	6.03	119	6.80	127	7.24	138	7.82	148	8.34	159	8.91	
106	70.1	3.90	85.2	4.65	96.6	5.28	108	6.10	119	6.87	127	7.29	138	7.87	148	8.39	159	8.96	
110	70.1	3.95	85.2	4.70	96.6	5.33	108	6.17	119	6.94	127	7.34	138	7.92	148	8.44	159	9.01	
114	70.1	4.00	85.2	4.75	96.6	5.38	108	6.24	119	7.01	127	7.39	138	7.97	148	8.49	159	9.06	
118	70.1	4.05	85.2	4.80	96.6	5.43	108	6.31	119	7.08	127	7.44	138	8.02	148	8.54	159	9.11	
122	70.1	4.10	85.2	4.85	96.6	5.48	108	6.38	119	7.15	127	7.49	138	8.07	148	8.59	159	9.16	
126	70.1	4.15	85.2	4.90	96.6	5.53	108	6.45	119	7.22	127	7.54	138	8.12	148	8.64	159	9.21	
130	70.1	4.20	85.2	4.95	96.6	5.58	108	6.52	119	7.29	127	7.59	138	8.17	148	8.69	159	9.26	
134	70.1	4.25	85.2	5.00	96.6	5.63	108	6.59	119	7.36	127	7.64	138	8.22	148	8.74	159	9.31	
138	70.1	4.30	85.2	5.05	96.6	5.68	108	6.66	119	7.43	127	7.69	138	8.27	148	8.79	159	9.36	
142	70.1	4.35	85.2	5.10	96.6	5.73	108	6.73	119	7.50	127	7.74	138	8.32	148	8.84	159	9.41	
146	70.1	4.40	85.2	5.15	96.6	5.78	108	6.80	119	7.57	127	7.79	138	8.37	148	8.89	159	9.46	
150	70.1	4.45	85.2	5.20	96.6	5.83	108	6.87	119	7.64	127	7.84	138	8.42	148	8.94	159	9.51	
154	70.1	4.50	85.2	5.25	96.6	5.88	108	6.94	119	7.71	127	7.89	138	8.47	148	8.99	159	9.56	
158	70.1	4.55	85.2	5.30	96.6	5.93	108	7.01	119	7.78	127	7.94	138	8.52	148	9.04	159	9.61	
162	70.1	4.60	85.2	5.35	96.6	5.98	108	7.08	119	7.85	127	7.99	138	8.57	148	9.09	159	9.66	
166	70.1	4.65	85.2	5.40	96.6	6.03	108	7.15	119	7.92	127	8.04	138	8.62	148	9.14	159	9.71	
170	70.1	4.70	85.2	5.45	96.6	6.08	108	7.22	119	8.00	127	8.09	138	8.67	148	9.19	159	9.76	
174	70.1	4.75	85.2	5.50	96.6	6.13	108	7.29	119	8.07	127	8.14	138	8.72	148	9.24	159	9.81	
178	70.1	4.80	85.2	5.55	96.6	6.18	108	7.36	119	8.14	127	8.19	138	8.77	148	9.29	159	9.86	
182	70.1	4.85	85.2	5.60	96.6	6.23	108	7.43	119	8.21	127	8.24	138	8.82	148	9.34	159	9.91	
186	70.1	4.90	85.2	5.65	96.6	6.28	108	7.50	119	8.28	127	8.29	138	8.87	148	9.39	159	9.96	
190	70.1	4.95	85.2	5.70	96.6	6.33	108	7.57	119	8.35	127	8.34	138	8.92	148	9.44	159	10.01	
194	70.1	5.00	85.2	5.75	96.6	6.38	108	7.64	119	8.42	127	8.39	138	8.97	148	9.49	159	10.06	
198	70.1	5.05	85.2	5.80	96.6	6.43	108	7.71	119	8.49	127	8.44	138	9.02	148	9.54	159	10.11	
202	70.1	5.10	85.2	5.85	96.6	6.48	108	7.78	119	8.56	127	8.49	138	9.07	148	9.59	159	10.16	
206	70.1	5.15	85.2	5.90	96.6	6.53	108	7.85	119	8.63	127	8.54	138	9.12	148	9.64	159	10.21	
210	70.1	5.20	85.2	5.95	96.6	6.58	108	7.92	119	8.70	127	8.59	138	9.17	148	9.69	159	10.26	
214	70.1	5.25	85.2	6.00	96.6	6.63	108	7.99	119	8.77	127	8.64	138	9.22	148	9.74	159	10.31	
218	70.1	5.30	85.2	6.05	96.6	6.68	108	8.06	119	8.84	127	8.69	138	9.27	148	9.79	159	10.36	
222	70.1	5.35	85.2	6.10	96.6	6.73	108	8.13	119	8.91	127	8.74	138	9.32	148	9.84	159	10.41	
226	70.1	5.40	85.2	6.15	96.6	6.78	108	8.20	119	8.98	127	8.79	138	9.37	148	9.89	159	10.46	
230	70.1	5.45	85.2	6.20	96.6	6.83	108	8.27	119	9.05	127	8.84	138	9.42	148	9.94	159	10.51	
234	70.1	5.50	85.2	6.25	96.6	6.88	108	8.34	119	9.12	127	8.89	138	9.47	148	9.99	159	10.56	
238	70.1	5.55	85.2	6.30	96.6	6.93	108	8.41	119	9.19	127	8.94	138	9.52	148	10.04	159	10.61	
242	70.1	5.60	85.2	6.35	96.6	6.98	108	8.48	119	9.26	127	8.99	138	9.57	148	10.09	159	10.66	
246	70.1	5.65	85.2	6.40	96.6	7.03	108	8.55	119	9.33	127	9.04	138	9.62	148	10.14	159	10.71	
250	70.1	5.70	85.2	6.45	96.6	7.08	108	8.62	119	9.40	127	9.09	138	9.67	148	10.19	159	10.76	
254	70.1	5.75	85.2	6.50	96.6	7.13	108	8.69	119	9.47	127	9.14	138	9.72	148	10.24	159	10.81	
258	70.1	5.80	85.2	6.55	96.6	7.18	108	8.76	119	9.54	127	9.19	138	9.77	148	10.29	159	10.86	
262	70.1	5.85	85.2	6.60	96.6	7.23	108	8.83	119	9.61	127	9.24	138	9.82	148	10.34	159	10.91	
266	70.1	5.90	85.2	6.65	96.6	7.28	108	8.90	119	9.68	127	9.29	138	9.87	148	10.39	159	10.96	
270	70.1	5.95	85.2	6.70	96.6	7.33	108	8.97	119	9.75	127	9.34	138	9.92	148	10.44	159	11.01	
274	70.1	6.00	85.2	6.75	96.6	7.38	108	9.04	119	9.82	127	9.39	138	9.97	148	10.49	159	11.06	
278	70.1	6.05	85.2	6.80	96.6	7.43	108	9.11	119	9.89	127	9.44	138	10.02	148	10.54	159	11.11	
282	70.1	6.10	85.2	6.85	96.6	7.48	108	9.18	119	9.96	127	9.49	138	10.07	148	10.59	159	11.16	
286	70.1	6.15	85.2	6.90	96.6	7.53	108	9.25	119	10.03	127	9.54	138	10.12	148	10.64	159	11.21	
290	70.1	6.20	85.2	6.95	96.6	7.58	108	9.32	119	10.10	127	9.59	138	10.17	148	10.69	159	11.26	
294	70.1	6.25	85.2	7.00	96.6	7.63	108	9.39	119	10.17	127	9.64	138	10.22	148	10.74	159	11.31	
298	70.1	6.30	85.2	7.05	96.6	7.68	108	9.46	119	10.24	1								

REYQ144PTJU

Combi- nation (%)	Outdoor air temp. (F/DB)	Indoor air temp. F/WB												Cooling capacity	
		57			61			64			70				
		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH		
90	50	84.1	3.91	102	4.81	110	5.52	130	6.26	143	7.02	152	7.54	166	8.32
	54	84.1	3.98	102	4.90	110	5.63	130	6.39	143	7.16	152	7.68	166	8.50
	58	84.1	4.06	102	5.00	110	5.67	130	6.42	143	7.20	152	7.72	166	8.62
	62	84.1	4.14	102	5.09	110	5.70	130	6.45	143	7.23	152	7.75	166	8.65
	66	84.1	4.22	102	5.21	110	6.00	130	6.81	143	7.64	152	8.36	166	9.50
	70	84.1	4.31	102	5.32	110	6.13	130	7.15	143	8.26	152	9.04	166	10.1
	72	84.1	4.35	102	5.38	110	6.36	130	7.43	143	8.58	152	9.40	166	10.4
	75	84.1	4.43	102	5.68	110	6.72	130	8.06	143	9.09	152	9.96	161	10.7
	79	84.1	4.75	102	6.15	110	7.23	130	8.47	143	9.80	152	10.7	159	11.3
	83	84.1	5.09	102	6.55	110	7.77	130	9.11	143	10.5	152	11.6	159	11.8
80	50	84.1	3.85	102	4.72	110	5.48	130	6.13	143	6.89	152	7.41	166	8.19
	54	84.1	3.92	102	4.81	110	5.59	130	6.26	143	7.02	152	7.54	166	8.32
	58	84.1	4.00	102	4.90	110	5.70	130	6.39	143	7.16	152	7.68	166	8.50
	62	84.1	4.08	102	5.00	110	5.81	130	6.52	143	7.30	152	7.82	166	8.62
	66	84.1	4.16	102	5.10	110	6.02	130	6.85	143	7.64	152	8.36	166	9.50
	70	84.1	4.24	102	5.21	110	6.13	130	7.15	143	8.26	152	9.04	166	10.1
	72	84.1	4.28	102	5.27	110	6.36	130	7.43	143	8.58	152	9.40	166	10.4
	75	84.1	4.36	102	5.57	110	6.72	130	8.06	143	9.09	152	9.96	161	10.7
	79	84.1	4.68	102	6.04	110	7.31	130	8.51	143	9.80	152	10.7	159	11.3
	83	84.1	5.02	102	6.44	110	7.85	130	9.16	143	10.5	152	11.6	159	11.8
70	50	84.1	3.77	102	4.65	110	5.41	130	6.06	143	6.81	152	7.38	166	8.16
	54	84.1	3.84	102	4.74	110	5.52	130	6.19	143	6.94	152	7.51	166	8.29
	58	84.1	3.92	102	4.83	110	5.63	130	6.32	143	7.07	152	7.64	166	8.42
	62	84.1	4.00	102	4.92	110	5.74	130	6.45	143	7.20	152	7.77	166	8.55
	66	84.1	4.08	102	5.04	110	5.95	130	6.58	143	7.33	152	7.90	166	8.68
	70	84.1	4.16	102	5.15	110	6.16	130	7.12	143	8.02	152	8.50	166	9.50
	72	84.1	4.20	102	5.21	110	6.37	130	7.41	143	8.32	152	8.86	166	10.0
	75	84.1	4.28	102	5.51	110	6.73	130	8.07	143	8.91	152	9.91	161	10.7
	79	84.1	4.60	102	6.02	110	7.28	130	8.56	143	9.81	152	10.7	159	11.3
	83	84.1	4.94	102	6.42	110	7.80	130	9.21	143	10.6	152	11.6	159	11.8
60	50	84.1	3.70	102	4.58	110	5.38	130	6.03	143	6.78	152	7.35	166	8.13
	54	84.1	3.77	102	4.67	110	5.49	130	6.16	143	6.91	152	7.48	166	8.26
	58	84.1	3.85	102	4.76	110	5.60	130	6.29	143	7.04	152	7.61	166	8.39
	62	84.1	3.93	102	4.85	110	5.71	130	6.42	143	7.17	152	7.74	166	8.52
	66	84.1	4.01	102	4.94	110	5.82	130	6.55	143	7.30	152	7.87	166	8.65
	70	84.1	4.09	102	5.03	110	6.03	130	7.14	143	8.03	152	8.51	166	9.50
	72	84.1	4.13	102	5.09	110	6.24	130	7.43	143	8.32	152	8.86	166	10.0
	75	84.1	4.21	102	5.39	110	6.60	130	8.06	143	8.91	152	9.91	161	10.7
	79	84.1	4.53	102	6.06	110	7.31	130	8.56	143	9.81	152	10.7	159	11.3
	83	84.1	4.87	102	6.46	110	7.82	130	9.21	143	10.6	152	11.6	159	11.8
50	50	84.1	3.63	102	4.51	110	5.35	130	6.00	143	6.75	152	7.32	166	8.10
	54	84.1	3.70	102	4.60	110	5.46	130	6.08	143	6.88	152	7.45	166	8.23
	58	84.1	3.78	102	4.69	110	5.57	130	6.21	143	7.01	152	7.58	166	8.36
	62	84.1	3.86	102	4.78	110	5.68	130	6.34	143	7.14	152	7.71	166	8.49
	66	84.1	3.94	102	4.87	110	5.79	130	6.47	143	7.27	152	7.84	166	8.62
	70	84.1	4.02	102	4.96	110	5.90	130	6.60	143	7.40	152	7.97	166	8.75
	72	84.1	4.06	102	5.02	110	6.11	130	7.19	143	8.06	152	8.51	166	9.50
	75	84.1	4.14	102	5.32	110	6.47	130	7.72	143	8.80	152	9.91	161	10.7
	79	84.1	4.46	102	6.09	110	7.28	130	8.59	143	9.81	152	10.7	159	11.3
	83	84.1	4.80	102	6.50	110	7.83	130	9.26	143	10.6	152	11.6	159	11.8

TC : Total capacity ; MBH
 PI : Power Input ; kW (Comp.+Outdoor fan motor)
 Note1 : The above table shows the average value of conditions which may occur.

REYQ192PTJU

Combi- nation (%)	Outdoor air temp. (F/DB)	Indoor air temp. F/WB												Cooling capacity				
		57				61				64					70			
		TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW		TC	PI	MBH	KW
90	50	112	4.83	136	5.94	155	6.81	173	7.73	191	8.67	203	9.31	221	10.3	103		
	54	112	4.82	136	6.05	155	6.95	173	7.89	191	8.85	203	9.50	221	10.5			
	58	112	4.81	136	6.16	155	7.10	173	8.00	191	8.99	203	9.69	221	10.7			
	62	112	4.80	136	6.27	155	7.25	173	8.25	191	9.20	203	9.89	221	11.0			
	66	112	4.79	136	6.38	155	7.40	173	8.41	191	9.44	203	10.1	221	11.3			
	70	112	4.78	136	6.50	155	7.57	173	8.63	191	9.64	203	10.3	221	11.7			
	72	112	4.77	136	6.65	155	7.85	173	9.17	191	10.2	203	10.6	221	12.5			
	75	112	4.76	136	7.01	155	8.30	173	9.71	191	11.2	203	11.6	221	14.2			
	79	112	4.75	136	7.54	155	9.03	173	10.5	191	12.1	203	12.3	221	15.9			
	83	112	4.74	136	8.09	155	9.60	173	11.2	191	13.0	203	13.3	221	18.4			
80	50	112	4.83	136	5.94	155	6.81	173	7.73	191	8.67	203	9.31	221	10.3	103		
	54	112	4.82	136	6.05	155	6.95	173	7.89	191	8.85	203	9.50	221	10.5			
	58	112	4.81	136	6.16	155	7.10	173	8.00	191	8.99	203	9.69	221	10.7			
	62	112	4.80	136	6.27	155	7.25	173	8.25	191	9.20	203	9.89	221	11.0			
	66	112	4.79	136	6.38	155	7.40	173	8.41	191	9.44	203	10.1	221	11.3			
	70	112	4.78	136	6.50	155	7.57	173	8.63	191	9.64	203	10.3	221	11.7			
	72	112	4.77	136	6.65	155	7.85	173	9.17	191	10.2	203	10.6	221	12.5			
	75	112	4.76	136	7.01	155	8.30	173	9.71	191	11.2	203	11.6	221	14.2			
	79	112	4.75	136	7.54	155	9.03	173	10.5	191	12.1	203	12.3	221	15.9			
	83	112	4.74	136	8.09	155	9.60	173	11.2	191	13.0	203	13.3	221	18.4			
70	50	112	4.83	136	5.94	155	6.81	173	7.73	191	8.67	203	9.31	221	10.3	103		
	54	112	4.82	136	6.05	155	6.95	173	7.89	191	8.85	203	9.50	221	10.5			
	58	112	4.81	136	6.16	155	7.10	173	8.00	191	8.99	203	9.69	221	10.7			
	62	112	4.80	136	6.27	155	7.25	173	8.25	191	9.20	203	9.89	221	11.0			
	66	112	4.79	136	6.38	155	7.40	173	8.41	191	9.44	203	10.1	221	11.3			
	70	112	4.78	136	6.50	155	7.57	173	8.63	191	9.64	203	10.3	221	11.7			
	72	112	4.77	136	6.65	155	7.85	173	9.17	191	10.2	203	10.6	221	12.5			
	75	112	4.76	136	7.01	155	8.30	173	9.71	191	11.2	203	11.6	221	14.2			
	79	112	4.75	136	7.54	155	9.03	173	10.5	191	12.1	203	12.3	221	15.9			
	83	112	4.74	136	8.09	155	9.60	173	11.2	191	13.0	203	13.3	221	18.4			
60	50	112	4.83	136	5.94	155	6.81	173	7.73	191	8.67	203	9.31	221	10.3	103		
	54	112	4.82	136	6.05	155	6.95	173	7.89	191	8.85	203	9.50	221	10.5			
	58	112	4.81	136	6.16	155	7.10	173	8.00	191	8.99	203	9.69	221	10.7			
	62	112	4.80	136	6.27	155	7.25	173	8.25	191	9.20	203	9.89	221	11.0			
	66	112	4.79	136	6.38	155	7.40	173	8.41	191	9.44	203	10.1	221	11.3			
	70	112	4.78	136	6.50	155	7.57	173	8.63	191	9.64	203	10.3	221	11.7			
	72	112	4.77	136	6.65	155	7.85	173	9.17	191	10.2	203	10.6	221	12.5			
	75	112	4.76	136	7.01	155	8.30	173	9.71	191	11.2	203	11.6	221	14.2			
	79	112	4.75	136	7.54	155	9.03	173	10.5	191	12.1	203	12.3	221	15.9			
	83	112	4.74	136	8.09	155	9.60	173	11.2	191	13.0	203	13.3	221	18.4			
50	50	112	4.83	136	5.94	155	6.81	173	7.73	191	8.67	203	9.31	221	10.3	103		
	54	112	4.82	136	6.05	155	6.95	173	7.89	191	8.85	203	9.50	221	10.5			
	58	112	4.81	136	6.16	155	7.10	173	8.00	191	8.99	203	9.69	221	10.7			
	62	112	4.80	136	6.27	155	7.25	173	8.25	191	9.20	203	9.89	221	11.0			
	66	112	4.79	136	6.38	155	7.40	173	8.41	191	9.44	203	10.1	221	11.3			
	70	112	4.78	136	6.50	155	7.57	173	8.63	191	9.64	203	10.3	221	11.7			
	72	112	4.77	136	6.65	155	7.85	173	9.17	191	10.2	203	10.6	221	12.5			
	75	112	4.76	136	7.01	155	8.30	173	9.71	191	11.2	203	11.6	221	14.2			
	79	112	4.75	136	7.54	155	9.03	173	10.5	191	12.1	203	12.3	221	15.9			
	83	112	4.74	136	8.09	155	9.60	173	11.2	191	13.0	203	13.3	221	18.4			

TC : Total capacity ; MBH
 PI : Power Input ; kW (Comp.+Outdoor fan motor)
 Note1 : The above table shows the average value of conditions which may occur.

REYQ216PTJU

Outdoor air temp. °F	Indoor air temp. °F												Cooling capacity																															
	64				70				76																																			
	TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW																																
50	50	54	58	62	50	54	58	62	50	54	58	62	50	54	58	62	50	54	58	62	50	54	58	62	50	54	58	62	50	54	58	62	50	54	58	62	50	54	58	62				
55	55	59	63	67	55	59	63	67	55	59	63	67	55	59	63	67	55	59	63	67	55	59	63	67	55	59	63	67	55	59	63	67	55	59	63	67	55	59	63	67	55	59	63	67
60	60	64	68	72	60	64	68	72	60	64	68	72	60	64	68	72	60	64	68	72	60	64	68	72	60	64	68	72	60	64	68	72	60	64	68	72	60	64	68	72	60	64	68	72
65	65	69	73	77	65	69	73	77	65	69	73	77	65	69	73	77	65	69	73	77	65	69	73	77	65	69	73	77	65	69	73	77	65	69	73	77	65	69	73	77	65	69	73	77
70	70	74	78	82	70	74	78	82	70	74	78	82	70	74	78	82	70	74	78	82	70	74	78	82	70	74	78	82	70	74	78	82	70	74	78	82	70	74	78	82	70	74	78	82
75	75	79	83	87	75	79	83	87	75	79	83	87	75	79	83	87	75	79	83	87	75	79	83	87	75	79	83	87	75	79	83	87	75	79	83	87	75	79	83	87	75	79	83	87
80	80	84	88	92	80	84	88	92	80	84	88	92	80	84	88	92	80	84	88	92	80	84	88	92	80	84	88	92	80	84	88	92	80	84	88	92	80	84	88	92	80	84	88	92
85	85	89	93	97	85	89	93	97	85	89	93	97	85	89	93	97	85	89	93	97	85	89	93	97	85	89	93	97	85	89	93	97	85	89	93	97	85	89	93	97	85	89	93	97
90	90	94	98	102	90	94	98	102	90	94	98	102	90	94	98	102	90	94	98	102	90	94	98	102	90	94	98	102	90	94	98	102	90	94	98	102	90	94	98	102	90	94	98	102
95	95	99	103	107	95	99	103	107	95	99	103	107	95	99	103	107	95	99	103	107	95	99	103	107	95	99	103	107	95	99	103	107	95	99	103	107	95	99	103	107	95	99	103	107
100	100	104	108	112	100	104	108	112	100	104	108	112	100	104	108	112	100	104	108	112	100	104	108	112	100	104	108	112	100	104	108	112	100	104	108	112	100	104	108	112	100	104	108	112

TC : Total capacity ; MBH
 PI : Power Input ; kW (Comp.+Outdoor fan motor)
 Note1 : The above table shows the average value of conditions which may occur.

REYQ240PTJU

Combi- nation (%)	Outdoor air temp. (F/DB)	Indoor air temp. F/WB												Cooling capacity				
		57			61			64			70			72		75		
		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	TC	PI	
90	50	54	140	6.46	17.0	7.94	18.3	9.11	21.6	10.3	23.9	11.6	25.4	12.4	27.7	13.7	30.7	
	55	54	140	6.58	17.0	8.09	18.3	9.30	21.6	10.5	23.9	11.8	25.4	12.7	27.7	14.0	31.0	
	60	54	140	6.69	17.0	8.23	18.3	9.49	21.6	10.6	23.9	12.1	25.4	13.0	27.7	14.3	31.3	
	65	54	140	6.81	17.0	8.37	18.3	9.69	21.6	10.8	23.9	12.4	25.4	13.4	27.7	14.6	31.6	
	70	54	140	6.92	17.0	8.51	18.3	9.89	21.6	11.0	23.9	12.7	25.4	13.7	27.7	14.8	31.9	
	75	54	140	7.04	17.0	8.65	18.3	10.09	21.6	11.2	23.9	13.0	25.4	14.0	27.7	15.1	32.2	
	80	54	140	7.15	17.0	8.79	18.3	10.29	21.6	11.4	23.9	13.3	25.4	14.3	27.7	15.4	32.5	
	85	54	140	7.27	17.0	8.93	18.3	10.49	21.6	11.6	23.9	13.6	25.4	14.6	27.7	15.7	32.8	
	90	54	140	7.38	17.0	9.07	18.3	10.69	21.6	11.8	23.9	13.9	25.4	14.9	27.7	16.0	33.1	
	95	54	140	7.50	17.0	9.21	18.3	10.89	21.6	12.0	23.9	14.2	25.4	15.2	27.7	16.3	33.4	
80	50	54	125	5.74	15.2	7.00	17.2	8.00	19.2	9.05	21.2	10.1	22.6	10.9	24.6	23.8	28.8	
	55	54	125	5.84	15.2	7.14	17.2	8.13	19.2	9.23	21.2	10.3	22.6	11.1	24.6	24.2	29.2	
	60	54	125	5.95	15.2	7.27	17.2	8.26	19.2	9.42	21.2	10.5	22.6	11.3	24.6	24.6	29.6	
	65	54	125	6.06	15.2	7.42	17.2	8.50	19.2	9.62	21.2	10.8	22.6	11.6	24.6	25.0	30.0	
	70	54	125	6.18	15.2	7.57	17.2	8.68	19.2	9.83	21.2	11.0	22.6	11.8	24.6	25.4	30.4	
	75	54	125	6.30	15.2	7.73	17.2	8.87	19.2	10.0	21.2	11.5	22.6	12.2	24.6	25.8	30.8	
	80	54	125	6.42	15.2	7.88	17.2	9.07	19.2	10.2	21.2	12.0	22.6	12.6	24.6	26.2	31.2	
	85	54	125	6.54	15.2	8.04	17.2	9.27	19.2	10.4	21.2	12.5	22.6	13.0	24.6	26.6	31.6	
	90	54	125	6.66	15.2	8.20	17.2	9.47	19.2	10.6	21.2	13.0	22.6	13.4	24.6	27.0	32.0	
	95	54	125	6.78	15.2	8.36	17.2	9.67	19.2	10.8	21.2	13.5	22.6	13.8	24.6	27.4	32.4	
70	50	54	109	5.00	13.3	6.22	15.0	7.00	16.8	17.6	18.6	19.6	20.6	21.6	22.6	23.6	24.6	
	55	54	109	5.13	13.3	6.33	15.0	7.21	16.8	17.8	18.8	19.8	20.8	21.8	22.8	23.8	24.8	
	60	54	109	5.26	13.3	6.46	15.0	7.35	16.8	18.0	19.0	20.0	21.0	22.0	23.0	24.0	25.0	
	65	54	109	5.40	13.3	6.58	15.0	7.50	16.8	18.2	19.2	20.2	21.2	22.2	23.2	24.2	25.2	
	70	54	109	5.52	13.3	6.71	15.0	7.66	16.8	18.4	19.4	20.4	21.4	22.4	23.4	24.4	25.4	
	75	54	109	5.65	13.3	6.85	15.0	7.74	16.8	18.6	19.6	20.6	21.6	22.6	23.6	24.6	25.6	
	80	54	109	5.78	13.3	6.99	15.0	7.87	16.8	18.8	19.8	20.8	21.8	22.8	23.8	24.8	25.8	
	85	54	109	5.92	13.3	7.13	15.0	8.00	16.8	19.0	20.0	21.0	22.0	23.0	24.0	25.0	26.0	
	90	54	109	6.05	13.3	7.27	15.0	8.13	16.8	19.2	20.2	21.2	22.2	23.2	24.2	25.2	26.2	
	95	54	109	6.18	13.3	7.41	15.0	8.26	16.8	19.4	20.4	21.4	22.4	23.4	24.4	25.4	26.4	
60	50	54	83.4	4.41	11.4	5.26	12.9	5.93	14.4	6.64	15.9	7.37	16.9	7.88	18.4	8.65	19.4	
	55	54	83.4	4.48	11.4	5.35	12.9	6.04	14.4	6.76	15.9	7.52	16.9	8.03	18.4	8.83	19.4	
	60	54	83.4	4.55	11.4	5.44	12.9	6.15	14.4	6.89	15.9	7.66	16.9	8.19	18.4	9.01	19.4	
	65	54	83.4	4.63	11.4	5.54	12.9	6.27	14.4	7.03	15.9	7.82	16.9	8.36	18.4	9.20	19.4	
	70	54	83.4	4.70	11.4	5.64	12.9	6.39	14.4	7.16	15.9	7.99	16.9	8.54	18.4	9.39	19.4	
	75	54	83.4	4.78	11.4	5.74	12.9	6.52	14.4	7.32	15.9	8.16	16.9	8.72	18.4	9.58	19.4	
	80	54	83.4	4.83	11.4	5.81	12.9	6.58	14.4	7.42	15.9	8.24	16.9	8.82	18.4	9.68	19.4	
	85	54	83.4	4.90	11.4	5.89	12.9	6.68	14.4	7.56	15.9	8.37	16.9	8.92	18.4	9.78	19.4	
	90	54	83.4	4.99	11.4	5.99	12.9	6.80	14.4	7.70	15.9	8.51	16.9	9.08	18.4	9.97	19.4	
	95	54	83.4	5.00	11.4	6.00	12.9	6.88	14.4	7.84	15.9	8.65	16.9	9.16	18.4	10.16	19.4	
50	50	54	77.9	3.61	9.47	4.54	10.7	5.07	12.0	5.63	13.3	6.22	14.1	6.75	15.4	7.24	16.3	
	55	54	77.9	3.66	9.47	4.61	10.7	5.16	12.0	5.74	13.3	6.30	14.1	6.82	15.4	7.31	16.3	
	60	54	77.9	3.71	9.47	4.68	10.7	5.25	12.0	5.84	13.3	6.38	14.1	6.89	15.4	7.38	16.3	
	65	54	77.9	3.76	9.47	4.75	10.7	5.34	12.0	5.95	13.3	6.46	14.1	6.96	15.4	7.45	16.3	
	70	54	77.9	3.81	9.47	4.82	10.7	5.44	12.0	6.07	13.3	6.54	14.1	7.02	15.4	7.52	16.3	
	75	54	77.9	3.86	9.47	4.89	10.7	5.54	12.0	6.17	13.3	6.62	14.1	7.09	15.4	7.59	16.3	
	80	54	77.9	3.91	9.47	4.96	10.7	5.64	12.0	6.28	13.3	6.70	14.1	7.16	15.4	7.66	16.3	
	85	54	77.9	3.96	9.47	5.03	10.7	5.74	12.0	6.39	13.3	6.78	14.1	7.23	15.4	7.73	16.3	
	90	54	77.9	4.01	9.47	5.10	10.7	5.84	12.0	6.49	13.3	6.86	14.1	7.30	15.4	7.80	16.3	
	95	54	77.9	4.06	9.47	5.17	10.7	5.94	12.0	6.59	13.3	6.94	14.1	7.37	15.4	7.87	16.3	

Combi- nation (%)	Outdoor air temp. (F/DB)	Indoor air temp. F/WB												Cooling capacity				
		57			61			64			70			72		75		
		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	TC	PI	
130	50	202	9.60	24.6	12.0	27.9	13.9	30.2	14.4	30.8	14.6	31.3	14.6	31.9	14.8	32.1		
	55	202	9.80	24.6	12.3	27.9	14.2	29.8	14.7	30.8	14.9	31.4	14.9	32.1	14.9	32.1		
	60	202	10.0	24.6	12.6	27.9	14.5	29.8	15.0	30.8	15.1	31.4	15.1	32.1	15.1	32.1		
	65	202	10.2	24.6	12.9	27.9	14.8	29.8	15.3	30.8	15.4	31.4	15.4	32.1	15.4	32.1		
	70	202	10.4	24.6	13.2	27.9	15.1	29.8	15.6	30.8	15.7	31.4	15.7	32.1	15.7	32.1		
	75	202	10.6	24.6	13.5	27.9	15.4	29.8	15.9	30.8	16.0	31.4	16.0	32.1	16.0	32.1		
	80	202	10.8	24.6	13.8	27.9	15.7	29.8	16.2	30.8	16.3	31.4	16.3	32.1	16.3	32.1		
	85	202	11.0	24.6	14.1	27.9	16.0	29.8	16.5	30.8	16.6	31.4	16.6	32.1	16.6	32.1		
	90	202	11.2	24.6	14.4	27.9	16.3	29.8	16.8	30.8	16.9	31.4	16.9	32.1	16.9	32.1		
	95	202	11.4	24.6	14.7	27.9	16.6	29.8	17.1	30.8	17.2	31.4	17.2	32.1	17.2	32.1		
120	50	187	8.96	22.7	11.0	25.8	12.9	28.8	14.4	30.7	14.6	31.3	14.6	31.3	14.6	31.3		
	55	187	9.14	22.7	11.4	25.8	13.2	28.8	14.7	30.9	14.9	31.3	14.9	31.3	14.9	31.3		
	60	187	9.33	22.7	11.7	25.8	13.5	28.8	15.1	30.9	15.1	31.3	15.1	31.3	15.1	31.3		
	65	187	9.52	22.7	12.0	25.8	13.8	28.8	15.4	30.9	15.4	31.3	15.4	31.3	15.4	31.3		
	70	187	9.71	22.7	12.3	25.8	14.1	28.8	15.7	30.9	15.7	31.3	15.7	31.3	15.7	31.3		
	75	187	9.90	22.7	12.6	25.8	14.4	28.8	16.0	30.9	16.0	31.3	16.0	31.3	16.0	31.3		
	80	187	10.09	22.7	12.9	25.8	14.7	28.8	16.3	30.9	16.3	31.3	16.3	31.3	16.3	31.3		
	85	187	10.28	22.7	13.2	25.8	15.0	28.8	16.6	30.9	16.6	31.3	16.6	31				

8.2 Heating Capacity (REYQ-PTJU)

REYQ72PTJU

Combit-nation (%)	Outdoor air temp. (F/DDB)	Indoor air temp. F/DB												Heating capacity																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																							
		61				65				68					70				75																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																		
		TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW		TC	PI	MBH	KW	TC	PI	MBH	KW																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																															
100	-3.64	-4.0	70.6	7.12	70.4	7.34	70.3	7.50	70.2	7.61	70.1	7.72	70.0	7.88	70.0	7.88	70.0	7.88	70.0	7.88	70.0	7.88	70.0	7.88	90	-1.84	-2.2	71.0	7.14	70.8	7.36	70.7	7.52	70.6	7.63	70.5	7.74	70.4	7.90	70.4	7.90	70.4	7.90	70.4	7.90	70.4	7.90	70.4	7.90	80	9.5	8.5	73.3	7.35	74.2	7.53	75.0	7.66	75.8	7.75	76.5	7.82	77.1	7.89	77.7	7.95	78.2	7.99	78.7	8.04	79.1	8.11	79.6	8.17	70	13.0	12.0	76.6	7.41	76.4	7.61	76.3	7.76	76.2	7.88	76.1	7.96	76.0	8.04	76.0	8.11	76.0	8.17	76.0	8.24	76.0	8.31	76.0	8.38	60	15.0	14.0	77.7	7.46	77.6	7.65	77.4	7.80	77.3	7.90	77.3	8.00	77.3	8.08	77.3	8.15	77.3	8.22	77.3	8.29	77.3	8.36	77.3	8.43	50	17.0	15.5	78.6	7.49	78.5	7.69	78.3	7.84	78.2	7.93	78.0	8.01	78.0	8.08	78.0	8.15	78.0	8.22	78.0	8.29	78.0	8.36	78.0	8.43	40	19.0	18.0	80.0	7.52	80.1	7.73	79.9	7.89	79.8	7.98	79.8	8.06	79.8	8.13	79.8	8.20	79.8	8.27	79.8	8.34	79.8	8.41	79.8	8.48	30	22.0	20.0	84.6	7.61	84.4	7.82	84.4	8.00	84.0	8.10	84.0	8.17	84.0	8.24	84.0	8.31	84.0	8.38	84.0	8.45	84.0	8.52	84.0	8.59	20	35.0	32.0	91.6	7.95	88.5	8.01	84.0	8.10	84.0	8.17	84.0	8.24	84.0	8.31	84.0	8.38	84.0	8.45	84.0	8.52	84.0	8.59	84.0	8.66	10	43.0	40.0	94.5	7.92	88.5	8.02	84.0	8.11	84.0	8.18	84.0	8.25	84.0	8.32	84.0	8.39	84.0	8.46	84.0	8.53	84.0	8.60	84.0	8.67	0	47.0	43.0	94.5	7.17	88.5	7.35	84.0	7.44	84.0	7.53	84.0	7.62	84.0	7.71	84.0	7.80	84.0	7.89	84.0	7.98	84.0	8.07	84.0	8.16	-10	51.0	47.0	94.5	6.76	88.5	6.95	84.0	7.04	84.0	7.13	84.0	7.22	84.0	7.31	84.0	7.40	84.0	7.49	84.0	7.58	84.0	7.67	84.0	7.76	-20	54.0	50.0	94.5	6.20	88.5	6.39	84.0	6.48	84.0	6.57	84.0	6.66	84.0	6.75	84.0	6.84	84.0	6.93	84.0	7.02	84.0	7.11	84.0	7.20	-30	57.0	53.0	94.5	5.93	88.5	6.12	84.0	6.21	84.0	6.30	84.0	6.39	84.0	6.48	84.0	6.57	84.0	6.66	84.0	6.75	84.0	6.84	84.0	6.93	-40	60.0	56.0	94.5	5.93	88.5	6.12	84.0	6.21	84.0	6.30	84.0	6.39	84.0	6.48	84.0	6.57	84.0	6.66	84.0	6.75	84.0	6.84	84.0	6.93	-50	-3.64	-4.0	70.3	7.46	70.2	7.66	70.1	7.81	70.0	7.91	69.9	8.00	69.8	8.09	69.7	8.18	69.6	8.27	69.5	8.36	69.4	8.45	69.3	8.54	-60	-1.84	-2.2	70.7	7.48	70.6	7.68	70.5	7.83	70.4	7.92	70.2	8.00	70.2	8.08	70.2	8.16	70.2	8.24	70.2	8.32	70.2	8.40	70.2	8.48	-70	9.5	5.0	73.1	7.59	72.9	7.78	72.8	7.92	72.7	8.01	72.7	8.08	72.7	8.15	72.7	8.22	72.7	8.29	72.7	8.36	72.7	8.43	72.7	8.50	-80	15.0	14.0	72.5	7.72	72.3	7.95	72.6	8.11	72.9	8.26	73.2	8.37	73.5	8.48	73.8	8.59	74.1	8.70	74.4	8.81	74.7	8.92	75.0	9.03	-90	17.0	15.5	78.8	7.86	78.6	8.01	78.6	8.16	78.6	8.31	78.6	8.46	78.6	8.61	78.6	8.76	78.6	8.91	78.6	9.06	78.6	9.21	78.6	9.36	-100	19.0	18.0	80.0	7.86	79.6	8.01	79.6	8.16	79.6	8.31	79.6	8.46	79.6	8.61	79.6	8.76	79.6	8.91	79.6	9.06	79.6	9.21	79.6	9.36	-110	22.0	20.0	84.3	8.01	79.6	8.16	79.6	8.31	79.6	8.46	79.6	8.61	79.6	8.76	79.6	8.91	79.6	9.06	79.6	9.21	79.6	9.36	79.6	9.51	-120	30.0	32.0	85.0	7.33	79.6	7.48	79.6	7.63	79.6	7.78	79.6	7.93	79.6	8.08	79.6	8.23	79.6	8.38	79.6	8.53	79.6	8.68	79.6	8.83	-130	35.0	36.0	85.0	6.95	79.6	7.10	79.6	7.25	79.6	7.40	79.6	7.55	79.6	7.70	79.6	7.85	79.6	8.00	79.6	8.15	79.6	8.30	79.6	8.45	-140	40.0	40.0	85.0	6.57	79.6	6.72	79.6	6.87	79.6	7.02	79.6	7.17	79.6	7.32	79.6	7.47	79.6	7.62	79.6	7.77	79.6	7.92	79.6	8.07	-150	47.0	47.0	85.0	5.96	79.6	6.13	79.6	6.28	79.6	6.43	79.6	6.58	79.6	6.73	79.6	6.88	79.6	7.03	79.6	7.18	79.6	7.33	79.6	7.48	-160	51.0	51.0	85.0	5.71	79.6	6.08	79.6	6.23	79.6	6.38	79.6	6.53	79.6	6.68	79.6	6.83	79.6	6.98	79.6	7.13	79.6	7.28	79.6	7.43	-170	54.0	50.0	85.0	5.47	79.6	5.93	79.6	6.08	79.6	6.23	79.6	6.38	79.6	6.53	79.6	6.68	79.6	6.83	79.6	6.98	79.6	7.13	79.6	7.28	-180	57.0	53.0	85.0	5.47	79.6	5.93	79.6	6.08	79.6	6.23	79.6	6.38	79.6	6.53	79.6	6.68	79.6	6.83	79.6	6.98	79.6	7.13	79.6	7.28	-190	60.0	56.0	85.0	5.24	79.6	5.88	79.6	6.03	79.6	6.18	79.6	6.33	79.6	6.48	79.6	6.63	79.6	6.78	79.6	6.93	79.6	7.08	79.6	7.23	-200	-3.64	-4.0	70.1	7.81	69.9	8.00	69.8	8.09	69.7	8.18	69.6	8.27	69.5	8.36	69.4	8.45	69.3	8.54	69.2	8.63	69.1	8.72	69.0	8.81	-210	-1.84	-2.2	70.5	7.83	70.3	8.00	70.2	8.09	70.1	8.18	70.0	8.27	69.9	8.36	69.8	8.45	69.7	8.54	69.6	8.63	69.5	8.72	69.4	8.81	-220	9.5	5.0	72.8	7.92	72.7	8.11	72.6	8.20	72.5	8.29	72.4	8.38	72.3	8.47	72.2	8.56	72.1	8.65	72.0	8.74	71.9	8.83	71.8	8.92	-230	15.0	14.0	75.6	7.96	75.5	8.15	75.4	8.24	75.3	8.33	75.2	8.42	75.1	8.51	75.0	8.60	74.9	8.69	74.8	8.78	74.7	8.87	74.6	8.96	-240	17.0	15.5	76.6	7.70	76.5	7.89	76.4	7.98	76.3	8.07	76.2	8.16	76.1	8.25	76.0	8.34	75.9	8.43	75.8	8.52	75.7	8.61	75.6	8.70	-250	19.0	18.0	75.6	7.34	75.5	7.53	75.4	7.62	75.3	7.71	75.2	7.80	75.1	7.89	75.0	7.98	74.9	8.07	74.8	8.16	74.7	8.25	74.6	8.34	-260	22.0	20.0	75.6	6.98	75.5	7.17	75.4	7.26	75.3	7.35	75.2	7.44	75.1	7.53	75.0	7.62	74.9	7.71	74.8	7.80	74.7	7.89	74.6	7.98	-270	30.0	30.0	75.6	6.68	75.5	6.87	75.4	6.96	75.3	7.05	75.2	7.14	75.1	7.23	75.0	7.32	74.9	7.41	74.8	7.50	74.7	7.59	74.6	7.68	-280	35.0	32.0	75.6	6.35	75.5	6.54	75.4	6.63	75.3	6.72	75.2	6.81	75.1	6.90	75.0	6.99	74.9	7.08	74.8	7.17	74.7	7.26	74.6	7.35	-290	40.0	40.0	75.6	6.08	75.5	6.27	75.4	6.36	75.3	6.45	75.2	6.54	75.1	6.63	75.0	6.72	74.9	6.81	74.8	6.90	74.7	6.99	74.6	7.08	-300	47.0	43.0	75.6	5.71	75.5	5.94	75.4	6.03	75.3	6.12	75.2	6.21	75.1	6.30	75.0	6.39	74.9	6.48	74.8	6.57	74.7	6.66	74.6	6.75	-310	51.0	51.0	75.6	5.47	75.5	5.70	75.4	5.79	75.3	5.88	75.2	5.97	75.1	6.06	75.0	6.15	74.9	6.24	74.8	6.33	74.7	6.42	74.6	6.51	-320	54.0	50.0	75.6	5.24	75.5	5.47	75.4	5.56	75.3	5.65	75.2	5.74	75.1	5.83	75.0	5.92	74.9	6.01	74.8	6.10	74.7	6.19	74.6	6.28	-330	57.0	53.0	75.6	5.24	75.5	5.47	75.4	5.56	75.3	5.65	75.2	5.74	75.1	5.83	75.0	5.92	74.9	6.01	74.8	6.10	74.7	6.19	74.6	6.28	-340	60.0	56.0	75.6	5.01	75.5	5.24	75.4	5.33	75.3	5.42	75.2	5.51	75.1	5.60	75.0	5.69	74.9	5.78	74.8	5.87	74.7	5.96	74.6	6.05	-350

Combit-nation (%)	Outdoor air temp. (F/DDB)	Indoor air temp. F/DB												Heating capacity																																																																																																																				
		61				65				68					70				75																																																																																																															
		TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW		TC	PI	MBH	KW	TC	PI	MBH	KW																																																																																																												
130	-3.64	-4.0	71.4	6.08	71.2	6.37	71.0	6.58	70.9	6.72	70.8	6.87	70.8	7.02	70.8	7.17	70.8	7.32	70.8	7.47	70.8	7.62	70.8	7.77	90	-1.84	-2.2	71.8	6.11	71.6	6.40	71.4	6.61	71.3	6.75	71.2	6.89	71.0	7.03	71.0	7.17	71.0	7.31	71.0	7.45	71.0	7.59	71.0	7.73	80	9.5	8.5	75.7	6.54	75.3	6.83	75.0	7.04	74.9	7.18	74.8	7.32	74.7	7.46	74.6	7.60	74.5	7.74	74.4	7.88	74.3	8.02	74.2	8.16	70	13.0	12.0	77.4	6.46	77.2	6.72	77.0	6.91	76.9	7.04	76.8	7.18	76.6	7.32	76.5	7.46	76.4	7.60	76.3	7.74	76.2	7.88	76.1	8.02	60	15.0	14.0	78.5	6.52	78.3	6.78	78.2	6.97	78.0	7.10	77.9	7.23	77.8	7.37	77.7	7.50	77.6	7.64	77.5	7.78	77.4	7.92	77.3	8.06	50	17.0	15.5	79.4	6.52	79.2

Heating capacity

Comb- ration (%)	Outdoor air temp. (F/DB)	Indoor air Temp. F/DB																	
		61			65			68			70			72			75		
		TC MBH	PI kW	TC MBH	PI kW	TC MBH	PI kW	TC MBH	PI kW	TC MBH	PI kW	TC MBH	PI kW	TC MBH	PI kW	TC MBH	PI kW		
70	-3.64	-4.0	66.1	7.48	61.9	6.90	58.8	6.47	56.7	6.20	54.6	5.92	51.3	5.52	48.1	5.13	44.1		
	-1.84	-2.2	68.1	7.43	61.9	6.85	58.8	6.43	56.7	6.15	54.6	5.82	51.3	5.48	48.1	5.09	44.1		
	0.5	0.5	68.1	7.43	61.9	6.85	58.8	6.43	56.7	6.15	54.6	5.82	51.3	5.48	48.1	5.09	44.1		
	13.0	12.0	66.1	6.94	61.9	6.34	58.8	6.05	56.7	5.71	54.6	5.46	51.3	4.92	48.1	4.66	44.1		
	17.0	15.0	66.1	6.62	61.9	6.23	58.8	5.85	56.7	5.51	54.6	5.27	51.3	4.92	48.1	4.66	44.1		
	19.0	17.0	66.1	6.53	61.9	6.03	58.8	5.67	56.7	5.43	54.6	5.20	51.3	4.86	47.4	4.66	44.1		
	22.0	20.0	66.1	6.23	61.9	5.89	58.8	5.53	56.7	5.30	54.6	5.08	51.3	4.74	46.6	4.46	44.1		
	30.0	28.0	66.1	5.96	61.9	5.52	58.8	5.19	56.7	4.98	54.6	4.77	51.3	4.46	44.1	4.27	41.4		
	35.0	32.0	66.1	5.42	61.9	5.02	58.8	4.73	56.7	4.54	54.6	4.35	51.3	4.08	39.0	3.79	37.9		
	40.0	30.0	66.1	4.89	61.9	4.54	58.8	4.29	56.7	4.13	54.6	3.95	51.3	3.79	37.9	3.57	35.7		
	47.0	43.0	66.1	4.37	61.9	4.37	58.8	4.12	56.7	3.92	54.6	3.80	51.3	3.57	35.7	3.34	34.0		
	54.0	50.0	66.1	4.28	61.9	4.14	58.8	3.92	56.7	3.62	54.6	3.48	51.3	3.27	34.0	3.15	32.7		
57.0	53.0	66.1	4.11	61.9	3.83	58.8	3.62	56.7	3.49	54.6	3.35	51.3	3.15	31.5	3.04	31.5			
60.0	56.0	66.1	3.95	61.9	3.68	58.8	3.49	56.7	3.36	54.6	3.23	51.3	3.04	30.4	2.93	30.4			
60	-3.64	-4.0	56.7	6.19	53.1	5.73	50.4	5.39	48.6	5.17	46.8	4.95	44.1	4.62	41.4	4.33	39.0		
	-1.84	-2.2	56.7	6.15	53.1	5.69	50.4	5.35	48.6	5.13	46.8	4.91	44.1	4.59	41.4	4.33	39.0		
	0.5	0.5	56.7	6.15	53.1	5.69	50.4	5.35	48.6	5.13	46.8	4.91	44.1	4.59	41.4	4.33	39.0		
	13.0	12.0	56.7	5.67	53.1	5.34	50.4	5.03	48.6	4.82	46.8	4.62	44.1	4.32	41.4	4.14	39.0		
	17.0	15.0	56.7	5.51	53.1	5.10	50.4	4.81	46.8	4.63	46.8	4.42	44.1	4.14	39.0	3.90	37.9		
	19.0	17.0	56.7	5.43	53.1	5.04	50.4	4.74	46.8	4.55	46.8	4.37	44.1	4.09	39.0	3.79	37.9		
	22.0	20.0	56.7	5.20	53.1	4.92	50.4	4.63	46.8	4.45	46.8	4.27	44.1	4.00	39.0	3.79			
	26.0	24.0	56.7	4.98	53.1	4.82	50.4	4.54	46.8	4.36	46.8	4.18	44.1	3.92	37.9	3.79			
	30.0	28.0	56.7	4.76	53.1	4.62	50.4	4.36	46.8	4.19	46.8	4.02	44.1	3.61	36.1	3.61			
	35.0	32.0	56.7	4.54	53.1	4.42	50.4	4.17	46.8	4.01	46.8	3.85	44.1	3.46	34.6	3.46			
	39.0	36.0	56.7	4.33	53.1	4.22	50.4	3.99	46.8	3.83	46.8	3.68	44.1	3.30	33.0	3.30			
	44.0	40.0	56.7	4.11	53.1	4.02	50.4	3.80	46.8	3.66	46.8	3.51	44.1	3.15	31.5	3.15			
47.0	43.0	56.7	3.96	53.1	3.83	50.4	3.62	46.8	3.49	46.8	3.35	44.1	3.04	30.4	3.04				
51.0	47.0	56.7	3.76	53.1	3.61	50.4	3.42	46.8	3.20	46.8	3.08	44.1	2.90	29.0	2.90				
54.0	50.0	56.7	3.62	53.1	3.38	50.4	3.20	46.8	3.09	46.8	2.97	44.1	2.80	28.0	2.80				
57.0	53.0	56.7	3.49	53.1	3.26	50.4	3.09	46.8	2.97	46.8	2.86	44.1	2.70	27.0	2.70				
60.0	56.0	56.7	3.35	53.1	3.14	50.4	2.97	46.8	2.87	46.8	2.76	44.1	2.61	26.1	2.61				
50	-3.64	-4.0	47.2	5.00	44.2	4.64	42.0	4.38	40.5	4.20	39.0	4.03	36.8	3.78	36.8	3.55	34.6		
	-1.84	-2.2	47.2	4.97	44.2	4.61	42.0	4.35	40.5	4.18	39.0	4.01	36.8	3.76	36.8	3.55	34.6		
	0.5	0.5	47.2	4.97	44.2	4.61	42.0	4.35	40.5	4.18	39.0	4.01	36.8	3.76	36.8	3.55	34.6		
	13.0	12.0	47.2	4.67	44.2	4.34	42.0	4.10	40.5	3.94	39.0	3.78	36.8	3.55	34.6	34.6			
	17.0	15.0	47.2	4.35	44.2	4.23	42.0	3.99	40.5	3.84	39.0	3.69	36.8	3.46	34.6	34.6			
	19.0	17.0	47.2	4.21	44.2	4.10	42.0	3.88	40.5	3.75	39.0	3.58	36.8	3.36	33.6	33.6			
	22.0	20.0	47.2	4.31	44.2	4.01	42.0	3.79	40.5	3.65	39.0	3.50	36.8	3.29	32.9	32.9			
	26.0	24.0	47.2	4.23	44.2	3.94	42.0	3.72	40.5	3.58	39.0	3.44	36.8	3.23	32.3	32.3			
	30.0	28.0	47.2	4.06	44.2	3.78	42.0	3.58	40.5	3.44	39.0	3.31	36.8	3.11	31.1	31.1			
	35.0	32.0	47.2	3.89	44.2	3.63	42.0	3.43	40.5	3.30	39.0	3.18	36.8	2.99	29.9	29.9			
	39.0	36.0	47.2	3.72	44.2	3.47	42.0	3.29	40.5	3.16	39.0	3.05	36.8	2.87	28.7	28.7			
	44.0	40.0	47.2	3.55	44.2	3.31	42.0	3.14	40.5	3.03	39.0	2.91	36.8	2.75	27.5	27.5			
47.0	43.0	47.2	3.39	44.2	3.16	42.0	3.00	40.5	2.89	39.0	2.79	36.8	2.63	26.3	26.3				
51.0	47.0	47.2	3.27	44.2	3.05	42.0	2.90	40.5	2.79	39.0	2.69	36.8	2.54	25.4	25.4				
54.0	50.0	47.2	3.11	44.2	2.89	42.0	2.76	40.5	2.67	40.5	2.56	39.0	2.43	24.3	24.3				
57.0	53.0	47.2	2.89	44.2	2.71	42.0	2.67	40.5	2.49	39.0	2.40	36.8	2.27	22.7	22.7				
60.0	56.0	47.2	2.79	44.2	2.62	42.0	2.49	40.5	2.40	39.0	2.32	36.8	2.20	22.0	22.0				

TC : Total capacity ; MBH
 PI : Power Input ; kW (Comp.+Outdoor fan motor)
 Note1 : is shown as reference
 Note 2 : The above table shows the average value of outdoor air temperature range shown by

REYQ96PTJU

Combit-nation (%)	Outdoor air temp. (F/DB)	Indoor air temp. F/DB												Heating capacity			
		61				65				70				72		75	
		TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW
100	-3.64	4.0	7.30	7.27	7.88	7.27	8.26	7.23	8.51	7.22	8.76	7.20	9.14	7.12	10.07	7.12	10.77
	-1.84	2.2	7.42	7.52	8.02	7.37	8.39	7.36	8.64	7.35	8.88	7.33	9.25	7.24	10.18	7.24	10.8
	0.5	5.0	8.02	8.14	7.99	8.59	7.97	8.93	7.95	9.16	7.94	8.95	7.92	9.73	7.85	10.9	7.83
	9.5	8.5	8.76	8.76	8.23	8.69	8.21	8.62	8.69	8.66	8.95	8.66	9.72	8.61	10.9	8.61	11.3
	13.0	12.0	8.76	8.21	8.73	8.66	8.71	8.69	8.69	8.66	8.95	8.66	10.4	8.66	11.2	8.79	11.4
	15.0	14.0	8.99	8.40	8.96	8.84	8.91	8.92	8.88	8.95	8.88	9.06	10.2	9.03	10.5	8.82	11.4
	17.0	15.5	9.17	8.54	9.14	8.97	9.12	9.01	9.51	9.09	9.39	10.2	10.3	10.3	11.1	9.82	11.4
	19.0	18.0	9.48	8.78	9.45	9.19	9.42	9.50	9.41	9.71	9.39	9.92	10.2	10.2	11.1	10.1	11.1
	22.0	20.0	9.74	8.96	9.71	9.37	9.67	9.67	10.2	10.2	10.4	10.2	10.7	10.7	11.4	11.1	11.1
	30.0	28.0	10.9	9.67	10.9	10.3	10.8	10.5	10.8	10.5	10.8	10.7	10.8	10.9	10.4	10.4	10.4
90	-3.64	4.0	7.30	7.27	7.88	7.27	8.26	7.23	8.51	7.22	8.76	7.20	9.14	7.12	10.07	7.12	10.77
	-1.84	2.2	7.42	7.52	8.02	7.37	8.39	7.36	8.64	7.35	8.88	7.33	9.25	7.24	10.18	7.24	10.8
	0.5	5.0	8.02	8.14	7.99	8.59	7.97	8.93	7.95	9.16	7.94	8.95	7.92	9.73	7.85	10.9	7.83
	9.5	8.5	8.76	8.76	8.23	8.69	8.21	8.62	8.69	8.66	8.95	8.66	9.72	8.61	10.9	8.61	11.3
	13.0	12.0	8.76	8.21	8.73	8.66	8.71	8.69	8.69	8.66	8.95	8.66	10.4	8.66	11.2	8.79	11.4
	15.0	14.0	8.99	8.40	8.96	8.84	8.91	8.92	8.88	8.95	8.88	9.06	10.2	9.03	10.5	8.82	11.4
	17.0	15.5	9.17	8.54	9.14	8.97	9.12	9.01	9.51	9.09	9.39	10.2	10.3	10.3	11.1	10.1	11.1
	19.0	18.0	9.48	8.78	9.45	9.19	9.42	9.50	9.41	9.71	9.39	9.92	10.2	10.2	11.1	10.1	11.1
	22.0	20.0	9.74	8.96	9.71	9.37	9.67	9.67	10.2	10.2	10.4	10.2	10.7	10.7	11.4	11.1	11.1
	30.0	28.0	10.9	9.67	10.9	10.3	10.8	10.5	10.8	10.5	10.8	10.7	10.8	10.9	10.4	10.4	10.4
80	-3.64	4.0	7.30	7.27	7.88	7.27	8.26	7.23	8.51	7.22	8.76	7.20	9.14	7.12	10.07	7.12	10.77
	-1.84	2.2	7.42	7.52	8.02	7.37	8.39	7.36	8.64	7.35	8.88	7.33	9.25	7.24	10.18	7.24	10.8
	0.5	5.0	8.02	8.14	7.99	8.59	7.97	8.93	7.95	9.16	7.94	8.95	7.92	9.73	7.85	10.9	7.83
	9.5	8.5	8.76	8.76	8.23	8.69	8.21	8.62	8.69	8.66	8.95	8.66	9.72	8.61	10.9	8.61	11.3
	13.0	12.0	8.76	8.21	8.73	8.66	8.71	8.69	8.69	8.66	8.95	8.66	10.4	8.66	11.2	8.79	11.4
	15.0	14.0	8.99	8.40	8.96	8.84	8.91	8.92	8.88	8.95	8.88	9.06	10.2	9.03	10.5	8.82	11.4
	17.0	15.5	9.17	8.54	9.14	8.97	9.12	9.01	9.51	9.09	9.39	10.2	10.3	10.3	11.1	10.1	11.1
	19.0	18.0	9.48	8.78	9.45	9.19	9.42	9.50	9.41	9.71	9.39	9.92	10.2	10.2	11.1	10.1	11.1
	22.0	20.0	9.74	8.96	9.71	9.37	9.67	9.67	10.2	10.2	10.4	10.2	10.7	10.7	11.4	11.1	11.1
	30.0	28.0	10.9	9.67	10.9	10.3	10.8	10.5	10.8	10.5	10.8	10.7	10.8	10.9	10.4	10.4	10.4

Combit-nation (%)	Outdoor air temp. (F/DB)	Indoor air temp. F/DB												Heating capacity			
		61				65				70				72		75	
		TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW
130	-3.64	4.0	7.30	7.27	7.88	7.27	8.26	7.23	8.51	7.22	8.76	7.20	9.14	7.12	10.07	7.12	10.77
	-1.84	2.2	7.42	7.52	8.02	7.37	8.39	7.36	8.64	7.35	8.88	7.33	9.25	7.24	10.18	7.24	10.8
	0.5	5.0	8.02	8.14	7.99	8.59	7.97	8.93	7.95	9.16	7.94	8.95	7.92	9.73	7.85	10.9	7.83
	9.5	8.5	8.76	8.76	8.23	8.69	8.21	8.62	8.69	8.66	8.95	8.66	9.72	8.61	10.9	8.61	11.3
	13.0	12.0	8.76	8.21	8.73	8.66	8.71	8.69	8.69	8.66	8.95	8.66	10.4	8.66	11.2	8.79	11.4
	15.0	14.0	8.99	8.40	8.96	8.84	8.91	8.92	8.88	8.95	8.88	9.06	10.2	9.03	10.5	8.82	11.4
	17.0	15.5	9.17	8.54	9.14	8.97	9.12	9.01	9.51	9.09	9.39	10.2	10.3	10.3	11.1	10.1	11.1
	19.0	18.0	9.48	8.78	9.45	9.19	9.42	9.50	9.41	9.71	9.39	9.92	10.2	10.2	11.1	10.1	11.1
	22.0	20.0	9.74	8.96	9.71	9.37	9.67	9.67	10.2	10.2	10.4	10.2	10.7	10.7	11.4	11.1	11.1
	30.0	28.0	10.9	9.67	10.9	10.3	10.8	10.5	10.8	10.5	10.8	10.7	10.8	10.9	10.4	10.4	10.4
120	-3.64	4.0	7.30	7.27	7.88	7.27	8.26	7.23	8.51	7.22	8.76	7.20	9.14	7.12	10.07	7.12	10.77
	-1.84	2.2	7.42	7.52	8.02	7.37	8.39	7.36	8.64	7.35	8.88	7.33	9.25	7.24	10.18	7.24	10.8
	0.5	5.0	8.02	8.14	7.99	8.59	7.97	8.93	7.95	9.16	7.94	8.95	7.92	9.73	7.85	10.9	7.83
	9.5	8.5	8.76	8.76	8.23	8.69	8.21	8.62	8.69	8.66	8.95	8.66	9.72	8.61	10.9	8.61	11.3
	13.0	12.0	8.76	8.21	8.73	8.66	8.71	8.69	8.69	8.66	8.95	8.66	10.4	8.66	11.2	8.79	11.4
	15.0	14.0	8.99	8.40	8.96	8.84	8.91	8.92	8.88	8.95	8.88	9.06	10.2	9.03	10.5	8.82	11.4
	17.0	15.5	9.17	8.54	9.14	8.97	9.12	9.01	9.51	9.09	9.39	10.2	10.3	10.3	11.1	10.1	11.1
	19.0	18.0	9.48	8.78	9.45	9.19	9.42	9.50	9.41	9.71	9.39	9.92	10.2	10.2	11.1	10.1	11.1
	22.0	20.0	9.74	8.96	9.71	9.37	9.67	9.67	10.2	10.2	10.4	10.2	10.7	10.7	11.4	11.1	11.1
	30.0	28.0	10.9	9.67	10.9	10.3	10.8	10.5	10.8	10.5	10.8	10.7	10.8	10.9	10.4	10.4	10.4
110	-3.64	4.0	7.30	7.27	7.88	7.27	8.26	7.23	8.51	7.22	8.76	7.20	9.14	7.12	10.07	7.12	10.77
	-1.84	2.2	7.42	7.52	8.02	7.37	8.39	7.36	8.64	7.35	8.88	7.33	9.25	7.24	10.18	7.24	10.8
	0.5	5.0	8.02	8.14	7.99	8.59	7.97	8.93	7.95	9.16	7.94	8.95	7.92	9.73	7.85	10.9	7.83
	9.5	8.5	8.76	8.76	8.23	8.69	8.21	8.62	8.69	8.66	8.95	8.66	9.72	8.61	10.9	8.61	11.3
	13.0	12.0	8.76	8.21	8.73	8.66	8.71	8.69	8.69	8.66	8.95	8.66	10.4	8.66	11.2	8.79	11.4
	15.0	14.0	8.99	8.40	8.96	8.84	8.91	8.92	8.88	8.95	8.88	9.06	10.2	9.03	10.5	8.82	11.4
	17.0	15.5	9.17	8.54	9.14	8.97	9.12	9.01	9.51	9.09	9.39	10.2	10.3	10.3	11.1	10.1	11.1
	19.0	18.0	9.48	8.78	9.45	9.19	9.42	9.50	9.41	9.71	9.39	9.92	10.2	10.2	11.1	10.1	11.1
	22.0	20.0	9.74	8.96	9.71	9.37	9.67	9.67	10.2	10.2	10.4	10.2	10.7	10.7	11.4	11.1	11.1
	30.0	28.0	10.9	9.67	10.9	10.3	10.8	10.5	10.8	10.5	10.8	10.7	10.8	10.9	10.4	10.4	10.4

TC: Total capacity; MBH
 PI: Power Input; kW (Comp.+Outdoor fan motor)

Note 1: is shown as reference.

Note 2: The above table shows the average value of conditions which may occur.

Heating capacity

Combustion (%)	Outdoor air temp. (F/DB)	Indoor air Temp. F/DB												
		61			65			70			75			
		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	
70	-3.64	-4.0	71.2	10.7	71.0	11.0	70.9	11.2	70.8	11.3	70.7	11.5	68.8	11.2
	-1.84	-2.2	72.4	10.8	72.3	11.1	72.1	11.3	72.1	11.4	72.0	11.6	68.8	10.9
	9.5	8.5	81.7	11.1	81.2	11.6	78.1	11.6	75.6	10.2	72.8	10.5	68.6	9.9
	13.0	12.0	85.4	11.5	82.6	11.1	78.4	10.4	75.6	9.9	72.8	9.54	68.6	8.88
	15.0	14.0	87.7	11.6	82.6	10.8	78.4	10.1	75.6	9.67	72.8	9.24	68.6	8.60
	17.0	15.5	88.2	11.4	82.6	10.5	78.4	9.86	75.6	9.43	72.8	9.01	68.6	8.40
	19.0	18.0	88.2	10.9	82.6	10.1	78.4	9.45	75.6	9.04	72.8	8.65	68.6	8.06
	22.0	20.0	88.2	10.5	82.6	9.72	78.4	9.13	75.6	8.74	72.8	8.36	68.6	7.80
	26.0	24.0	88.2	9.82	82.6	9.07	78.4	8.52	75.6	8.17	72.8	7.81	68.6	7.30
	30.0	28.0	88.2	9.15	82.6	8.46	78.4	7.96	75.6	7.63	72.8	7.30	68.6	6.83
	35.0	32.0	88.2	8.52	82.6	7.89	78.4	7.43	75.6	7.13	72.8	6.83	68.6	6.39
	40.0	36.0	88.2	7.94	82.6	7.34	78.4	6.94	75.6	6.63	72.8	6.39	68.6	5.96
44.0	40.0	88.2	7.44	82.6	6.98	78.4	6.54	75.6	6.25	72.8	6.08	68.6	5.57	
47.0	43.0	88.2	7.04	82.6	6.54	78.4	6.18	75.6	5.93	72.8	5.70	68.6	5.35	
51.0	47.0	88.2	6.59	82.6	6.13	78.4	5.79	75.6	5.57	72.8	5.35	68.6	5.02	
54.0	50.0	88.2	6.27	82.6	5.84	78.4	5.52	75.6	5.31	72.8	5.10	68.6	4.80	
57.0	53.0	88.2	5.98	82.6	5.57	78.4	5.27	75.6	5.07	72.8	4.87	68.6	4.58	
60.0	56.0	88.2	5.70	82.6	5.31	78.4	5.03	75.6	4.84	72.8	4.65	68.6	4.39	
60	-3.64	-4.0	70.8	11.3	70.7	11.6	67.2	10.9	64.8	10.4	62.4	9.95	58.8	9.26
	-1.84	-2.2	72.1	11.4	70.8	11.4	67.2	10.7	64.8	10.2	62.4	9.73	58.8	9.06
	9.5	5.0	75.6	11.2	70.8	10.3	67.2	9.65	64.8	9.23	62.4	8.83	58.8	8.23
	13.0	9.5	75.6	11.6	70.8	9.73	67.2	9.15	64.8	8.77	62.4	8.58	58.8	7.42
	15.0	14.0	75.6	9.67	70.8	8.63	67.2	8.40	64.8	8.05	62.4	7.70	58.8	7.16
	17.0	15.5	75.6	9.43	70.8	8.72	67.2	8.20	64.8	7.86	62.4	7.52	58.8	7.03
	19.0	18.0	75.6	9.04	70.8	8.36	67.2	7.87	64.8	7.54	62.4	7.23	58.8	6.75
	22.0	20.0	75.6	8.74	70.8	8.09	67.2	7.61	64.8	7.30	62.4	7.00	58.8	6.54
	26.0	24.0	75.6	8.17	70.8	7.57	67.2	7.13	64.8	6.84	62.4	6.56	58.8	6.14
	30.0	28.0	75.6	7.63	70.8	7.07	67.2	6.67	64.8	6.41	62.4	6.14	58.8	5.76
	35.0	32.0	75.6	7.13	70.8	6.62	67.2	6.24	64.8	6.00	62.4	5.76	58.8	5.40
	39.0	36.0	75.6	6.66	70.8	6.19	67.2	5.85	64.8	5.62	62.4	5.40	58.8	5.07
44.0	40.0	75.6	6.23	70.8	5.80	67.2	5.48	64.8	5.28	62.4	5.04	58.8	4.77	
47.0	43.0	75.6	5.88	70.8	5.49	67.2	5.19	64.8	4.93	62.4	4.85	58.8	4.57	
51.0	47.0	75.6	5.58	70.8	5.19	67.2	4.91	64.8	4.73	62.4	4.65	58.8	4.26	
54.0	50.0	75.6	5.31	70.8	4.95	67.2	4.73	64.8	4.52	62.4	4.46	58.8	4.11	
57.0	53.0	75.6	5.07	70.8	4.73	67.2	4.49	64.8	4.33	62.4	4.17	58.8	3.93	
60.0	56.0	75.6	4.84	70.8	4.53	67.2	4.30	64.8	4.14	62.4	3.99	58.8	3.77	
50	-3.64	-4.0	63.0	10.1	59.0	9.29	56.0	8.73	54.0	8.36	52.0	8.00	49.0	7.47
	-1.84	-2.2	63.0	9.84	59.0	9.09	56.0	8.54	54.0	8.19	52.0	7.83	49.0	7.31
	9.5	5.0	63.0	8.93	59.0	8.28	56.0	7.77	54.0	7.45	52.0	7.14	49.0	6.67
	13.0	8.5	63.0	8.48	59.0	7.85	56.0	7.39	54.0	7.09	52.0	6.79	49.0	6.36
	15.0	12.0	63.0	7.93	59.0	7.42	56.0	6.92	54.0	6.53	52.0	6.49	49.0	6.05
	17.0	14.0	63.0	7.79	59.0	7.25	56.0	6.85	54.0	6.39	52.0	6.13	49.0	5.74
	19.0	15.5	63.0	7.69	59.0	7.05	56.0	6.65	54.0	6.39	52.0	6.13	49.0	5.74
	22.0	18.0	63.0	7.30	59.0	6.78	56.0	6.40	54.0	6.14	52.0	5.90	49.0	5.53
	26.0	20.0	63.0	7.07	59.0	6.57	56.0	6.20	54.0	5.96	52.0	5.72	49.0	5.37
	30.0	24.0	63.0	6.63	59.0	6.16	56.0	5.82	54.0	5.60	52.0	5.38	49.0	5.05
	35.0	28.0	63.0	6.21	59.0	5.78	56.0	5.46	54.0	5.26	52.0	5.05	49.0	4.75
	39.0	32.0	63.0	5.82	59.0	5.42	56.0	5.13	54.0	4.94	52.0	4.75	49.0	4.47
44.0	40.0	63.0	5.46	59.0	5.09	56.0	4.82	54.0	4.65	52.0	4.47	49.0	4.21	
47.0	43.0	63.0	5.12	59.0	4.79	56.0	4.54	54.0	4.37	52.0	4.21	49.0	3.97	
51.0	45.0	63.0	4.89	59.0	4.57	56.0	4.34	54.0	4.16	52.0	4.03	49.0	3.80	
54.0	47.0	63.0	4.68	59.0	4.36	56.0	4.14	54.0	3.97	52.0	3.84	49.0	3.45	
57.0	50.0	63.0	4.40	59.0	4.12	56.0	3.91	54.0	3.78	52.0	3.64	49.0	3.45	
60.0	53.0	63.0	4.21	59.0	3.94	56.0	3.75	54.0	3.62	52.0	3.50	49.0	3.31	
60.0	56.0	63.0	4.03	59.0	3.78	56.0	3.60	54.0	3.48	52.0	3.36	49.0	3.18	

TC : Total capacity ; MBH

PI : Power Input ; kW (Comp.+Outdoor fan motor)

Note1 : is shown as reference

Note 2 : The above table shows the average value of conditions which may occur.

When selecting the unit models, avoid the Outdoor air temperature range shown by

Heating capacity

Combustion (%)	Outdoor air temp. (F/DB)	Indoor air Temp. F/DB																										
		61			65			68			70			72			75											
		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH									
70	-3.64	-4.0	75.9	9.98	75.7	10.3	75.5	10.6	75.4	10.8	75.3	11.0	75.2	11.3	-1.84	-2.2	77.2	10.1	77.0	10.4	76.8	10.7	76.7	10.9	76.6	11.1	76.5	11.3
	5.5	8.5	87.5	10.5	86.3	10.9	86.7	11.3	86.0	11.3	86.5	11.6	86.5	11.7	9.5	12.0	91.0	11.0	90.8	11.3	90.6	11.5	90.5	11.7	90.4	11.8	90.3	12.1
	13.0	14.0	93.4	11.1	93.2	11.4	93.1	11.6	93.0	11.8	93.0	12.1	93.0	12.4	17.0	15.5	95.3	11.2	95.1	11.5	94.9	11.7	94.5	11.8	94.5	12.1	94.4	12.5
	19.0	18.0	98.6	11.4	98.4	11.7	98.0	12.0	98.0	12.3	98.0	12.6	98.0	12.9	22.0	20.0	101.0	11.5	101.1	11.8	101.4	12.1	101.4	12.4	101.4	12.7	101.3	13.0
	26.0	24.0	107.1	11.7	103.1	10.6	98.0	9.96	94.5	9.54	90.2	9.10	85.8	8.28	35.0	32.0	110.0	10.7	103.0	9.87	98.0	9.45	94.5	9.10	89.8	8.28	85.8	7.09
	39.0	36.0	110.0	10.9	98.4	10.8	96.2	10.8	94.5	10.8	92.6	10.8	90.4	10.8	44.0	40.0	114.0	11.0	108.0	10.9	106.0	10.9	104.0	11.0	102.0	11.0	99.8	9.88
	47.0	43.0	110.0	10.8	98.0	10.3	94.5	9.85	94.5	9.85	92.6	9.85	90.4	9.85	51.0	47.0	114.0	11.0	108.0	10.9	106.0	10.9	104.0	11.0	102.0	11.0	99.8	9.88
	54.0	50.0	110.0	10.8	98.0	10.3	94.5	9.85	94.5	9.85	92.6	9.85	90.4	9.85	57.0	53.0	110.0	10.8	106.0	10.3	98.0	9.85	94.5	9.85	92.6	9.85	90.4	9.85
	60.0	56.0	110.0	10.8	98.0	10.3	94.5	9.85	94.5	9.85	92.6	9.85	90.4	9.85	-3.64	-4.0	75.4	10.8	75.2	11.1	75.1	11.4	75.1	11.5	74.9	11.7	73.5	11.6
															-1.84	-2.2	76.7	10.9	76.6	11.2	76.4	11.4	76.4	11.6	76.3	11.7	73.5	11.3
															9.5	12.0	93.0	11.1	92.8	11.4	92.7	11.8	92.7	12.1	92.6	12.4	92.5	12.7
															15.0	14.0	93.0	11.6	88.5	11.2	84.0	10.5	81.0	10.1	78.0	9.64	73.5	9.06
														17.0	15.5	94.5	11.8	88.5	10.9	84.0	10.3	81.0	9.83	78.0	9.41	73.5	8.79	
														22.0	20.0	94.5	10.9	88.5	10.1	84.0	9.53	81.0	9.14	78.0	8.75	73.5	8.45	
														26.0	24.0	94.5	10.2	88.5	9.47	84.0	8.92	81.0	8.56	78.0	8.20	73.5	7.68	
														35.0	32.0	94.5	8.92	88.5	8.28	84.0	7.81	81.0	7.51	78.0	7.21	73.5	6.76	
														39.0	36.0	94.5	8.34	88.5	7.75	84.0	7.32	81.0	7.04	78.0	6.76	73.5	6.35	
														44.0	40.0	94.5	7.80	88.5	7.20	84.0	6.86	81.0	6.60	78.0	6.35	73.5	5.97	
														51.0	47.0	94.5	7.36	88.5	6.82	84.0	6.15	81.0	5.93	78.0	5.70	73.5	5.37	
														54.0	50.0	94.5	6.84	88.5	6.20	84.0	5.68	81.0	5.66	78.0	5.45	73.5	5.14	
														57.0	53.0	94.5	6.34	88.5	5.92	84.0	5.42	81.0	5.42	78.0	5.22	73.5	4.92	
														60.0	56.0	94.5	6.06	88.5	5.67	84.0	5.38	81.0	5.18	78.0	5.00	73.5	4.72	
														-3.64	-4.0	75.0	11.6	73.7	11.6	70.0	10.9	67.5	10.5	65.0	10.0	61.3	9.35	
														-1.84	-2.2	76.3	11.7	73.7	11.4	70.0	10.7	67.5	10.2	65.0	9.80	9.15		
														5.5	8.5	78.7	11.2	73.7	10.3	70.0	9.72	67.5	9.32	85.0	8.83	8.35		
														9.5	12.0	78.7	10.6	73.7	9.82	70.0	9.25	67.5	8.87	85.0	8.50	8.13		
														13.0	12.0	78.7	11.1	73.7	9.32	70.0	8.75	67.5	8.43	85.0	8.04	7.57		
														17.0	15.5	78.7	9.51	73.7	8.83	70.0	8.32	67.5	7.99	7.66	7.18			
														19.0	18.0	78.7	9.14	73.7	8.48	70.0	8.00	67.5	7.69	7.38	6.13			
														22.0	20.0	78.7	8.85	73.7	8.22	70.0	7.76	67.5	7.45	7.16	6.71			
														26.0	24.0	78.7	8.29	73.7	7.71	70.0	7.28	67.5	7.00	6.73	6.13			
														30.0	28.0	78.7	7.77	73.7	7.23	70.0	6.84	67.5	6.58	6.32	5.94			
														35.0	32.0	78.7	7.28	73.7	6.79	70.0	6.42	67.5	6.18	5.95	5.60			
														39.0	36.0	78.7	6.83	73.7	6.37	70.0	6.03	67.5	5.81	5.59	5.27			
														44.0	40.0	78.7	6.41	73.7	5.99	70.0	5.68	67.5	5.47	5.27				
														47.0	43.0	78.7	6.12	73.7	5.72	70.0	5.43	67.5	5.23	5.04				
														51.0	47.0	78.7	5.75	73.7	5.35	70.0	5.14	67.5	4.96	4.76				
														54.0	50.0	78.7	5.55	73.7	5.15	70.0	4.90	67.5	4.73	4.56				
														57.0	53.0	78.7	5.27	73.7	4.94	70.0	4.69	67.5	4.53	4.37				
														60.0	56.0	78.7	5.04	73.7	4.73	70.0	4.50	67.5	4.35	4.20				

TC : Total capacity ; MBH

PI : Power Input ; kW (Comp.+Outdoor fan motor)

Note1 : is shown as reference

Note 2 : The above table shows the average value of outdoor air temperature range shown by

REYQ144PTJU

Combit-nation (%)	Outdoor air temp. (F/DB) (F/WB)	Indoor air temp. F/DB											
		61			65			70			75		
		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH
100	-3.64	-4.0	92.7	8.97	92.3	9.60	92.1	10.1	91.9	10.4	91.7	10.7	91.5
	-1.84	-2.2	94.3	9.15	93.3	9.77	93.7	10.2	93.5	10.5	93.3	10.8	93.1
	9.5	8.5	106	9.91	106	10.6	106	10.1	106	10.2	106	10.1	106
	13.0	12.0	114	10.7	110	11.2	110	11.6	110	11.9	110	12.1	110
	15.0	14.0	114	10.9	111	11.4	111	11.8	111	12.0	111	12.3	111
	17.0	15.5	116	11.1	116	11.6	116	12.2	116	12.5	116	12.8	116
	19.0	18.0	120	11.3	120	11.8	119	12.4	119	12.4	119	12.4	119
	22.0	20.0	123	11.6	123	12.0	123	12.4	122	12.6	122	12.8	122
	30.0	28.0	138	12.4	137	12.8	137	13.1	137	13.3	137	13.5	137
	35.0	32.0	146	12.8	146	13.1	145	13.4	145	13.6	145	13.8	145
90	-3.64	-4.0	92.1	8.96	91.6	91.6	91.6	91.6	91.4	91.4	91.3	91.3	91.0
	-1.84	-2.2	93.2	9.01	92.8	9.32	92.8	9.32	92.8	9.32	92.8	9.32	92.8
	9.5	8.5	101	9.08	101	9.32	101	9.32	101	9.32	101	9.32	101
	13.0	12.0	108	9.12	108	9.32	108	9.32	108	9.32	108	9.32	108
	15.0	14.0	113	9.17	113	9.32	113	9.32	113	9.32	113	9.32	113
	17.0	15.5	115	9.19	115	9.32	115	9.32	115	9.32	115	9.32	115
	19.0	18.0	119	9.21	119	9.32	119	9.32	119	9.32	119	9.32	119
	22.0	20.0	123	9.23	123	9.32	123	9.32	123	9.32	123	9.32	123
	30.0	28.0	137	9.30	137	9.32	137	9.32	137	9.32	137	9.32	137
	35.0	32.0	145	9.34	145	9.32	145	9.32	145	9.32	145	9.32	145
80	-3.64	-4.0	91.6	8.96	91.6	91.6	91.6	91.6	91.4	91.4	91.3	91.3	91.0
	-1.84	-2.2	92.7	9.01	92.3	9.32	92.3	9.32	92.3	9.32	92.3	9.32	92.3
	9.5	8.5	101	9.08	101	9.32	101	9.32	101	9.32	101	9.32	101
	13.0	12.0	108	9.12	108	9.32	108	9.32	108	9.32	108	9.32	108
	15.0	14.0	113	9.17	113	9.32	113	9.32	113	9.32	113	9.32	113
	17.0	15.5	115	9.19	115	9.32	115	9.32	115	9.32	115	9.32	115
	19.0	18.0	119	9.21	119	9.32	119	9.32	119	9.32	119	9.32	119
	22.0	20.0	123	9.23	123	9.32	123	9.32	123	9.32	123	9.32	123
	30.0	28.0	137	9.30	137	9.32	137	9.32	137	9.32	137	9.32	137
	35.0	32.0	145	9.34	145	9.32	145	9.32	145	9.32	145	9.32	145

Combit-nation (%)	Outdoor air temp. (F/DB) (F/WB)	Indoor air temp. F/DB											
		61			65			70			75		
		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH
130	-3.64	-4.0	93.8	6.00	93.3	6.31	92.8	6.89	92.6	7.06	92.3	7.63	9.63
	-1.84	-2.2	95.4	6.21	94.9	6.52	94.4	7.10	94.2	7.24	93.9	7.80	9.80
	9.5	8.5	103	6.12	102	6.80	102	6.86	102	7.00	101	7.00	10.5
	13.0	12.0	107	6.24	106	6.73	106	7.01	104	7.04	106	10.9	10.9
	15.0	14.0	115	6.31	114	6.82	114	7.07	114	7.11	113	11.4	11.4
	17.0	15.5	117	6.31	117	6.82	117	7.07	117	7.11	116	11.6	11.6
	19.0	18.0	121	6.31	121	6.82	121	7.07	121	7.11	120	11.8	11.8
	22.0	20.0	124	6.31	124	6.82	124	7.07	124	7.11	123	12.0	12.0
	30.0	28.0	131	6.31	131	6.82	131	7.07	131	7.11	130	12.4	12.4
	35.0	32.0	147	6.31	147	6.82	147	7.07	147	7.11	146	12.8	12.8
120	-3.64	-4.0	93.3	6.00	92.8	6.31	92.3	6.89	92.1	7.06	91.6	7.63	9.63
	-1.84	-2.2	94.9	6.21	94.4	6.52	93.9	7.10	93.7	7.24	93.4	7.80	9.80
	9.5	8.5	102	6.12	101	6.80	101	6.86	101	7.00	100	10.5	10.5
	13.0	12.0	106	6.24	105	6.73	105	7.01	104	7.04	106	10.9	10.9
	15.0	14.0	114	6.31	113	6.82	113	7.07	113	7.11	112	11.4	11.4
	17.0	15.5	116	6.31	116	6.82	116	7.07	116	7.11	115	11.5	11.5
	19.0	18.0	120	6.31	120	6.82	120	7.07	120	7.11	119	11.9	11.9
	22.0	20.0	124	6.31	124	6.82	124	7.07	124	7.11	123	12.0	12.0
	30.0	28.0	131	6.31	131	6.82	131	7.07	131	7.11	130	12.4	12.4
	35.0	32.0	147	6.31	147	6.82	147	7.07	147	7.11	146	12.8	12.8
110	-3.64	-4.0	92.8	6.00	92.3	6.31	91.8	6.89	92.1	7.06	91.6	7.63	9.63
	-1.84	-2.2	94.4	6.21	93.9	6.52	93.4	7.10	93.2	7.24	92.9	7.80	9.80
	9.5	8.5	101	6.12	100	6.80	100	6.86	100	7.00	99	10.5	10.5
	13.0	12.0	105	6.24	104	6.73	104	7.01	104	7.04	105	10.9	10.9
	15.0	14.0	113	6.31	112	6.82	112	7.07	112	7.11	111	11.4	11.4
	17.0	15.5	115	6.31	115	6.82	115	7.07	115	7.11	114	11.5	11.5
	19.0	18.0	119	6.31	119	6.82	119	7.07	119	7.11	118	11.8	11.8
	22.0	20.0	123	6.31	123	6.82	123	7.07	123	7.11	122	12.2	12.2
	30.0	28.0	130	6.31	130	6.82	130	7.07	130	7.11	129	12.4	12.4
	35.0	32.0	146	6.31	146	6.82	146	7.07	146	7.11	145	12.8	12.8

TC: Total capacity; MBH

PI: Power Input; kW (Comp.+Outdoor fan motor)

Note 1: is shown as reference.

Note 2: The above table shows the average value of conditions which may occur.

Heating capacity

Combustion ratio (%)	Outdoor air temp. (F/WB)	Indoor air Temp. F:DB																						
		61			65			68			70			72			75							
		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH		
	-3.64	-4.0	91.0	11.9	90.8	12.4	90.6	12.7	90.5	12.9	90.4	13.1	90.2	13.5	90.2	13.5	90.4	13.7	90.2	13.9	90.2	13.9	90.2	14.0
	-1.84	-2.2	92.6	12.1	92.4	12.5	92.2	12.8	92.1	13.0	92.0	13.3	91.9	13.5	91.8	13.6	91.7	13.8	91.6	14.1	91.5	14.1	91.4	14.1
	9.5	5.0	100	12.6	99.9	13.0	99.7	13.3	99.6	13.5	99.5	13.7	99.3	14.0	99.3	14.0	99.3	14.1	99.2	14.4	99.1	14.4	99.0	14.4
	9.5	8.5	104	12.9	104	13.3	104	13.5	104	13.7	104	13.9	104	14.1	104	14.1	104	14.1	104	14.4	104	14.4	104	14.4
	13.0	12.0	109	13.1	109	13.5	109	13.8	109	14.0	109	14.1	109	14.1	109	14.1	109	14.1	109	14.4	109	14.4	109	14.4
	15.0	14.0	112	13.3	112	13.7	112	13.9	112	14.1	112	14.1	112	14.1	112	14.1	112	14.1	112	14.4	112	14.4	112	14.4
	17.0	15.5	114	13.4	114	13.8	114	14.0	114	14.1	114	14.1	114	14.1	114	14.1	114	14.1	114	14.4	114	14.4	114	14.4
	19.0	18.0	118	13.6	118	13.9	118	14.1	118	14.1	118	14.1	118	14.1	118	14.1	118	14.1	118	14.4	118	14.4	118	14.4
	22.0	20.0	122	13.8	121	14.1	118	14.1	118	14.1	118	14.1	118	14.1	118	14.1	118	14.1	118	14.4	118	14.4	118	14.4
	30.0	28.0	132	13.7	124	12.7	118	11.9	11.4	11.3	11.2	11.2	11.2	11.2	11.2	11.2	11.2	11.2	11.2	11.2	11.2	11.2	11.2	11.2
	35.0	32.0	132	12.8	124	11.8	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1
	44.0	40.0	132	11.1	124	10.3	118	9.72	113	9.33	109	8.95	103	8.40	103	8.00	103	7.52	103	7.18	103	6.86	103	6.57
	51.0	47.0	132	10.5	124	9.80	118	9.25	113	8.89	109	8.53	103	8.00	103	7.52	103	7.18	103	6.86	103	6.57	103	6.28
	54.0	50.0	132	9.86	124	9.17	118	8.67	113	8.33	109	8.00	103	7.52	103	7.18	103	6.86	103	6.57	103	6.28	103	6.00
	57.0	53.0	132	8.95	124	8.33	118	7.88	113	7.59	109	7.30	103	6.86	103	6.57	103	6.28	103	5.99	103	5.72	103	5.45
	60.0	56.0	132	8.53	124	7.95	118	7.53	113	7.25	109	7.00	103	6.57	103	6.28	103	5.99	103	5.72	103	5.45	103	5.18
	-3.64	-4.0	89.9	13.9	88.5	13.9	88.5	13.9	88.5	14.0	88.9	14.0	89.2	14.0	89.2	14.0	89.2	14.0	89.2	14.0	89.2	14.0	89.2	14.0
	-1.84	-2.2	91.6	14.0	88.5	13.6	84.0	12.8	81.0	12.3	78.0	11.7	73.5	11.0	73.5	11.0	73.5	11.0	73.5	11.0	73.5	11.0	73.5	11.0
	9.5	5.0	94.5	13.4	88.5	12.4	84.0	11.6	81.0	11.2	78.0	10.7	73.5	9.99	73.5	9.99	73.5	9.99	73.5	9.99	73.5	9.99	73.5	9.99
	9.5	8.5	94.5	12.7	88.5	11.8	84.0	11.1	81.0	10.6	78.0	10.2	73.5	9.52	73.5	9.52	73.5	9.52	73.5	9.52	73.5	9.52	73.5	9.52
	13.0	12.0	94.5	12.0	88.5	11.1	84.0	10.5	81.0	10.1	78.0	9.66	73.5	9.05	73.5	9.05	73.5	9.05	73.5	9.05	73.5	9.05	73.5	9.05
	15.0	14.0	94.5	11.7	88.5	10.8	84.0	10.2	81.0	9.78	78.0	9.38	73.5	8.79	73.5	8.79	73.5	8.79	73.5	8.79	73.5	8.79	73.5	8.79
	17.0	15.5	94.5	11.4	88.5	10.6	84.0	9.96	81.0	9.56	78.0	9.17	73.5	8.60	73.5	8.60	73.5	8.60	73.5	8.60	73.5	8.60	73.5	8.60
	19.0	18.0	94.5	10.9	88.5	10.2	84.0	9.58	81.0	9.20	78.0	8.83	73.5	8.28	73.5	8.28	73.5	8.28	73.5	8.28	73.5	8.28	73.5	8.28
	22.0	20.0	94.5	10.6	88.5	9.83	84.0	9.28	81.0	8.92	78.0	8.56	73.5	8.03	73.5	8.03	73.5	8.03	73.5	8.03	73.5	8.03	73.5	8.03
	26.0	24.0	94.5	9.92	88.5	9.23	84.0	8.71	81.0	8.38	78.0	8.05	73.5	7.56	73.5	7.56	73.5	7.56	73.5	7.56	73.5	7.56	73.5	7.56
	35.0	32.0	94.5	8.71	88.5	8.12	84.0	8.18	81.0	7.87	78.0	7.56	73.5	7.11	73.5	7.11	73.5	7.11	73.5	7.11	73.5	7.11	73.5	7.11
	39.0	36.0	94.5	8.17	88.5	7.62	84.0	7.62	81.0	7.40	78.0	7.11	73.5	6.69	73.5	6.69	73.5	6.69	73.5	6.69	73.5	6.69	73.5	6.69
	44.0	40.0	94.5	7.67	88.5	7.16	84.0	7.22	81.0	6.96	78.0	6.69	73.5	6.31	73.5	6.31	73.5	6.31	73.5	6.31	73.5	6.31	73.5	6.31
	47.0	43.0	94.5	7.32	88.5	6.84	84.0	6.49	81.0	6.26	78.0	6.03	73.5	5.69	73.5	5.69	73.5	5.69	73.5	5.69	73.5	5.69	73.5	5.69
	51.0	47.0	94.5	6.89	88.5	6.44	84.0	6.12	81.0	5.90	78.0	5.69	73.5	5.38	73.5	5.38	73.5	5.38	73.5	5.38	73.5	5.38	73.5	5.38
	54.0	50.0	94.5	6.58	88.5	6.03	84.0	5.86	81.0	5.66	78.0	5.45	73.5	5.16	73.5	5.16	73.5	5.16	73.5	5.16	73.5	5.16	73.5	5.16
	57.0	53.0	94.5	6.30	88.5	5.91	84.0	5.61	81.0	5.42	78.0	5.23	73.5	4.95	73.5	4.95	73.5	4.95	73.5	4.95	73.5	4.95	73.5	4.95
	60.0	56.0	94.5	6.03	88.5	5.66	84.0	5.39	81.0	5.20	78.0	5.03	73.5	4.76	73.5	4.76	73.5	4.76	73.5	4.76	73.5	4.76	73.5	4.76

TC : Total capacity ; MBH

PI : Power Input ; kW (Comp.+Outdoor fan motor)

Note1 : is shown as reference.

When selecting the unit models, avoid the Outdoor air temperature range shown by

Note 2: The above table shows the average value of conditions which may occur.

Heating capacity

Comb- ration (%)	Outdoor air temp. (F/DB)	Indoor air Temp. F/DB												
		61		65		68		70		72		75		
		TC MBH	PI kW	TC MBH	PI kW	TC MBH	PI kW	TC MBH	PI kW	TC MBH	PI kW	TC MBH	PI kW	
70	-3.64	-4.0	125	17.7	18.2	125	18.5	125	18.7	125	19.0	120	18.2	
	-1.84	-2.2	128	17.9	18.3	127	18.6	127	18.9	127	19.1	120	17.8	
	0.5	0.5	134	18.4	19.1	131	19.1	131	19.2	131	19.2	120	16.5	
	5.5	8.5	138	18.7	19.4	137	19.4	137	19.5	137	19.5	120	15.2	
	13.0	12.0	151	19.0	14.5	18.2	137	17.1	132	16.3	127	15.6	120	14.5
	15.0	14.0	154	19.1	14.5	17.6	137	16.5	132	15.8	127	15.1	120	14.1
	17.0	15.5	154	18.6	14.5	17.2	137	16.1	132	15.4	127	14.7	120	13.7
	19.0	18.0	154	17.9	14.5	16.5	137	15.5	132	14.8	127	14.1	120	13.2
	22.0	20.0	154	17.2	14.5	15.9	137	14.9	132	14.3	127	13.7	120	12.8
	26.0	24.0	154	16.1	14.5	14.9	137	14.0	132	13.4	127	12.8	120	12.0
	30.0	28.0	154	15.0	14.5	13.9	137	13.0	132	12.5	127	12.0	120	11.2
	35.0	32.0	154	14.0	14.5	12.9	137	12.2	132	11.7	127	11.2	120	10.5
40.0	38.0	154	13.0	14.5	11.7	137	11.0	132	10.9	127	10.9	120	9.8	
44.0	42.0	154	12.0	14.5	10.7	137	10.1	132	9.72	127	9.96	120	9.2	
47.0	43.0	154	11.6	14.5	10.7	137	10.1	132	9.72	127	9.96	120	8.78	
51.0	47.0	154	10.8	14.5	10.1	137	9.51	132	9.15	127	8.79	120	8.25	
54.0	50.0	154	10.3	14.5	9.60	137	9.07	132	8.73	127	8.39	120	7.89	
57.0	53.0	154	9.83	14.5	9.16	137	8.66	132	8.34	127	8.02	120	7.54	
60.0	56.0	154	9.38	14.5	8.74	137	8.28	132	7.97	127	7.67	120	7.22	
60	-3.64	-4.0	125	18.7	124	19.0	118	17.8	113	17.0	109	16.2	103	15.1
	-1.84	-2.2	127	18.9	124	18.6	118	17.4	113	16.6	109	15.9	103	14.8
	0.5	5.0	132	18.2	124	16.8	118	15.8	113	15.1	109	14.4	103	13.4
	5.5	9.5	136	17.3	124	15.9	118	15.0	113	14.3	109	13.7	103	12.6
	11.0	15.0	141	16.4	124	14.9	118	14.0	113	13.5	109	13.0	103	11.8
	15.0	14.0	132	15.8	124	14.6	118	13.7	113	13.0	109	12.6	103	11.1
	17.0	15.5	132	15.4	124	14.3	118	13.4	113	12.8	109	12.3	103	11.1
	19.0	18.0	132	14.8	124	13.7	118	12.9	113	12.3	109	11.8	103	11.1
	22.0	20.0	132	14.3	124	13.2	118	12.5	113	12.0	109	11.5	103	10.7
	26.0	24.0	132	13.4	124	12.4	118	11.7	113	11.2	109	10.7	103	10.1
	30.0	28.0	132	12.5	124	11.6	118	10.9	113	10.5	109	10.1	103	9.44
	35.0	32.0	132	11.7	124	10.9	118	10.2	113	9.84	109	9.44	103	8.86
39.0	36.0	132	10.9	124	10.2	118	9.60	113	9.23	109	8.86	103	8.32	
44.0	40.0	132	10.2	124	9.56	118	8.95	113	8.55	109	8.25	103	7.83	
47.0	43.0	132	9.72	124	9.53	118	8.50	113	8.10	109	7.89	103	7.46	
51.0	47.0	132	9.15	124	8.53	118	8.08	113	7.76	109	7.49	103	7.06	
54.0	50.0	132	8.73	124	8.15	118	7.72	113	7.44	109	7.16	103	6.75	
57.0	53.0	132	8.34	124	7.79	118	7.38	113	7.12	109	6.86	103	6.47	
60.0	56.0	132	7.97	124	7.45	118	7.07	113	6.82	109	6.57	103	6.20	
50	-3.64	-4.0	110	16.4	103	15.2	98.0	14.2	94.5	13.6	91.0	13.0	85.8	12.2
	-1.84	-2.2	110	16.1	103	14.8	98.0	13.9	94.5	13.4	91.0	12.8	85.8	11.9
	0.5	5.0	110	14.6	103	13.5	98.0	12.7	94.5	12.2	91.0	11.7	85.8	10.9
	5.5	8.5	110	13.9	103	12.8	98.0	12.1	94.5	11.6	91.0	11.1	85.8	10.4
	13.0	12.0	110	13.1	103	12.2	98.0	11.5	94.5	11.0	91.0	10.5	85.8	9.86
	15.0	14.0	110	12.7	103	11.8	98.0	11.1	94.5	10.7	91.0	10.4	85.8	9.39
	17.0	15.5	110	12.4	103	11.5	98.0	10.9	94.5	10.4	91.0	10.0	85.8	9.05
	19.0	18.0	110	12.0	103	11.1	98.0	10.5	94.5	10.1	91.0	9.65	85.8	8.78
	22.0	20.0	110	11.6	103	10.8	98.0	10.1	94.5	9.75	91.0	9.36	85.8	8.27
	26.0	24.0	110	10.9	103	10.1	98.0	9.53	94.5	9.17	88.0	8.80	85.8	7.79
	30.0	28.0	110	10.2	103	9.47	98.0	8.95	94.5	8.62	91.0	8.28	85.8	7.33
	35.0	32.0	110	9.54	103	8.89	98.0	8.41	94.5	8.10	91.0	7.79	85.8	6.91
39.0	36.0	110	8.95	103	8.35	98.0	7.91	94.5	7.62	91.0	7.34	85.8	6.52	
44.0	40.0	110	8.41	103	7.86	98.0	7.45	94.5	7.18	91.0	6.91	85.8	6.25	
47.0	43.0	110	7.93	103	7.51	98.0	7.02	94.5	6.87	91.0	6.62	85.8	5.97	
51.0	47.0	110	7.46	103	7.01	98.0	6.53	94.5	6.31	91.0	6.09	85.8	5.67	
54.0	50.0	110	7.22	103	6.77	98.0	6.43	94.5	6.21	91.0	5.99	85.8	5.44	
57.0	53.0	110	6.92	103	6.49	98.0	6.17	94.5	5.96	91.0	5.75	85.8	5.23	
60.0	56.0	110	6.63	103	6.22	98.0	5.92	94.5	5.72	91.0	5.52	85.8	5.23	

TC : Total capacity ; MBH

PI : Power Input ; kW (Comp.+Outdoor fan motor)

Note1 : is shown as reference

Note 2 : The above table shows the average value of Outdoor air temperature range shown by .
When selecting the unit models, avoid the Outdoor air temperature range shown by .

REYQ192PTJU

Combit-nation (%)	Outdoor air temp. (F/DB)	Indoor air temp. F/DB												Heating capacity
		61			65			70			75			
		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	
100	-3.64	4.0	132	14.0	132	14.8	131	15.4	131	15.7	131	16.1	131	16.7
	-1.84	-2.2	134	14.2	134	15.0	134	15.6	133	15.9	133	16.3	133	16.9
	0.5	5.5	135	14.5	135	15.3	135	15.9	134	16.2	134	16.6	134	17.2
	9.5	8.5	136	14.8	136	15.6	136	16.2	135	16.5	135	16.9	135	17.5
	13.0	12.0	137	15.1	137	15.9	137	16.5	136	17.4	136	17.8	136	18.1
	15.0	14.0	138	15.4	138	16.2	138	16.8	137	17.7	137	18.1	137	18.4
	17.0	15.5	139	15.7	139	16.5	139	17.1	138	18.0	18.4	138	18.8	18.8
	19.0	18.0	140	16.0	140	16.8	140	17.4	139	18.7	18.8	140	19.1	19.1
	22.0	20.0	141	16.3	141	17.1	141	17.7	140	19.0	19.0	141	19.3	19.3
	30.0	28.0	142	16.6	142	17.4	142	18.0	141	19.3	19.3	142	19.6	19.6
90	-3.64	-4.0	131	15.2	131	15.9	131	16.4	131	16.8	130	17.1	130	17.7
	-1.84	-2.2	133	15.4	133	16.1	133	16.6	133	17.0	133	17.3	132	17.8
	0.5	5.0	134	15.7	134	16.4	134	16.9	134	17.4	134	17.7	134	18.5
	9.5	8.5	135	16.0	135	16.7	135	17.2	135	17.7	135	18.0	135	19.1
	13.0	12.0	136	16.3	136	17.0	136	17.5	136	18.0	136	18.3	136	19.6
	15.0	14.0	137	16.6	137	17.3	137	17.8	137	18.3	137	18.6	137	20.1
	17.0	15.5	138	16.9	138	17.6	138	18.1	138	18.6	138	18.9	138	20.6
	19.0	18.0	139	17.2	139	17.9	139	18.4	139	18.9	139	19.2	139	21.1
	22.0	20.0	140	17.5	140	18.2	140	18.7	140	19.4	140	19.7	140	21.6
	30.0	28.0	141	17.8	141	18.5	141	19.0	141	19.7	141	20.0	141	22.1
80	-3.64	-4.0	130	15.0	130	15.7	130	16.2	130	16.6	130	17.0	130	17.4
	-1.84	-2.2	132	15.2	132	15.9	132	16.4	132	16.8	132	17.2	132	17.6
	0.5	5.0	133	15.4	133	16.1	133	16.6	133	17.0	133	17.4	133	18.0
	9.5	8.5	134	15.7	134	16.4	134	16.9	134	17.4	134	17.8	134	18.4
	13.0	12.0	135	16.0	135	16.7	135	17.2	135	17.7	135	18.1	135	18.9
	15.0	14.0	136	16.3	136	17.0	136	17.5	136	18.0	136	18.4	136	19.4
	17.0	15.5	137	16.6	137	17.3	137	17.8	137	18.3	137	18.7	137	19.9
	19.0	18.0	138	16.9	138	17.6	138	18.1	138	18.6	138	19.0	138	20.4
	22.0	20.0	139	17.2	139	17.9	139	18.4	139	18.9	139	19.3	139	20.9
	30.0	28.0	140	17.5	140	18.2	140	18.7	140	19.2	140	19.6	140	21.4

Combit-nation (%)	Outdoor air temp. (F/DB)	Indoor air temp. F/DB												Heating capacity
		61			65			70			75			
		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	
130	-3.64	4.0	134	10.4	134	11.4	134	12.6	133	13.1	132	13.9	133	14.1
	-1.84	-2.2	135	10.7	135	11.6	135	12.9	134	13.4	134	14.1	134	14.3
	0.5	5.0	136	11.0	136	12.0	136	13.2	135	13.7	135	14.5	135	14.7
	9.5	8.5	137	11.3	137	12.3	137	13.5	136	14.0	136	14.8	136	15.0
	13.0	12.0	138	11.6	138	12.6	138	13.8	137	14.3	137	15.1	137	15.3
	15.0	14.0	139	11.9	139	12.9	139	14.1	138	14.6	138	15.4	138	15.6
	17.0	15.5	140	12.2	140	13.2	140	14.4	139	14.9	139	15.7	139	15.9
	19.0	18.0	141	12.5	141	13.5	141	14.7	140	15.2	140	16.0	140	16.1
	22.0	20.0	142	12.8	142	13.8	142	15.0	141	15.5	141	16.3	141	16.4
	30.0	28.0	143	13.1	143	14.1	143	15.3	142	15.8	142	16.6	142	16.6
120	-3.64	-4.0	133	12.5	133	13.2	132	13.7	132	14.1	132	14.8	133	15.0
	-1.84	-2.2	134	12.8	134	13.5	134	14.0	134	14.4	134	15.1	134	15.3
	0.5	5.0	135	13.1	135	13.8	135	14.3	135	14.7	135	15.4	135	15.6
	9.5	8.5	136	13.4	136	14.1	136	14.6	136	15.0	136	15.7	136	15.9
	13.0	12.0	137	13.7	137	14.4	137	14.9	137	15.3	137	16.0	137	16.1
	15.0	14.0	138	14.0	138	14.7	138	15.2	138	15.6	138	16.3	138	16.4
	17.0	15.5	139	14.3	139	15.0	139	15.5	139	16.0	139	16.6	139	16.7
	19.0	18.0	140	14.6	140	15.3	140	15.8	140	16.3	140	16.9	140	16.9
	22.0	20.0	141	14.9	141	15.6	141	16.1	141	16.6	141	17.1	141	17.1
	30.0	28.0	142	15.2	142	15.9	142	16.4	142	16.9	142	17.4	142	17.4
110	-3.64	-4.0	132	12.8	132	13.5	132	14.0	132	14.4	132	15.1	133	15.8
	-1.84	-2.2	133	13.1	133	13.8	133	14.3	133	14.7	133	15.4	134	16.0
	0.5	5.0	134	13.4	134	14.1	134	14.6	134	15.0	134	15.7	134	16.1
	9.5	8.5	135	13.7	135	14.4	135	14.9	135	15.3	135	16.0	135	16.2
	13.0	12.0	136	14.0	136	14.7	136	15.2	136	15.6	136	16.3	136	16.4
	15.0	14.0	137	14.3	137	15.0	137	15.5	137	16.0	137	16.6	137	16.7
	17.0	15.5	138	14.6	138	15.3	138	15.8	138	16.3	138	16.9	138	16.9
	19.0	18.0	139	14.9	139	15.6	139	16.1	139	16.6	139	17.1	139	17.1
	22.0	20.0	140	15.2	140	15.9	140	16.4	140	16.9	140	17.4	140	17.4
	30.0	28.0	141	15.5	141	16.2	141	16.7	141	17.2	141	17.7	141	17.7

TC : Total capacity ; MBH
 PI : Power Input ; kW (Comp.+Outdoor fan motor)

Note 1 : is shown as reference.

Note 2 : The above table shows the average value of conditions which may occur.

Heating capacity

Combustion (%)	Outdoor air temp. (F/DB)	Indoor air Temp. F/DB																	
		61		65		68		70		72		75							
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI						
70	-3.64	-4.0	129	18.9	129	19.3	129	19.7	129	19.9	129	19.9	129	19.9	129	19.9	129	19.9	
	-1.84	-2.2	132	19.0	131	19.5	131	19.8	130	19.7	129	19.8	131	19.8	131	19.9	129	19.9	129
	5.5	5.0	142	19.6	142	19.9	134	18.7	130	17.9	125	17.1	118	15.9	15.1	130	17.0	125	17.1
	9.5	8.5	149	18.9	142	19.9	134	16.7	130	16.0	125	15.2	118	14.1	130	16.0	125	15.2	118
	13.0	12.0	156	18.5	143	19.3	149	16.3	130	15.6	120	14.6	118	13.9	139	15.6	120	14.6	118
	15.0	14.0	161	18.7	142	17.3	134	16.3	130	15.6	120	14.6	118	13.9	139	15.6	120	14.6	118
	17.0	15.5	151	18.3	142	16.9	134	15.9	130	15.2	125	14.6	118	13.9	139	15.6	120	14.6	118
	19.0	18.0	151	17.5	142	16.2	134	15.2	130	14.6	125	14.0	118	13.1	131	14.6	125	14.0	118
	22.0	20.0	151	16.9	142	15.7	134	14.8	130	14.1	125	13.6	118	12.7	118	11.9	11.9	11.9	11.9
	26.0	24.0	151	15.8	142	14.7	134	13.8	130	13.3	125	12.7	118	11.2	11.2	11.2	11.2	11.2	11.2
	30.0	28.0	151	14.8	142	13.7	134	12.9	130	12.4	125	11.9	11.8	11.1	11.1	11.1	11.1	11.1	11.1
	35.0	32.0	151	13.8	142	12.8	134	12.1	130	11.6	125	11.2	11.8	10.5	11.8	10.5	11.8	10.5	11.8
39.0	36.0	151	12.9	142	12.0	134	11.4	130	10.9	125	10.5	11.8	10.5	11.8	10.5	11.8	10.5	11.8	
44.0	40.0	151	12.1	142	11.2	134	10.7	130	10.3	125	10.3	11.8	10.3	11.8	10.3	11.8	10.3	11.8	
47.0	43.0	151	11.4	142	10.7	134	10.2	130	10.2	125	10.2	11.8	10.2	11.8	10.2	11.8	10.2	11.8	
51.0	47.0	151	10.8	142	10.1	134	9.56	130	9.21	125	9.86	11.8	9.86	11.8	9.86	11.8	9.86	11.8	
54.0	50.0	151	10.3	142	9.64	134	9.14	130	8.81	125	8.48	11.8	8.48	11.8	8.48	11.8	8.48	11.8	
57.0	53.0	151	9.87	142	9.22	134	8.74	130	8.43	125	8.12	11.8	8.12	11.8	8.12	11.8	8.12	11.8	
60.0	56.0	151	9.43	142	8.82	134	8.37	130	8.07	125	7.78	11.8	7.78	11.8	7.78	11.8	7.78	11.8	
60	-3.64	-4.0	126	19.4	118	17.9	112	16.9	108	16.1	104	15.4	98.0	14.4	14.4	14.4	14.4	14.4	
	-1.84	-2.2	126	19.0	118	17.6	112	16.5	108	15.8	104	15.1	98.0	14.1	98.0	14.1	98.0	14.1	
	5.5	5.0	126	17.3	118	16.0	112	15.0	108	14.4	104	13.8	98.0	12.9	12.9	12.9	12.9	12.9	
	9.5	8.5	126	16.4	118	15.2	112	14.3	108	13.7	104	13.1	98.0	12.3	12.3	12.3	12.3	12.3	
	13.0	12.0	126	15.5	118	14.4	112	13.5	108	13.0	104	12.5	98.0	11.7	11.7	11.7	11.7	11.7	
	15.0	14.0	126	14.7	118	13.7	112	12.9	108	12.9	104	12.5	98.0	11.4	11.4	11.4	11.4	11.4	
	17.0	15.5	126	14.1	118	13.1	112	12.4	108	12.9	104	11.9	98.0	11.1	11.1	11.1	11.1	11.1	
	19.0	18.0	126	13.7	118	12.7	112	12.0	108	11.5	104	11.4	98.0	10.7	10.7	10.7	10.7	10.7	
	22.0	20.0	126	12.8	118	11.9	112	11.3	108	10.8	104	10.4	98.0	10.4	10.4	10.4	10.4	10.4	
	26.0	24.0	126	12.0	118	11.2	112	10.6	108	10.2	104	9.80	98.0	9.22	9.22	9.22	9.22	9.22	
	30.0	28.0	126	11.3	118	10.5	112	9.96	108	9.59	104	8.68	98.0	8.68	8.68	8.68	8.68	8.68	
	35.0	32.0	126	10.6	118	9.89	112	9.37	108	9.02	104	8.68	98.0	8.18	8.18	8.18	8.18	8.18	
39.0	36.0	126	9.95	118	9.30	112	8.81	108	8.50	104	7.63	98.0	7.63	7.63	7.63	7.63	7.63		
44.0	40.0	126	9.50	118	8.89	112	8.43	108	8.13	104	7.63	98.0	7.63	7.63	7.63	7.63	7.63		
47.0	43.0	126	8.50	118	8.29	112	7.62	108	7.35	104	7.09	98.0	6.79	6.79	6.79	6.79	6.79		
51.0	47.0	126	8.55	118	8.02	112	7.62	108	7.35	104	7.09	98.0	6.79	6.79	6.79	6.79	6.79		
54.0	50.0	126	8.19	118	7.68	112	7.01	108	7.05	104	6.81	98.0	6.44	6.44	6.44	6.44	6.44		
57.0	53.0	126	7.85	118	7.37	112	7.01	108	6.77	104	6.54	98.0	6.19	6.19	6.19	6.19	6.19		
60.0	56.0	126	7.85	118	7.37	112	7.01	108	6.77	104	6.54	98.0	6.19	6.19	6.19	6.19	6.19	6.19	

TC : Total capacity ; MBH

PI : Power Input ; kW (Comp.+Outdoor fan motor)

Note1 : is shown as reference

Note 2 : The above table shows the average value of conditions which may occur.

REYQ216PTJU

Capacity table for REYQ216PTJU showing heating capacity (kW, MBH) and power input (kW, MBH) for indoor air temperature ranges of 61, 65, 70, 75, and 75°F DB. Includes columns for Combustion (%), Outdoor air temp. (F, W, B), and heating capacity.

Capacity table for REYQ216PTJU showing heating capacity (kW, MBH) and power input (kW, MBH) for indoor air temperature ranges of 61, 65, 70, 75, and 75°F DB. Includes columns for Combustion (%), Outdoor air temp. (F, W, B), and heating capacity.

TC: Total capacity; MBH Power Input; kW (Comp.+Outdoor fan motor) Note 1: is shown as reference. Note 2: The above table shows the average value of conditions which may occur.

Heating capacity

Combustion (%)	Outdoor air temp. (F/DB)	Indoor air Temp. F/DB												
		61			65			70			75			
		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	
70	-3.64	-4.0	147	20.7	21.3	146	21.8	22.1	146	22.3	140	22.3	132	20.8
	-1.84	-2.2	150	20.9	21.5	149	22.0	149	22.0	140	21.9	132	20.3	
	0.5	0.5	152	21.1	21.6	151	22.2	151	22.2	140	21.9	132	19.5	
	1.0	1.0	154	21.3	21.8	153	22.3	152	22.3	140	21.9	132	18.5	
	1.5	1.5	156	21.5	22.0	155	22.4	153	22.4	140	21.9	132	17.5	
	2.0	2.0	158	21.7	22.2	157	22.5	154	22.5	140	21.9	132	16.5	
	2.5	2.5	160	21.9	22.4	159	22.6	155	22.6	140	21.9	132	15.5	
	3.0	3.0	162	22.1	22.6	161	22.7	156	22.7	140	21.9	132	14.5	
	3.5	3.5	164	22.3	22.8	163	22.8	157	22.8	140	21.9	132	13.5	
	4.0	4.0	166	22.5	23.0	165	22.9	158	22.9	140	21.9	132	12.5	
	4.5	4.5	168	22.7	23.2	167	23.0	159	23.0	140	21.9	132	11.5	
	5.0	5.0	170	22.9	23.4	169	23.1	160	23.1	140	21.9	132	10.5	
60	-3.64	-4.0	146	22.1	22.7	146	23.1	146	23.3	140	22.3	132	20.8	
	-1.84	-2.2	149	22.3	22.8	148	23.2	146	22.9	140	21.9	132	20.3	
	0.5	0.5	151	22.5	23.1	151	23.2	146	22.9	140	21.9	132	19.5	
	1.0	1.0	153	22.7	23.3	153	23.3	146	22.9	140	21.9	132	18.5	
	1.5	1.5	155	22.9	23.5	155	23.4	146	22.9	140	21.9	132	17.5	
	2.0	2.0	157	23.1	23.7	157	23.5	146	22.9	140	21.9	132	16.5	
	2.5	2.5	159	23.3	23.9	159	23.6	146	22.9	140	21.9	132	15.5	
	3.0	3.0	161	23.5	24.1	161	23.7	146	22.9	140	21.9	132	14.5	
	3.5	3.5	163	23.7	24.3	163	23.8	146	22.9	140	21.9	132	13.5	
	4.0	4.0	165	23.9	24.5	165	23.9	146	22.9	140	21.9	132	12.5	
	4.5	4.5	167	24.1	24.7	167	24.0	146	22.9	140	21.9	132	11.5	
	5.0	5.0	169	24.3	24.9	169	24.1	146	22.9	140	21.9	132	10.5	
50	-3.64	-4.0	142	22.6	23.3	142	23.6	142	23.3	140	22.3	132	20.8	
	-1.84	-2.2	142	22.6	23.3	142	23.6	142	23.3	140	22.3	132	20.3	
	0.5	0.5	142	22.6	23.3	142	23.6	142	23.3	140	22.3	132	19.5	
	1.0	1.0	142	22.6	23.3	142	23.6	142	23.3	140	22.3	132	18.5	
	1.5	1.5	142	22.6	23.3	142	23.6	142	23.3	140	22.3	132	17.5	
	2.0	2.0	142	22.6	23.3	142	23.6	142	23.3	140	22.3	132	16.5	
	2.5	2.5	142	22.6	23.3	142	23.6	142	23.3	140	22.3	132	15.5	
	3.0	3.0	142	22.6	23.3	142	23.6	142	23.3	140	22.3	132	14.5	
	3.5	3.5	142	22.6	23.3	142	23.6	142	23.3	140	22.3	132	13.5	
	4.0	4.0	142	22.6	23.3	142	23.6	142	23.3	140	22.3	132	12.5	
	4.5	4.5	142	22.6	23.3	142	23.6	142	23.3	140	22.3	132	11.5	
	5.0	5.0	142	22.6	23.3	142	23.6	142	23.3	140	22.3	132	10.5	

TC : Total capacity ; MBH
 PI : Power Input ; kW (Comp.+Outdoor fan motor)
 Note1 : is shown as reference
 Note 2 : The above table shows the average value of conditions which may occur.

REYQ240PTJU

Combit-nation (%)	Outdoor air temp. (F/DB)	Indoor air temp. F/DB												
		61			65			70			75			
		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	
100	-3.64	4.0	156	109	122	156	132	155	139	155	145	154	154	155
	-1.84	2.2	157	113	126	158	142	158	148	158	148	157	158	158
	9.5	8.5	177	137	148	178	163	177	163	177	163	177	177	177
	13.0	12.0	187	145	166	186	169	185	175	185	185	183	183	183
	15.0	14.0	192	149	191	194	180	191	188	191	189	187	187	187
	17.0	15.5	196	153	195	194	171	194	176	194	182	193	189	189
	19.0	18.0	202	159	202	169	201	176	201	181	200	186	200	194
	22.0	20.0	208	163	207	173	207	180	208	185	206	190	205	197
	24.0	22.0	210	172	210	183	218	197	217	197	217	204	210	204
	26.0	24.0	212	181	211	196	231	200	230	204	230	211	243	217
90	-3.64	4.0	156	109	122	156	132	155	139	155	145	154	154	155
	-1.84	2.2	157	113	126	158	142	158	148	158	148	157	158	158
	9.5	8.5	177	137	148	178	163	177	163	177	163	177	177	177
	13.0	12.0	187	145	166	186	169	185	175	185	185	183	183	183
	15.0	14.0	192	149	191	194	180	191	188	191	189	187	187	187
	17.0	15.5	196	153	195	194	171	194	176	194	182	193	189	189
	19.0	18.0	202	159	202	169	201	176	201	181	200	186	200	194
	22.0	20.0	208	163	207	173	207	180	208	185	206	190	205	197
	24.0	22.0	210	172	210	183	218	197	217	197	217	204	210	204
	26.0	24.0	212	181	211	196	231	200	230	204	230	211	243	217
80	-3.64	4.0	156	109	122	156	132	155	139	155	145	154	154	155
	-1.84	2.2	157	113	126	158	142	158	148	158	148	157	158	158
	9.5	8.5	177	137	148	178	163	177	163	177	163	177	177	177
	13.0	12.0	187	145	166	186	169	185	175	185	185	183	183	183
	15.0	14.0	192	149	191	194	180	191	188	191	189	187	187	187
	17.0	15.5	196	153	195	194	171	194	176	194	182	193	189	189
	19.0	18.0	202	159	202	169	201	176	201	181	200	186	200	194
	22.0	20.0	208	163	207	173	207	180	208	185	206	190	205	197
	24.0	22.0	210	172	210	183	218	197	217	197	217	204	210	204
	26.0	24.0	212	181	211	196	231	200	230	204	230	211	243	217

Combit-nation (%)	Outdoor air temp. (F/DB)	Indoor air temp. F/DB												
		61			65			70			75			
		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	
130	-3.64	4.0	156	109	122	156	132	155	139	155	145	154	154	155
	-1.84	2.2	157	113	126	158	142	158	148	158	148	157	158	158
	9.5	8.5	177	137	148	178	163	177	163	177	163	177	177	177
	13.0	12.0	187	145	166	186	169	185	175	185	185	183	183	183
	15.0	14.0	192	149	191	194	180	191	188	191	189	187	187	187
	17.0	15.5	196	153	195	194	171	194	176	194	182	193	189	189
	19.0	18.0	202	159	202	169	201	176	201	181	200	186	200	194
	22.0	20.0	208	163	207	173	207	180	208	185	206	190	205	197
	24.0	22.0	210	172	210	183	218	197	217	197	217	204	210	204
	26.0	24.0	212	181	211	196	231	200	230	204	230	211	243	217
120	-3.64	4.0	156	109	122	156	132	155	139	155	145	154	154	155
	-1.84	2.2	157	113	126	158	142	158	148	158	148	157	158	158
	9.5	8.5	177	137	148	178	163	177	163	177	163	177	177	177
	13.0	12.0	187	145	166	186	169	185	175	185	185	183	183	183
	15.0	14.0	192	149	191	194	180	191	188	191	189	187	187	187
	17.0	15.5	196	153	195	194	171	194	176	194	182	193	189	189
	19.0	18.0	202	159	202	169	201	176	201	181	200	186	200	194
	22.0	20.0	208	163	207	173	207	180	208	185	206	190	205	197
	24.0	22.0	210	172	210	183	218	197	217	197	217	204	210	204
	26.0	24.0	212	181	211	196	231	200	230	204	230	211	243	217
110	-3.64	4.0	156	109	122	156	132	155	139	155	145	154	154	155
	-1.84	2.2	157	113	126	158	142	158	148	158	148	157	158	158
	9.5	8.5	177	137	148	178	163	177	163	177	163	177	177	177
	13.0	12.0	187	145	166	186	169	185	175	185	185	183	183	183
	15.0	14.0	192	149	191	194	180	191	188	191	189	187	187	187
	17.0	15.5	196	153	195	194	171	194	176	194	182	193	189	189
	19.0	18.0	202	159	202	169	201	176	201	181	200	186	200	194
	22.0	20.0	208	163	207	173	207	180	208	185	206	190	205	197
	24.0	22.0	210	172	210	183	218	197	217	197	217	204	210	204
	26.0	24.0	212	181	211	196	231	200	230	204	230	211	243	217

TC: Total capacity; MBH
 PI: Power Input; kW (Comp.+Outdoor fan motor)

Note 1: is shown as reference.

Note 2: The above table shows the average value of conditions which may occur.

Heating capacity

Combustion (%)	Outdoor air temp. (F/DB)	Indoor air Temp. F/DB												
		61		65		68		70		72		75		
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	
70	-3.64	-4.0	151	22.1	150	22.7	150	23.2	150	23.5	150	23.8	147	23.6
	-1.84	-2.2	153	22.3	153	22.9	153	23.3	153	23.6	153	23.9	147	23.1
	5.5	5.0	166	23.0	166	23.6	165	24.0	162	23.5	156	22.5	147	21.0
	9.5	8.5	174	23.4	173	23.8	168	24.3	162	22.3	156	20.2	147	19.9
	13.0	12.0	182	23.6	177	24.1	168	24.4	162	20.2	156	19.6	147	18.3
	17.0	15.5	189	24.0	177	24.2	168	24.9	162	20.0	156	19.2	147	17.9
	19.0	18.0	189	23.0	177	21.3	168	20.0	162	19.2	156	18.4	147	17.2
	22.0	20.0	189	22.3	177	20.6	168	19.4	162	17.4	156	17.8	147	16.7
	26.0	24.0	189	20.8	177	19.3	168	18.2	162	17.4	156	16.7	147	15.6
	30.0	28.0	189	19.4	177	18.0	168	17.0	162	16.3	156	15.7	147	14.7
	35.0	32.0	189	18.2	177	16.9	168	15.9	162	15.3	156	14.7	147	13.8
	39.0	36.0	189	17.0	177	15.8	168	14.9	162	14.3	156	13.8	147	12.9
44.0	40.0	189	15.9	177	14.4	168	13.9	162	13.4	156	12.9	147	12.1	
47.0	44.0	189	14.2	177	13.2	168	12.5	162	12.9	156	11.6	147	10.9	
51.0	47.0	189	12.9	177	12.1	168	11.4	162	11.5	156	11.1	147	10.5	
54.0	50.0	189	12.9	177	12.1	168	11.4	162	11.0	156	10.6	147	10.0	
57.0	53.0	189	12.9	177	12.1	168	11.4	162	11.0	156	10.6	147	10.0	
60.0	56.0	220	14.5	206	14.2	196	13.4	189	12.9	182	12.4	172	11.2	
60	-3.64	-4.0	151	22.1	150	22.7	150	23.2	150	23.5	150	23.8	147	23.6
	-1.84	-2.2	153	22.3	153	22.9	153	23.3	153	23.6	153	23.9	147	23.1
	5.5	5.0	166	23.0	166	23.6	165	24.0	162	23.5	156	22.5	147	21.0
	9.5	8.5	174	23.4	173	23.8	168	24.3	162	22.3	156	20.2	147	19.9
	13.0	12.0	182	23.6	177	24.1	168	24.4	162	20.2	156	19.6	147	18.3
	17.0	15.5	189	24.0	177	24.2	168	24.9	162	20.0	156	19.2	147	17.9
	19.0	18.0	189	23.0	177	21.3	168	20.0	162	19.2	156	18.4	147	17.2
	22.0	20.0	189	22.3	177	20.6	168	19.4	162	17.4	156	17.8	147	16.7
	26.0	24.0	189	20.8	177	19.3	168	18.2	162	17.4	156	16.7	147	15.6
	30.0	28.0	189	19.4	177	18.0	168	17.0	162	16.3	156	15.7	147	14.7
	35.0	32.0	189	18.2	177	16.9	168	15.9	162	15.3	156	14.7	147	13.8
	39.0	36.0	189	17.0	177	15.8	168	14.9	162	14.3	156	13.8	147	12.9
44.0	40.0	189	15.9	177	14.4	168	13.9	162	13.4	156	12.9	147	12.1	
47.0	44.0	189	14.2	177	13.2	168	12.5	162	12.9	156	11.6	147	10.9	
51.0	47.0	189	12.9	177	12.1	168	11.4	162	11.5	156	11.1	147	10.5	
54.0	50.0	189	12.9	177	12.1	168	11.4	162	11.0	156	10.6	147	10.0	
57.0	53.0	189	12.9	177	12.1	168	11.4	162	11.0	156	10.6	147	10.0	
60.0	56.0	220	14.5	206	14.2	196	13.4	189	12.9	182	12.4	172	11.2	
50	-3.64	-4.0	150	23.7	147	23.7	140	22.2	135	21.3	130	20.4	123	19.0
	-1.84	-2.2	153	23.8	147	23.2	140	21.8	135	20.9	130	20.0	123	18.6
	5.5	5.0	157	22.7	147	21.0	140	19.8	135	19.0	130	18.2	123	17.0
	9.5	8.5	157	21.6	147	20.0	140	18.8	135	18.1	130	17.3	123	16.2
	13.0	12.0	157	20.5	147	18.4	140	17.9	135	17.2	130	16.4	123	15.4
	17.0	15.5	157	19.4	147	18.0	140	16.9	135	16.9	130	15.6	123	14.6
	19.0	18.0	157	18.6	147	17.3	140	16.3	135	16.7	130	15.0	123	14.1
	22.0	20.0	157	18.0	147	16.7	140	15.8	135	16.2	130	14.6	123	13.7
	26.0	24.0	157	16.9	147	15.7	140	14.8	135	15.2	130	13.7	123	12.9
	30.0	28.0	157	15.8	147	14.7	140	13.9	135	15.4	130	13.7	123	12.1
	35.0	32.0	157	14.8	147	13.8	140	13.1	135	15.6	130	12.9	123	11.4
	39.0	36.0	157	13.9	147	13.0	140	12.3	135	15.8	130	12.1	123	11.4
44.0	40.0	157	13.0	147	12.2	140	11.6	135	16.1	130	11.4	123	10.7	
47.0	45.0	157	12.5	147	11.6	140	11.0	135	16.3	130	10.7	123	10.1	
51.0	47.0	157	11.2	147	10.5	140	10.0	135	16.5	130	10.3	123	9.69	
54.0	50.0	157	11.2	147	10.5	140	9.97	135	16.9	130	9.98	123	9.75	
57.0	53.0	157	10.7	147	10.0	140	9.97	135	17.3	130	9.91	123	9.83	
60.0	56.0	157	10.3	147	9.63	140	9.16	135	17.7	130	8.55	123	8.10	

TC : Total capacity ; MBH

PI : Power Input ; kW (Comp.+Outdoor fan motor)

Note1 : is shown as reference


Note 2 : The above table shows the average value of conditions which may occur.

When selecting the unit models, avoid the Outdoor air temperature range shown by


8.3 Capacity Correction Factor

REYQ72PTJU

1. Rate of change in cooling capacity

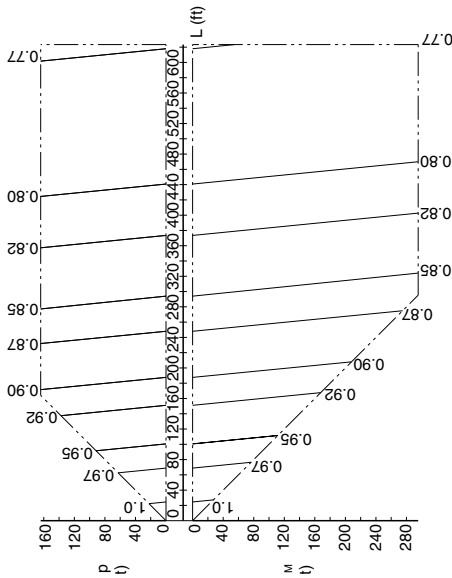

2. Rate of change in heating capacity

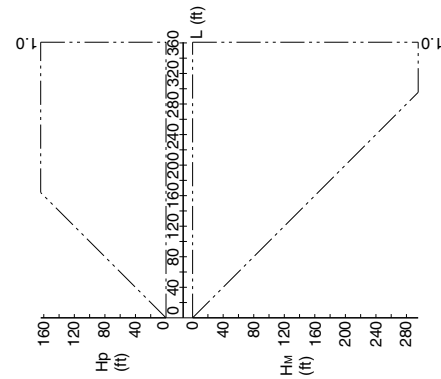

[Explanation of symbols]
 Hp : Level difference (ft) between indoor and outdoor units where indoor unit in inferior position
 Hm : Level difference (ft) between indoor and outdoor units where indoor unit in superior position
 L : Equivalent pipe length (ft)
 α : Capacity correction factor

[Diameter of pipe (standard size)]

Model	liquid
REYQ72PYDN REYQ72PTJU	φ 3/8
REYQ216PYDN REYQ216PTJU	φ 5/8

otes]

These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures. With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out. Method of calculating A/C (cooling/heating) capacity: The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units mentioned below, whichever smaller. Calculating A/C capacity of outdoor units

- Condition: Indoor unit combination ratio does not exceed 100%.

$$[\text{Maximum A/C capacity of outdoor units}] = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the 100\% combination}}{\text{Capacity change rate due to piping length to the farthest indoor unit}}$$

- Condition: Indoor unit combination ratio exceeds 100%.

$$[\text{Maximum A/C capacity of outdoor units}] = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the combination}}{\text{Capacity change rate due to piping length to the farthest indoor unit}}$$

When overall equivalent pipe length is 295.3ft or more, the diameter of the main liquid pipes (outdoor unit-branch sections) must be increased.

When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.

Model	liquid
REYQ72PYDN REYQ72PTJU	φ 1/2
REYQ216PYDN REYQ216PTJU	φ 3/4


- When the main sections of the interunit liquid pipe diameters are increased the overall equivalent length should be calculated as follows. (Heating only)

$$\text{Overall equivalent length} = \text{Equivalent length to main pipe} \times \text{Correction factor} + \text{Equivalent length after branching}$$

[Choose a correction factor from the following table]

Model	Correction factor
REYQ72PYDN REYQ72PTJU	0.2
REYQ216PYDN REYQ216PTJU	0.4

(Example) In case of REYQ216PYDN

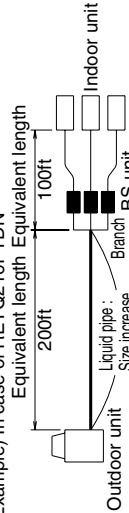

In the above case (Heating)


$$\text{Overall equivalent length} = 200\text{ft} \times 0.4 + 100\text{ft} = 180\text{ft}$$

The correction factor in capacity when Hp = 0ft is thus approximately 1.0.

- In the combination which does not include cooling only indoor unit, Calculate the equivalent length pipe by the following when you calculate cooling capacity.

$$\text{Overall equivalent length} = \text{Equivalent length to main pipe} \times 0.5 + \text{Equivalent length after branching}$$

(Example)

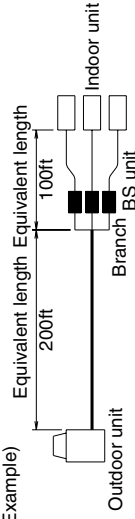

In the above case (Cooling)


$$\text{Overall equivalent length} = 200\text{ft} \times 0.5 + 100\text{ft} = 200\text{ft}$$

The correction factor in capacity when Hp = 0m is thus approximately 0.86.


3D058626

REYQ96PTJU

1. Rate of change in cooling capacity

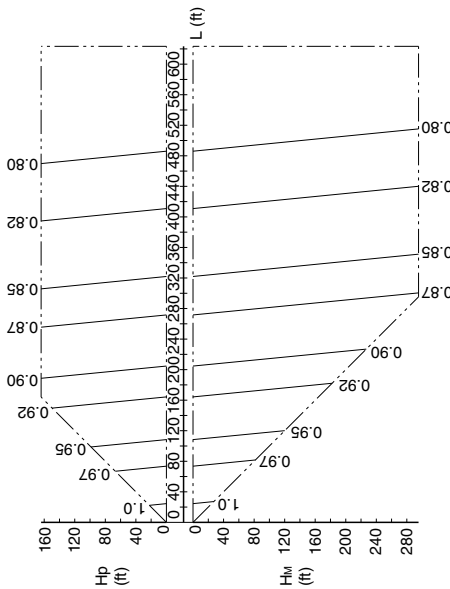

2. Rate of change in heating capacity

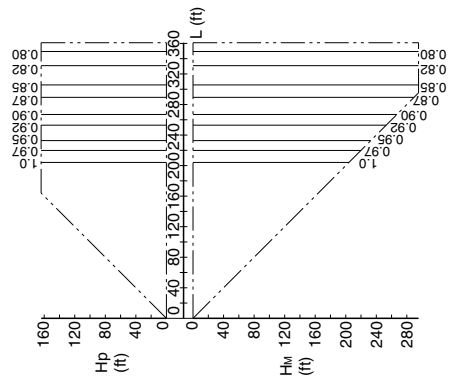

[Explanation of symbols]
 Hp : Level difference (ft) between indoor and outdoor units where indoor unit in inferior position
 Hm : Level difference (ft) between indoor and outdoor units where indoor unit in superior position
 L : Equivalent pipe length (ft)
 α : Capacity correction factor

[Diameter of pipe (standard size)]

Model	liquid
REYQ96PYDN	φ 3/8
REYQ96PTJU	φ 3/8

[Notes]

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
- Method of calculating A/C (cooling/heating) capacity:
 The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.
 Calculating A/C capacity of outdoor units
 • Condition: Indoor unit combination ratio does not exceed 100%.
 [Maximum A/C capacity of outdoor units] = A/C capacity of outdoor units obtained from capacity characteristic table at the 100% combination
 × Capacity change rate due to piping length to the farthest indoor unit
 • Condition: Indoor unit combination ratio exceeds 100%.
 [Maximum A/C capacity of outdoor units] = A/C capacity of outdoor units obtained from capacity characteristic table at the combination
 × Capacity change rate due to piping length to the farthest indoor unit


- When overall equivalent pipe length is 295.3ft or more, the diameter of the main liquid pipes (outdoor unit-branch sections) must be increased.
 When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.
 [Diameter of above case]

Model	liquid
REYQ96PYDN	φ 1/2
REYQ96PTJU	φ 1/2

- When the main sections of the interunit liquid pipe diameters are increased the overall equivalent length should be calculated as follows. (Heating only)

Overall equivalent length = Equivalent length to main pipe × 0.2 + Equivalent length after branching

(Example)

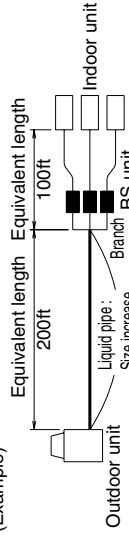


In the above case (Heating)
 Overall equivalent length = 200ft × 0.2 + 100ft = 140ft
 The correction factor in capacity when Hp = 0ft is thus approximately 1.0.

- In the combination which does not include cooling only indoor unit, Calculate the equivalent length pipe by the following when you calculate cooling capacity.

Overall equivalent length = Equivalent length to main pipe × 0.5 + Equivalent length after branching

(Example)

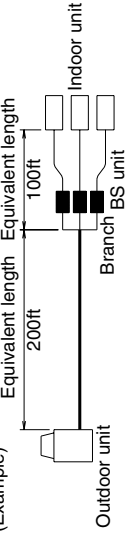


In the above case (Cooling)
 Overall equivalent length = 200ft × 0.5 + 100ft = 200ft
 The correction factor in capacity when Hp = 0ft is thus approximately 0.88.


3D058627

REYQ120PTJU

1. Rate of change in cooling capacity

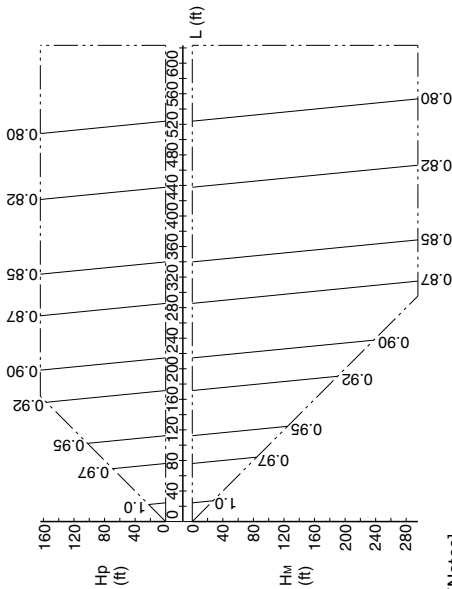

2. Rate of change in heating capacity

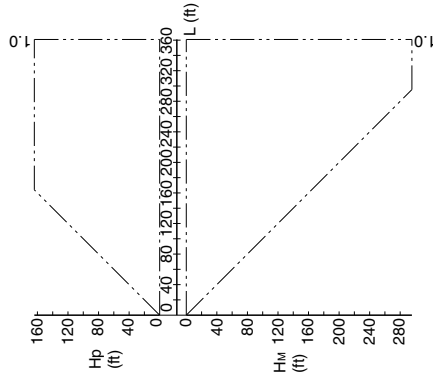

[Explanation of symbols]
 Hp : Level difference (ft) between indoor and outdoor units where indoor unit in inferior position
 Hm : Level difference (ft) between indoor and outdoor units where indoor unit in superior position
 L : Equivalent pipe length (ft)
 α : Capacity correction factor

[Diameter of pipe (standard size)]

Model	liquid
REYQ120PYDN REYQ120PTJU	φ 1/2
REYQ168PYDN REYQ168PTJU	φ 5/8

[Notes]

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
- Method of calculating A/C (cooling/heating) capacity:
 The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.
 Calculating A/C capacity of outdoor units

• Condition: Indoor unit combination ratio does not exceed 100%.

$$\left[\frac{\text{Maximum A/C capacity of outdoor units}}{\text{Maximum A/C capacity of indoor units}} \right] = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the 100\% combination}}{\text{A/C capacity of indoor units obtained from capacity characteristic table at the 100\% combination}}$$
 × Capacity change rate due to piping length to the farthest indoor unit

• Condition: Indoor unit combination ratio exceeds 100%.

$$\left[\frac{\text{Maximum A/C capacity of outdoor units}}{\text{Maximum A/C capacity of indoor units}} \right] = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the combination}}{\text{A/C capacity of indoor units obtained from capacity characteristic table at the combination}}$$
 × Capacity change rate due to piping length to the farthest indoor unit

4. When overall equivalent pipe length is 295.3ft or more, the diameter of the main liquid pipes (outdoor unit-branch sections) must be increased.
 When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.

[Diameter of above case]


Model	liquid
REYQ120PYDN REYQ120PTJU	φ 5/8
REYQ168PYDN REYQ168PTJU	φ 3/4

- When the main sections of the interunit liquid pipe diameters are increased the overall equivalent length should be calculated as follows. (Heating only)

$$\text{Overall equivalent length} = \text{Equivalent length to main pipe} \times \text{Correction factor} + \text{Equivalent length after branching}$$
 [Choose a correction factor from the following table]

Model	Correction factor
REYQ120PYDN REYQ120PTJU	0.3
REYQ168PYDN REYQ168PTJU	0.4

(Example) In case of REYQ18PY1

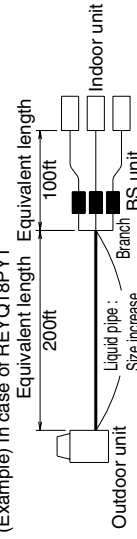


In the above case (Heating)

Overall equivalent length = 200ft × 0.4 + 100ft = 180ft

The correction factor in capacity when Hp = 0ft is thus approximately 1.0.

- In the combination which does not include cooling only indoor unit, Calculate the equivalent length pipe by the following when you calculate cooling capacity.

Overall equivalent length = Equivalent length to main pipe × 0.5 + Equivalent length after branching

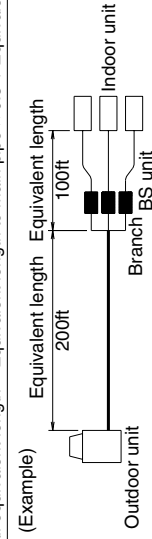

In the above case (Cooling)


Overall equivalent length = 200ft × 0.5 + 100ft = 200ft

The correction factor in capacity when Hp = 0ft is thus approximately 0.88.


3D058628

REYQ144PTJU

1. Rate of change in cooling capacity

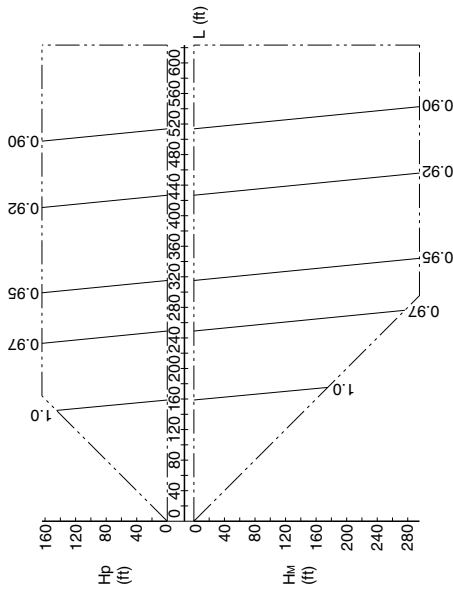

2. Rate of change in heating capacity

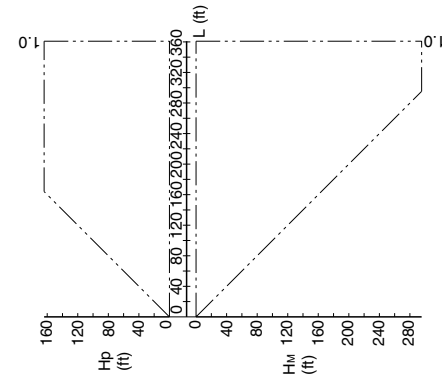

[Explanation of symbols]

Hp : Level difference (ft) between indoor and outdoor units where indoor unit in inferior position

Hm : Level difference (ft) between indoor and outdoor units where indoor unit in superior position

L : Equivalent pipe length (ft)

α : Capacity correction factor

[Diameter of pipe (standard size)]

Model	liquid
REYQ144PYDN	ϕ 1/2
REYQ144PTJU	ϕ 1/2

[Notes]

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
- Method of calculating A/C (cooling/heating) capacity:
The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.

Calculating A/C capacity of outdoor units

• Condition: Indoor unit combination ratio does not exceed 100%.

$$[\text{Maximum A/C capacity of outdoor units}] = \text{A/C capacity of outdoor units obtained from capacity characteristic table at the 100\% combination} \times \text{Capacity change rate due to piping length to the farthest indoor unit}$$

• Condition: Indoor unit combination ratio exceeds 100%.

$$[\text{Maximum A/C capacity of outdoor units}] = \text{A/C capacity of outdoor units obtained from capacity characteristic table at the combination} \times \text{Capacity change rate due to piping length to the farthest indoor unit}$$


- When overall equivalent pipe length is 295.3ft or more, the diameter of the main liquid pipes (outdoor unit-branch sections) must be increased. When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.
[Diameter of above case]

Model	liquid
REYQ144PYDN	ϕ 5/8
REYQ144PTJU	ϕ 5/8

- When the main sections of the interunit liquid pipe diameters are increased the overall equivalent length should be calculated as follows. (Heating only)

$$\text{Overall equivalent length} = \text{Equivalent length to main pipe} \times 0.3 + \text{Equivalent length after branching}$$

(Example)

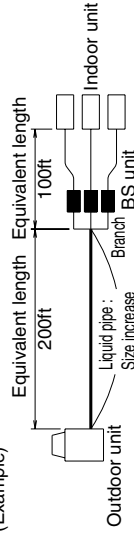

In the above case (Heating)


$$\text{Overall equivalent length} = 200\text{ft} \times 0.3 + 100\text{ft} = 160\text{ft}$$

The correction factor in capacity when Hp = 0ft is thus approximately 1.0.

- In the combination which does not include cooling only indoor unit, Calculate the equivalent length pipe by the following when you calculate cooling capacity.

$$\text{Overall equivalent length} = \text{Equivalent length to main pipe} \times 0.5 + \text{Equivalent length after branching}$$

(Example)



In the above case (Cooling)


$$\text{Overall equivalent length} = 200\text{ft} \times 0.5 + 100\text{ft} = 200\text{ft}$$

The correction factor in capacity when Hp = 0ft is thus approximately 0.96.


3D058629

REYQ168PTJU

1. Rate of change in cooling capacity

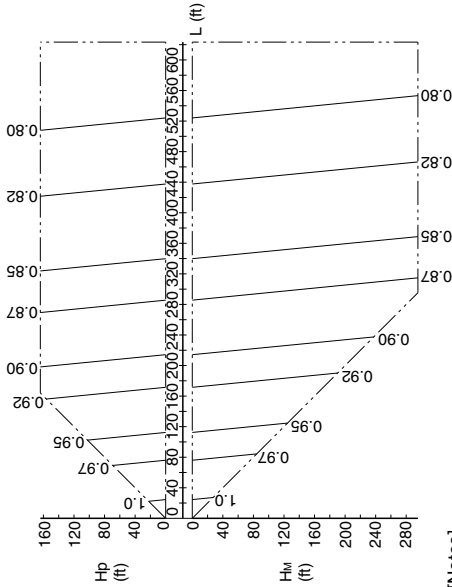

2. Rate of change in heating capacity

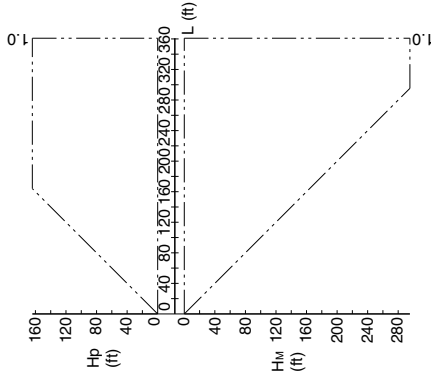

[Explanation of symbols]

- Hp : Level difference (ft) between indoor and outdoor units where indoor unit in inferior position
- Hm : Level difference (ft) between indoor and outdoor units where indoor unit in superior position
- L : Equivalent pipe length (ft)
- α : Capacity correction factor

[Diameter of pipe (standard size)]

Model	liquid
REYQ120PYDN	φ 1/2
REYQ120PTJU	
REYQ168PYDN	φ 5/8
REYQ168PTJU	

[Notes]

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
- Method of calculating A/C (cooling/heating) capacity:
The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.
Calculating A/C capacity of outdoor units

• Condition: Indoor unit combination ratio does not exceed 100%.

$$\left[\frac{\text{Maximum A/C capacity of outdoor units}}{\text{Maximum A/C capacity of indoor units}} \right] = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the 100% combination}}{\text{Capacity change rate due to piping length to the farthest indoor unit}} \times 100\%$$

$$\left[\frac{\text{Maximum A/C capacity of outdoor units}}{\text{Maximum A/C capacity of indoor units}} \right] = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the combination}}{\text{Capacity change rate due to piping length to the farthest indoor unit}} \times 100\%$$

- When overall equivalent pipe length is 295.3ft or more, the diameter of the main liquid pipes (outdoor unit-branch sections) must be increased.
When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.

[Diameter of above case]

Model	liquid
REYQ120PYDN	φ 5/8
REYQ120PTJU	
REYQ168PYDN	φ 3/4
REYQ168PTJU	


- When the main sections of the interunit liquid pipe diameters are increased the overall equivalent length should be calculated as follows. (Heating only)

$$\text{Overall equivalent length} = \text{Equivalent length to main pipe} \times \text{Correction factor} + \text{Equivalent length after branching}$$

[Choose a correction factor from the following table]

Model	Correction factor
REYQ120PYDN	0.3
REYQ120PTJU	
REYQ168PYDN	0.4
REYQ168PTJU	

(Example) In case of REYQ18PY1

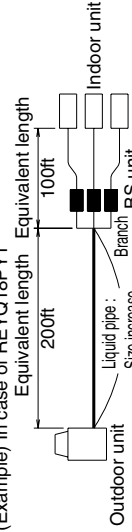

In the above case (Heating)


$$\text{Overall equivalent length} = 200\text{ft} \times 0.4 + 100\text{ft} = 180\text{ft}$$

The correction factor in capacity when Hp = 0ft is thus approximately 1.0.

- In the combination which does not include cooling only indoor unit, Calculate the equivalent length pipe by the following when you calculate cooling capacity.

$$\text{Overall equivalent length} = \text{Equivalent length to main pipe} \times 0.5 + \text{Equivalent length after branching}$$

(Example)

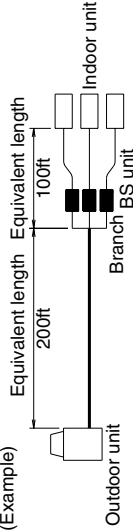

In the above case (Cooling)


$$\text{Overall equivalent length} = 200\text{ft} \times 0.5 + 100\text{ft} = 200\text{ft}$$

The correction factor in capacity when Hp = 0ft is thus approximately 0.88.


3D058628

REYQ192PTJU

1. Rate of change in cooling capacity

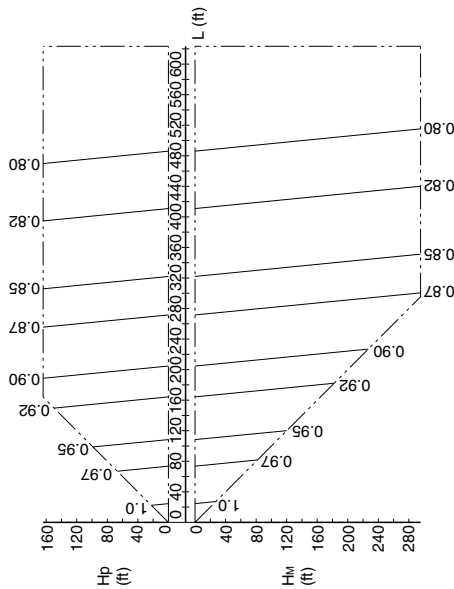

2. Rate of change in heating capacity

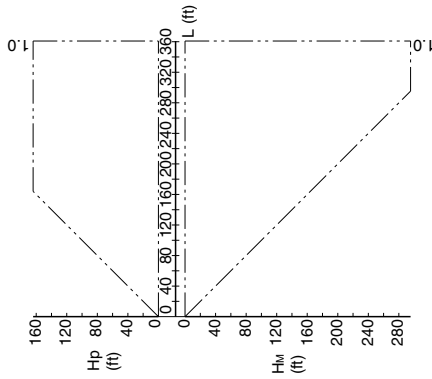

[Explanation of symbols]

- Hp : Level difference (ft) between indoor and outdoor units where indoor unit in inferior position
- H_M : Level difference (ft) between indoor and outdoor units where indoor unit in superior position
- L : Equivalent pipe length (ft)
- α : Capacity correction factor

[Diameter of pipe (standard size)]

Model	liquid
REYQ192PYDN	φ 5/8
REYQ192PTJU	φ 5/8

[Notes]

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
- Method of calculating A/C (cooling/heating) capacity:
The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.

Calculating A/C capacity of outdoor units

- Condition: Indoor unit combination ratio does not exceed 100%.

$$[\text{Maximum A/C capacity of outdoor units}] = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the 100\% combination}}{\text{Capacity change rate due to piping length to the farthest indoor unit}}$$

- Condition: Indoor unit combination ratio exceeds 100%.

$$[\text{Maximum A/C capacity of outdoor units}] = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the combination}}{\text{Capacity change rate due to piping length to the farthest indoor unit}}$$

- When overall equivalent pipe length is 295.3ft or more, the diameter of the main liquid pipes (outdoor unit-branch sections) must be increased. When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.


[Diameter of above case]

Model	liquid
REYQ192PYDN	φ 3/4
REYQ192PTJU	φ 3/4

- When the main sections of the interunit liquid pipe diameters are increased the overall equivalent length should be calculated as follows. (Heating only)

$$\text{Overall equivalent length} = \text{Equivalent length to main pipe} \times 0.4 + \text{Equivalent length after branching}$$

(Example)

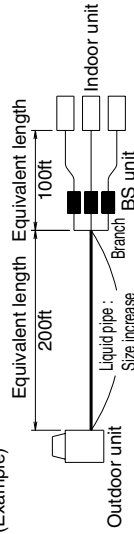

In the above case (Heating)


$$\text{Overall equivalent length} = 200\text{ft} \times 0.4 + 100\text{ft} = 180\text{ft}$$

The correction factor in capacity when Hp = 0ft is thus approximately 1.0.

- In the combination which does not include cooling only indoor unit, Calculate the equivalent length pipe by the following when you calculate cooling capacity.

$$\text{Overall equivalent length} = \text{Equivalent length to main pipe} \times 0.5 + \text{Equivalent length after branching}$$

(Example)

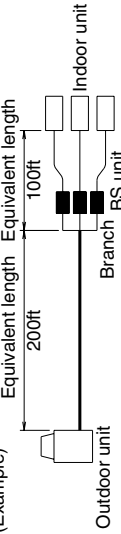

In the above case (Cooling)


$$\text{Overall equivalent length} = 200\text{ft} \times 0.5 + 100\text{ft} = 200\text{ft}$$

The correction factor in capacity when Hp = 0ft is thus approximately 0.88.


3D059674

REYQ216PTJU

1. Rate of change in cooling capacity

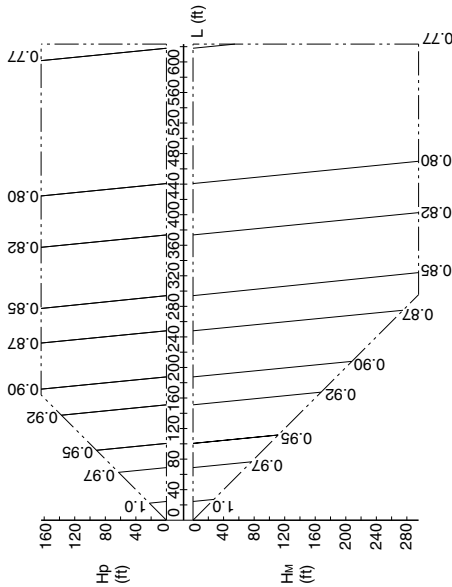

2. Rate of change in heating capacity

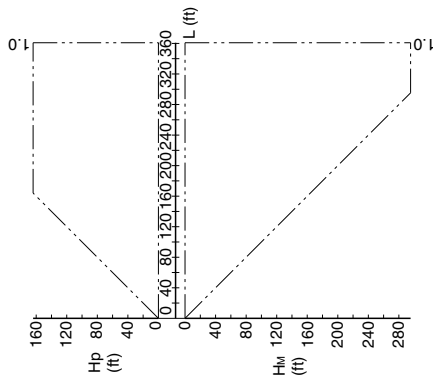

[Explanation of symbols]

Hp : Level difference (ft) between indoor and outdoor units where indoor unit in inferior position
 Hm : Level difference (ft) between indoor and outdoor units where indoor unit in superior position
 L : Equivalent pipe length (ft)
 α : Capacity correction factor

[Diameter of pipe (standard size)]

Model	liquid
REYQ72PYDN REYQ72PTJU	φ 3/8
REYQ216PYDN REYQ216PTJU	φ 5/8

[Notes]

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
- Method of calculating A/C (cooling/heating) capacity:
 The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.
 Calculating A/C capacity of outdoor units

• Condition: Indoor unit combination ratio does not exceed 100%.

[Maximum A/C capacity of outdoor units] = A/C capacity of outdoor units obtained from capacity characteristic table at the 100% combination

x Capacity change rate due to piping length to the farthest indoor unit

• Condition: Indoor unit combination ratio exceeds 100%.

[Maximum A/C capacity of outdoor units] = A/C capacity of outdoor units obtained from capacity characteristic table at the combination

x Capacity change rate due to piping length to the farthest indoor unit

- When overall equivalent pipe length is 295.3ft or more, the diameter of the main liquid pipes (outdoor unit-branch sections) must be increased.

When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.

[Diameter of above case]

Model	liquid
REYQ72PYDN REYQ72PTJU	φ 1/2
REYQ216PYDN REYQ216PTJU	φ 3/4


- When the main sections of the interunit liquid pipe diameters are increased the overall equivalent length should be calculated as follows. (Heating only)

Overall equivalent length = Equivalent length to main pipe x Correction factor + Equivalent length after branching

[Choose a correction factor from the following table]

Model	Correction factor
REYQ72PYDN REYQ72PTJU	0.2
REYQ216PYDN REYQ216PTJU	0.4

(Example) In case of REYQ216PYDN

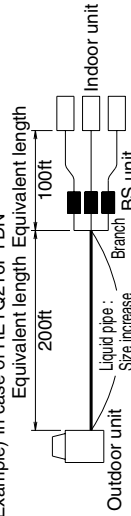

In the above case (Heating)


Overall equivalent length = 200ft x 0.4 + 100ft = 180ft

The correction factor in capacity when Hp = 0ft is thus approximately 1.0.

- In the combination which does not include cooling only indoor unit, Calculate the equivalent length pipe by the following when you calculate cooling capacity.

Overall equivalent length = Equivalent length to main pipe x 0.5 + Equivalent length after branching

(Example)

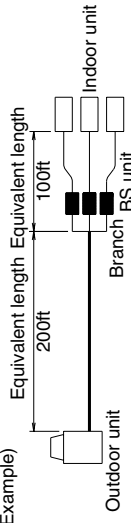

In the above case (Cooling)


Overall equivalent length = 200ft x 0.5 + 100ft = 200ft

The correction factor in capacity when Hp = 0m is thus approximately 0.86.


3D058626

REYQ240PTJU

1. Rate of change in cooling capacity

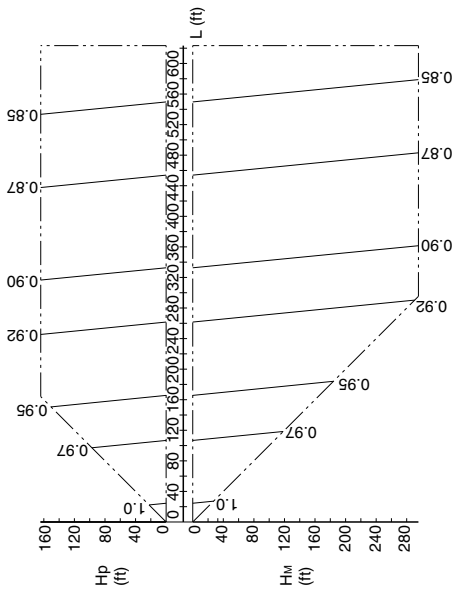

2. Rate of change in heating capacity

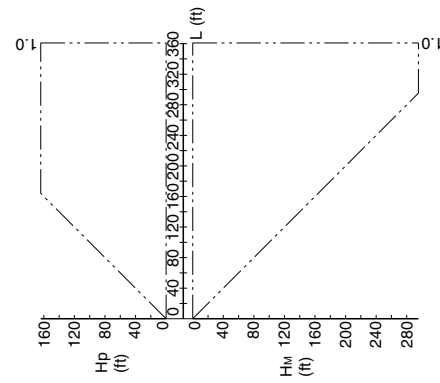

[Explanation of symbols]

- Hp : Level difference (ft) between indoor and outdoor units where indoor unit in inferior position
- Hm : Level difference (ft) between indoor and outdoor units where indoor unit in superior position
- L : Equivalent pipe length (ft)
- α : Capacity correction factor

[Diameter of pipe (standard size)]

Model	liquid
REYQ240PYDN	ϕ 5/8
REYQ240PTJU	ϕ 5/8

[Notes]

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
- Method of calculating A/C (cooling/heating) capacity:
The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.
Calculating A/C capacity of outdoor units

• Condition: Indoor unit combination ratio does not exceed 100%.

[Maximum A/C capacity of outdoor units] = A/C capacity of outdoor units obtained from capacity characteristic table at the 100% combination
 x [Capacity change rate due to piping length to the farthest indoor unit]

• Condition: Indoor unit combination ratio exceeds 100%.

[Maximum A/C capacity of outdoor units] = A/C capacity of outdoor units obtained from capacity characteristic table at the combination
 x [Capacity change rate due to piping length to the farthest indoor unit]


- When overall equivalent pipe length is 295.3ft or more, the diameter of the main liquid pipes (outdoor unit-branch sections) must be increased.
When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.
[Diameter of above case]

Model	liquid
REYQ240PYDN	ϕ 3/4
REYQ240PTJU	ϕ 3/4

- When the main sections of the interunit liquid pipe diameters are increased the overall equivalent length should be calculated as follows. (Heating only)

Overall equivalent length = Equivalent length to main pipe x 0.4 + Equivalent length after branching

(Example)

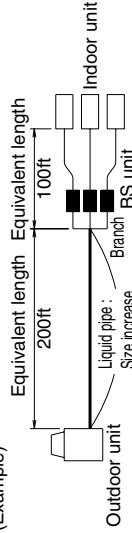

In the above case (Heating)


Overall equivalent length = 200ft x 0.4 + 100ft = 180ft

The correction factor in capacity when Hp = 0ft is thus approximately 1.0.

- In the combination which does not include cooling only indoor unit, Calculate the equivalent length pipe by the following when you calculate cooling capacity.

Overall equivalent length = Equivalent length to main pipe x 0.5 + Equivalent length after branching

(Example)



In the above case (Cooling)



Overall equivalent length = 200ft x 0.5 + 100ft = 200ft

The correction factor in capacity when Hp = 0ft is thus approximately 0.91.

3D059673

9. Operation Limits

REYQ72, 96, 120, 144, 168, 192, 216, 240PTJU

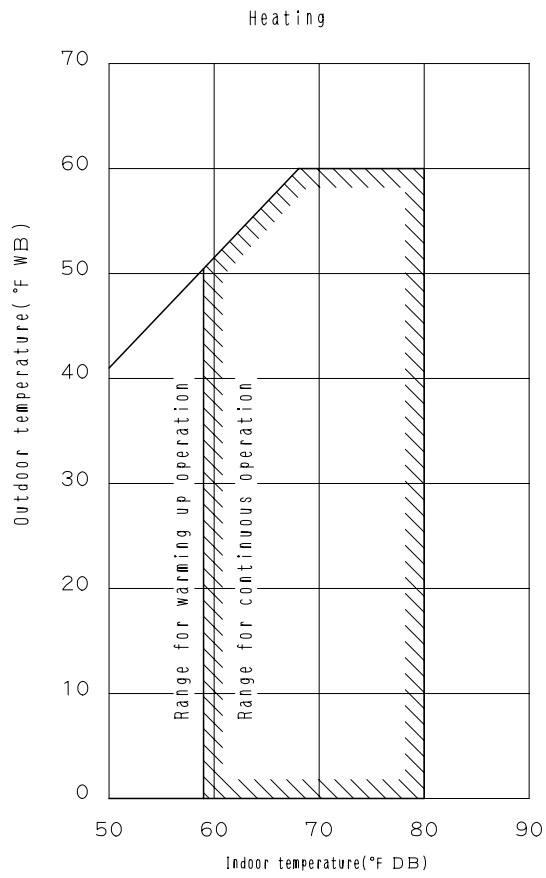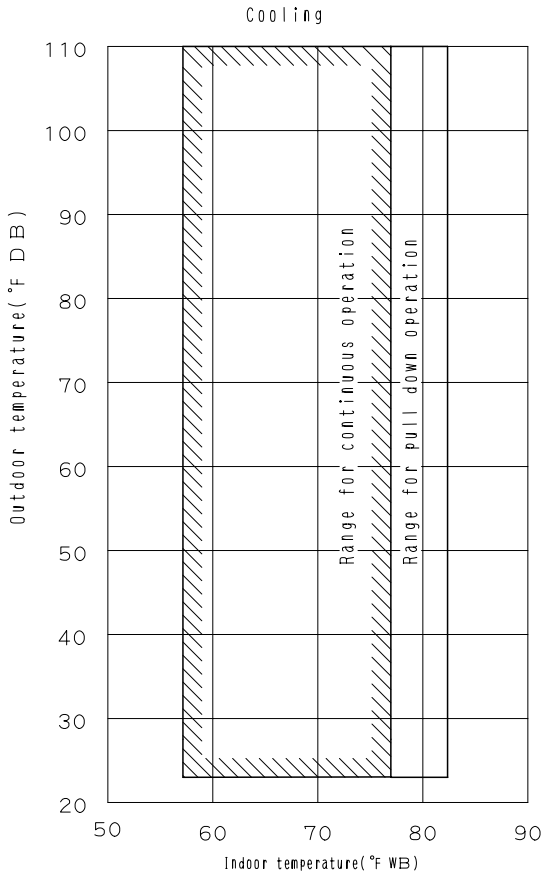

3D043026C

Notes:


- These figures assume the following operating conditions :
- Indoor and outdoor units :
- Equivalent pipe length : 25ft
- Level difference : 0ft

10. Sound Levels

Overall

Model	Power Supply	60Hz/208-230V
REYQ72PTJU		58
REYQ96PTJU		58
REYQ120PTJU		60
REYQ144PTJU		62
REYQ168PTJU		61
REYQ192PTJU		62
REYQ216PTJU		62
REYQ240PTJU		63

dBA

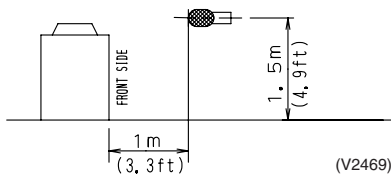

Note:


Sound level:

Anechoic chamber conversion value, measured at a point 3.3ft in front of the unit at a height of 4.9ft.


During actual operation, these values are normally somewhat higher as a result of ambient conditions.

Octave Band Level


REYQ72PTJU

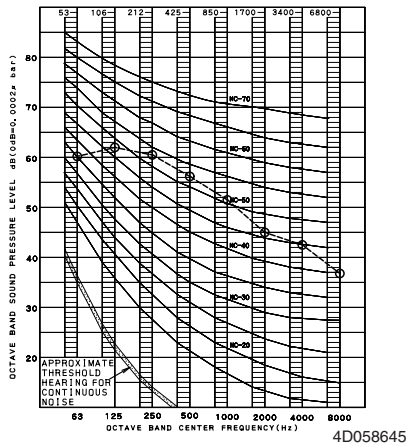


REYQ96PTJU

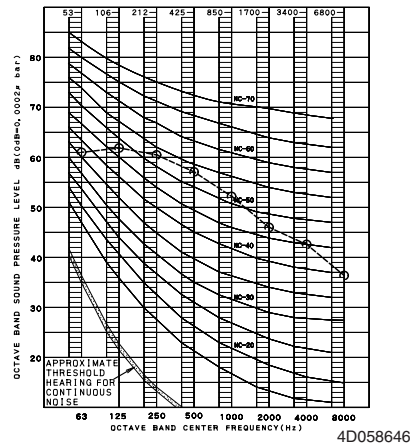

REYQ120PTJU

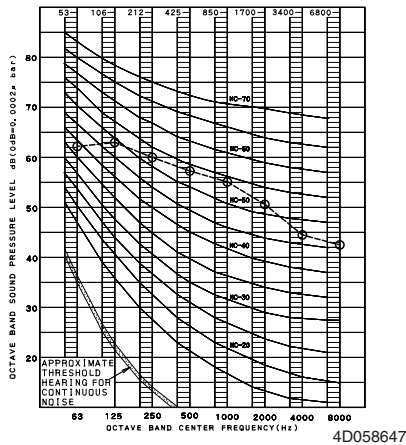

REYQ144PTJU

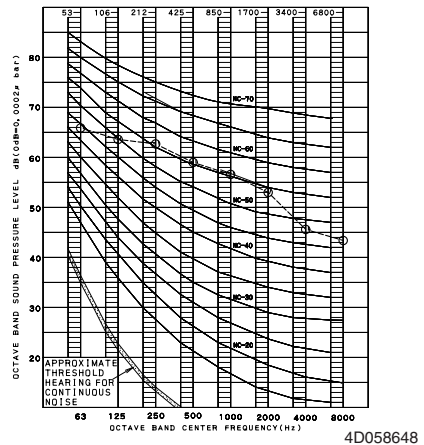

11. Accessories

Standard Accessories

REYQ72, 96, 120, 144PTJU

Name		Liquid side accessory pipe (1)	Liquid side accessory pipe (2)	Suction gas side accessory pipe (1)			Suction gas side accessory pipe (2)		
Quantity	72P type	1 pc.	1 pc.	1 pc.			1 pc.		
	96P type			1 pc.			1 pc.		
	120P/144P type				1 pc.		1 pc.		
Shape									
				φ7/8	φ7/8	φ1-1/8	φ3/4	φ7/8	φ1-1/8






Name		HP / LP gas side accessory pipe (1)			HP / LP gas side accessory pipe (2)			L type accessory joint (1)	L type accessory joint (2)	accessory joint (2)
Quantity	72P type	1 pc.			1 pc.			1 pc.	1 pc.	1 pc.
	96P type				1 pc.					1 pc.
	120P/144P type		1 pc.	1 pc.						
Shape										
		φ5/8	φ3/4	φ7/8	φ5/8	φ3/4	φ7/8	φ1	φ3/4	

REM72, 96, 120PTJU

Name	Clamp (1)	Clamp (2)	Clamp (3)	Vinyl tube
Quantity	8 pcs.	2 pcs.	1 pc.	4 pcs.
Shape				
	(Small)		(Large)	

Name	Conduit mounting plate		Manuals, etc.
Quantity	2 pcs.	2 pcs.	1 pc. about each item
Shape			<ul style="list-style-type: none"> • Operation manual • Installation manual • "REQUEST FOR THE INDICATON" label (Installation records)

Name		Liquid side accessory pipe (1)	Liquid side accessory pipe (2)	Suction gas side accessory pipe (1)		Suction gas side accessory pipe (2)		HP / LP gas side accessory pipe (1)		HP / LP gas side accessory pipe (2)
Quantity	72-96P type	1 pc.	1 pc.	1 pc.			1 pc.			2 pcs.
	120P type						1 pc.			1 pc.
Shape										
				φ7/8	φ1-1/8	φ7/8	φ1-1/8	φ3/4	φ7/8	φ7/8

Name		Equalizer side accessory pipe (1)	Equalizer side accessory pipe (2)	L type accessory joint (1)	L type accessory joint (2)
Quantity	72-96P type	1 pc.		1 pc.	2 pc.
	120P type				
Shape			 φ3/4	 φ1	 φ3/4

Optional Accessories (For Unit)

Series			VRV III			
Models			REYQ72PYDN REYQ72PTJU	REYQ96PYDN REYQ96PTJU REYQ120PYDN REYQ120PTJU REYQ144PTJU	REYQ144PYDN REYQ168PYDN REYQ168PTJU	REYQ192PYDN REYQ192PTJU REYQ216PYDN REYQ216PTJU REYQ240PYDN REYQ240PTJU
Optional accessories						
Distributive piping	Refnet header	Model	KHRP25M33H (Max. 8 branch)	KHRP25M33H (Max. 8 branch) KHRP25M72H (Max. 8 branch)		KHRP25M33H (Max. 8 branch) KHRP25M72H (Max. 8 branch) KHRP25M73HU (Max. 8 branch)
	Refnet joint	Model	KHRP25A22T KHRP25A33T	KHRP25A22T KHRP25A33T KHRP25M72TU		KHRP25A22T KHRP25A33T KHRP25M72TU KHRP25M73TU
Outdoor unit multi connection piping kit		Model	—		BHFP26P90U	

3D059681A

Warning



- Daikin Industries, Ltd.'s products are manufactured for export to numerous countries throughout the world. Daikin Industries, Ltd. does not have control over which products are exported to and used in a particular country. Prior to purchase, please therefore confirm with your local authorized importer, distributor and/or retailer whether this product conforms to the applicable standards, and is suitable for use, in the region where the product will be used. This statement does not purport to exclude, restrict or modify the application of any local legislation.
- Ask a qualified installer or contractor to install this product. Do not try to install the product yourself. Improper installation can result in water or refrigerant leakage, electrical shock, fire or explosion.
- Use only those parts and accessories supplied or specified by Daikin. Ask a qualified installer or contractor to install those parts and accessories. Use of unauthorized parts and accessories or improper installation of parts and accessories can result in water or refrigerant leakage, electrical shock, fire or explosion.
- Read the User's Manual carefully before using this product. The User's Manual provides important safety instructions and warnings. Be sure to follow these instructions and warnings.

If you have any inquiries, please contact your local importer, distributor and/or retailer.



© 2004 Daikin Industries, Limited.

Daikin®, Daikin AC™, Absolute Comfort™, VRV® and REFNET™ are trademarks pending or registered trademarks of Daikin Industries, Limited. All rights reserved. LowWorks® and LON® are registered trademarks of Echelon Corporation. BACnet® is a Data Communication Protocol for Building Automation and Control Networks, developed under the auspices of the American Society of Heating, Refrigerating and Air-Conditioning Engineers (ASHRAE).



JMI-0107



JQA-1452

About ISO9001

ISO 9001 is a plant certification system defined by the International Organization for Standardization (ISO) relating to quality assurance. ISO 9001 certification covers quality assurance aspects related to the "design, development, manufacture, installation, and supplementary service" of products manufactured at the plant.



EC99J2044



JQA-E-90108

About ISO 14001

ISO 14001 is the standard defined by the International Organization for Standardization (ISO) relating to environmental management systems. Our group has been acknowledged by an internationally accredited compliance organisation as having an appropriate programme of environmental protection procedures and activities to meet the requirements of ISO 14001.

Dealer

DAIKIN AC (AMERICAS), INC.

1645 Wallace Drive, Suite 110

Carrollton, TX75006

info@daikinac.com

www.daikinac.com

©All rights reserved

•Specifications, designs and other content appearing in this brochure are current as of July 2009 but subject to change without notice.

EDUS39-802-R2_a

Printed in U.S.A. 07/2009 K AK-FS