



*EDUS 391005 - R1*

**R-410A**

# Engineering Data



**RXYQ-PBYD**

**3 phase**

**460V, 60Hz**

**DAIKIN AC (AMERICAS), INC.**

# **RXYQ-PBYD Heat Pump 3 phase 460V, 60Hz**

1. Specifications .....	2
2. Dimensions .....	7
3. Service Space .....	14
4. Piping Diagrams.....	15
5. Wiring Diagrams.....	17
6. Field Wiring .....	19
7. Electric Characteristics.....	22
8. Capacity Tables (Reference Data).....	25
8.1 Cooling Capacity (RXYQ-PBYD).....	25
8.2 Heating Capacity (RXYQ-PBYD) .....	38
8.3 Capacity Correction Factor.....	51
9. Sound Levels (Reference) .....	57
9.1 Overall .....	57
9.2 Octave Band Level.....	57
10. Operation Limits .....	59
11. Accessories.....	60

# 1. Specifications

Model Name			RXYQ72PBYD	RXYQ96PBYD	RXYQ120PBYD
Power Supply			3 phase, 460V, 60Hz	3 phase, 460V, 60Hz	3 phase, 460V, 60Hz
★1 Cooling Capacity	Nominal	Btu / h	72,000	96,000	120,000
	Rated		69,000	92,000	114,000
★2 Heating Capacity	Nominal	Btu / h	81,000	108,000	135,000
	Rated		77,000	103,000	129,000
Casing Color			Ivory White (5Y7.5/1)	Ivory White (5Y7.5/1)	Ivory White (5Y7.5/1)
Dimensions: (H×W×D)		in. (mm)	66-1/8 × 36-5/8 × 30-1/8 (1680 × 930 × 765)	66-1/8 × 48-7/8 × 30-1/8 1680 × 1241 × 765	66-1/8 × 48-7/8 × 30-1/8 1680 × 1241 × 765
Heat Exchanger			Cross Fin Coil	Cross Fin Coil	Cross Fin Coil
Comp.	Type		Hermetically Sealed Scroll Type	Hermetically Sealed Scroll Type	Hermetically Sealed Scroll Type
	Displacement	m <sup>3</sup> /h	16.90	10.53+13.34	10.53+13.34
	Number of Revolutions	r/min	7980	2900, 6300	2900, 6300
	Motor Output×Number of Units	kW	4.7 × 1	(2.2+4.5) × 1	(3.5+4.5) × 1
	Starting Method		Soft Start	Soft Start	Soft Start
Fan	Type		Propellor Fan	Propellor Fan	Propellor Fan
	Motor Output	kW	0.75 × 1	0.35 × 2	0.35 × 2
	Airflow Rate	cfm	6,350	8,230	8,230
	Drive		Direct Drive	Direct Drive	Direct Drive
Connecting Pipes	Liquid Pipe	in. (mm)	φ 3/8 (9.5) C1220T (Brazing Connection)	φ 3/8 (9.5) C1220T (Brazing Connection)	φ 1/2 (12.7) C1220T (Brazing Connection)
	Gas Pipe	in. (mm)	φ 3/4 (19.1) C1220T (Brazing Connection)	φ 7/8 (22.2) C1220T (Brazing Connection)	φ 1-1/8 (28.6) C1220T (Brazing Connection)
Mass	Lbs (kg)	433 (196)	633 (287)	633 (287)	
★3 Sound Level (Reference Value)	dBA	57	60	60	
Safety Devices			High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector	High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector	High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector
Defrost Method			Deicer	Deicer	Deicer
Capacity Control		%	20~100	14~100	14~100
Refrigerant	Refrigerant Name		R-410A	R-410A	R-410A
	Charge	Lbs (kg)	16.5 (7.5)	21.4 (9.7)	22.1 (10)
	Control		Electronic Expansion Valve	Electronic Expansion Valve	Electronic Expansion Valve
Standard Accessories			Installation Manual, Operation Manual, Connection Pipes, Clamps	Installation Manual, Operation Manual, Connection Pipes, Clamps	Installation Manual, Operation Manual, Connection Pipes, Clamps
Drawing No.			C: 4D070504	C: 4D070505	C: 4D070506

## Notes:

- ★1 Indoor temp. : 80°FDB (27°CDB), 67°FWB(19.4°CWB) / outdoor temp. : 95°FDB (35°CDB) / Equivalent piping length : 25ft (7.5 m), level difference : 0 ft.
- ★2 Indoor temp. : 70°FDB (21°CDB) / outdoor temp. : 47°FDB, 43°FWB ( 8.3° CDB, 6° CWB) / Equivalent piping length : 25ft (7.5 m), difference : 0 ft.
- ★3 Anechoic chamber conversion value, measure under JISB8616 conditions. During actual operation, these values are normally somewhat higher as a result of ambient conditions.

Model Name (Combination Unit)			RXYQ144PBYD	RXYQ168PBYD	RXYQ192PBYD
Model Name (Independent Unit)			RXYQ72PBYD RXYQ72PBYD	RXYQ72PBYD RXYQ96PBYD	RXYQ72PBYD RXYQ120PBYD
Power Supply			3 phase, 460V, 60Hz	3 phase, 460V, 60Hz	3 phase, 460V, 60Hz
★1 Cooling Capacity	Nominal	Btu / h	144,000	168,000	192,000
	Rated		138,000	160,000	184,000
★2 Heating Capacity	Nominal	Btu / h	162,000	188,000	216,000
	Rated		154,000	180,000	206,000
Casing Color			Ivory White (5Y7.5/1)	Ivory White (5Y7.5/1)	Ivory White (5Y7.5/1)
Dimensions: (HxWxD)		in. (mm)	66-1/8 x 36-5/8 x 30-1/8 + 66-1/8 x 36-5/8 x 30-1/8 (1680 x 930 x 765 + 1680 x 930 x 765)	66-1/8 x 36-5/8 x 30-1/8 + 66-1/8 x 48-7/8 x 30-1/8 (1680 x 930 x 765 + 1680 x 1241 x 765)	66-1/8 x 36-5/8 x 30-1/8 + 66-1/8 x 48-7/8 x 30-1/8 (1680 x 930 x 765 + 1680 x 1241 x 765)
Heat Exchanger			Cross Fin Coil	Cross Fin Coil	Cross Fin Coil
Comp.	Type		Hermetically Sealed Scroll Type	Hermetically Sealed Scroll Type	Hermetically Sealed Scroll Type
	Displacement	m <sup>3</sup> /h	(16.90) x 2	16.90 + (10.53+13.34)	16.90 + (10.53+13.34)
	Number of Revolutions	r/min	(7980) x 2	7980, (2900, 6300)	7980, (2900, 6300)
	Motor OutputxNumber of Units	kW	(4.7) x 2	(4.7) x 1 + (2.2+4.5) x 1	(4.7) x 1 + (3.5+4.5) x 1
Starting Method			Soft Start	Soft Start	Soft Start
Fan	Type		Propellor Fan	Propellor Fan	Propellor Fan
	Motor Output	kW	(0.75) x 1 + (0.75) x 1	(0.75) x 1 + (0.35) x 2	(0.75) x 1 + (0.35) x 2
	Airflow Rate	cfm	6,350+6,350	6,350+8,230	6,350+8,230
	Drive		Direct Drive	Direct Drive	Direct Drive
Connecting Pipes	Liquid Pipe	in. (mm)	φ1/2 (12.7) C1220T (Brazing Connection)	φ5/8 (15.8) C1220T (Brazing Connection)	φ5/8 (15.8) C1220T (Brazing Connection)
	Gas Pipe	in. (mm)	φ1-1/8 (28.6) C1220T (Brazing Connection)	φ1-1/8 (28.6) C1220T (Brazing Connection)	φ1-1/8 (28.6) C1220T (Brazing Connection)
Mass		Lbs (kg)	433 + 433 (196.4 + 196.4)	433 + 633 (196.4 + 287)	433 + 633 (196.4 + 287)
★3 Sound Level (Reference Value)		dBA	60	62	62
Safety Devices			High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector	High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector	High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector
Defrost Method			Deicer	Deicer	Deicer
Capacity Control		%	10~100	9~100	8~100
Refrigerant	Refrigerant Name		R-410A	R-410A	R-410A
	Charge	Lbs (kg)	16.5+16.5 (7.5 + 7.5)	16.5+21.4 (7.5 + 9.7)	16.5 + 22.1 (7.5 + 10)
	Control		Electronic Expansion Valve	Electronic Expansion Valve	Electronic Expansion Valve
Standard Accessories			Installation Manual, Operation Manual, Connection Pipes, Clamps	Installation Manual, Operation Manual, Connection Pipes, Clamps	Installation Manual, Operation Manual, Connection Pipes, Clamps
Drawing No.			C: 4D070909	C: 4D070910	C: 4D070911

**Notes:**

- ★1 Indoor temp. : 80°FDB(27°CDB), 67°FWB(19.4°CWB) / outdoor temp. : 95°FDB (35°CDB) / Equivalent piping length : 25ft (7.5 m), level difference : 0 ft.
- ★2 Indoor temp. : 70°FDB(21°CDB) / outdoor temp. : 47°FDB, 43°FWB ( 8.3° CDB, 6° CWB) / Equivalent piping length : 25ft (7.5 m), difference : 0 ft.
- ★3 Anechoic chamber conversion value, measure under JISB8616 conditions. During actual operation, these values are normally somewhat higher as a result of ambient conditions.

Model Name (Combination Unit)			RXYQ216PBYD	RXYQ240PBYD	RXYQ264PBYD
Model Name (Independent Unit)			RXYQ96PBYD RXYQ120PBYD	RXYQ120PBYD RXYQ120PBYD	RXYQ72PBYD RXYQ96PBYD RXYQ96PBYD
Power Supply			3 phase, 460V, 60Hz	3 phase, 460V, 60Hz	3 phase, 460V, 60Hz
★1 Cooling Capacity	Nominal	Btu / h	216,000	240,000	264,000
	Rated		206,000	228,000	251,000
★2 Heating Capacity	Nominal	Btu / h	243,000	270,000	297,000
	Rated		231,000	257,000	283,000
Casing Color			Ivory White (5Y7.5/1)	Ivory White (5Y7.5/1)	Ivory White (5Y7.5/1)
Dimensions: (HxWxD)		in. (mm)	66-1/8 x 48-7/8 x 30-1/8 + 66-1/8 x 48-7/8 x 30-1/8 (1680 x 1241 x 765 + 1680 x 1241 x 765)	66-1/8 x 48-7/8 x 30-1/8 + 66-1/8 x 48-7/8 x 30-1/8 (1680 x 1241 x 765 + 1680 x 1241 x 765)	66-1/8 x 36-5/8 x 30-1/8 + 66-1/8 x 48-7/8 x 30-1/8 + 66-1/8 x 48-7/8 x 30-1/8 (1680 x 930 x 765 +1680 x 1241 x 765 + 1680 x 1241 x 765)
Heat Exchanger			Cross Fin Coil	Cross Fin Coil	Cross Fin Coil
Comp.	Type		Hermetically Sealed Scroll Type	Hermetically Sealed Scroll Type	Hermetically Sealed Scroll Type
	Displacement	m <sup>3</sup> /h	(10.53+13.34) × 2	(10.53+13.34) × 2	16.90 + (10.53+13.34) × 2
	Number of Revolutions	r/min	(2900, 6300) × 2	(2900, 6300) × 2	7980, (2900, 6300) × 2
	Motor Output×Number of Units	kW	(2.2+4.5) × 1 + (3.5+4.5) × 1	(3.5+4.5) × 2	(4.7) × 1 + (2.2+4.5) × 2
Starting Method			Soft Start	Soft Start	Soft Start
Fan	Type		Propellor Fan	Propellor Fan	Propellor Fan
	Motor Output	kW	(0.35) × 2 + (0.35) × 2	(0.35) × 2 + (0.35) × 2	(0.75) × 1 + (0.35) × 2 + (0.35) × 2
	Airflow Rate	cfm	8,230+8,230	8,230+8,230	6,350+8,230+8,230
	Drive			Direct Drive	Direct Drive
Connecting Pipes	Liquid Pipe	in. (mm)	φ5/8 (15.8) C1220T (Brazing Connection)	φ5/8 (15.8) C1220T (Brazing Connection)	φ3/4 (19.1)C1220T (Brazing Connection)
	Gas Pipe	in. (mm)	φ1-1/8 (28.6) C1220T (Brazing Connection)	φ1-3/8 (35) C1220T (Brazing Connection)	φ1-3/8 (35) C1220T (Brazing Connection)
Mass		Lbs (kg)	633 + 633 (287 + 287)	633 + 633 (287 + 287)	433 + 633 + 633 (196 + 287 + 287)
★3 Sound Level (Reference Value)		dBA	63	63	64
Safety Devices			High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector	High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector	High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector
Defrost Method			Deicer	Deicer	Deicer
Capacity Control		%	7~100	7~100	6~100
Refrigerant	Refrigerant Name		R-410A	R-410A	R-410A
	Charge	Lbs (kg)	21.4 + 22.1 (9.7 + 10)	22.1 + 22.1 (10 + 10)	16.5+21.4+21.4 (7.5 + 9.7 + 9.7)
	Control		Electronic Expansion Valve	Electronic Expansion Valve	Electronic Expansion Valve
Standard Accessories			Installation Manual, Operation Manual, Connection Pipes, Clamps	Installation Manual, Operation Manual, Connection Pipes, Clamps	Installation Manual, Operation Manual, Connection Pipes, Clamps
Drawing No.			C: 4D070912	C: 4D070913	C: 4D070914

**Notes:**

- ★1 Indoor temp. : 80°FDB(27°CDB), 67°FWB(19.4°CWB) / outdoor temp. : 95°FDB (35°CDB) / Equivalent piping length : 25ft (7.5 m), level difference : 0 ft.
- ★2 Indoor temp. : 70°FDB(21°CDB) / outdoor temp. : 47°FDB, 43°FWB ( 8.3° CDB, 6° CWB) / Equivalent piping length : 25ft (7.5 m), difference : 0 ft.
- ★3 Anechoic chamber conversion value, measure under JISB8616 conditions. During actual operation, these values are normally somewhat higher as a result of ambient conditions.

Model Name (Combination Unit)			RXYQ288PBYD	RXYQ312PBYD	RXYQ336PBYD
Model Name (Independent Unit)			RXYQ72PBYD RXYQ96PBYD RXYQ120PBYD	RXYQ72PBYD RXYQ120PBYD RXYQ120PBYD	RXYQ96PBYD RXYQ120PBYD RXYQ120PBYD
Power Supply			3 phase, 460V, 60Hz	3 phase, 460V, 60Hz	3 phase, 460V, 60Hz
★1 Cooling Capacity	Nominal	Btu / h	288,000	312,000	336,000
	Rated		274,000	297,000	320,000
★2 Heating Capacity	Nominal	Btu / h	324,000	351,000	378,000
	Rated		308,000	334,000	360,000
Casing Color			Ivory White (5Y7.5/1)	Ivory White (5Y7.5/1)	Ivory White (5Y7.5/1)
Dimensions: (HxWxD)		in. (mm)	66-1/8 × 36-5/8 × 30-1/8 + 66-1/8 × 48-7/8 × 30-1/8 + 66-1/8 × 48-7/8 × 30-1/8 (1680 × 930 × 765 + 1680 × 1241 × 765 + 1680 × 1241 × 765)	66-1/8 × 36-5/8 × 30-1/8 + 66-1/8 × 48-7/8 × 30-1/8 + 66-1/8 × 48-7/8 × 30-1/8 (1680 × 930 × 765 + 1680 × 1241 × 765 + 1680 × 1241 × 765)	66-1/8 × 48-7/8 × 30-1/8 + 66-1/8 × 48-7/8 × 30-1/8 + 66-1/8 × 48-7/8 × 30-1/8 (1680 × 1241 × 765 + 1680 × 1241 × 765 + 1680 × 1241 × 765)
Heat Exchanger			Cross Fin Coil	Cross Fin Coil	Cross Fin Coil
Comp.	Type		Hermetically Sealed Scroll Type	Hermetically Sealed Scroll Type	Hermetically Sealed Scroll Type
	Displacement	m <sup>3</sup> /h	16.90 + (10.53+13.34) × 2	16.90 + (10.53+13.34) × 2	(10.53+13.34) × 3
	Number of Revolutions	r/min	7980, (2900, 6300) × 2	7980, (2900, 6300) × 2	(2900, 6300) × 3
	Motor Output×Number of Units	kW	(4.7) × 1 + (2.2+4.5) × 1 + (3.5+4.5) × 1	(4.7) × 1 + (3.5+4.5) × 2	(2.2+4.5) × 1 + (3.5+4.5) × 2
Starting Method			Soft Start	Soft Start	Soft Start
Fan	Type		Propellor Fan	Propellor Fan	Propellor Fan
	Motor Output	kW	(0.75) × 1 + (0.35) × 2 + (0.35) × 2	(0.75) × 1 + (0.35) × 2 + (0.35) × 2	(0.35) × 2 + (0.35) × 2 + (0.35) × 2
	Airflow Rate	cfm	6,350+8,230+8,230	6,350+8,230+8,230	8,230+8,230+8,230
	Drive			Direct Drive	Direct Drive
Connecting Pipes	Liquid Pipe	in. (mm)	φ3/4 (19.1) C1220T (Brazing Connection)	φ3/4 (19.1) C1220T (Brazing Connection)	φ3/4 (19.1) C1220T (Brazing Connection)
	Gas Pipe	in. (mm)	φ1-3/8 (35) C1220T (Brazing Connection)	φ1-3/8 (35) C1220T (Brazing Connection)	φ1-3/8 (35) C1220T (Brazing Connection)
Mass		Lbs (kg)	433 + 633 + 633 (196 + 28 7+ 287)	433 + 633 + 633 (196 + 28 7+ 287)	633 + 633+ 633 (196 + 28 7+ 287)
★3 Sound Level (Reference Value)		dBA	64	64	65
Safety Devices			High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector	High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector	High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector
Defrost Method			Deicer	Deicer	Deicer
Capacity Control		%	5~100	5~100	4~100
Refrigerant	Refrigerant Name		R-410A	R-410A	R-410A
	Charge	Lbs (kg)	16.5 + 21.4 + 22.1 (7.5 + 9.7 + 10)	16.5 + 22.1 + 22.1 (7.5 + 10 + 10)	21.4 + 22.1 + 22.1 (9.7 + 10 + 10)
	Control		Electronic Expansion Valve	Electronic Expansion Valve	Electronic Expansion Valve
Standard Accessories			Installation Manual, Operation Manual, Connection Pipes, Clamps	Installation Manual, Operation Manual, Connection Pipes, Clamps	Installation Manual, Operation Manual, Connection Pipes, Clamps
Drawing No.			C: 4D070915	C: 4D070916	C: 4D070917

**Notes:**

- ★1 Indoor temp. : 80°FDB(27°CDB), 67°FWB(19.4°CWB) / outdoor temp. : 95°FDB (35°CDB) / Equivalent piping length : 25ft (7.5 m), level difference : 0 ft.
- ★2 Indoor temp. : 70°FDB(21°CDB) / outdoor temp. : 47°FDB, 43°FWB ( 8.3°CDB, 6°CWB) / Equivalent piping length : 25ft (7.5 m), difference : 0 ft.
- ★3 Anechoic chamber conversion value, measure under JISB8616 conditions. During actual operation, these values are normally somewhat higher as a result of ambient conditions.


Model Name (Combination Unit)		RXYQ360PBYD	
Model Name (Independent Unit)		RXYQ120PBYD RXYQ120PBYD RXYQ120PBYD	
Power Supply		3 phase, 460V, 60Hz	
★1 Cooling Capacity	Nominal	Btu / h	360,000
	Rated		342,000
★2 Heating Capacity	Nominal	Btu / h	405,000
	Rated		385,000
Casing Color		Ivory White (5Y7.5/1)	
Dimensions: (HxWxD)		in. (mm)	66-1/8 x 48-7/8 x 30-1/8 + 66-1/8 x 48-7/8 x 30-1/8 + 66-1/8 x 48-7/8 x 30-1/8 (1680 x 1241 x 765 + 1680 x 1241 x 765 + 1680 x 1241 x 765)
Heat Exchanger		Cross Fin Coil	
Comp.	Type	Hermetically Sealed Scroll Type	
	Displacement	m <sup>3</sup> /h	(10.53+13.34) x 3
	Number of Revolutions	r/min	(2900, 6300) x 3
	Motor Output×Number of Units	kW	(3.5+4.5) x 3
	Starting Method	Soft Start	
Fan	Type	Propellor Fan	
	Motor Output	kW	(0.35) x 2 + (0.35) x 2 + (0.35) x 2
	Airflow Rate	cfm	8,230+8,230+8,230
	Drive	Direct Drive	
Connecting Pipes	Liquid Pipe	in. (mm)	φ3/4 (19.1) C1220T (Brazing Connection)
	Gas Pipe	in. (mm)	φ1-5/8 (41.3) C1220T (Brazing Connection)
Mass	Lbs (kg)	633 + 633 + 633 (287 + 287 + 287)	
★3 Sound Level (Reference Value)	dBA	65	
Safety Devices		High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector	
Defrost Method		Deicer	
Capacity Control		%	5-100
Refrigerant	Refrigerant Name	R-410A	
	Charge	Lbs (kg)	22.1+22.1+22.1 (10 + 10 + 10)
	Control	Electronic Expansion Valve	
Standard Accessories		Installation Manual, Operation Manual, Connection Pipes, Clamps	
Drawing No.		C: 4D070918	

**Notes:**

- ★1 Indoor temp. : 80°FDB(27°CDB), 67°FWB(19.4°CWB) / outdoor temp. : 95°FDB (35°CDB) / Equivalent piping length : 25ft (7.5 m), level difference : 0 ft.
- ★2 Indoor temp. : 70°FDB(21°CDB) / outdoor temp. : 47°FDB, 43°FWB ( 8.3° CDB, 6° CWB) / Equivalent piping length : 25ft (7.5 m), difference : 0 ft.
- ★3 Anechoic chamber conversion value, measure under JISB8616 conditions. During actual operation, these values are normally somewhat higher as a result of ambient conditions.

# 2. Dimensions

## RXYQ72PBYD

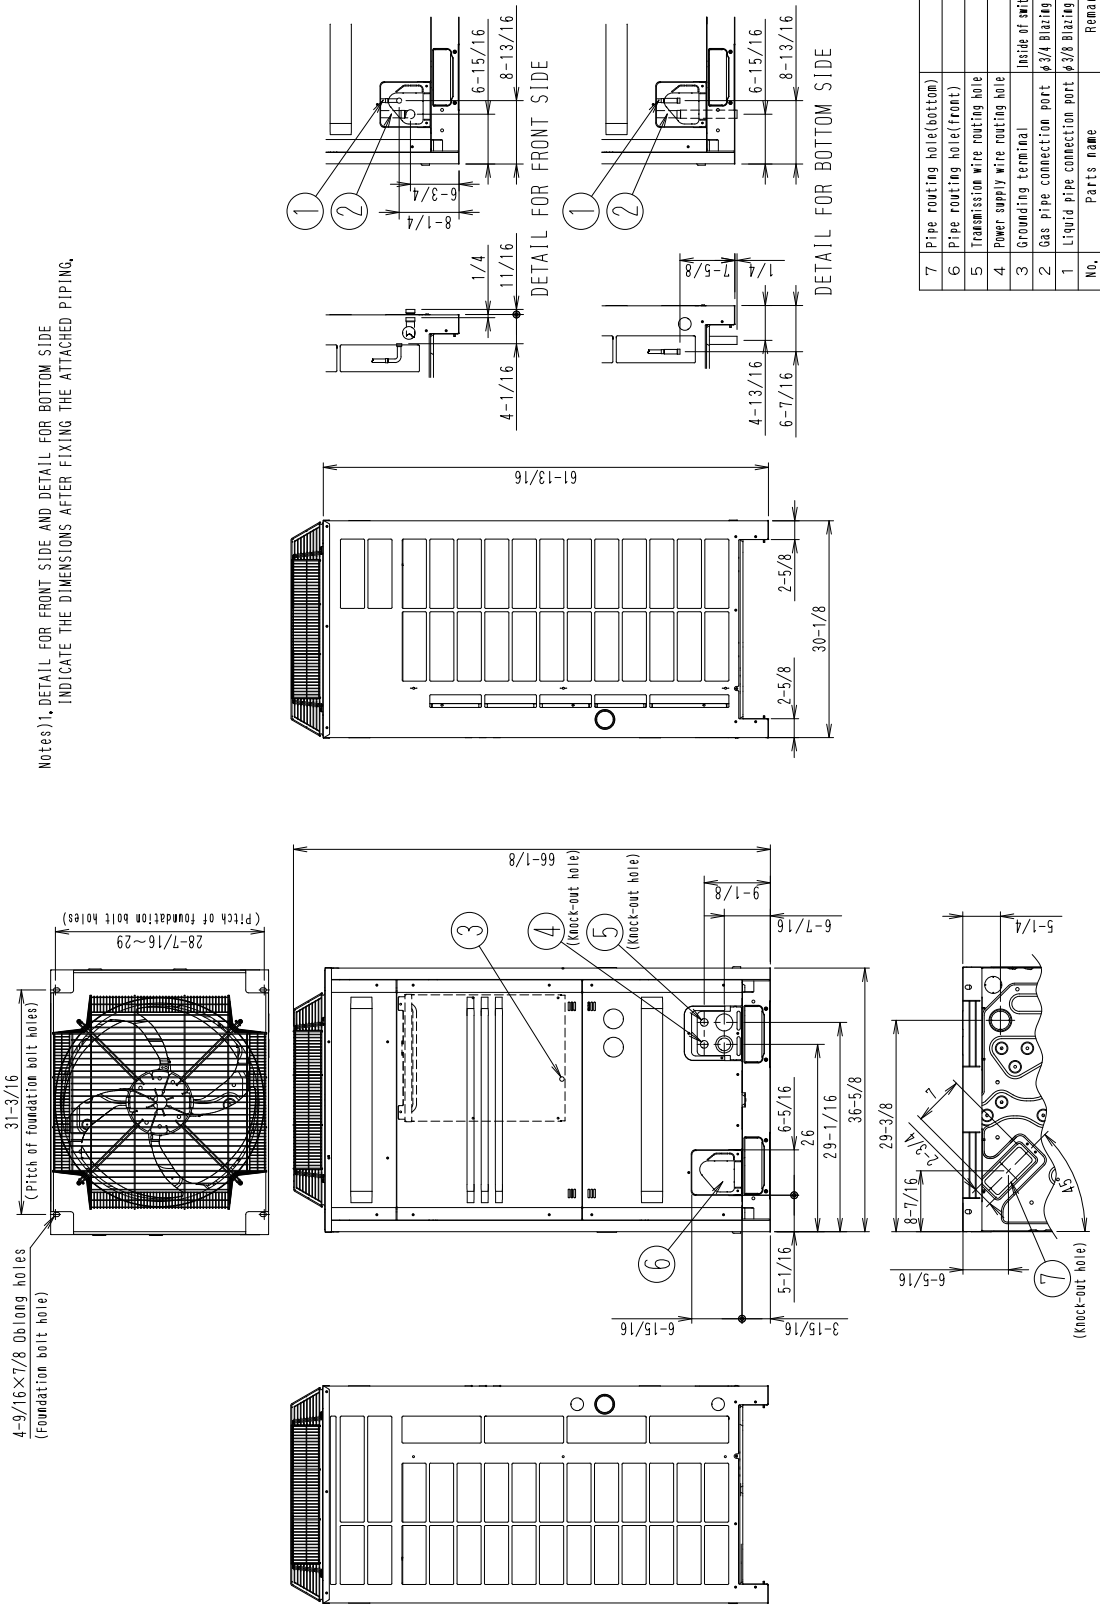


3D070517





RXYQ96PBYD / RXYQ120PBYD

MODEL	AA	BB
RXYQ96PBYD	4-1/16	7-11/16
RXYQ120PBYD	3-1/4	6-7/8


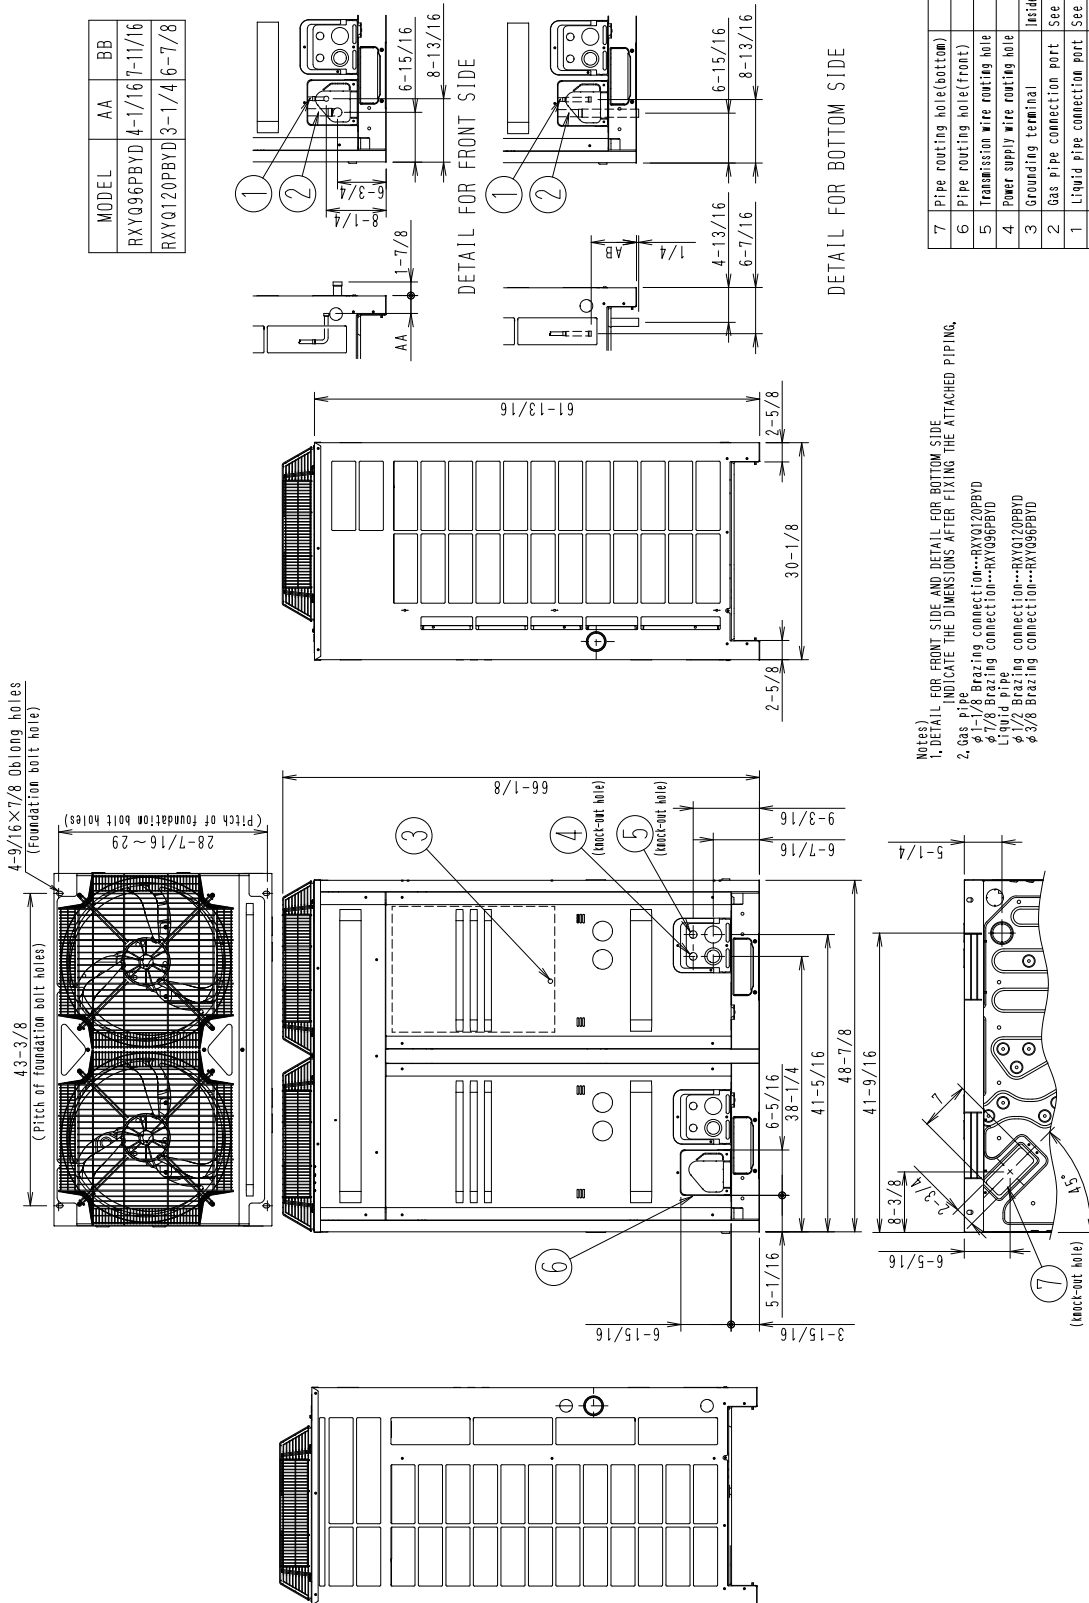


C: 3D070518A

RXYQ144PBYD

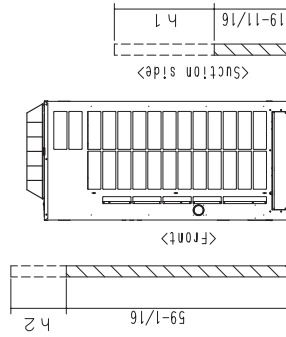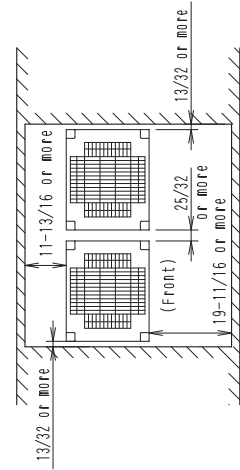


Model Name	Outdoor Unit 1	Outdoor Unit 2	Drawing No.
RXYQ144PBYD	RXYQ72PBYD	RXYQ72PBYD	3D070517

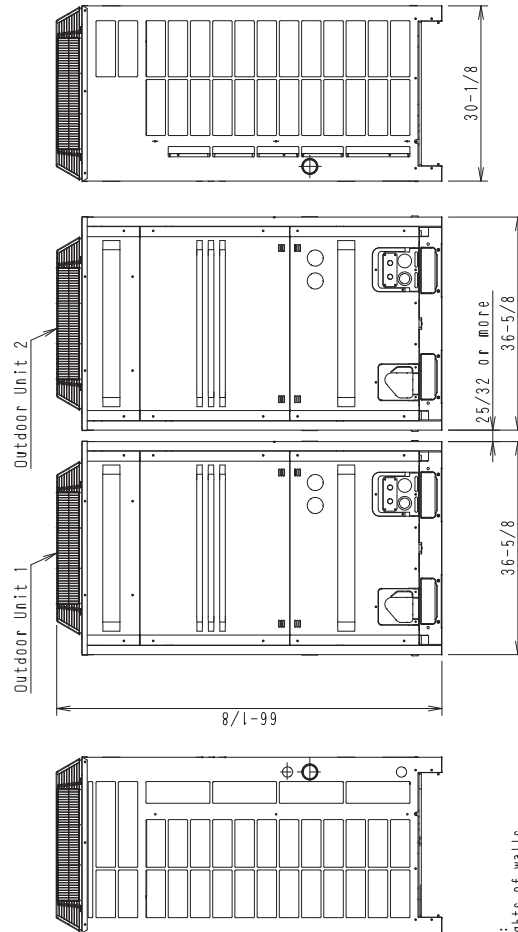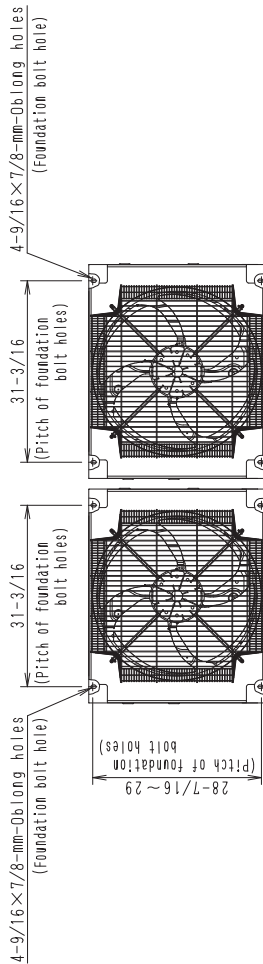

- Notes :
1. Heights of walls  
 Front : 59-1/16in  
 Suction side : 19-11/16in  
 Side : Height unrestricted  
 The installation space shown in this figure is based on the condition of cooling operation at the outdoor air temperature of 95°F.  
 The installation space of suction side shown above must be expanded in the following case.  
 • Design outdoor temperature becomes over 95°F.  
 • Operating over Max. operating load (in case of causing a heavy heating load at indoor unit side)
  2. If the above wall heights are exceeded then h2/2 and h1/2 should be added to the front and suction side service spaces respectively as shown in the following figure
  3. When installing the units the most appropriate pattern should be selected from Section 3. in order to obtain the best fit in the space available always bearing in mind the need to leave enough room for a person to pass between units and wall and for the air to circulate freely.
- NOTE: If more units are to be installed than are shown in Section 3, your layout should take account of the possibility of short circuiting.  
 4. The units should be installed to leave sufficient space at the front for the on site refrigerant piping work to be carried out comfortably.

C: 3D070788

RXYQ168PBYD / RXYQ192PBYD

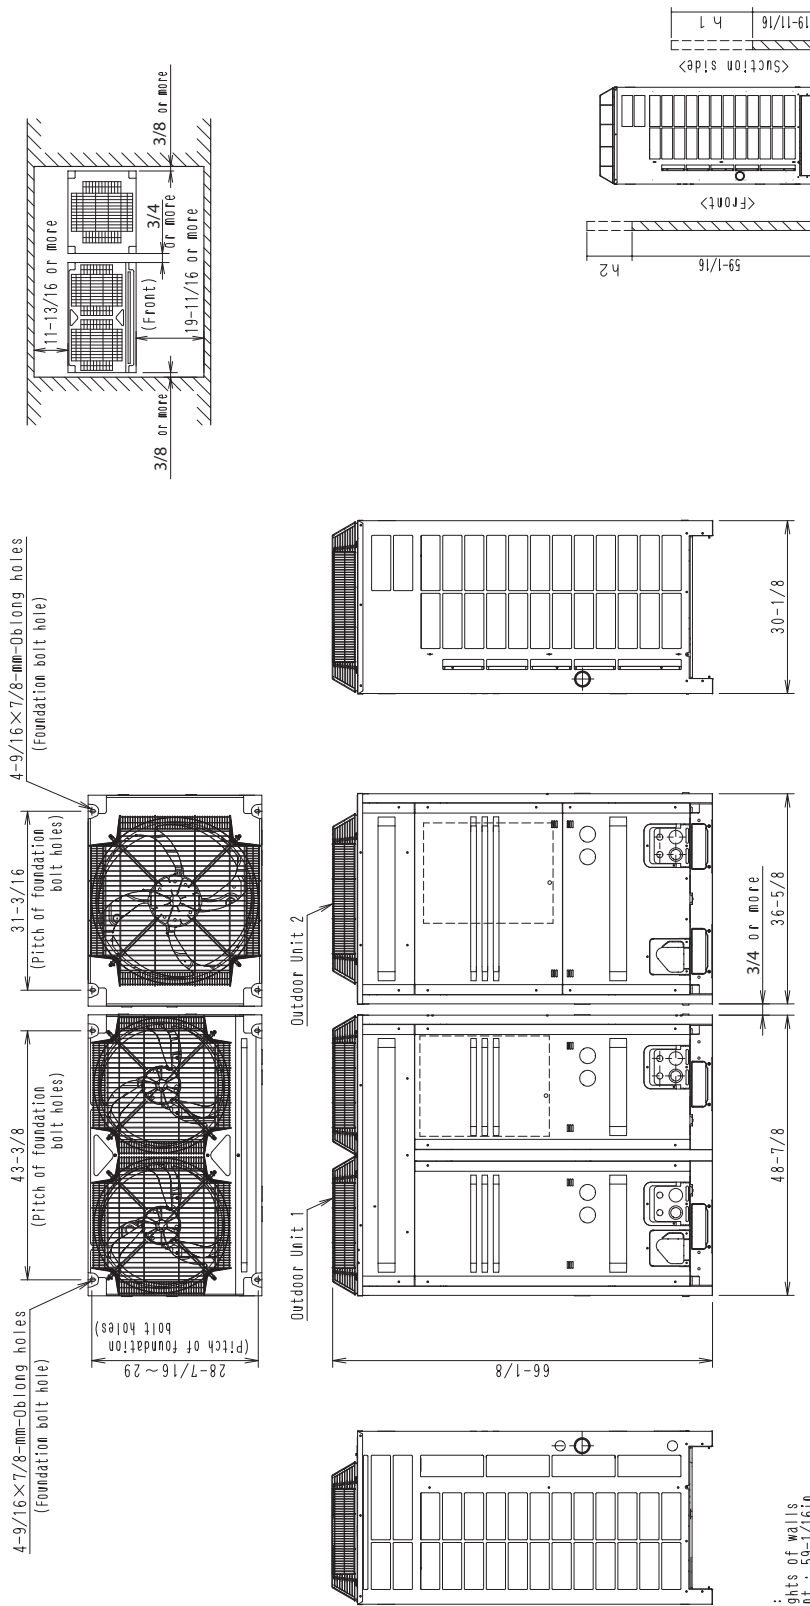


Notes :

- Heights of walls:  
Front : 59-1/16in  
Suction Side : 19-11/16in  
Side : Height unrestricted  
The installation space shown in this figure is based on the condition of cooling operation at the outdoor air temperature of 95°F.  
The installation space of suction side shown above must be expanded in the following case.  
• Design outdoor temperature becomes over 95°F.  
• Operating over Max. operating load (in case of causing a heavy heating load at indoor unit side)  
2. If the above wall heights are exceeded then h2/2 and h1/2 should be added to the front and suction side service spaces respectively as shown in the following figure.  
3. When installing the units the most appropriate pattern should be selected from Section 3. In order to obtain the best fit, in the space available always bearing in mind the need to leave enough room for a person to pass between units and wall and for the air to circulate freely.  
NOTE: If more units are to be installed than are shown in Section 3, your layout should take account of the possibility of short circuiting.  
4. The units should be installed to leave sufficient space at the front for the on site refrigerant piping work to be carried out comfortably.

C: 3D070851

RXYQ216PBYD / RXYQ240PBYD

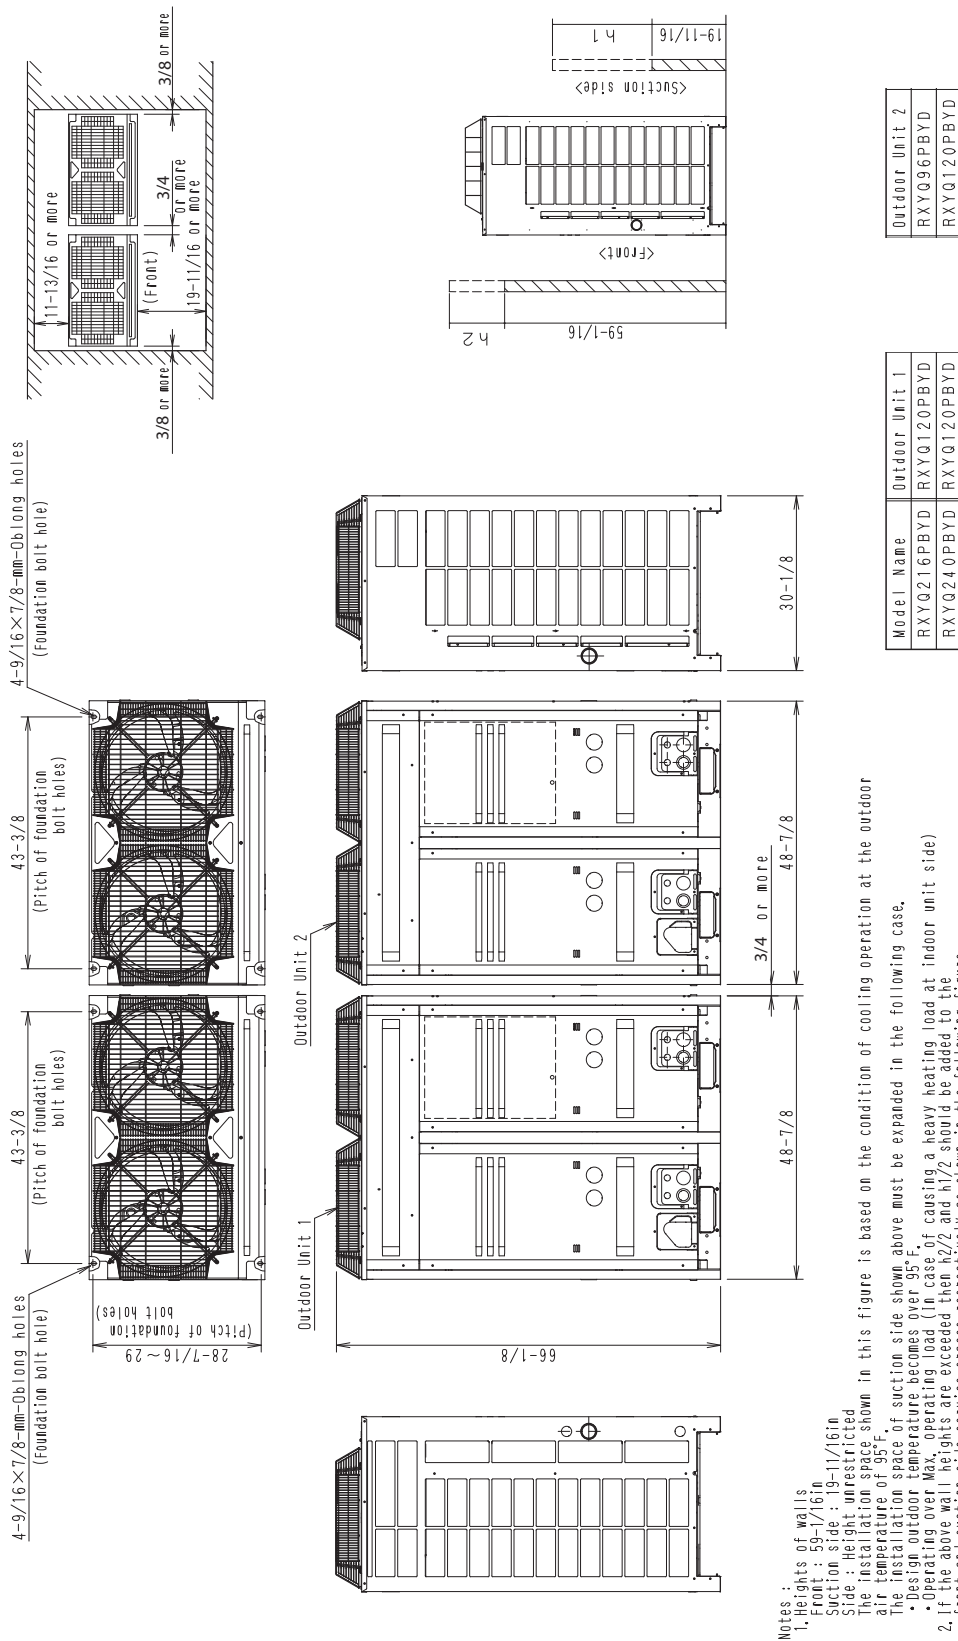


Notes :

1. Heights of walls  
 Front : 59-1/16in  
 Suction side : 19-11/16in  
 Side : Height unrestricted  
 The installation space shown in this figure is based on the condition of cooling operation at the outdoor air temperature of 95°F.  
 The installation space of suction side above must be expanded in the following case.  
 • Design outdoor temperature becomes over 95°F.  
 • Operating over Max. operating load (in case of causing a heavy heating load at indoor unit side)  
 2. If the above wall heights are exceeded then h2/2 and h1/2 should be added to the front and suction side service spaces respectively as shown in the following figure.  
 3. When installing the units the most appropriate pattern should be selected from Section 3. in order to obtain the best fit in the space available always bearing in mind the need to leave enough room for a person to pass between units and wall and for the air to circulate freely.
- NOTE: If more units are to be installed than are shown in Section 3, your layout should take account of the possibility of short circuiting.
4. The units should be installed to leave sufficient space at the front for the on site refrigerant piping work to be carried out comfortably.

C: 3D070852



RXYQ336PBYD / RXYQ360PBYD

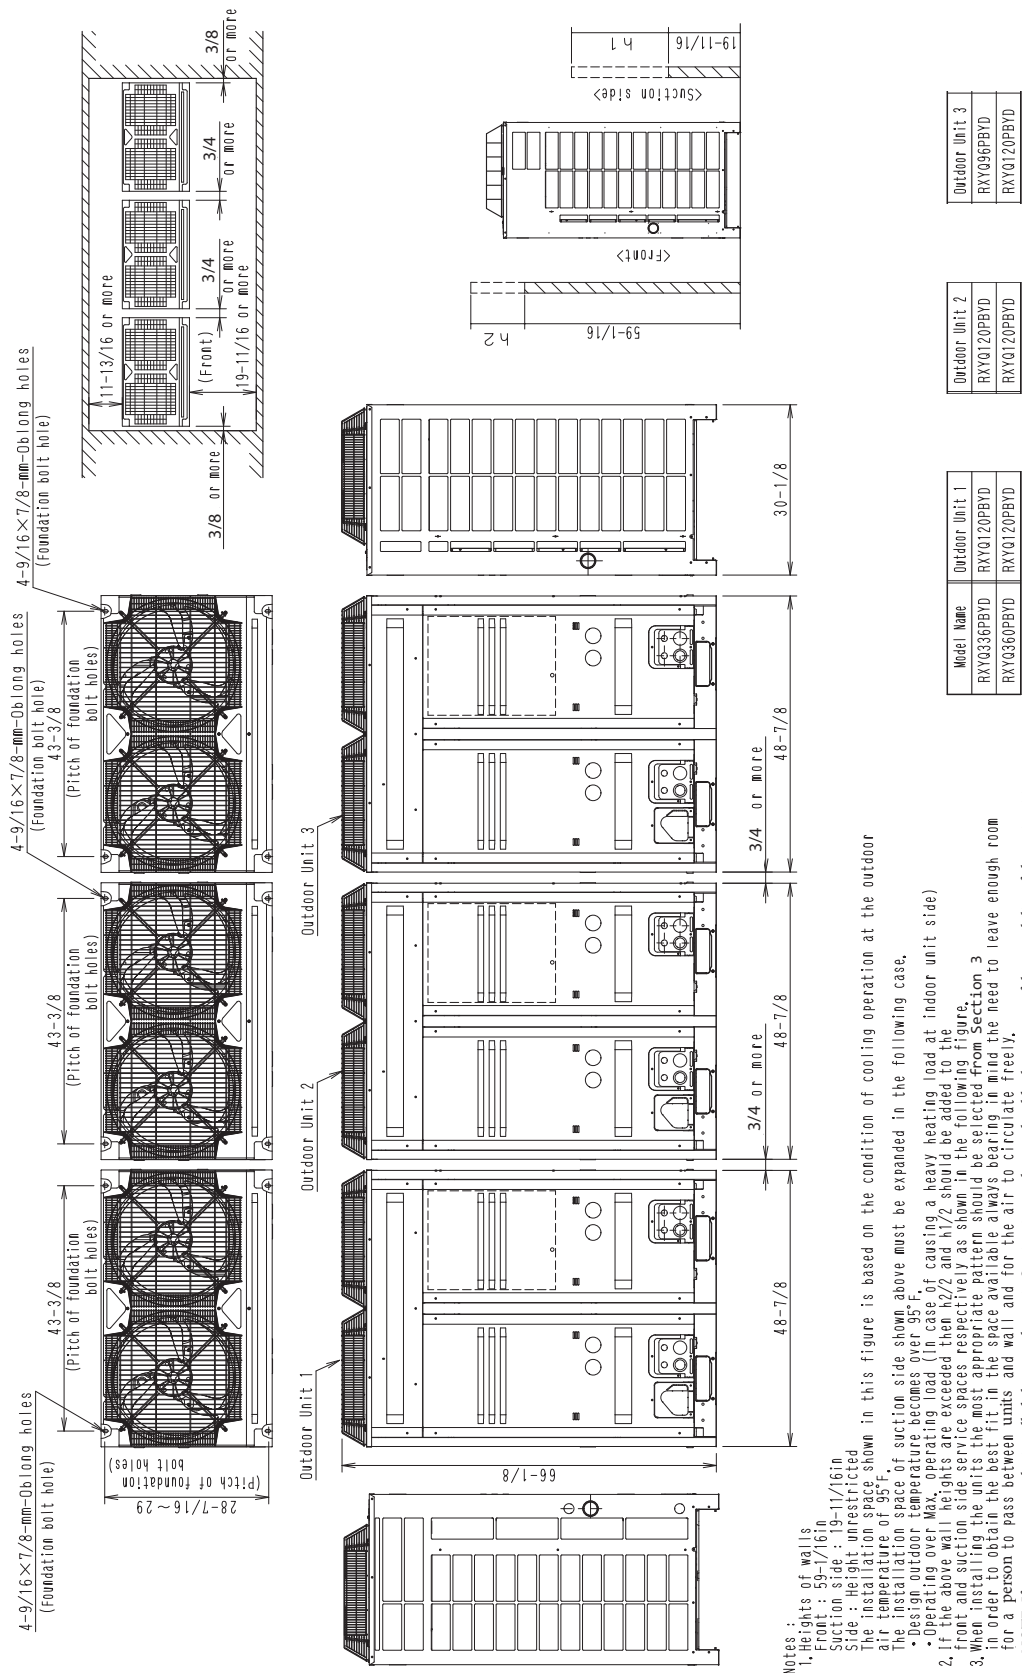


C: 3D070857



# 4. Piping Diagrams


RXYQ72PBYD

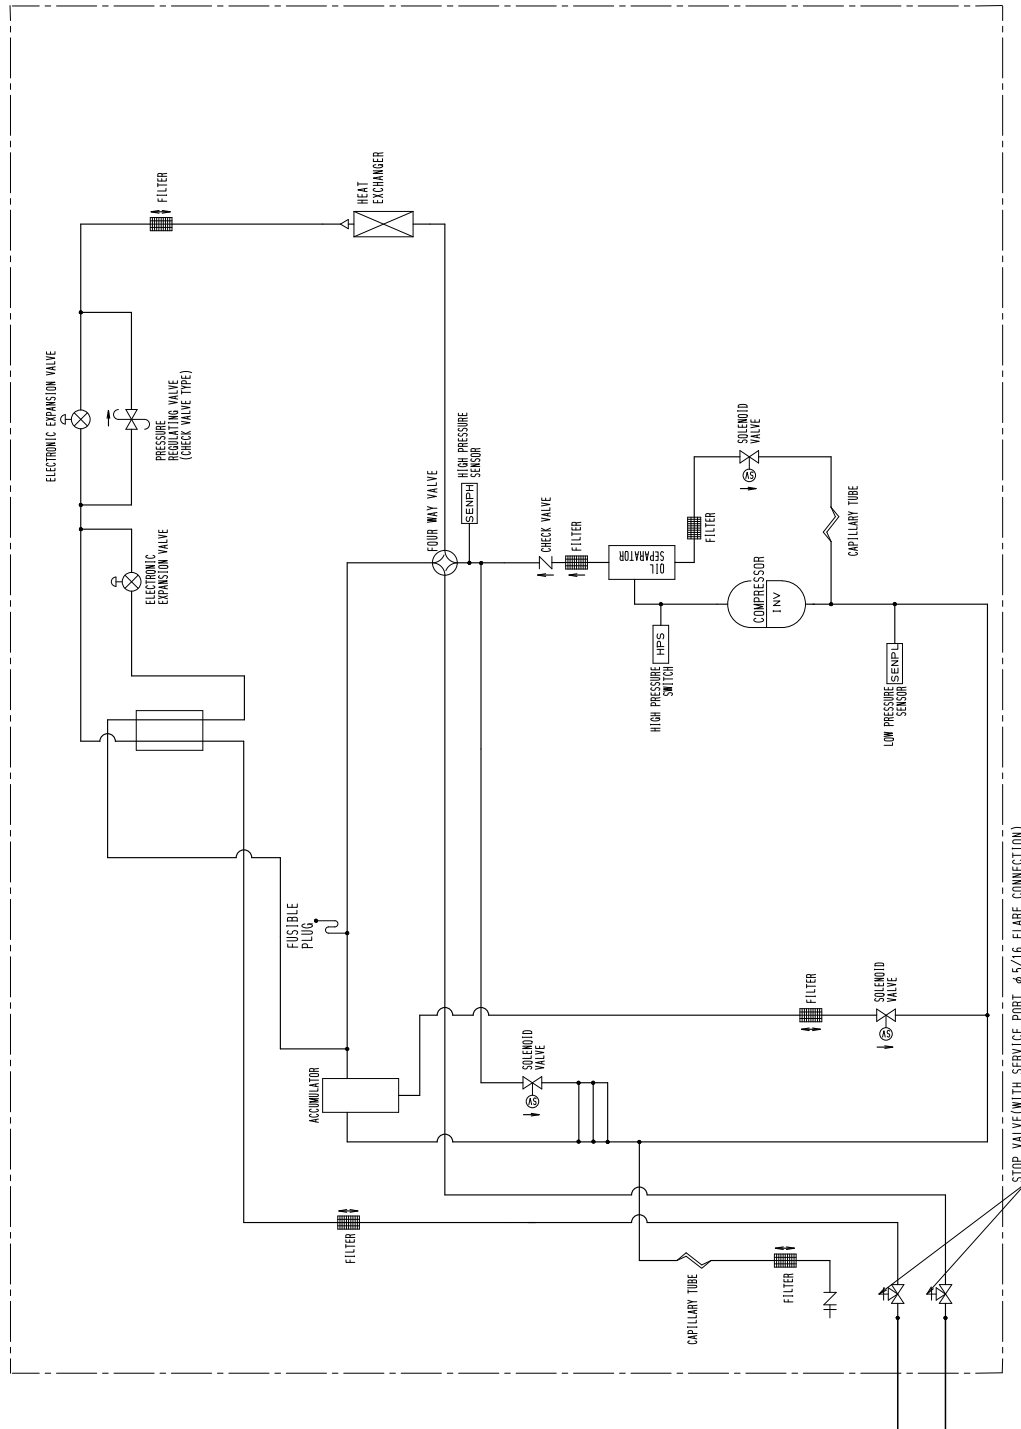

3D070507



RXYQ96PBYD / RXYQ120PBYD

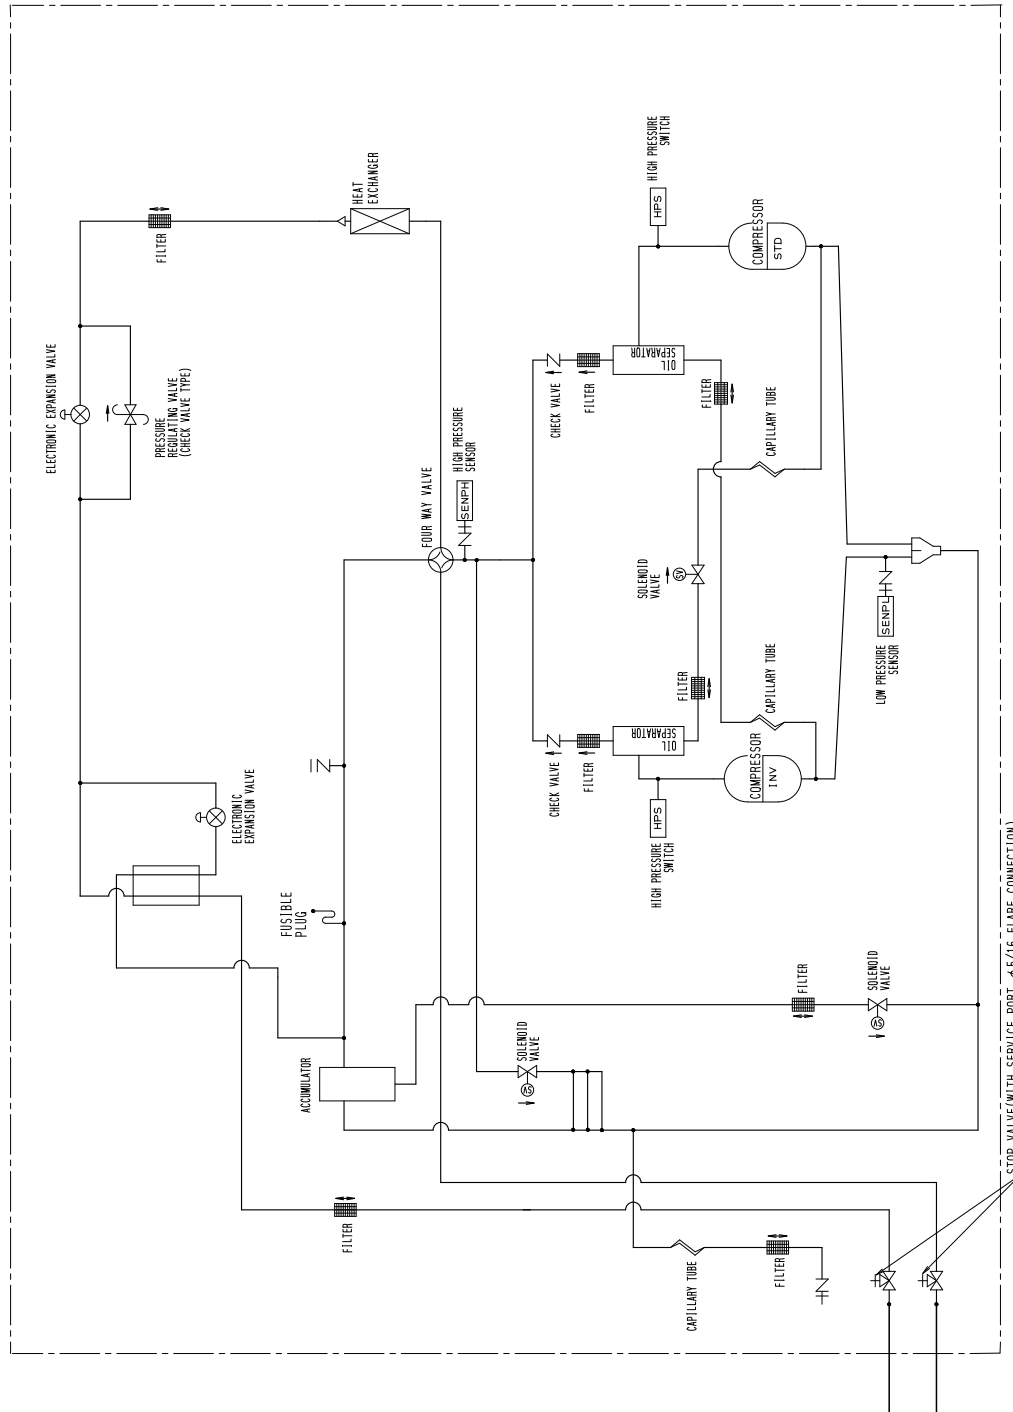

3D070508






# 6. Field Wiring

## RXYQ72PBYD / RXYQ96PBYD / RXYQ120PBYD

- Notes 1) All wiring, components and materials to be procured on the site must comply with the applicable local and national codes.
- 2) Use copper conductors only.
- 3) As for details, see wiring diagram.
- 4) Field wiring diagram is to be used as a guideline only. Wiring should comply with applicable local and national codes.
- 5) Unit shall be grounded in compliance with the applicable local and national codes.
- 6) Wiring shown are general points-of-connection guides only and are not intended for or to include all details for a specific installation.
- 7) Be sure to install the switch and the breaker/fuse to the power line of each piece of equipment.
- 8) Install the main switch that can interrupt all the power sources in an integrated manner because this system consists of the equipment utilizing multiple power sources.
- 9) If there exists the possibility of reversed phase, lost phase, momentary blackout or the power goes on and off while the product is operating, attach a reversed phase protection circuit locally.


Running the product in reversed phase may break the compressor and other parts.

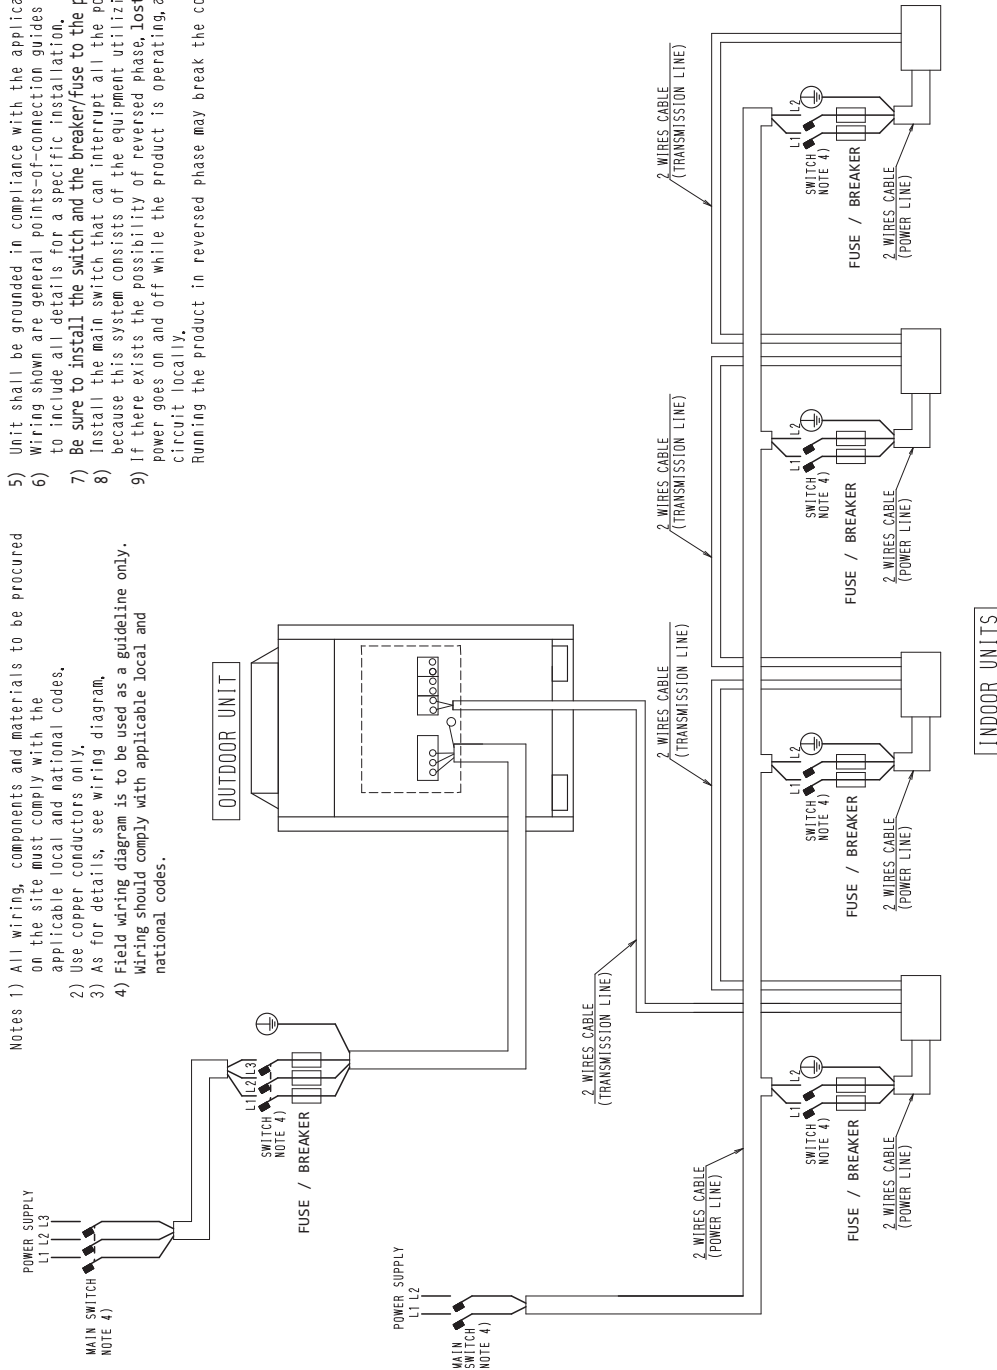

C: 3D058621D

RXYQ144PBYD / RXYQ168PBYD / RXYQ192PBYD / RXYQ216PBYD / RXYQ240PBYD


- Notes 1) All wiring, components and materials to be procured on the site must comply with the applicable local and national codes, use copper conductors only.
- 2) Use copper conductors only.
- 3) As for details, see wiring diagram.
- 4) Field wiring diagram is to be used as a guideline only. Wiring should comply with applicable local and national codes.
- 5) Unit shall be grounded in compliance with the applicable local and national codes.
- 6) Wiring shown are general points-of-connection guides only and are not intended for or to include all details for a specific installation.
- 7) Be sure to install the switch and the breaker/fuse to the power line of each piece of equipment.
- 8) Install the main switch that can interrupt all the power sources in an integrated manner because this system consists of the equipment utilizing multiple power sources.
- 9) If there exists the possibility of reversed phase, lost phase, momentary blackout or the power goes on and off while the product is operating, attach a reversed phase protection circuit locally.
- Running the product in reversed phase may break the compressor and other parts.

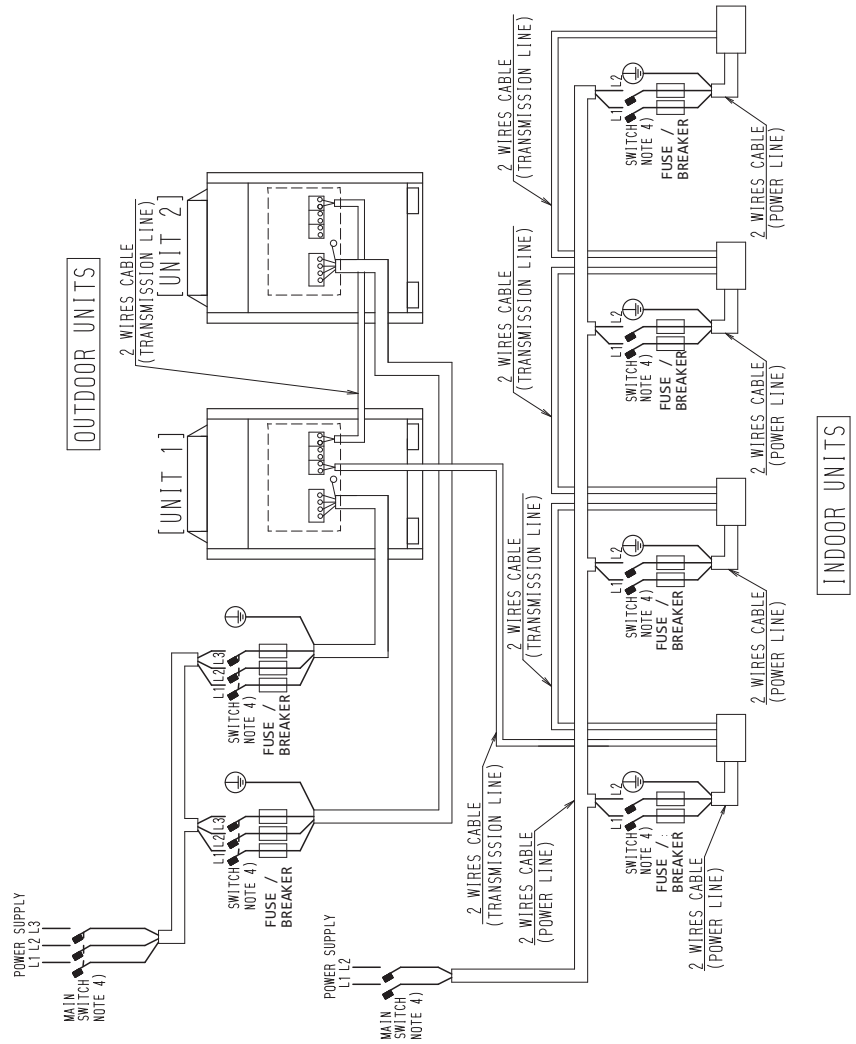

C: 3D059672D

RXYQ264PBYD / RXYQ288PBYD / RXYQ312PBYD / RXYQ336PBYD / RXYQ360PBYD


- Notes 1) All wiring, components and materials to be procured on the site must comply with the applicable local and national codes, to include all details for a specific installation.  
 2) Use copper conductors only.  
 3) As for details, see wiring diagram.  
 4) Field wiring diagram is to be used as a guideline only. Wiring should comply with applicable local and national codes.
- 5) Unit shall be grounded in compliance with the applicable local and national codes.  
 6) Wiring shown are general points-of-connection guides only and are not intended for or to include all details for a specific installation.  
 7) Be sure to install the switch and the breaker/fuse to the power line of each piece of equipment.  
 8) Install the main switch that can interrupt all the power sources in an integrated manner because this system consists of the equipment utilizing the multiple power sources.  
 9) If there exists the possibility of reversed phase, lost phase, momentary blackout or power goes on and off while the product is operating, attach a reversed phase protection circuit locally.  
 Running the product in reversed phase may break the compressor and other parts.

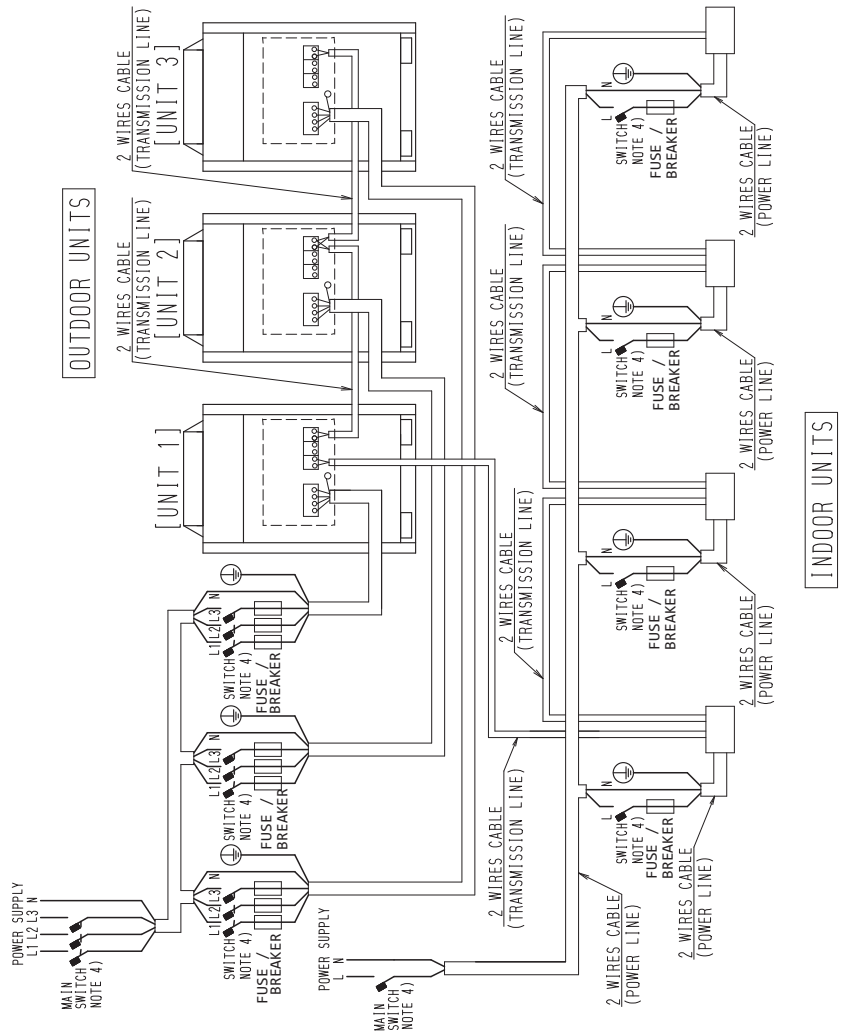

## 7. Electric Characteristics

Model Name	Units				Power supply		Comp.		OFM	
	Hz	Volts	Min.	Max.	MCA	MOP	MSC	RLA	KW	FLA
RXYQ72PBYD	60	460	416	508	16	20	--	7.1	0.75	0.6
RXYQ96PBYD	60	460	416	508	21	25	65	3.9+8.4	0.35 x 2	0.5 x 2
RXYQ120PBYD	60	460	416	508	21	25	65	5.4 + 8.4	0.35 x2	0.5 x 2

The relationship between the starting time and the starting current,

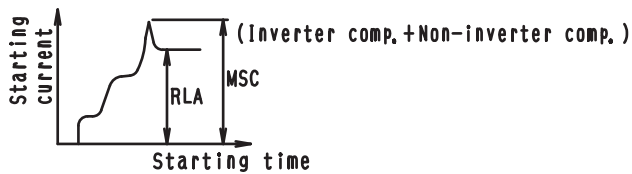

**NOTES:**

1. RLA is based on the following conditions:  
 Indoor temp: 80° FDB / 67° FWB  
 Outdoor temp: 95° FDB
2. MSC means the maximum current during the starting of the compressor.
3. Voltage range:  
 Units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits.
4. Maximum allowable voltage variation between phases is 2%.
5. Select wire size based on the value of MCA.
6. MOP is used to select the fuse, circuit breaker, or the ground fault circuit interrupter (ground leakage circuit breaker).


**SYMBOLS:**

- MCA: Minimum Circuit Amps. (A)
- MOP: Maximum Overcurrent Protective Device (A) (See Note 6)
- MSC: Maximum current when starting the compressor. (A)
- RLA: Rate Load Amps (A)
- OFM: Outdoor Fan Motor (A)
- FLA: Full Load Amps (A)
- KW: Fan Motor Rated Output

3D067246

Combination Unit	Model Name		Units				Power supply		Comp.		OFM	
	Independent Unit		Hz	Volts	Min.	Max.	MCA	MOP	MSC	RLA	KW	FLA
RXYQ144PBYD	RXYQ72PBYD	RXYQ72PBYD	60	460	416	508	16 + 16	20+20	--	7.1 + 7.1	0.75+ 0.75	0.6+0.6
RXYQ168PBYD	RXQY72PBYD	RXYQ96PBYD	60	460	416	508	16 + 21	20+25	69	7.1 +3.9 + 8.4	0.75 +(0.35x2)	0.6+(0.5x2)
RXYQ192PBYD	RXYQ72PBYD	RXYQ120PBYD	60	460	416	508	16 + 21	20+25	69	7.1 + 5.4 + 8.4	0.75+(0.35x2)	0.6+(0.5x2)
RXYQ216PBYD	RXYQ96PBYD	RXYQ120PBYD	60	460	416	508	21 + 21	25 +25	77	3.9 + 8.4+ 5.4 +8.4	(0.35x2) +(0.35x2)	(0.5x2) +(0.5x2)
RXYQ240PBYD	RXYQ120PBYD	RXYQ120PBYD	60	460	416	508	21 + 21	25+25	78	5.4+ 8.4+ 5.4 +8.4	(0.35x2) +(0.35x2)	(0.5x2) +(0.5x2)

The relationship between the starting time and the starting current.

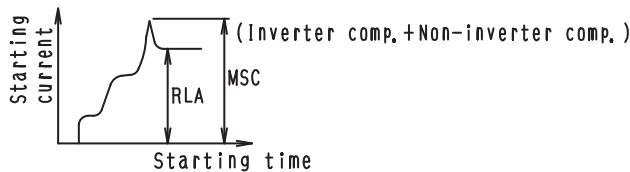

**NOTES:**

1. RLA is based on the following conditions:  
Indoor temp: 80° FDB / 67° FWB  
Outdoor temp: 95° FDB
2. MSC means the maximum current during the starting of the compressor.
3. Voltage range:  
Units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits.
4. Maximum allowable voltage variation between phases is 2%.
5. Select wire size based on the value of MCA.
6. MOP is used to select the fuse, circuit breaker, or the ground fault circuit interrupter (ground leakage circuit breaker).

**SYMBOLS:**

- MCA: Minimum Circuit Amps. (A) n (A)
- MOP: Maximum Overcurrent Protective Device (A) (See Note 6)
- MSC: Maximum current when starting the compressor. (A)
- RLA: Rate Load Amps (A)
- OFM: Outdoor Fan Motor (A)
- FLA: Full Load Amps (A)
- KW: Fan Motor Rated Output



Model Name				Units				Power Supply		Comp.		OFM	
Combination Unit	Independent Units			Hz	Volts	Min	Max	MCA	MOP	MSC	RLA	KW	FLA
RXYQ264PBYD	RXYQ72PBYD	RXYQ96PBYD	RXYQ96PBYD	60	460	416	508	16 + 21+ 21	20 + 25 + 25	80	7.1+(3.9+ 8.4) x 2	0.75+(0.35 x 2) x 2	0.6 + (0.5 x 2) x 2
RXYQ288PBYD	RXYQ72PBYD	RXYQ96PBYD	RXYQ120PBYD	60	460	416	508	16 + 21+ 21	20+25+ 25	81	7.1+3.9+ 8.4+5.4+ 8.4	0.75+(0.35x 2) x 2	0.6 + (0.5 x 2) x 2
RXYQ312PBYD	RXYQ72PBYD	RXYQ120PBYD	RXYQ120PBYD	60	460	416	508	16 + 21+ 21	20+25+ 25	81	7.1+(5.4+ 8.4) x 2	0.75+(0.35x 2) x 2	0.6 + (0.5 x 2) x 2
RXYQ336PBYD	RXYQ96PBYD	RXYQ120PBYD	RXYQ120PBYD	60	460	416	508	21+ 21+ 21	25+25+ 25	89	3.9+8.4+ (5.4+8.4) x 2	(0.35x 2) x 2	(0.5 x 2) x 3
RXYQ360PBYD	RXYQ120PBYD	RXYQ120PBYD	RXYQ120PBYD	60	460	416	508	21+ 21+ 21	25+25+ 25	90	7.1+(3.9+ 8.4) x 2	(0.35x 2) x 2	(0.5 x 2) x 3

The relationship between the starting time and the starting current:



**NOTES:**

1. RLA is based on the following conditions:  
Indoor temp: 80° FDB / 67° FWB  
Outdoor temp: 95° FDB
2. MSC means the maximum current during the starting of the compressor.
3. Voltage range:  
Units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits.
4. Maximum allowable voltage variation between phases is 2%.
5. Select wire size based on the value of MCA.
6. MOP is used to select the fuse, circuit breaker, or the ground fault circuit interrupter (ground leakage circuit breaker).

**SYMBOLS:**

- MCA: Minimum Circuit Amps. (A)
- MOP: Maximum Overcurrent Protective Device (A) (See Note 6)
- MSC: Maximum current when starting the compressor. (A)
- RLA: Rate Load Amps (A)
- OFM: Outdoor Fan Motor (A)
- FLA: Full Load Amps (A)
- KW: Fan Motor Rated Output



RXYQ96PBYD

Combination	Outdoor air temp.	Indoor air temp. °FWB																Combination	Outdoor air temp.	Indoor air temp. °FWB															
		57		61		64		67		70		72		75		57				61		64		67		70		72		75					
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI			TC	PI	TC	PI	TC	PI	TC	PI	TC	PI						
130	23	81.0	2.55	98.5	2.55	112	2.55	125	2.55	135	2.55	137	2.55	139	2.55	23	56.1	2.55	68.2	2.55	77.3	2.55	86.4	2.55	95.5	2.55	102	2.55	111	2.55					
	30	81.0	3.05	98.5	3.05	112	3.05	125	3.05	132	3.05	134	3.05	136	3.05	56.1	3.05	68.2	3.05	77.3	3.05	86.4	3.05	95.5	3.05	102	3.05	111	3.05						
	40	81.0	3.75	98.5	3.75	112	3.75	125	3.75	128	3.75	129	3.75	132	3.75	56.1	3.75	68.2	3.75	77.3	3.75	86.4	3.75	95.5	3.75	102	3.75	111	3.75						
	50	81.0	4.43	98.5	4.43	112	4.43	121	4.43	123	4.43	125	4.43	127	4.43	56.1	4.43	68.2	4.43	77.3	4.43	86.4	4.43	95.5	4.43	102	4.43	111	4.43						
	54	81.0	4.70	98.5	4.70	112	4.70	119	4.70	122	4.70	123	4.70	126	4.70	56.1	4.70	68.2	4.70	77.3	4.70	86.4	4.70	95.5	4.70	102	4.70	111	4.70						
	58	81.0	4.96	98.5	4.96	112	4.96	117	4.96	120	4.97	122	4.97	124	4.97	56.1	4.96	68.2	4.96	77.3	4.96	86.4	4.96	95.5	4.96	102	4.97	111	4.97						
	62	81.0	5.22	98.5	5.23	112	5.23	116	5.23	118	5.23	120	5.23	122	5.23	56.1	5.22	68.2	5.23	77.3	5.23	86.4	5.23	95.5	5.23	102	5.23	111	5.23						
	66	81.0	5.48	98.5	5.48	112	5.48	114	5.48	116	5.48	118	5.48	121	5.49	56.1	5.48	68.2	5.48	77.3	5.48	86.4	5.48	95.5	5.48	102	5.48	111	5.49						
	70	81.0	5.74	98.5	5.74	112	5.74	114	5.74	115	5.74	116	5.74	119	5.74	56.1	5.74	68.2	5.74	77.3	5.74	86.4	5.74	95.5	5.74	102	5.74	111	5.74						
	72	81.0	5.86	98.5	5.86	109	5.86	111	5.86	114	5.86	115	5.86	118	5.86	56.1	5.86	68.2	5.86	77.3	5.86	86.4	5.86	95.5	5.86	102	5.86	109	5.86						
	75	81.0	6.05	98.5	6.05	108	6.05	110	6.05	113	6.05	114	6.05	117	6.05	56.1	6.05	68.2	6.05	77.3	6.05	86.4	6.05	95.5	6.05	102	6.05	107	6.05						
	79	81.0	6.29	98.5	6.29	106	6.29	108	6.29	111	6.29	112	6.29	115	6.30	56.1	6.29	68.2	6.29	77.3	6.29	86.4	6.29	95.5	6.29	102	6.29	106	6.30						
83	81.0	6.53	98.5	6.53	104	6.53	107	6.53	109	6.53	111	6.53	113	6.54	56.1	6.53	68.2	6.53	77.3	6.53	86.4	6.53	95.5	6.53	102	6.53	104	6.54							
87	81.0	6.77	98.5	6.77	102	6.77	105	6.77	107	6.77	109	6.77	111	6.77	56.1	6.77	68.2	6.77	77.3	6.77	86.4	6.77	95.5	6.77	101	6.77	102	6.77							
91	81.0	7.00	98.2	7.00	101	7.00	103	7.00	106	7.00	107	7.00	110	7.00	56.1	7.00	68.2	7.00	77.3	7.00	86.4	7.00	95.5	7.00	98.8	7.00	100	7.00							
93	81.0	7.11	97.3	7.11	99.8	7.11	102	7.11	105	7.11	106	7.11	108	7.11	56.1	7.11	68.2	7.11	77.3	7.11	86.4	7.11	95.5	7.11	98.7	7.11	99.6	7.11							
95	81.0	7.22	96.5	7.22	98.9	7.22	101	7.22	104	7.22	105	7.22	108	7.22	56.1	7.22	68.2	7.22	77.3	7.22	86.4	7.22	95.5	7.22	97.2	7.22	98.7	7.22							
99	81.0	7.44	94.7	7.44	97.2	7.44	99.7	7.44	102	7.44	104	7.44	106	7.44	56.1	7.44	68.2	7.44	77.3	7.44	86.4	7.44	94.2	7.44	95.3	7.44	97.0	7.44							
103	81.0	7.65	93.0	7.65	95.5	7.65	97.5	7.65	97.5	7.65	97.5	7.65	97.5	7.66	56.1	7.65	68.2	7.65	77.3	7.65	86.4	7.65	92.4	7.65	93.6	7.65	95.3	7.66							
106	81.0	7.91	91.7	7.91	94.2	7.91	94.3	7.91	94.3	7.91	94.3	7.91	94.4	7.92	56.1	7.91	68.2	7.91	77.3	7.91	86.4	7.91	91.1	7.91	92.3	7.91	94.0	7.92							
110	81.0	8.27	90.0	8.27	90.0	8.27	90.1	8.27	90.1	8.27	90.1	8.27	90.1	8.28	56.1	8.27	68.2	8.27	77.3	8.27	86.4	8.27	89.4	8.27	90.1	8.27	90.1	8.28							
115	81.0	8.16	81.8	8.16	82.0	8.16	82.4	8.16	82.4	8.16	82.4	8.16	82.5	8.30	56.1	8.16	68.2	8.16	77.3	8.16	86.4	8.16	90.3	8.16	90.3	8.16	92.5	8.30							
118	71.5	7.16	71.7	7.19	71.9	7.21	72.0	7.23	72.2	7.26	72.3	7.27	72.5	7.30	56.1	7.16	68.2	7.19	71.9	7.21	72.0	7.23	72.2	7.26	72.3	7.27	72.5	7.30							
122	58.1	5.79	58.3	5.82	58.4	5.84	58.6	5.86	58.8	5.89	58.9	5.90	59.0	5.92	56.1	5.79	58.3	5.82	58.4	5.84	58.6	5.86	58.8	5.89	58.9	5.90	59.0	5.92							
120	23	74.8	2.55	90.9	2.55	103	2.55	115	2.55	127	2.55	135	2.55	137	2.55	23	49.8	2.55	60.6	2.55	68.7	2.55	76.8	2.55	84.9	2.55	90.3	2.55	98.4	2.55					
	30	74.8	3.05	90.9	3.05	103	3.05	115	3.05	127	3.05	132	3.05	134	3.05	40	49.8	3.05	60.6	3.05	68.7	3.05	76.8	3.05	84.9	3.05	90.3	3.05	98.4	3.05					
	40	74.8	3.75	90.9	3.75	103	3.75	115	3.75	126	3.75	127	3.75	130	3.75	40	49.8	3.75	60.6	3.75	68.7	3.75	76.8	3.75	84.9	3.75	90.3	3.75	98.4	3.75					
	50	74.8	4.43	90.9	4.43	103	4.43	115	4.43	121	4.43	123	4.43	125	4.43	50	49.8	4.43	60.6	4.43	68.7	4.43	76.8	4.43	84.9	4.43	90.3	4.43	98.4	4.43					
	54	74.8	4.70	90.9	4.70	103	4.70	115	4.70	120	4.70	121	4.70	123	4.70	54	49.8	4.70	60.6	4.70	68.7	4.70	76.8	4.70	84.9	4.70	90.3	4.70	98.4	4.70					
	58	74.8	4.96	90.9	4.96	103	4.96	115	4.96	118	4.97	119	4.97	122	4.97	58	49.8	4.96	60.6	4.96	68.7	4.96	76.8	4.96	84.9	4.96	90.3	4.97	98.4	4.97					
	62	74.8	5.22	90.9	5.23	103	5.23	114	5.23	116	5.23	118	5.23	120	5.23	62	49.8	5.22	60.6	5.23	68.7	5.23	76.8	5.23	84.9	5.23	90.3	5.23	98.4	5.23					
	66	74.8	5.48	90.9	5.48	103	5.48	112	5.48	114	5.48	116	5.48	118	5.49	66	49.8	5.48	60.6	5.48	68.7	5.48	76.8	5.48	84.9	5.48	90.3	5.48	98.4	5.49					
	70	74.8	5.74	90.9	5.74	103	5.74	110	5.74	113	5.74	114	5.74	116	5.74	70	49.8	5.74	60.6	5.74	68.7	5.74	76.8	5.74	84.9	5.74	90.3	5.74	98.4	5.74					
	72	74.8	5.86	90.9	5.86	103	5.86	110	5.86	112	5.86	113	5.86	116	5.86	72	49.8	5.86	60.6	5.86	68.7	5.86	76.8	5.86	84.9	5.86	90.3	5.86	98.4	5.86					
	75	74.8	6.05	90.9	6.05	103	6.05	108	6.05	111	6.05	112	6.05	114	6.05	75	49.8	6.05	60.6	6.05	68.7	6.05	76.8	6.05	84.9	6.05	90.3	6.05	98.4	6.05					
	79	74.8	6.29	90.9	6.29	103	6.29	107	6.29	109	6.29	110	6.29	113	6.30	79	49.8	6.29	60.6	6.29	68.7	6.29	76.8	6.29	84.9	6.29	90.3	6.29	98.4	6.30					
83	74.8	6.53	90.9	6.53	103	6.53	105	6.53	107	6.53	109	6.53	111	6.54	83	49.8	6.53	60.6	6.53	68.7	6.53	76.8	6.53	84.9	6.53	90.3	6.53	98.4	6.54						
87	74.8	6.77	90.9	6.77	101	6.77	103	6.77	105	6.77	107	6.77	109	6.77	87	49.8	6.77	60.6	6.77	68.7	6.77	76.8	6.77	84.9	6.77	90.3	6.77	98.4	6.77						
91	74.8	7.00	90.9	7.00	99.1	7.00	101	7.00	104	7.00	105	7.00	107	7.00	91	49.8	7.00	60.6	7.00	68.7	7.00	76.8	7.00	84.9	7.00	90.3	7.00	98.2	7.00						
93	74.8	7.11	90.9	7.11	98.2	7.11	100	7.11	103	7.11	104	7.11	107	7.11	93	49.8	7.11	60.6	7.11	68.7	7.11	76.8	7.11	84.9	7.11	90.3	7.11	97.3	7.11						
95	74.8	7.22	90.9	7.22	97.3	7.22	99.6	7.22	102	7.22	103	7.22	106	7.22	95	49.8	7.22	60.6	7.22	68.7	7.22	76.8	7.22	84.9	7.22	90.3	7.22	96.4	7.22						
99	74.8	7.44	90.9	7.44	95.6	7.44	97.9	7.44	100	7.44	102	7.44	104	7.44	99	49.8	7.44	60.6	7.44	68.7	7.44	76.8	7.44	84.9	7.44	90.3	7.44	94.7	7.44						
103	74.8	7.65	90.9	7.65	96.1	7.65	97.5	7.65	97.5	7.65	97.5	7.65	97.6	7.66	103	49.8	7.65	60.6	7.65	68.7	7.65	76.8	7.65	84.9	7.65	90.3	7.65	93.0	7.66						
106	74.8	7.91	90.3	7.91	92.6	7.91	94.3	7.91	94.3	7.91	94.3	7.91	94.4	7.92	106	49.8	7.91	60.6	7.91	68.7	7.91	76.8	7.91	84.9	7.91	90									

**RXYQ120PBYD**

Combination	Outdoor air temp.	Indoor air temp. °FWB														Combination	Outdoor air temp.	Indoor air temp. °FWB													
		57		61		64		67		70		72		75				57		61		64		67		70		72		75	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI			TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI		
130	23	101	3.52	123	4.39	140	5.07	156	5.77	169	6.24	171	6.12	174	5.93	23	70.1	2.40	85.2	2.93	96.6	3.35	108	3.79	119	4.24	127	4.55	138	5.02	
	30	101	3.64	123	4.54	140	5.24	156	5.96	165	6.19	167	6.06	170	5.87	30	70.1	2.47	85.2	3.02	96.6	3.45	108	3.91	119	4.38	127	4.70	138	5.19	
	40	101	3.81	123	4.76	140	5.50	156	6.26	160	6.10	162	5.97	165	5.77	40	70.1	2.57	85.2	3.16	96.6	3.62	108	4.10	119	4.59	127	4.93	138	5.44	
	50	101	4.00	123	5.00	140	5.78	151	6.21	154	6.01	156	5.87	159	5.66	50	70.1	2.69	85.2	3.31	96.6	3.80	108	4.30	119	4.83	127	5.18	138	5.73	
	54	101	4.08	123	5.11	140	5.91	149	6.18	152	5.97	154	5.83	157	5.72	54	70.1	2.74	85.2	3.37	96.6	3.87	108	4.39	119	4.93	127	5.29	138	5.85	
	58	101	4.17	123	5.22	140	6.03	147	6.14	150	6.00	152	6.04	155	6.08	58	70.1	2.79	85.2	3.44	96.6	3.95	108	4.49	119	5.03	127	5.41	138	5.97	
	62	101	4.26	123	5.33	140	6.16	145	6.31	148	6.36	150	6.39	153	6.44	62	70.1	2.85	85.2	3.51	96.6	4.04	108	4.58	119	5.14	127	5.52	138	6.10	
	66	101	4.35	123	5.50	139	6.61	142	6.66	146	6.72	148	6.75	151	6.80	66	70.1	2.90	85.2	3.58	96.6	4.12	108	4.68	119	5.26	127	5.75	138	6.54	
	70	101	4.49	123	5.95	137	6.96	140	7.02	143	7.07	145	7.11	148	7.17	70	70.1	2.96	85.2	3.66	96.6	4.22	108	4.92	119	5.68	127	6.22	137	6.96	
	72	101	4.67	123	6.18	136	7.14	139	7.19	142	7.25	144	7.29	147	7.35	72	70.1	2.99	85.2	3.70	96.6	4.37	108	5.11	119	5.91	127	6.47	136	7.13	
	75	101	4.93	123	6.55	135	7.40	138	7.46	141	7.52	143	7.56	146	7.63	75	70.1	3.05	85.2	3.91	96.6	4.63	108	5.41	119	6.25	127	6.85	134	7.39	
	79	101	5.31	123	7.06	132	7.75	135	7.82	138	7.88	141	7.93	144	7.99	79	70.1	3.27	85.2	4.20	96.6	4.98	108	5.82	119	6.74	127	7.39	132	7.75	
	83	101	5.71	123	7.60	130	8.11	133	8.18	136	8.25	138	8.29	141	8.36	83	70.1	3.50	85.2	4.51	96.6	5.35	108	6.26	119	7.26	127	7.96	130	8.10	
	87	101	6.13	123	8.18	128	8.46	131	8.54	134	8.61	136	8.66	139	8.74	87	70.1	3.74	85.2	4.83	96.6	5.74	108	6.73	119	7.80	126	8.41	128	8.46	
91	101	6.58	123	8.74	126	8.82	129	8.90	132	8.98	134	9.03	137	9.10	91	70.1	4.00	85.2	5.18	96.6	6.16	108	7.23	119	8.39	123	8.76	126	8.82		
93	101	6.82	122	8.92	125	9.00	128	9.08	131	9.16	133	9.22	134	9.25	93	70.1	4.14	85.2	5.36	96.6	6.38	108	7.49	119	8.69	122	8.94	125	8.99		
95	101	7.06	121	9.10	124	9.18	127	9.27	130	9.35	131	9.39	131	9.39	95	70.1	4.28	85.2	5.54	96.6	6.60	108	7.76	119	9.01	121	9.12	123	9.14		
99	101	7.57	118	9.45	121	9.54	125	9.63	126	9.68	126	9.68	126	9.68	99	70.1	4.57	85.2	5.93	96.6	7.07	108	8.32	118	9.43	119	9.47	121	9.57		
103	101	8.11	116	9.81	119	9.91	121	9.95	121	9.95	121	9.95	121	9.95	103	70.1	4.87	85.2	6.34	96.6	7.58	108	8.92	116	9.79	117	9.83	119	9.90		
106	101	8.65	115	10.2	117	10.3	117	10.3	117	10.3	117	10.3	117	10.3	106	70.1	5.19	85.2	6.76	96.6	8.08	108	9.53	114	10.2	115	10.2	117	10.3		
110	101	9.45	111	10.8	111	10.8	111	10.8	111	10.8	111	10.8	111	10.8	110	70.1	5.84	85.2	7.37	96.6	8.82	108	10.4	111	10.8	111	10.8	112	10.8		
115	96.0	10.8	96.2	10.8	96.4	10.9	96.6	10.9	96.8	10.9	97.0	10.9	97.2	10.9	115	70.1	6.25	85.2	8.19	96.6	10.09	96.6	10.9	96.8	10.9	97.0	10.9	97.2	10.9		
118	83.4	9.17	83.6	9.18	83.8	9.20	84.0	9.21	84.2	9.22	84.4	9.23	84.6	9.24	118	70.1	6.95	83.6	9.18	83.8	9.20	84.0	9.21	84.2	9.22	84.4	9.23	84.6	9.24		
122	66.6	6.95	66.8	6.97	67.0	6.98	67.2	6.99	67.4	7.00	67.6	7.01	67.8	7.02	122	66.6	6.95	66.8	6.97	67.0	6.98	67.2	6.99	67.4	7.00	67.6	7.01	67.8	7.02		
23	93.4	3.23	114	4.01	129	4.63	144	5.26	159	5.91	168	6.27	171	6.11	23	62.3	2.15	75.8	2.60	85.9	2.95	96.0	3.33	106	3.71	113	3.98	123	4.38		
30	93.4	3.33	114	4.14	129	4.78	144	5.43	159	6.10	164	6.22	167	6.05	30	62.3	2.20	75.8	2.67	85.9	3.04	96.0	3.43	106	3.83	113	4.11	123	4.53		
40	93.4	3.49	114	4.34	129	5.01	144	5.70	157	6.26	159	6.14	162	5.96	40	62.3	2.29	75.8	2.79	85.9	3.18	96.0	3.59	106	4.02	113	4.31	123	4.75		
50	93.4	3.66	114	4.56	129	5.27	144	6.00	152	6.18	154	6.05	156	5.86	50	62.3	2.39	75.8	2.92	85.9	3.33	96.0	3.77	106	4.22	113	4.53	123	5.00		
54	93.4	3.73	114	4.66	129	5.38	144	6.12	150	6.14	151	6.01	154	5.81	54	62.3	2.43	75.8	2.97	85.9	3.40	96.0	3.84	106	4.31	113	4.62	123	5.10		
58	93.4	3.81	114	4.76	129	5.50	144	6.25	147	6.10	149	6.00	152	6.04	58	62.3	2.48	75.8	3.03	85.9	3.47	96.0	3.92	106	4.40	113	4.72	123	5.21		
62	93.4	3.89	114	4.86	129	5.62	142	6.27	145	6.32	147	6.35	150	6.40	62	62.3	2.52	75.8	3.09	85.9	3.54	96.0	4.01	106	4.49	113	4.82	123	5.32		
66	93.4	3.97	114	4.97	129	5.88	140	6.62	143	6.67	145	6.71	148	6.75	66	62.3	2.57	75.8	3.15	85.9	3.61	96.0	4.09	106	4.59	113	4.93	123	5.49		
70	93.4	4.05	114	5.29	129	6.36	138	6.98	141	7.03	143	7.06	146	7.11	70	62.3	2.62	75.8	3.22	85.9	3.69	96.0	4.18	106	4.80	113	5.24	123	5.93		
72	93.4	4.18	114	5.50	129	6.61	137	7.15	140	7.21	142	7.24	145	7.30	72	62.3	2.65	75.8	3.25	85.9	3.73	96.0	4.34	106	4.98	113	5.44	123	6.17		
75	93.4	4.42	114	5.82	129	7.00	135	7.42	138	7.47	140	7.51	143	7.57	75	62.3	2.69	75.8	3.36	85.9	3.95	96.0	4.58	106	5.27	113	5.76	123	6.53		
79	93.4	4.75	114	6.27	129	7.55	133	7.77	136	7.83	138	7.87	141	7.93	79	62.3	2.83	75.8	3.60	85.9	4.24	96.0	4.93	106	5.68	113	6.21	123	7.04		
83	93.4	5.10	114	6.75	128	8.06	131	8.13	134	8.19	136	8.23	139	8.30	83	62.3	3.03	75.8	3.86	85.9	4.55	96.0	5.30	106	6.11	113	6.68	123	7.58		
87	93.4	5.48	114	7.26	126	8.41	129	8.48	132	8.55	134	8.60	136	8.67	87	62.3	3.24	75.8	4.13	85.9	4.88	96.0	5.69	106	6.56	113	7.18	123	8.16		
91	93.4	5.87	114	7.79	124	8.77	127	8.84	129	8.92	131	8.96	134	9.04	91	62.3	3.46	75.8	4.42	85.9	5.23	96.0	6.10	106	7.04	113	7.71	123	8.74		
93	93.4	6.08	114	8.08	123	8.95	126	9.02	128	9.10	130	9.15	133	9.22	93	62.3	3.57	75.8	4.58	85.9	5.41	96.0	6.32	106	7.30	113	7.99	122	8.92		
95	93.4	6.30																													

**RXYQ144PBYD**

Combination	Outdoor air temp.	Indoor air temp. °FWB																								Combination	Outdoor air temp.	Indoor air temp. °FWB																															
		57				61				64				67				70				72						75				57				61				64				67				70				72				75			
		TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW			TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW								
23	121	3.59	148	4.47	167	5.16	187	5.87	203	6.35	205	6.23	209	6.04	23	84.1	2.44	102	2.98	116	3.41	130	3.85	143	4.31	152	4.63	166	5.11	23	84.1	2.44	102	2.98	116	3.41	130	3.85	143	4.31	152	4.63	166	5.11															
30	121	3.70	148	4.62	167	5.33	187	6.07	198	6.29	201	6.17	204	5.97	30	84.1	2.51	102	3.07	116	3.51	130	3.98	143	4.45	152	4.78	166	5.28	30	84.1	2.51	102	3.07	116	3.51	130	3.98	143	4.45	152	4.78	166	5.28															
40	121	3.88	148	4.84	167	5.60	187	6.37	192	6.21	194	6.08	198	5.87	40	84.1	2.62	102	3.21	116	3.68	130	4.17	143	4.67	152	5.02	166	5.54	40	84.1	2.62	102	3.21	116	3.68	130	4.17	143	4.67	152	5.02	166	5.54															
50	121	4.07	148	5.09	167	5.89	181	6.32	195	6.12	198	5.97	191	5.76	50	84.1	2.74	102	3.36	116	3.86	130	4.38	143	4.91	152	5.27	166	5.83	50	84.1	2.74	102	3.36	116	3.86	130	4.38	143	4.91	152	5.27	166	5.83															
54	121	4.15	148	5.20	167	6.01	179	6.29	182	6.08	185	5.93	189	5.82	54	84.1	2.79	102	3.43	116	3.94	130	4.47	143	5.02	152	5.39	166	5.95	54	84.1	2.79	102	3.43	116	3.94	130	4.47	143	5.02	152	5.39	166	5.95															
58	121	4.24	148	5.31	167	6.14	176	6.25	180	6.11	182	6.14	186	6.19	58	84.1	2.84	102	3.50	116	4.02	130	4.56	143	5.12	152	5.50	166	6.08	58	84.1	2.84	102	3.50	116	4.02	130	4.56	143	5.12	152	5.50	166	6.08															
62	121	4.33	148	5.43	167	6.27	174	6.42	177	6.47	180	6.50	183	6.56	62	84.1	2.90	102	3.57	116	4.11	130	4.66	143	5.23	152	5.62	166	6.21	62	84.1	2.90	102	3.57	116	4.11	130	4.66	143	5.23	152	5.62	166	6.21															
66	121	4.42	148	5.59	167	6.73	171	6.78	175	6.83	177	6.87	181	6.92	66	84.1	2.95	102	3.65	116	4.20	130	4.77	143	5.35	152	5.85	166	6.65	66	84.1	2.95	102	3.65	116	4.20	130	4.77	143	5.35	152	5.85	166	6.65															
70	121	4.57	148	6.05	165	7.08	168	7.14	172	7.20	174	7.24	178	7.29	70	84.1	3.01	102	3.73	116	4.29	130	5.01	143	5.78	152	6.33	164	7.08	70	84.1	3.01	102	3.73	116	4.29	130	5.01	143	5.78	152	6.33	164	7.08															
72	121	4.75	148	6.29	163	7.26	167	7.32	171	7.38	173	7.42	177	7.48	72	84.1	3.05	102	3.77	116	4.45	130	5.20	143	6.01	152	6.58	163	7.26	72	84.1	3.05	102	3.77	116	4.45	130	5.20	143	6.01	152	6.58	163	7.26															
75	121	5.02	148	6.66	161	7.53	165	7.59	169	7.66	171	7.70	175	7.76	75	84.1	3.10	102	3.98	116	4.71	130	5.50	143	6.36	152	6.97	161	7.52	75	84.1	3.10	102	3.98	116	4.71	130	5.50	143	6.36	152	6.97	161	7.52															
79	121	5.40	148	7.18	159	7.89	162	7.96	166	8.02	169	8.07	172	8.14	79	84.1	3.32	102	4.27	116	5.06	130	5.93	143	6.86	152	7.52	159	7.88	79	84.1	3.32	102	4.27	116	5.06	130	5.93	143	6.86	152	7.52	159	7.88															
83	121	5.81	148	7.79	156	8.25	160	8.32	164	8.39	166	8.44	170	8.51	83	84.1	3.56	102	4.58	116	5.44	130	6.37	143	7.38	152	8.10	156	8.24	83	84.1	3.56	102	4.58	116	5.44	130	6.37	143	7.38	152	8.10	156	8.24															
87	121	6.24	148	8.32	154	8.61	157	8.69	161	8.76	163	8.82	167	8.89	87	84.1	3.81	102	4.92	116	5.84	130	6.85	143	7.94	151	8.55	153	8.61	87	84.1	3.81	102	4.92	116	5.84	130	6.85	143	7.94	151	8.55	153	8.61															
91	121	6.70	147	8.90	151	8.98	155	9.06	158	9.14	161	9.19	164	9.26	91	84.1	4.07	102	5.27	116	6.27	130	7.36	143	8.54	148	9.91	151	8.97	91	84.1	4.07	102	5.27	116	6.27	130	7.36	143	8.54	148	9.91	151	8.97															
93	121	6.94	146	9.08	150	9.16	153	9.24	157	9.33	160	9.38	163	9.41	93	84.1	4.21	102	5.45	116	6.49	130	7.62	143	8.85	147	9.10	149	9.15	93	84.1	4.21	102	5.45	116	6.49	130	7.62	143	8.85	147	9.10	149	9.15															
95	121	7.18	145	9.26	148	9.34	152	9.43	156	9.51	158	9.56	158	9.56	95	84.1	4.35	102	5.64	116	6.72	130	7.89	143	9.17	146	9.28	148	9.34	95	84.1	4.35	102	5.64	116	6.72	130	7.89	143	9.17	146	9.28	148	9.34															
99	121	7.70	142	9.62	146	9.71	149	9.80	151	9.85	151	9.85	151	9.85	99	84.1	4.65	102	6.03	116	7.20	130	8.47	141	9.60	143	9.64	146	9.70	99	84.1	4.65	102	6.03	116	7.20	130	8.47	141	9.60	143	9.64	146	9.70															
103	121	8.25	139	9.98	143	10.1	145	10.1	145	10.1	145	10.1	145	10.1	103	84.1	4.96	102	6.45	116	7.71	130	9.08	139	9.96	140	10.0	143	10.1	103	84.1	4.96	102	6.45	116	7.71	130	9.08	139	9.96	140	10.0	143	10.1															
106	121	8.81	138	10.4	140	10.5	140	10.5	140	10.5	140	10.5	140	10.5	106	84.1	5.28	102	6.88	116	8.23	130	9.69	137	10.4	138	10.4	140	10.5	106	84.1	5.28	102	6.88	116	8.23	130	9.69	137	10.4	138	10.4	140	10.5															
110	121	9.62	134	10.9	134	10.9	134	10.9	134	10.9	134	10.9	134	10.9	110	84.1	5.74	102	7.50	116	8.98	130	10.6	134	10.9	134	10.9	134	10.9	110	84.1	5.74	102	7.50	116	8.98	130	10.6	134	10.9	134	10.9	134	10.9															
115	115	11.0	115	11.0	116	11.1	116	11.1	116	11.1	116	11.1	117	11.1	115	84.1	6.38	102	8.34	116	11.1	116	11.1	116	11.1	116	11.1	117	11.1	115	84.1	6.38	102	8.34	116	11.1	116	11.1	116	11.1	116	11.1	116	11.1	117	11.1													
118	100	9.33	100	9.35	101	9.36	101	9.37	101	9.38	101	9.39	101	9.40	118	84.1	6.76	100	9.35	101	9.36	101	9.37	101	9.38	101	9.39	101	9.40	118	84.1	6.76	100	9.35	101	9.36	101	9.37	101	9.38	101	9.39	101	9.40															
122	79.9	7.07	80.2	7.09	80.5	7.10	80.7	7.11	80.9	7.12	81.1	7.13	81.3	7.15	122	79.9	7.07	80.2	7.09	80.5	7.10	80.7	7.11	80.9	7.12	81.1	7.13	81.3	7.15	122	79.9	7.07	80.2	7.09	80.5	7.10	80.7	7.11	80.9	7.12	81.1	7.13	81.3	7.15															

TC: Total capacity ; MBH  
 PI: Power Input ; kW (Comp.+Outdoor fan motor)  
 Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

RXYQ168PBYD

Capacity tables for RXYQ168PBYD heat pump. The table is organized into four main sections based on indoor air temperature (°FWB) and outdoor air temperature (°FDB). Each section contains a grid of TC (Total Capacity) and PI (Power Input) values for various indoor and outdoor conditions. The indoor air temperature sections are 57, 61, 64, 67, 70, 72, and 75 °FWB. The outdoor air temperature sections are 23, 30, 40, 50, 54, 58, 62, 66, 70, 72, 75, 79, 83, 87, 91, 93, 95, 99, 103, 106, 110, 115, 118, and 122 °FDB. The table also includes a 'Combination' column with percentage and °FDB values.

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

**RXYQ192PBYD**

Combination	Outdoor air temp.	Indoor air temp. °FWB																Combination	Outdoor air temp.	Indoor air temp. °FWB															
		57		61		64		67		70		72		75		57				61		64		67		70		72		75					
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI			TC	PI	TC	PI	TC	PI	TC	PI	TC	PI						
23	162	5.32	197	6.63	223	7.65	250	8.71	270	9.42	273	9.23	278	8.95	23	112	3.62	136	4.42	155	5.05	173	5.71	191	6.40	203	6.86	221	7.58						
30	162	5.49	197	6.84	223	7.91	250	9.00	264	9.33	267	9.14	272	8.86	30	112	3.73	136	4.55	155	5.21	173	5.90	191	6.61	203	7.09	221	7.83						
40	162	5.75	197	7.18	223	8.30	250	9.44	255	9.21	259	9.01	264	8.71	40	112	3.88	136	4.76	155	5.46	173	6.18	191	6.93	203	7.44	221	8.21						
50	162	6.03	197	7.55	223	8.73	242	9.36	247	9.07	250	8.96	255	8.54	50	112	4.06	136	4.99	155	5.73	173	6.49	191	7.28	203	7.82	221	8.64						
54	162	6.16	197	7.71	223	8.91	238	9.32	243	9.01	247	8.79	251	8.63	54	112	4.13	136	5.09	155	5.84	173	6.63	191	7.44	203	7.99	221	8.82						
58	162	6.29	197	7.87	223	9.10	235	9.27	240	9.06	243	9.11	248	9.17	58	112	4.21	136	5.19	155	5.96	173	6.77	191	7.59	203	8.16	221	9.01						
62	162	6.42	197	8.04	223	9.30	231	9.52	236	9.60	240	9.64	245	9.72	62	112	4.29	136	5.30	155	6.09	173	6.91	191	7.76	203	8.33	221	9.21						
66	162	6.56	197	8.29	223	9.97	228	10.1	233	10.1	236	10.2	241	10.3	66	112	4.38	136	5.41	155	6.22	173	7.07	191	7.93	203	8.67	221	9.86						
70	162	6.78	197	8.97	220	10.5	226	10.6	229	10.7	233	10.7	238	10.8	70	112	4.47	136	5.53	155	6.36	173	7.42	191	8.57	203	9.39	219	10.5						
72	162	7.04	197	9.33	218	10.8	223	10.9	228	10.9	231	11.0	236	11.1	72	112	4.52	136	5.59	155	6.60	173	7.71	191	8.91	203	9.76	217	10.8						
75	162	7.45	197	9.88	215	11.2	220	11.3	225	11.4	228	11.4	233	11.5	75	112	4.59	136	5.89	155	6.98	173	8.16	191	9.43	203	10.3	215	11.2						
79	162	8.01	197	10.6	212	11.7	217	11.8	222	11.9	225	12.0	230	12.1	79	112	4.93	136	6.33	155	7.51	173	8.79	191	10.2	203	11.1	211	11.7						
83	162	8.62	197	11.5	208	12.2	213	12.3	218	12.4	221	12.5	226	12.6	83	112	5.28	136	6.80	155	8.07	173	9.45	191	10.9	203	12.0	208	12.2						
87	162	9.25	197	12.3	205	12.8	210	12.9	215	13.0	218	13.1	223	13.2	87	112	5.65	136	7.29	155	8.66	173	10.2	191	11.8	201	12.7	204	12.8						
91	162	9.93	196	13.2	201	13.3	206	13.4	211	13.5	214	13.6	219	13.7	91	112	6.04	136	7.81	155	9.29	173	10.9	191	12.7	198	13.2	201	13.3						
93	162	10.3	195	13.5	203	13.6	205	13.7	209	13.8	213	13.9	215	14.0	93	112	6.24	136	8.08	155	9.62	173	11.3	191	13.1	196	13.5	199	13.6						
95	162	10.6	193	13.7	198	13.9	203	14.0	208	14.1	210	14.2	210	14.2	95	112	6.45	136	8.36	155	9.96	173	11.7	191	13.6	194	13.8	197	13.8						
99	162	11.4	189	14.3	194	14.4	199	14.5	202	14.6	202	14.6	202	14.6	99	112	6.89	136	8.95	155	10.7	173	12.6	188	14.2	191	14.3	194	14.4						
103	162	12.2	186	14.8	191	14.9	193	15.0	193	15.0	193	15.0	193	15.0	103	112	7.35	136	9.57	155	11.4	173	13.5	185	14.8	187	14.8	191	14.9						
106	162	13.1	183	15.4	187	15.5	187	15.5	187	15.5	187	15.5	187	15.5	106	112	7.83	136	10.2	155	12.2	173	14.4	182	15.4	185	15.5	187	15.5						
110	162	14.3	178	16.2	178	16.2	178	16.2	178	16.2	178	16.2	178	16.2	110	112	8.51	136	11.1	155	13.3	173	15.7	178	16.2	178	16.2	178	16.2						
115	154	16.3	154	16.4	154	16.4	155	16.4	155	16.4	155	16.4	155	16.5	115	112	9.44	136	12.4	154	16.4	155	16.4	155	16.4	155	16.4	155	16.5						
118	133	13.8	134	13.9	134	13.9	134	13.9	135	13.9	135	13.9	135	13.9	118	112	10.0	134	13.9	134	13.9	134	13.9	135	13.9	135	13.9	135	13.9						
122	107	10.5	107	10.5	107	10.5	108	10.5	108	10.6	108	10.6	108	10.6	122	107	10.5	107	10.5	107	10.5	108	10.5	108	10.6	108	10.6	108	10.6						
23	150	4.87	182	6.05	206	6.98	230	7.94	255	8.91	269	9.47	274	9.21	23	99.7	3.24	121	3.92	137	4.46	154	5.02	170	5.80	181	6.00	197	6.82						
30	150	5.02	182	6.25	206	7.21	230	8.20	255	9.21	263	9.39	268	9.13	30	99.7	3.33	121	4.03	137	4.59	154	5.17	170	5.78	181	6.20	197	6.83						
40	150	5.26	182	6.55	206	7.56	230	8.61	251	9.44	254	9.26	259	8.99	40	99.7	3.46	121	4.21	137	4.80	154	5.42	170	6.06	181	6.50	197	7.17						
50	150	5.52	182	6.88	206	7.95	230	9.05	243	9.32	246	9.13	250	8.84	50	99.7	3.61	121	4.40	137	5.03	154	5.69	170	6.36	181	6.83	197	7.54						
54	150	5.63	182	7.03	206	8.12	230	9.24	239	9.26	242	9.07	247	8.77	54	99.7	3.67	121	4.48	137	5.13	154	5.80	170	6.50	181	6.97	197	7.70						
58	150	5.74	182	7.18	206	8.30	230	9.44	236	9.21	239	9.05	243	9.11	58	99.7	3.74	121	4.57	137	5.23	154	5.92	170	6.63	181	7.12	197	7.86						
62	150	5.87	182	7.33	206	8.48	228	9.47	232	9.54	235	9.58	240	9.65	62	99.7	3.81	121	4.66	137	5.34	154	6.05	170	6.78	181	7.27	197	8.03						
66	150	5.99	182	7.50	206	8.67	224	9.99	229	10.1	232	10.1	236	10.2	66	99.7	3.88	121	4.76	137	5.45	154	6.18	170	6.92	181	7.43	197	8.28						
70	150	6.12	182	7.98	206	9.59	221	10.5	225	10.6	228	10.7	233	10.7	70	99.7	3.96	121	4.86	137	5.57	154	6.31	170	7.24	181	7.90	197	8.55						
72	150	6.31	182	8.30	206	9.97	219	10.9	224	10.9	227	10.9	231	11.0	72	99.7	4.00	121	4.91	137	5.63	154	6.54	170	7.52	181	8.21	197	9.31						
75	150	6.67	182	8.78	206	10.6	217	11.2	221	11.3	224	11.3	229	11.4	75	99.7	4.06	121	5.06	137	5.95	154	6.92	170	7.96	181	8.69	197	9.86						
79	150	7.17	182	9.46	206	11.4	213	11.7	218	11.8	221	11.9	225	12.0	79	99.7	4.28	121	5.43	137	6.40	154	7.42	170	8.57	181	9.36	197	10.6						
83	150	7.70	182	10.2	205	12.2	210	12.3	214	12.4	217	12.4	222	12.5	83	99.7	4.58	121	5.83	137	6.87	154	8.00	170	9.21	181	10.1	197	11.4						
87	150	8.27	182	10.9	202	12.7	206	12.8	211	12.9	214	13.0	218	13.1	87	99.7	4.89	121	6.24	137	7.36	154	8.58	170	9.90	181	10.8	197	12.3						
91	150	8.86	182	11.8	198	13.2	203	13.3	207	13.5	210	13.5	215	13.6	91	99.7	5.22	121	6.68	137	7.89	154	9.21	170	10.6	181	11.6	196	13.2						
93	150	9.18	182	12.2	196	13.5	201	13.6	205	13.7	208	13.8	213	13.9	93	99.7	5.39	121	6.90	137	8.16	154	9.53	170	11.0	181	12.1	195	13.5						
95	150	9.50	182	12.6	195	13.8	199	13.9	204	14.0	207	14.1	210	14.2	95	99.7	5.57	121	7.14	137	8.45	154	9.87	170	11.4	181	12.5	195	13.7						
99	150	10.2	182	13.5	191	14.3	196	14.4	200	14.6	202	14.6	202	14.6	99	99.7	5.94	121	7.63	137	9.04	154	10.6	170	12.2	181	13.4	189	14.3						
103	150	10.9	182	14.5	188	14.9	192	15.0	193	15.0	193	15.0	193	15.0	103	99.7	6.33	121	8.15	137	9.67	154	11.3	170	13.1	181	14.4	186	14.8						
106	150	11.6	181	15.3	185	15.5	187	15.5	187	15.5	187	15.5	187	15.5	106	99.7	6.73	121	8.68	137	10.3	154	12.1	170	14.0	180	15.3	183	15.4						
110	150	12.7	177	16.2	178	16.2	178	16.2	178	16.2	178	16.2	178	16.2	110	99.7	7.31	121	9.45	137	11.2	154	13.2	170	15.3	177	16.2	178	16.2						
115	150	14.1	154	16.4	154	16.4																													

RXYQ216PBYD

Capacity tables for RXYQ216PBYD heat pump. The table is organized into four main sections based on indoor air temperature (°FWB) and outdoor air temperature (°FDB). Each section contains a grid of capacity (TC) and power input (PI) values for various indoor and outdoor conditions. The conditions are defined by indoor air temperature (57, 61, 64, 67, 70, 72, 75 °FWB) and outdoor air temperature (23, 30, 40, 50, 54, 58, 62, 66, 70, 72, 75, 79, 83, 87, 91, 93, 95, 99, 103, 106, 110, 115, 118, 122 °FDB). The table includes data for four different capacity and power input configurations: 1) TC (kW), PI (kW); 2) TC (MBH), PI (kW); 3) TC (kW), PI (MBH); 4) TC (MBH), PI (MBH). The values represent the average performance under the specified conditions.

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.



RXYQ240PBYD

Main capacity table with columns for Combination, Outdoor air temp., Indoor air temp. °FWB, and various capacity metrics (MBH, kW, etc.) for different indoor air temperatures (57, 61, 64, 67, 70, 72, 75).

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: [shaded] is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

RXYQ264PBYD

Capacity tables for RXYQ264PBYD heat pump, showing performance metrics (Capacity, Power Input) for indoor air temperatures from 57°F to 75°F across various combinations of indoor and outdoor air temperatures.

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

RXYQ288PBYD

Capacity tables for RXYQ288PBYD heat pump. The table is organized into four main sections: 130, 120, 110, and 100. Each section contains two tables: one for indoor air temp. °FWB and one for indoor air temp. °FWB. Each table has columns for outdoor air temp. (°FDB, °FDB, °FDB) and indoor air temp. (°FDB, °FDB, °FDB) for various indoor conditions (57, 61, 64, 67, 70, 72, 75). Rows represent different combinations of indoor and outdoor air temperatures, with values for Total Capacity (TC), Power Input (PI), and Total Capacity (TC).

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

RXYQ312PBYD

Large table with columns for Outdoor air temp., Indoor air temp. °FWB, and Capacity Tables. Includes sub-headers for TC, PI, MBH, KW and rows for different indoor air temperatures (57, 61, 64, 67, 70, 72, 75) and outdoor air temperatures (23 to 122).

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

**RXYQ336PBYD**

Combination	Outdoor air temp.	Indoor air temp. °FWB																				Combination	Outdoor air temp.	Indoor air temp. °FWB																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																		
		57				61				64				67				70						72				75				57				61				64				67				70				72				75																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																		
		TC	PI	TCH	PIH	TC	PI	TCH	PIH	TC	PI	TCH	PIH	TC	PI	TCH	PIH	TC	PI	TCH	PIH			TC	PI	TCH	PIH	TC	PI	TCH	PIH	TC	PI	TCH	PIH	TC	PI	TCH	PIH	TC	PI	TCH	PIH	TC	PI	TCH	PIH																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																											
23	283	9.75	345	12.5	391	14.0	437	16.0	473	17.3	479	16.9	487	16.4	23	196	6.65	239	8.11	271	9.27	302	10.5	334	11.7	355	13.0	387	14.4	23	196	6.65	239	8.11	271	9.27	302	10.5	334	11.7	355	13.0	387	14.4	30	196	6.83	239	8.35	271	9.56	302	10.8	334	12.1	355	13.6	387	14.9	30	196	6.83	239	8.35	271	9.56	302	10.8	334	12.1	355	13.6	387	14.9	40	196	7.12	239	8.73	271	10.0	302	11.3	334	12.7	355	14.6	387	15.1	40	196	7.12	239	8.73	271	10.0	302	11.3	334	12.7	355	14.6	387	15.1	50	196	7.44	239	9.15	271	10.5	302	11.9	334	13.4	355	15.3	387	15.8	50	196	7.44	239	9.15	271	10.5	302	11.9	334	13.4	355	15.3	387	15.8	54	196	7.58	239	9.33	271	10.7	302	12.2	334	13.6	355	14.6	387	16.2	54	196	7.58	239	9.33	271	10.7	302	12.2	334	13.6	355	14.6	387	16.2	58	196	7.72	239	9.52	271	10.9	302	12.4	334	13.9	355	15.0	387	16.5	58	196	7.72	239	9.52	271	10.9	302	12.4	334	13.9	355	15.0	387	16.5	62	196	7.87	239	9.71	271	11.2	302	12.7	334	14.2	355	15.3	387	16.9	62	196	7.87	239	9.71	271	11.2	302	12.7	334	14.2	355	15.3	387	16.9	66	196	8.03	239	9.92	271	11.4	302	13.0	334	14.5	355	15.9	387	18.1	66	196	8.03	239	9.92	271	11.4	302	13.0	334	14.5	355	15.9	387	18.1	70	196	8.20	239	10.1	271	11.7	302	13.6	334	15.7	355	17.2	384	19.2	70	196	8.20	239	10.1	271	11.7	302	13.6	334	15.7	355	17.2	384	19.2	72	196	8.28	239	10.2	271	12.1	302	14.1	334	16.3	355	17.9	381	19.7	72	196	8.28	239	10.2	271	12.1	302	14.1	334	16.3	355	17.9	381	19.7	75	196	8.42	239	10.8	271	12.8	302	15.0	334	17.3	355	19.0	376	20.5	75	196	8.42	239	10.8	271	12.8	302	15.0	334	17.3	355	19.0	376	20.5	79	196	9.03	239	11.6	271	13.8	302	16.1	334	18.6	355	20.4	370	21.4	79	196	9.03	239	11.6	271	13.8	302	16.1	334	18.6	355	20.4	370	21.4	83	196	9.68	239	12.5	271	14.8	302	17.3	334	20.1	355	22.0	364	22.4	83	196	9.68	239	12.5	271	14.8	302	17.3	334	20.1	355	22.0	364	22.4	87	196	10.4	239	13.4	271	15.9	302	18.6	334	21.6	352	23.3	358	24.0	87	196	10.4	239	13.4	271	15.9	302	18.6	334	21.6	352	23.3	358	24.0	91	196	11.1	239	14.3	271	17.0	302	20.0	334	23.2	346	24.2	352	24.4	91	196	11.1	239	14.3	271	17.0	302	20.0	334	23.2	346	24.2	352	24.4	93	196	11.4	239	14.8	271	17.6	302	20.7	334	24.0	343	24.7	349	24.9	93	196	11.4	239	14.8	271	17.6	302	20.7	334	24.0	343	24.7	349	24.9	95	196	11.8	239	15.3	271	18.3	302	21.5	334	24.9	340	25.2	346	25.4	95	196	11.8	239	15.3	271	18.3	302	21.5	334	24.9	340	25.2	346	25.4	99	196	12.6	239	16.4	271	19.6	302	23.0	330	26.1	334	26.2	340	26.4	99	196	12.6	239	16.4	271	19.6	302	23.0	330	26.1	334	26.2	340	26.4	103	196	13.4	239	17.5	271	21.0	302	24.7	324	27.1	328	27.2	333	27.4	103	196	13.4	239	17.5	271	21.0	302	24.7	324	27.1	328	27.2	333	27.4	106	196	14.5	239	18.7	271	22.4	302	26.4	319	28.2	323	28.3	327	28.5	106	196	14.5	239	18.7	271	22.4	302	26.4	319	28.2	323	28.3	327	28.5	110	196	15.6	239	20.4	271	24.4	302	28.8	312	29.8	312	29.8	312	29.8	110	196	15.6	239	20.4	271	24.4	302	28.8	312	29.8	312	29.8	312	29.8	115	196	17.1	239	22.7	270	27.0	301	31.1	272	30.2	272	30.2	272	30.2	115	196	17.1	239	22.7	270	27.0	301	31.1	272	30.2	272	30.2	272	30.2	118	196	18.4	234	25.4	235	25.5	236	25.5	236	25.5	236	25.5	237	25.6	118	196	18.4	234	25.4	235	25.5	236	25.5	236	25.5	236	25.5	237	25.6	122	186	19.2	187	19.3	188	19.3	189	19.4	189	19.4	190	19.4	122	186	19.2	187	19.3	188	19.3	189	19.4	189	19.4	190	19.4

TC: Total capacity ; MBH  
 PI: Power Input ; kW (Comp.+Outdoor fan motor)  
 Note1: █ is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

RXYQ360PBYD

Large data table with columns for Indoor air temp. °FWB (57, 61, 64, 67, 70, 72, 75) and Outdoor air temp. (23, 30, 40, 50, 54, 58, 62, 66, 70, 72, 75, 79, 83, 87, 91, 93, 95, 99, 103, 106, 110, 115, 118, 122). Rows are grouped by Combi-nation (130, 120, 110, 100) and Outdoor air temp. (23, 30, 40, 50, 54, 58, 62, 66, 70, 72, 75, 79, 83, 87, 91, 93, 95, 99, 103, 106, 110, 115, 118, 122).

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.



RXYQ96PBYD

Capacity tables for RXYQ96PBYD heat pump. The table is organized into four main sections based on indoor air temperature (°FDB) and outdoor air temperature (°FDB and °FWB). Each section contains a grid of TC (Total Capacity) and PI (Power Input) values for various combinations of indoor and outdoor temperatures. The indoor air temperature ranges from 61°F to 75°F, and the outdoor air temperature ranges from -3.64°F to 60°F. The table is divided into four quadrants: 130, 120, 110, and 100, representing different capacity levels.

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.



RXYQ120PBYD

Main capacity table with columns for Combination, Outdoor air temp., Indoor air temp. (°FDB) and rows for 130, 120, 110, and 100 MBH.

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

**RXYQ144PBYD**

Combination	Outdoor air temp.		Indoor air temp. °FDB														Combination	Outdoor air temp.		Indoor air temp. °FDB																																						
			61				65				68				72					75				61				65				68				72				75																		
			TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI				MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW																	
130	%	°FDB	°FWB	TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW							
		-3.64	-4.0	111	9.48	111	10.2	110	10.7	110	11.0	110	11.4	110	11.9	110	12.0	109	12.8	109	13.3	108	13.6	108	13.9	108	14.1	108	14.5	108	14.8	108	14.8	108	15.1	107	15.3	107	15.5	107	15.5	107	15.6	107	15.7	107	15.8	107	15.9	107	16.0	107	16.0	107	16.1	107	16.1	107

TC: Total capacity ; MBH  
 PI: Power Input ; kW (Comp.+Outdoor fan motor)  
 Note1: [Shaded Cell] is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

**RXYQ168PBYD**

Combi- nation	Outdoor air temp.		Indoor air temp. °FDB																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																						
			61				65				68				72				75																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																						
			TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW	TC	PI	MBH	KW																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																			
130	%	*FDB	*FWB	-3.64	-4.0	128	11.0	128	11.8	127	12.4	127	12.8	127	13.2	127	13.8	-3.64	-4.0	126	14.8	126	15.4	125	15.8	125	16.1	125	16.4	125	16.8	-1.84	-2.2	131	11.2	130	12.0	129	13.0	129	13.4	129	13.9	5.5	5.0	141	12.2	141	12.9	140	13.5	140	13.8	140	14.2	139	14.7	9.5	8.5	145	12.7	147	13.4	146	13.9	146	14.3	146	14.6	145	15.1	13.0	12.0	154	13.2	153	13.9	153	14.4	152	14.7	152	15.0	152	15.5	15.0	14.0	158	13.5	157	14.1	157	14.6	156	14.9	156	15.3	156	15.7	17.0	15.5	161	13.7	160	14.3	160	14.8	160	15.1	159	15.4	159	15.9	19.0	18.0	166	14.0	166	14.7	165	15.1	165	15.4	165	15.7	164	16.2	22.0	20.0	171	14.3	170	14.9	170	15.4	170	15.7	169	16.0	169	16.4	30.0	28.0	181	14.9	180	15.4	180	15.8	179	16.1	179	16.4	179	16.8	35.0	32.0	202	15.9	202	16.4	201	16.8	201	17.0	201	17.3	201	17.6	39.0	36.0	214	16.4	214	16.8	214	17.2	213	17.4	213	17.7	213	18.0	44.0	40.0	227	16.8	227	17.3	226	17.5	226	17.8	226	18.0	222	17.9	47.0	43.0	237	17.1	237	17.6	236	17.9	236	18.1	235	18.2	222	16.9	51.0	47.0	251	17.5	251	17.9	251	18.2	244	17.7	235	16.9	222	15.7	54.0	50.0	263	17.8	262	18.2	253	17.6	244	16.8	235	16.0	222	14.9	57.0	53.0	274	18.1	267	17.7	253	16.6	244	15.9	235	15.2	222	14.1	60.0	56.0	285	18.2	267	16.8	253	15.8	244	15.1	235	14.4	222	13.4	-3.64	-4.0	128	11.9	127	12.7	127	13.2	127	13.6	126	14.0	126	14.5	-1.84	-2.2	130	12.1	130	12.9	129	13.4	129	13.8	129	14.1	128	14.7	5.5	5.0	140	13.1	140	13.7	140	14.2	139	14.6	139	14.9	139	15.4	9.5	8.5	145	13.5	145	14.2	145	14.7	145	15.0	145	15.3	145	15.8	13.0	12.0	153	14.0	153	14.6	152	15.1	152	15.4	152	15.7	151	16.1	15.0	14.0	157	14.3	157	14.9	156	15.3	156	15.6	156	15.9	155	16.4	17.0	15.5	160	14.5	160	15.0	159	15.5	159	15.8	159	16.1	159	16.5	19.0	18.0	166	14.8	165	15.3	165	15.8	165	16.1	164	16.3	164	16.8	22.0	20.0	170	15.0	170	15.6	169	16.0	169	16.3	169	16.6	169	17.0	30.0	28.0	180	15.0	175	16.1	179	16.5	179	16.7	179	16.7	179	17.0	35.0	32.0	190	16.0	190	16.5	190	16.9	189	17.1	189	17.4	189	17.7	39.0	36.0	202	16.5	201	17.0	201	17.3	201	17.5	200	17.8	200	18.0	44.0	40.0	214	16.9	213	17.4	213	17.7	213	17.9	213	18.1	205	17.4	47.0	43.0	227	17.3	226	17.8	226	18.1	226	18.3	217	17.4	205	16.2	51.0	47.0	241	17.7	236	18.0	234	18.1	226	17.3	217	16.5	205	15.3	54.0	50.0	251	18.0	246	17.9	234	16.8	226	16.1	217	15.3	205	14.3	57.0	53.0	263	18.3	246	17.0	234	15.9	226	15.2	217	14.5	205	13.5	60.0	56.0	283	17.4	246	16.1	234	15.1	226	14.4	217	13.8	205	12.8	-3.64	-4.0	127	12.9	127	13.6	126	14.1	126	14.4	126	14.8	126	15.3	-1.84	-2.2	129	13.1	129	13.8	128	14.3	128	14.6	128	14.9	128	15.4	5.5	5.0	140	13.9	139	14.6	139	15.0	139	15.3	139	15.6	138	16.1	9.5	8.5	145	14.0	145	14.5	145	15.0	145	15.5	145	16.0	144	16.4	13.0	12.0	152	14.4	152	15.0	151	15.5	151	16.0	151	16.5	151	17.0	15.0	14.0	156	15.0	156	15.6	156	16.0	155	16.3	155	16.5	155	17.0	17.0	15.5	160	15.2	159	15.8	159	16.2	159	16.6	158	17.1	19.0	18.0	165	15.5	165	16.0	164	16.4	164	16.7	164	17.0	164	17.3	22.0	20.0	170	15.8	169	16.3	169	16.6	169	16.9	168	17.1	168	17.5	30.0	28.0	179	16.2	179	16.7	179	17.1	178	17.3	178	17.5	178	17.9	35.0	32.0	190	16.7	189	17.1	189	17.5	189	17.9	188	18.1	188	18.4	39.0	36.0	201	17.1	201	17.5	200	17.8	200	18.0	199	18.1	188	16.8	44.0	40.0	213	17.5	213	17.9	212	18.2	207	17.6	199	16.8	188	15.6	47.0	43.0	226	17.9	226	18.3	214	17.1	207	16.4	199	15.6	188	14.6	51.0	47.0	241	18.2	226	17.3	214	16.2	207	15.5	199	14.8	188	13.8	54.0	50.0	251	18.5	226	16.5	214	15.3	207	13.7	199	13.1	188	12.2	57.0	53.0	263	18.8	226	15.2	214	14.3	207	13.0	199	12.4	188	11.6	60.0	56.0	281	14.8	226	13.7	214	12.9	207	12.4	199	11.8	188	11.0	-3.64	-4.0	124	13.9	124	14.5	126	14.9	126	15.3	125	15.6	125	16.0	-1.84	-2.2	129	14.1	128	14.7	128	15.1	128	15.4	128	15.7	127	16.2	5.5	5.0	139	14.8	139	15.4	139	15.8	138	16.1	138	16.4	138	16.8	9.5	8.5	145	15.2	145	15.7	145	16.2	144	16.4	144	16.7	144	17.1	13.0	12.0	152	15.6	151	16.1	151	16.5	151	16.9	151	17.2	154	17.6	15.0	14.0	156	15.8	155	16.3	155	16.7	155	17.0	17.0	15.5	160	15.9	158	16.5	158	16.8	158	17.1	158	17.3	158	17.7	19.0	18.0	164	16.3	164	16.7	164	17.1	164	17.3	164	17.6	163	17.9	22.0	20.0	169	16.5	169	16.9	168	17.3	168	17.5	168	17.7	168	18.1	30.0	28.0	181	17.3	181	17.7	181	18.0	180	18.2	181	18.3	171	16.1	35.0	32.0	201	17.7	200	18.1	195	17.7	188	16.9	181	16.7	171	15.0	39.0	36.0	213	18.1	205	17.5	195	16.4	188	15.7	181	15.0	171	13.9	44.0	40.0	219	17.6	205	16.2	195	15.2	188	14.6	181	13.9	171	13.0	47.0	43.0	236	18.2	226	17.3	214	16.2	207	15.5	199	14.8	188	13.8	51.0	47.0	249	18.5	205	14.3	195	13.5	188	12.9	181	12.3	171	11.5	54.0	50.0	259	14.7	205	13.6	195	12.8	188	12.2	181	11.7	171	10.9	57.0	53.0	271	13.9	205	12.9	195	12.1	188	11.6	181	11.1	171	10.4	60.0	56.0	289	13.2	205	12.3	195	11.5	188	11.1	181	10.6	171	9.9

TC: Total capacity ; MBH  
 PI: Power Input ; kW (Comp.+Outdoor fan motor)  
 Note1:  is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

RXYQ192PBYD

Capacity tables for RXYQ192PBYD heat pump. The table is organized into three main sections for capacity ratings of 130, 120, and 110 MBH. Each section contains a grid of data for different outdoor air temperatures (from -3.64 to 60.0 °F) and indoor air temperatures (61, 65, 68, 70, 72, 75 °F). The grid columns are labeled with TC (Total Capacity) and PI (Power Input) in MBH and kW. The rows are labeled with % (Efficiency) and Outdoor air temp. (°F and °C).

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

RXYQ216PBYD

Main data table with columns for Combi-nation, Outdoor air temp., Indoor air temp. °FDB, and various capacity/Power Input values. Includes sub-sections for 130, 120, 110, and 100.

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.
Note2: The above table shows the average value of conditions which may occur.

RXYQ240PBYD

Main capacity table with columns for Combination, Outdoor air temp., Indoor air temp. °FDB, and Capacity (TC, PI) for various conditions (61, 65, 68, 70, 72, 75).

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.
Note2: The above table shows the average value of conditions which may occur.

**RXYQ264PBYD**

Combination	Outdoor air temp.	Indoor air temp. °FDB												
		61		65		68		70		72		75		
%	*FDB *FWB	TC MBH	PI kW	TC MBH	PI kW	TC MBH	PI kW	TC MBH	PI kW	TC MBH	PI kW	TC MBH	PI kW	
130	-3.64	-4.0	201	17.0	200	18.3	200	19.2	199	19.9	199	20.5	199	21.4
	-1.84	-2.2	205	17.4	204	18.6	203	19.5	203	20.2	203	20.8	202	21.7
	5.5	5.0	221	18.9	220	20.1	220	20.8	219	21.5	219	22.1	218	22.9
	9.5	8.5	230	19.7	230	20.9	229	21.6	229	22.2	228	22.7	228	23.5
	13.0	12.0	241	20.5	240	21.5	239	22.3	239	22.8	239	23.4	238	24.2
	15.0	14.0	247	20.9	246	21.9	246	22.7	245	23.2	245	23.7	244	24.5
	17.0	15.5	252	21.3	251	22.3	251	23.0	250	23.5	250	24.0	249	24.8
	19.0	18.0	261	21.8	260	22.8	259	23.5	259	24.0	258	24.5	258	25.2
	22.0	20.0	268	22.2	267	23.2	266	23.9	266	24.4	266	24.8	265	25.5
	30.0	24.0	283	23.1	282	24.0	282	24.6	281	25.1	281	25.5	280	26.2
	35.0	32.0	317	24.7	316	25.4	316	26.0	315	26.4	315	26.8	314	27.4
120	-3.64	-4.0	200	18.5	200	19.7	199	20.6	199	21.2	198	21.8	198	22.6
	-1.84	-2.2	204	18.9	203	20.0	203	20.9	202	21.5	202	22.0	201	22.9
	5.5	5.0	220	20.3	219	21.4	219	22.2	219	22.7	218	23.2	218	24.0
	9.5	8.5	230	21.0	229	22.0	228	22.8	228	23.3	228	23.8	227	24.6
	13.0	12.0	240	21.8	239	22.7	239	23.4	238	23.9	238	24.4	237	25.1
	15.0	14.0	246	22.2	245	23.1	245	23.8	244	24.3	244	24.8	244	25.5
	17.0	15.5	251	22.5	250	23.4	250	24.1	249	24.6	249	25.0	249	25.7
	19.0	18.0	260	23.0	259	23.9	258	24.5	258	25.0	258	25.4	257	26.1
	22.0	20.0	267	23.4	266	24.2	266	24.9	265	25.3	265	25.8	264	26.4
	30.0	24.0	282	24.2	281	25.0	281	25.6	280	26.0	280	26.4	280	27.0
	35.0	32.0	299	24.9	298	25.7	297	26.3	297	26.6	297	27.0	296	27.6
110	-3.64	-4.0	199	20.1	199	21.1	198	22.0	198	22.5	198	23.0	197	23.8
	-1.84	-2.2	203	20.4	202	21.4	202	22.2	201	22.8	201	23.3	201	24.1
	5.5	5.0	219	21.7	219	22.7	218	23.4	218	23.9	217	24.4	217	25.1
	9.5	8.5	229	22.4	228	23.3	227	24.0	227	24.5	227	24.9	226	25.6
	13.0	12.0	239	23.0	238	23.9	238	24.6	237	25.0	237	25.5	237	26.1
	15.0	14.0	245	23.4	245	24.3	244	24.9	244	25.4	243	25.8	243	26.4
	17.0	15.5	250	23.7	249	24.5	249	25.2	249	25.6	248	26.0	248	26.7
	19.0	18.0	259	24.2	258	25.0	258	25.6	257	26.0	257	26.4	256	27.0
	22.0	20.0	266	24.5	265	25.3	265	25.9	264	26.3	264	26.7	264	27.3
	30.0	24.0	281	25.2	280	26.0	280	26.5	280	26.9	279	27.3	279	27.9
	35.0	32.0	315	26.6	315	27.2	314	27.7	314	28.1	313	28.4	296	28.5
100	-3.64	-4.0	198	21.6	198	22.6	197	23.3	197	23.8	197	24.3	196	25.0
	-1.84	-2.2	202	21.9	201	22.9	201	23.6	201	24.0	200	24.5	200	25.2
	5.5	5.0	218	23.1	218	24.0	217	24.6	217	25.1	217	25.5	216	26.2
	9.5	8.5	228	23.7	227	24.5	227	25.2	226	25.6	226	26.0	226	26.7
	13.0	12.0	238	24.3	237	25.1	237	25.7	237	26.1	236	26.5	236	27.1
	15.0	14.0	244	24.6	244	25.4	243	26.0	243	26.4	243	26.8	242	27.4
	17.0	15.5	249	24.9	249	25.7	248	26.2	248	26.6	247	27.0	247	27.6
	19.0	18.0	258	25.3	257	26.1	257	26.6	256	27.0	256	27.4	256	27.9
	22.0	20.0	265	25.7	264	26.4	264	26.9	264	27.3	263	27.6	263	28.2
	30.0	24.0	280	26.3	280	27.0	279	27.5	279	27.8	279	28.2	279	28.7
	35.0	32.0	297	26.9	296	27.6	296	28.1	295	28.4	286	27.3	270	28.4

TC: Total capacity ; MBH  
 PI: Power Input ; kW (Comp.+Outdoor fan motor)  
 Note1: **█** is shown as reference.  
 Note2: The above table shows the average value of conditions which may occur.

RXYQ288PBYD

Table with columns for Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and Capacity (TC, PI) in MBH and kW. Includes rows for 130, 120, 110, and 100 capacity units.

Table with columns for Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and Capacity (TC, PI) in MBH and kW. Includes rows for 90, 80, 70, and 60 capacity units.

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.



**RXYQ312PBYD**

Combi- nation	Outdoor air temp.		Indoor air temp. °FDB															
			61		65		68		70		72		75					
			TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI				
	%	*FDB	*FWB	MBH	KW	MBH	KW	MBH	KW	MBH	KW	MBH	KW	MBH	KW	MBH	KW	
130	-3.64	-4.0	222	16.6	221	18.1	220	19.3	220	20.0	219	20.8	218	22.0				
	-1.84	-2.2	226	17.1	225	18.6	224	19.7	223	20.4	223	21.2	222	22.3				
	5.5	5.0	244	18.9	243	20.3	242	21.3	241	22.0	241	22.7	240	23.7				
	9.5	8.5	254	19.9	253	21.2	252	22.2	252	22.8	251	23.5	251	24.5				
	13.0	12.0	265	20.8	264	22.1	263	23.0	263	23.6	263	24.3	262	25.2				
	15.0	14.0	272	21.3	271	22.6	270	23.5	270	24.1	269	24.7	269	25.6				
	17.0	15.5	277	21.7	276	22.9	276	23.8	275	24.4	275	25.0	274	25.9				
	19.0	18.0	287	22.4	286	23.6	285	24.4	285	25.0	284	25.6	284	26.5				
	22.0	20.0	295	23.0	294	24.0	293	24.9	293	25.4	292	26.0	291	26.9				
	30.0	24.0	311	23.9	311	25.0	310	25.8	309	26.3	309	26.8	308	27.6				
	35.0	32.0	349	25.8	348	26.8	347	27.5	347	27.9	346	28.4	346	29.1				
	39.0	36.0	370	26.7	369	27.6	368	28.2	368	28.7	367	29.1	366	29.8				
44.0	40.0	392	27.5	391	28.4	390	29.0	390	29.4	389	29.8	388	30.5					
47.0	43.0	409	28.1	408	28.9	407	29.5	407	29.9	407	30.3	406	30.9					
51.0	47.0	433	28.8	432	29.6	432	30.2	431	30.5	431	30.9	414	29.7					
54.0	50.0	452	29.4	452	30.1	451	30.6	450	31.0	439	30.2	414	28.1					
57.0	53.0	472	29.9	471	30.6	471	31.1	456	30.0	439	28.6	414	26.6					
60.0	56.0	493	30.3	492	31.0	473	29.7	456	28.4	439	27.1	414	25.3					
-3.64	-4.0	221	18.5	220	19.9	219	20.9	219	21.6	218	22.3	218	23.4					
-1.84	-2.2	224	18.9	224	20.3	223	21.3	223	22.0	222	22.7	221	23.7					
5.5	5.0	242	20.6	242	21.9	241	22.8	240	23.5	240	24.1	239	25.0					
9.5	8.5	253	21.5	252	22.7	251	23.6	251	24.2	250	24.8	250	25.7					
13.0	12.0	264	22.3	263	23.5	262	24.4	262	24.9	262	25.5	261	26.4					
15.0	14.0	271	22.8	270	24.0	269	24.8	269	25.4	269	25.9	268	26.8					
17.0	15.5	276	23.2	275	24.3	275	25.1	274	25.7	274	26.2	273	27.1					
19.0	18.0	286	23.8	285	24.9	284	25.7	284	26.2	283	26.7	283	27.5					
22.0	20.0	294	24.3	293	25.3	292	26.1	292	26.6	291	27.1	291	27.9					
30.0	24.0	310	25.2	309	26.2	309	26.9	308	27.4	308	27.9	307	28.6					
35.0	32.0	328	26.1	328	27.0	327	27.7	326	28.2	326	28.7	325	29.3					
39.0	36.0	348	27.0	347	27.8	346	28.5	346	28.9	345	29.4	345	30.0					
44.0	40.0	369	27.8	368	28.6	367	29.2	367	29.6	366	30.0	366	30.6					
47.0	43.0	389	28.5	389	29.3	388	29.9	388	30.3	388	30.7	387	31.2					
51.0	47.0	408	29.1	407	29.8	406	30.4	406	30.7	406	31.1	382	28.9					
54.0	50.0	432	29.8	431	30.5	431	31.0	421	30.3	406	28.9	382	26.9					
57.0	53.0	451	30.2	451	30.9	437	30.0	421	28.7	406	27.4	382	25.5					
60.0	56.0	471	30.7	460	30.3	437	28.4	421	27.2	406	26.0	382	24.0					
60.0	56.0	491	31.1	460	28.7	437	26.9	421	25.8	406	24.7	382	23.0					

Combi- nation	Outdoor air temp.		Indoor air temp. °FDB															
			61		65		68		70		72		75					
			TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI				
	%	*FDB	*FWB	MBH	KW	MBH	KW	MBH	KW	MBH	KW	MBH	KW	MBH	KW	MBH	KW	
90	-3.64	-4.0	217	24.0	217	25.1	216	25.8	216	26.4	215	27.5	215	28.0				
	-1.84	-2.2	221	24.3	220	25.3	220	26.1	220	26.6	219	27.2	219	27.7				
	5.5	5.0	239	25.6	238	26.6	238	27.3	238	27.7	237	28.3	237	28.9				
	9.5	8.5	249	26.3	249	27.2	248	27.9	248	28.3	247	28.9	247	29.7				
	13.0	12.0	261	26.9	260	27.8	259	28.4	259	28.9	258	29.4	258	30.0				
	15.0	14.0	268	27.3	267	28.1	266	28.8	266	29.2	265	29.6	265	30.3				
	17.0	15.5	273	27.6	272	28.4	272	28.8	271	29.2	271	29.4	271	29.8				
	19.0	18.0	282	28.0	282	28.8	281	29.4	281	29.8	281	29.8	281	30.2				
	22.0	20.0	290	28.4	290	29.2	289	29.2	289	29.2	289	30.1	288	30.8				
	30.0	24.0	307	29.1	306	29.8	306	30.4	306	30.4	306	30.7	304	30.9				
	35.0	32.0	325	29.8	324	30.4	324	31.0	316	30.1	316	30.1	304	28.8				
	39.0	36.0	344	30.4	344	31.1	328	29.3	316	28.0	304	26.8	287	25.0				
44.0	40.0	365	31.0	345	29.0	328	27.2	316	26.1	304	24.9	287	23.3					
47.0	43.0	369	29.2	345	27.0	328	25.4	316	24.3	304	23.2	287	21.7					
51.0	47.0	369	27.7	345	25.6	328	24.1	316	23.0	304	22.1	287	20.6					
54.0	50.0	369	25.8	345	23.8	328	22.4	316	21.5	304	20.6	287	19.3					
57.0	53.0	369	24.4	345	22.6	328	21.3	316	20.5	304	19.6	287	18.3					
60.0	56.0	369	23.2	345	21.5	328	20.3	316	19.5	304	18.7	287	17.5					
60.0	56.0	369	22.1	345	20.5	328	19.3	316	18.5	304	17.8	287	16.7					
-3.64	-4.0	216	25.9	216	26.8	215	27.5	215	28.0	215	28.4	214	29.1					
-1.84	-2.2	220	26.1	219	27.0	219	27.7	219	28.2	218	28.7	218	29.3					
5.5	5.0	238	27.3	237	28.1	237	28.8	237	29.2	236	29.6	236	30.2					
9.5	8.5	248	27.9	248	28.7	247	29.3	247	29.7	247	30.1	246	30.7					
13.0	12.0	259	28.4	259	29.2	258	29.8	258	30.2	258	30.6	256	30.6					
15.0	14.0	266	28.8	266	29.5	265	30.1	265	30.5	265	30.8	265	31.2					
17.0	15.5	272	29.0	271	29.8	271	30.3	271	30.7	271	31.0	270	31.4					
19.0	18.0	281	29.4	281	30.1	280	30.7	280	31.0	280	31.3	280	31.7					
22.0	20.0	289	29.7	288	30.4	288	31.0	281	30.1	281	30.7	280	31.1					
30.0	24.0	306	30.4	305	31.0	291	29.3	281	28.1	270	26.8	255	25.0					
35.0	32.0	324	31.0	307	29.1	291	27.3	281	26.1	270	25.0	255	23.8					
39.0	36.0	328	29.3	307	27.1	291	25.4	281	24.4	270	23.3	255	21.3					
44.0	40.0	328	27.2	307	25.2	291	23.7	281	22.7	270	21.7	255	20.3					
47.0	43.0	328	24.0	307	22.3	291	21.0	281	20.1	270	19.3	255	18.1					
51.0	47.0	328	22.4	307	20.8	291	19.6	281	18.8	270	18.1	255	16.9					
54.0	50.0	328	21.3	307	19.8	291	18.7	281	17.9	270	17.2	255	16.1					
57.0	53.0	328	20.3	307	18.8	291	17.8	281	17.1	270	16.4	255	15.4					
60.0	56.0	328	19.3	307	17.9	291	17.0	281	16.3	270	15.7	255	14.7					
-3.64	-4.0	215	27.7	215	28.5	214	29.1	214	29.5	214	30.0	213	30.6					
-1.84	-2.2	219	27.9	218	28.7	218	29.3	218	29.8	217	30.1	217	30.8					
5.5	5.0	237	28.9	236	29.7	236	30.2	236	30.6	235	31.0	233	32.0					
9.5	8.5	247	29.5	247	30.2	246	30.7	246	31.0	246	31.4	245	31.8					
13.0	12.0	258	30.0	258	30.6	258	31.0	258	31.4	257	31.8	256	32.2					
15.0	14.0	265	30.3	265	30.9	265	31.2	265	31.5	264	31.8	263	32.1					
17.0	15.5	271	30.5	268	30.8	268	31.1	268	31.4	267	31.7	266	32.0					
19.0	18.0	280	30.8	268	31.1	268	31.4	268	31.7	267	32.0	266						

RXYQ336PBYD

Capacity tables for RXYQ336PBYD heat pump. The table is organized into four main sections based on indoor air temperature (61, 65, 68, 70, 72, 75 °FDB) and outdoor air temperature (-3.64 to 60.0 °FDB). Each section contains sub-tables for different combinations of indoor and outdoor air temperatures, with columns for Total Capacity (TC) and Power Input (PI) in MBH and kW. The data is presented for four different capacity levels: 130, 120, 110, and 100 MBH.

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

RXYQ360PBYD

Combi- nation	Outdoor air temp.		Indoor air temp. °FDB													
			61		65		68		70		72		75			
			TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI		
%	*FDB	*FWB	MBH	kW	MBH	kW	MBH	kW	MBH	kW	MBH	kW	MBH	kW	MBH	kW
130	-3.64	-4.0	249	17.8	248	19.5	247	20.9	247	21.7	246	22.6	246	24.0		
	-1.84	-2.2	254	18.3	253	20.0	252	21.3	251	22.2	251	23.1	250	24.4		
	5.5	5.0	274	20.4	273	22.0	272	23.2	271	24.0	271	24.8	270	26.0		
	9.5	8.5	285	21.5	284	23.1	283	24.2	282	25.0	282	25.7	282	26.9		
	13.0	12.0	298	22.6	297	24.1	296	25.2	295	25.9	295	26.6	294	27.7		
	15.0	14.0	306	23.2	305	24.7	304	25.7	303	26.4	303	27.2	302	28.2		
	17.0	15.5	312	23.7	311	25.1	310	26.1	309	26.8	309	27.5	308	28.6		
	19.0	18.0	322	24.5	321	25.8	320	26.8	320	27.5	319	28.2	319	29.2		
	22.0	20.0	331	25.1	330	26.4	329	27.4	329	28.0	328	28.7	327	29.6		
	26.0	24.0	350	26.2	349	27.5	348	28.4	348	29.0	347	29.6	346	30.6		
	30.0	28.0	370	27.4	369	28.5	368	29.4	368	30.0	367	30.6	366	31.4		
	35.0	32.0	392	28.4	391	29.5	390	30.4	390	30.9	389	31.5	388	32.3		
	39.0	36.0	415	29.5	414	30.5	413	31.3	413	31.8	412	32.3	412	33.1		
44.0	40.0	440	30.4	439	31.4	438	32.1	438	32.6	437	33.1	436	33.8			
47.0	43.0	460	31.1	458	32.0	458	32.7	457	33.2	457	33.7	456	34.4			
51.0	47.0	487	32.0	486	32.8	485	33.5	484	33.9	484	34.4	483	34.4			
54.0	50.0	508	32.6	507	33.4	506	34.0	506	34.5	505	34.9	478	32.6			
57.0	53.0	531	33.1	529	33.9	529	34.5	527	34.8	507	33.2	478	30.9			
60.0	56.0	554	33.7	553	34.5	546	34.5	527	33.0	507	31.5	478	29.3			
120	-3.64	-4.0	248	19.9	247	21.5	246	22.8	246	23.6	245	24.4	245	25.6		
	-1.84	-2.2	252	20.4	251	22.0	251	23.2	250	24.0	250	24.8	249	26.0		
	5.5	5.0	272	22.4	271	23.9	271	25.0	270	25.7	270	26.4	269	27.5		
	9.5	8.5	284	23.4	283	24.8	282	25.9	282	26.6	281	27.3	281	28.3		
	13.0	12.0	297	24.4	296	25.7	295	26.8	294	27.4	294	28.1	293	29.1		
	15.0	14.0	304	25.0	303	26.3	303	27.3	302	27.9	302	28.6	301	29.6		
	17.0	15.5	310	25.4	309	26.7	309	27.6	308	28.3	308	28.9	307	29.9		
	19.0	18.0	321	26.1	320	27.3	319	28.3	319	28.9	318	29.5	318	30.4		
	22.0	20.0	330	26.7	329	27.9	328	28.8	328	29.4	327	30.0	326	30.9		
	26.0	24.0	349	27.7	348	28.9	347	29.7	346	30.3	346	30.9	345	31.7		
	30.0	28.0	369	28.8	368	29.8	367	30.7	367	31.2	366	31.7	366	32.5		
	35.0	32.0	391	29.8	390	30.8	389	31.5	389	32.0	388	32.6	387	33.3		
	39.0	36.0	414	30.7	413	31.7	412	32.4	412	32.9	411	33.3	411	34.0		
44.0	40.0	439	31.6	438	32.5	437	33.2	436	33.6	436	34.1	435	34.7			
47.0	43.0	458	32.2	457	33.1	456	33.7	456	34.2	455	34.6	441	33.6			
51.0	47.0	486	33.0	485	33.8	484	34.4	483	34.8	468	33.6	441	31.2			
54.0	50.0	507	33.6	506	34.4	504	34.8	486	33.3	468	31.8	441	29.6			
57.0	53.0	529	34.1	528	34.9	504	33.0	486	31.6	468	30.2	441	28.1			
60.0	56.0	552	34.6	531	33.3	504	31.3	486	29.9	468	28.6	441	26.7			
110	-3.64	-4.0	247	22.1	246	23.6	245	24.7	245	25.4	244	26.2	244	27.3		
	-1.84	-2.2	251	22.5	250	24.0	249	25.1	249	25.8	249	26.5	248	27.6		
	5.5	5.0	271	24.3	270	25.7	270	26.7	269	27.4	269	28.0	268	29.1		
	9.5	8.5	283	25.2	282	26.5	281	27.5	281	28.2	280	28.8	280	29.8		
	13.0	12.0	295	26.2	294	27.4	294	28.3	293	28.9	293	29.6	292	30.5		
	15.0	14.0	302	26.7	302	27.9	302	28.8	301	29.4	301	30.0	300	30.9		
	17.0	15.5	309	27.1	308	28.3	308	29.1	307	29.7	307	30.3	306	31.2		
	19.0	18.0	320	27.7	319	28.9	318	29.7	318	30.3	317	30.9	317	31.7		
	22.0	20.0	329	28.2	328	29.3	327	30.2	327	30.7	326	31.3	325	32.1		
	26.0	24.0	347	29.2	346	30.3	346	31.1	345	31.6	345	32.1	344	32.9		
	30.0	28.0	368	30.2	367	31.2	366	31.9	366	32.4	365	32.9	365	33.6		
	35.0	32.0	389	31.1	389	32.0	388	32.7	387	33.2	387	33.6	386	34.3		
	39.0	36.0	413	32.0	412	32.8	411	33.5	411	33.9	410	34.4	404	34.3		
44.0	40.0	437	32.8	437	33.6	436	34.2	435	34.6	429	34.3	404	31.9			
47.0	43.0	457	33.4	456	34.1	455	34.7	446	34.0	429	32.5	404	30.2			
51.0	47.0	484	34.1	483	34.8	462	33.0	446	31.6	429	30.2	404	28.2			
54.0	50.0	506	34.6	487	33.3	462	31.3	446	30.0	429	28.7	404	26.7			
57.0	53.0	520	34.2	487	31.6	462	29.7	446	28.4	429	27.2	404	25.4			
60.0	56.0	520	32.4	487	30.0	462	28.2	446	27.0	429	25.9	404	24.2			
100	-3.64	-4.0	245	24.2	245	25.6	244	26.6	244	27.3	243	27.9	243	29.0		
	-1.84	-2.2	250	24.6	249	25.9	248	26.9	248	27.6	247	28.3	247	29.3		
	5.5	5.0	270	26.3	269	27.5	268	28.4	268	29.0	268	29.6	267	30.6		
	9.5	8.5	281	27.1	281	28.3	280	29.2	280	29.7	279	30.3	279	31.2		
	13.0	12.0	294	27.9	293	29.1	293	29.9	292	30.5	292	31.0	291	31.9		
	15.0	14.0	302	28.4	301	29.5	300	30.3	300	30.9	300	31.4	299	32.2		
	17.0	15.5	308	28.8	307	29.8	306	30.6	306	31.2	306	31.7	305	32.5		
	19.0	18.0	318	29.4	318	30.4	317	31.2	317	31.7	316	32.2	316	33.0		
	22.0	20.0	327	29.8	326	30.8	326	31.6	325	32.1	325	32.6	324	33.3		
	26.0	24.0	346	30.7	345	31.7	345	32.4	344	32.9	344	33.4	343	34.1		
	30.0	28.0	366	31.6	366	32.5	365	33.2	365	33.6	364	34.1	364	34.7		
	35.0	32.0	388	32.4	387	33.3	387	33.9	386	34.3	386	34.7	386	32.9		
	39.0	36.0	411	33.2	411	34.0	410	34.6	405	34.4	390	32.8	368	30.6		
44.0	40.0	436	34.0	435	34.7	420	33.4	405	32.0	390	30.5	368	28.5			
47.0	43.0	456	34.5	442	33.7	420	31.6	405	30.3	390	29.0	368	27.0			
51.0	47.0	472	34.0	442	31.4	420	29.5	405	28.2	390	27.0	368	25.2			
54.0	50.0	472	32.2	442	29.7	420	28.0	405	26.8	390	25.6	368	24.0			
57.0	53.0	472	30.5	442	28.2	420	26.5	405	25.5	390	24.4	368	22.8			
60.0	56.0	472	28.9	442	26.8	420	25.2	405	24.2	390	23.2	368	21.7			


TC: Total capacity ; MBH  
PI: Power Input ; kW (Comp.+Outdoor fan motor)  
Note1: ■ is shown as reference.

Note2: The above table shows the average value of conditions which may occur.


### 8.3 Capacity Correction Factor

#### RXYQ72PBYD

1. Rate of change in cooling capacity

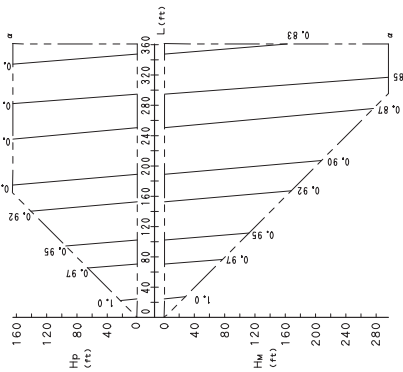

2. Rate of change in heating capacity

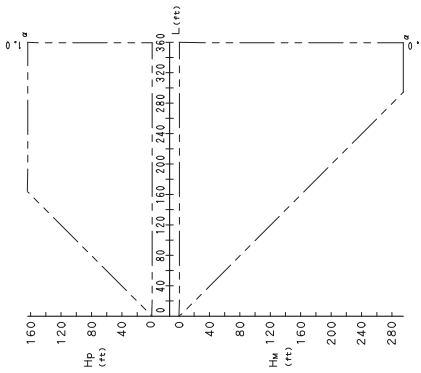

[Explanation of symbols]

Hp : Level difference (t) between indoor and outdoor units where indoor unit in inferior position  
 Hw : Level difference (t) between indoor and outdoor units where indoor unit in superior position  
 L : Equivalent pipe length (ft)  
 α : Rate of change in cooling / heating Capacity

[Diameter of the main pipes (standard size)]

Model	gas	Liquid
RXYQ72PBYD	φ 3/4	φ 3/8

[Temper grade and Thickness]

Temper grade	0 Type	1/2H Type
Outer diameter	φ3/8	φ1/2, φ3/4, φ7/8
Minimum Wall Thickness	0.80	0.80, 0.80, 0.80

[Notes]

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (With the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
- Method of calculating A/C (cooling/heating) capacity:  
 The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.  
 Calculating A/C capacity of outdoor units  
 • Condition: Indoor unit combination ratio does not exceed 100%.  

$$\text{Maximum A/C capacity of outdoor units} = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the 100\% combination}}{\text{X (Capacity change rate due to piping length to the farthest indoor unit)}}$$
 • Condition: Indoor unit combination ratio exceeds 100%.  

$$\text{Maximum A/C capacity of outdoor units} = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the combination}}{\text{X (Capacity change rate due to piping length to the farthest indoor unit)}}$$

4. When overall equivalent pipe length is 295, 3ft or more, the diameter of the main gas and liquid pipes (outdoor unit-branch sections) must be increased.  
 When level difference is 164, 0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.

[Diameter of above case]


Model	gas	Liquid
RXYQ72PBYD	φ 7/8	φ 1/2

5. Read cooling / heating capacity rate of change in the above figures based on the following equivalent length.

Overall equivalent length = (Equivalent length to main pipe) × Correction factor + (Equivalent length after branching)

Rate of change (object piping)	Correction factor
Cooling (gas pipe)	Standard size Site increase
Heating (liquid pipe)	1.0, 0.5, 0.2


(Example)

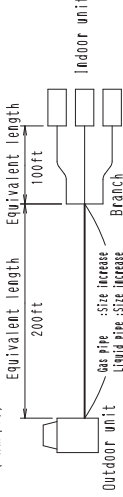


In the above case  
 (Cooling) Overall equivalent length = 200ft × 0.5 + 100ft = 200ft  
 (Heating) Overall equivalent length = 200ft × 0.2 + 100ft = 140ft  
 The rate of change in cooling capacity when Hp=0ft is thus approximately 0.89  
 heating capacity when Hp=0ft is thus approximately 1.0

RXYQ96PBYD

1. Rate of change in cooling capacity

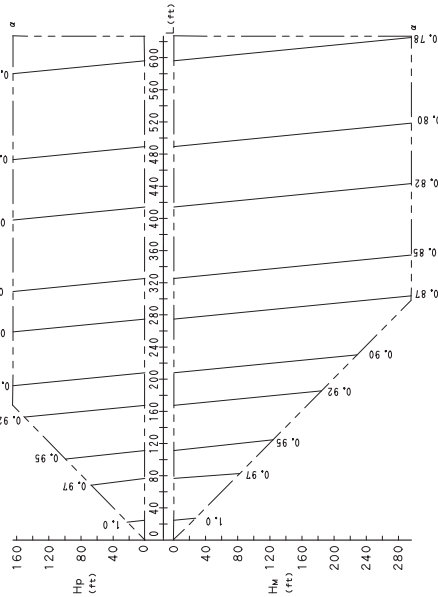

2. Rate of change in heating capacity

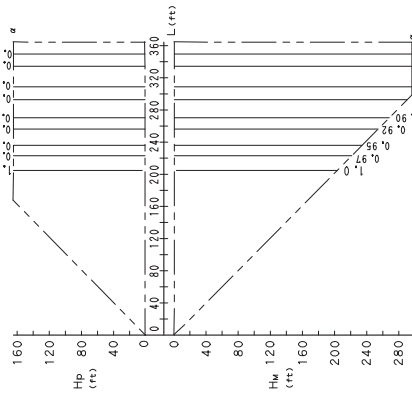

[Explanation of symbols]  
 Hp: Level difference(ft)between indoor and outdoor units where indoor unit is inferior position  
 Hm: Level difference(ft)between indoor and outdoor units where indoor unit is superior position  
 L : Equivalent pipe length(ft)  
 α : Rate of change in cooling / heating Capacity  
 [ Diameter of the main pipes(standard size) ]

Model	gas	liquid
RXYQ96PBYD	φ 7/8	φ 3/8

[ Temper grade and Thickness ]

Temper grade	□ Type	1/2H Type
Outer diameter	φ 3/8	φ 1/2
Minimum Wall Thickness	0.80	0.80
	0.80	0.88

[ Notes ]

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.  
 2. With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.  
 3. Method of calculating A/C (cooling/heating) capacity:  
 The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.  
 Calculating A/C capacity of outdoor units  
 • Condition: Indoor unit combination ratio does not exceed 100%.  

$$[\text{Maximum A/C capacity of outdoor units}] = A/C \text{ capacity of outdoor units obtained from capacity characteristic table at the 100\% combination}$$

$$X [\text{Capacity change rate due to piping length to the farthest indoor unit}]$$
 • Condition: Indoor unit combination ratio exceeds 100%.  

$$[\text{Maximum A/C capacity of outdoor units}] = A/C \text{ capacity of outdoor units obtained from capacity characteristic table at the combination}$$


$$X [\text{Capacity change rate due to piping length to the farthest indoor unit}]$$
 4. When overall equivalent pipe length is 295.3ft or more, the diameter of the main gas and liquid pipes (outdoor unit-branch sections) must be increased.  
 When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.  
 [ Diameter of above case ]

Model	gas	liquid
RXYQ96PBYD	Not Increased	φ 1/2

5. Read cooling / heating capacity rate of change in the above figures based on the following equivalent length,  
 Overall equivalent length = (Equivalent length to main pipe) × Correction factor + (Equivalent length after branching)

Choose a correction factor from the following table.  
 When cooling capacity is calculated: gas pipe size  
 When heating capacity is calculated: liquid pipe size


Rate of change (object piping)	Correction factor (Standard size)	Size increase
Cooling (gas pipe)	1.0	0.5
Heating (liquid pipe)	1.0	0.2

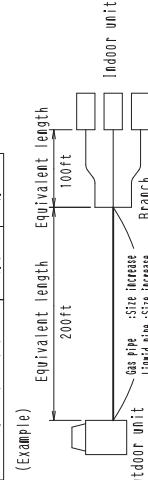


(Example)  
 In the above case  
 (Cooling) Overall equivalent length = 200ft × 0.5 + 100ft = 200ft  
 (Heating) Overall equivalent length = 200ft × 0.2 + 100ft = 140ft  
 The rate of change in cooling capacity when Hp=0ft is thus approximately 0.91  
 heating capacity when Hp=0ft is thus approximately 1.00

RXYQ120PBYD / RXYQ144PBYD / RXYQ240PBYD / RXYQ360PBYD

2. Rate of change in heating capacity

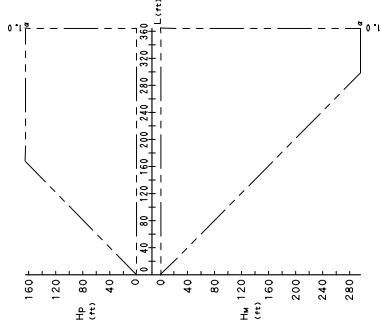

1. Rate of change in cooling capacity

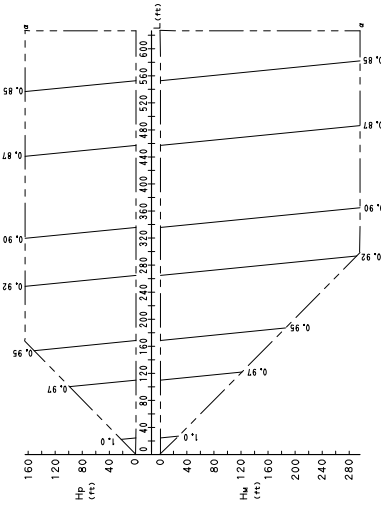

[Explanation of symbols]  
 Hp: Level difference(ft)between indoor and outdoor units where indoor unit is inferior position  
 Hm: Level difference(ft)between indoor and outdoor units where indoor unit is superior position  
 L: Equivalent pipe length(ft)  
 α: Rate of change in cooling / heating Capacity  
 [Diameter of the main pipes(standard size)]

Model	gas	liquid
RXYQ120, 144PBYD	φ 1-1/8	φ 1/2
RXYQ240PBYD	φ 1-3/8	φ 5/8
RXYQ360PBYD	φ 1-5/8	φ 3/4

[Temper grade and Thickness]

Temper grade	□ Type	1/2H Type
Outer diameter	φ 1/2	φ 5/8
Minimum Wall Thickness	φ 3/4	φ 1-1/8
	0.80	0.99
	0.80	0.80
	0.99	1.21
		1.43

[Notes]

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
- Method of calculating A/C (cooling/heating) capacity:  
 The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.  
 Calculating A/C capacity of outdoor units  
 • Condition: Indoor unit combination ratio does not exceed 100%.  
 [Maximum A/C capacity of outdoor units] = A/C capacity of outdoor units obtained from capacity characteristic table at the 100% combination  
 X Capacity change rate due to piping length to the farthest indoor unit  
 X Capacity change rate due to piping length to the farthest outdoor unit  
 • Condition: Indoor unit combination ratio exceeds 100%.  
 [Maximum A/C capacity of outdoor units] = A/C capacity of outdoor units obtained from capacity characteristic table at the combination must be increased.  
 X Capacity change rate due to piping length to the farthest indoor unit  
 X Capacity change rate due to piping length to the farthest outdoor unit
- When overall equivalent pipe length is 295.3ft or more, the diameter of the main gas and liquid pipes (outdoor unit-branch sections) must be increased.  
 When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.  
 [Diameter of above case]


Model	gas	liquid
RXYQ120, 144PBYD	Not increased	φ 5/8
RXYQ240PBYD	Not increased	φ 3/4
RXYQ360PBYD	Not increased	φ 7/8

Overall equivalent length = (Equivalent length to main pipe) X Correction factor + (Equivalent length after branching)

Choose a correction factor from the following table.  
 [When cooling capacity is calculated: gas pipe size  
 [When heating capacity is calculated: liquid pipe size

Rate of change (object piping)	Correction factor	
Cooling (gas pipe)	Standard size	
	Size increase	
RXYQ120, 144PBYD	1.0	120 • 144
RXYQ240PBYD	1.0	240 • 360
		0.3
		0.4


(Example) In case of RXYQ240PBYD

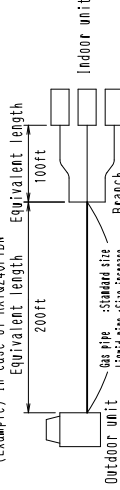

In the above case  
 (Cooling) Overall equivalent length = 200ft X 1.0 + 100ft = 300ft  
 (Heating) Overall equivalent length = 200ft X 0.4 + 100ft = 180ft  
 The rate of change in cooling capacity when Hp=0ft is thus approximately 0.91  
 heating capacity when Hp=0ft is thus approximately 1.0

RXYQ168PBYD / RXYQ264PBYD / RXYQ288PBYD

2. Rate of change in heating capacity

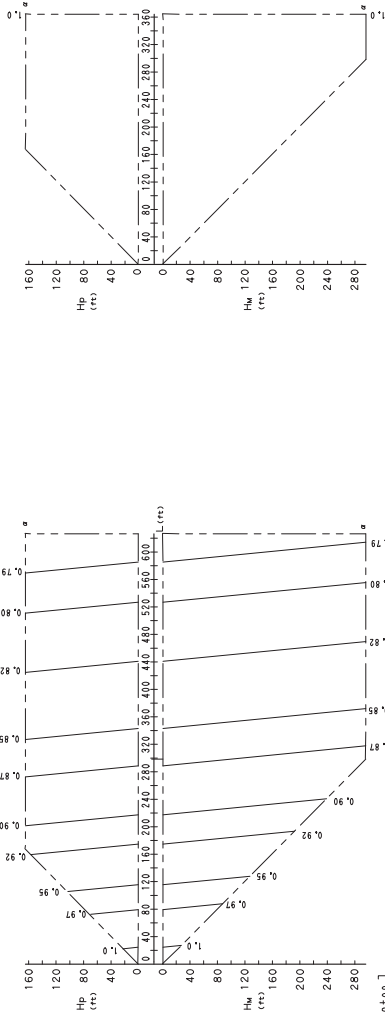


[ Notes ]

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
- Method of calculating A/C (cooling/heating) capacity:  
The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.  
Calculating A/C capacity of outdoor units  
• Condition: Indoor unit combination ratio does not exceed 100%.  
Maximum A/C capacity of outdoor units =  $\frac{A/C \text{ capacity of outdoor units}}{A/C \text{ capacity of indoor unit}}$  × Capacity change rate due to piping length to the farthest indoor unit  
• Condition: Indoor unit combination ratio exceeds 100%.  
Maximum A/C capacity of outdoor units =  $\frac{A/C \text{ capacity of outdoor units}}{A/C \text{ capacity of indoor unit}}$  × Capacity characteristic table at the combination  
• Condition: Indoor unit combination ratio exceeds 100%.  
Maximum A/C capacity of outdoor units =  $\frac{A/C \text{ capacity of outdoor units}}{A/C \text{ capacity of indoor unit}}$  × Capacity characteristic table at the combination  
• Condition: Indoor unit combination ratio exceeds 100%.  
Maximum A/C capacity of outdoor units =  $\frac{A/C \text{ capacity of outdoor units}}{A/C \text{ capacity of indoor unit}}$  × Capacity characteristic table at the combination

- Read cooling / heating capacity rate of change in the above figures based on the following equivalent length,  
Overall equivalent length = (Equivalent length to main pipe) × Correction factor + (Equivalent length after branching)  
Choose a correction factor from the following table.  
[ When cooling capacity is calculated: gas pipe size  
[ When heating capacity is calculated: liquid pipe size

Rate of change (Object Piping)	Correction factor
Cooling (gas pipe)	Standard size increase
Heating (liquid pipe)	1.0
	0.5
	1.0
	0.4

(Example)

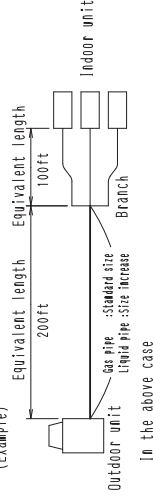

In the above case  
(Cooling) Overall equivalent length = 200ft × 1.0 + 100ft = 300ft  
(Heating) Overall equivalent length = 200ft × 0.4 + 100ft = 180ft  
The rate of change in cooling capacity when Hp=0ft is thus approximately 0.87  
heating capacity when Hp=0ft is thus approximately 1.0

[ Explanation of symbols ]  
HP : Level difference between indoor and outdoor units where indoor unit is inferior position  
HM : Level difference between indoor and outdoor units where indoor unit is superior position  
L : Equivalent pipe length  
α : Rate of change in cooling / heating capacity  
[ Diameter of the main pipes (standard size) ]

Model	gas	liquid
RXYQ168PBYD	φ 1-1/8	φ 5/8
RXYQ264PBYD RXYQ288PBYD	φ 1-3/8	φ 3/4

[ Temper grade and Thickness ]


Temper grade	□ Type	1/2H Type
Outer diameter	φ 5/8	φ 3/4
Minimum Wall Thickness	0.99	0.80
	0.80	0.99
	1.10	1.21
	1.10	1.32

- Read cooling / heating capacity rate of change in the above figures based on the following equivalent length,Overall equivalent length = (Equivalent length to main pipe) × Correction factor + (Equivalent length after branching)  
Choose a correction factor from the following table.  
[ When cooling capacity is calculated: gas pipe size  
[ When heating capacity is calculated: liquid pipe size

(Example)

Rate of change (Object Piping)	Correction factor
Cooling (gas pipe)	Standard size increase
Heating (liquid pipe)	1.0
	0.5
	1.0
	0.4


(Example)

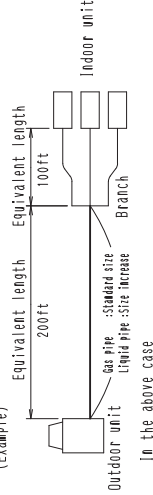


In the above case  
(Cooling) Overall equivalent length = 200ft × 1.0 + 100ft = 300ft  
(Heating) Overall equivalent length = 200ft × 0.4 + 100ft = 180ft  
The rate of change in cooling capacity when Hp=0ft is thus approximately 0.87  
heating capacity when Hp=0ft is thus approximately 1.0

RXYQ192PBYD / RXYQ312PBYD / RXYQ336PBYD

2. Rate of change in heating capacity

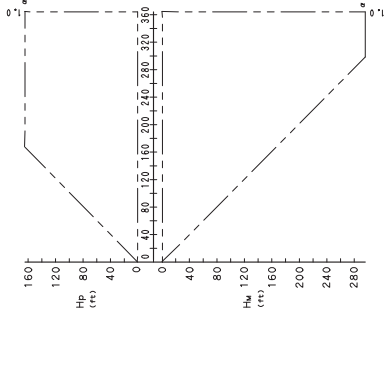

1. Rate of change in cooling capacity

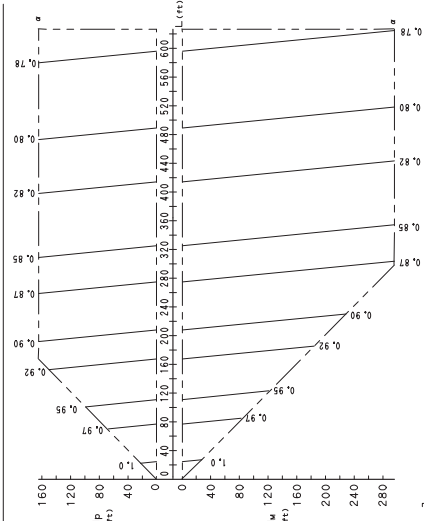

[Explanation of symbols ]  
 Hp : Level difference between indoor and outdoor units where indoor unit in inferior position  
 Hw : Level difference between indoor and outdoor units where indoor unit in superior position  
 L : Equivalent pipe length(ft)  
 C : Rate of change in cooling / heating capacity  
 [Diameter of the main pipes(standard size)]

Model	gas	liquid
RXYQ192PBYD	φ 1-1/8	φ 5/8
RXYQ312PBYD RXYQ336PBYD	φ 1-3/8	φ 3/4

[Temper grade and Thickness]

Temper grade	φ Type	1/2H Type
Outer diameter	φ 5/8	φ 3/4
Minimum Wall Thickness	0.99	0.80
	0.80	0.99
	1.10	1.21
	1.10	1.32

5. Read cooling / heating capacity rate of change in the above figures based on the following equivalent length.

Overall equivalent length=  
 (Equivalent length to main pipe)×Correction factor+(Equivalent length after branching)


Choose a correction factor from the following table.

When cooling capacity is calculated: gas pipe size

When heating capacity is calculated: liquid pipe size

Rate of change (object piping)	Correction factor
Cooling (gas pipe)	1.0
Heating (liquid pipe)	1.0
	0.5
	0.4

(Example)

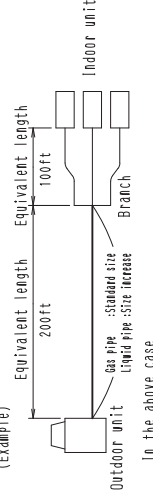

In the above case

(Cooling) Overall equivalent length=200ft×1.0+100ft=300ft

(Heating) Overall equivalent length=200ft×0.4+100ft=180ft

The rate of change in cooling capacity when Hp=0ft is thus approximately 0.86 heating capacity when Hp=0ft is thus approximately 1.0

[Notes]

1. These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.

2. With this outdoor unit evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.

3. Method of calculating A/C (cooling/heating) capacity:

The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.

Calculating A/C capacity of outdoor units

• Condition: Indoor unit combination ratio does not exceed 100%.

Maximum A/C capacity of outdoor units = A/C capacity of outdoor units obtained from capacity characteristic table at the 100% combination

X Capacity change rate due to piping length to the farthest indoor unit

X Capacity change rate exceeds 100%

Maximum A/C capacity of outdoor units = A/C capacity of outdoor units obtained from capacity characteristic table at the combination

X Capacity change rate due to piping length to the farthest indoor unit

X Capacity change rate due to piping length to the farthest indoor unit

4. When overall equivalent pipe length is 295.3ft or more, the diameter of the main gas and liquid pipes (outdoor unit-branch sections) must be increased.

When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.

[Diameter of above case]

Model	gas	liquid
RXYQ192PBYD	Not Increased	φ 3/4
RXYQ312PBYD RXYQ336PBYD	Not Increased	φ 7/8



RXYQ216PBYD

1. Rate of change in cooling capacity


2. Rate of change in heating capacity

[Explanation of symbols]  
 Hp : Level difference (between indoor and outdoor units where indoor unit in inferior position)  
 Hm : Level difference (between indoor and outdoor units where indoor unit in superior position)  
 L : Equivalent pipe length (ft)  
 α : Rate of change in cooling / heating capacity  
 [ Diameter of the main pipes (standard size) ]

Model	gas	liquid
RXYQ216PBYD	φ 1-1/8	φ 5/8

[Temper grade and Thickness]

Temper grade	0 Type	1/2H Type
Outer diameter	φ 5/8	φ 3/4 φ 1-1/8 φ 1-1/4
Minimum Wall Thickness	0.99	0.80 0.99 1.10

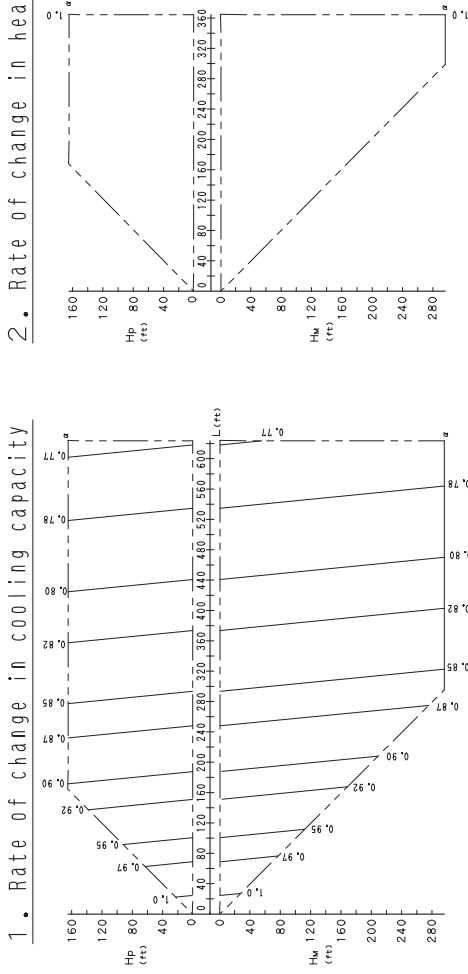

[Notes]

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
- Method of calculating A/C (cooling/heating) capacity:  
 The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.  
 Calculating A/C capacity of outdoor units  
 • Condition: Indoor unit combination ratio does not exceed 100%.  

$$\text{Maximum A/C capacity of outdoor units} = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the 100\% combination}}{\text{Capacity change rate due to piping length to the farthest indoor unit}}$$
 • Condition: Indoor unit combination ratio exceeds 100%.  


$$\text{Maximum A/C capacity of outdoor units} = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the combination}}{\text{Capacity change rate due to piping length to the farthest indoor unit}}$$
- When overall equivalent pipe length is 295.3ft or more, the diameter of the main gas and liquid pipes (outdoor unit-branch sections) must be increased.  
 When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.  
 [Diameter of above case]

Model	gas	liquid
RXYQ216PBYD	Not increased	φ 3/4

5. Read cooling / heating capacity rate of change in the above figures based on the following equivalent length,  
 Overall equivalent length = (Equivalent length to main pipe) × Correction factor + (Equivalent length after branching)

Choose a correction factor from the following table,  
 When cooling capacity is calculated: gas pipe size  
 When heating capacity is calculated: liquid pipe size


Rate of change (object piping)	Correction factor
Cooling (gas pipe)	Standard size increase
Heating (liquid pipe)	1.0 0.5 0.4

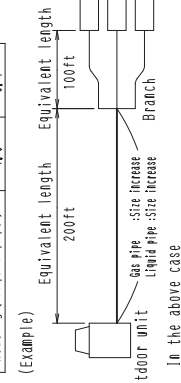

(Cooling) Overall equivalent length = 200ft × 0.5 + 100ft = 200ft  
 (Heating) Overall equivalent length = 200ft × 0.4 + 100ft = 180ft  
 The rate of change in cooling capacity when Hp=0ft is thus approximately 0.89  
 heating capacity when Hp=0ft is thus approximately 1.0

# 9. Sound Levels (Reference)

## 9.1 Overall

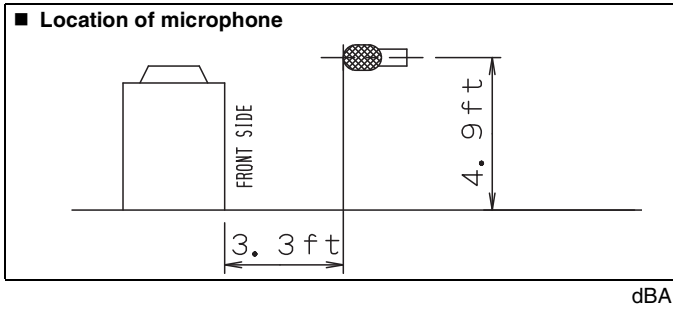

**Notes:**

1. The operating conditions are assumed to be standard (JIS conditions). Power source 460V, 60hz.
2. The operating values were obtained in an anechoic chamber (conversion values).
3. Sound levels will vary depending on a range of factors such as the construction (acoustic absorption coefficient) of the particular room in which the equipment is installed.



Model	460V, 60Hz
RXYQ72PBYD	58
RXYQ96PBYD	58
RXYQ120PBYD	60
RXYQ144PBYD	61
RXYQ168PBYD	61
RXYQ192PBYD	62
RXYQ216PBYD	62
RXYQ240PBYD	63

## 9.2 Octave Band Level

○ — ○ 460V, 60Hz


**RXYQ72PBYD**

**RXYQ96/120PBYD**

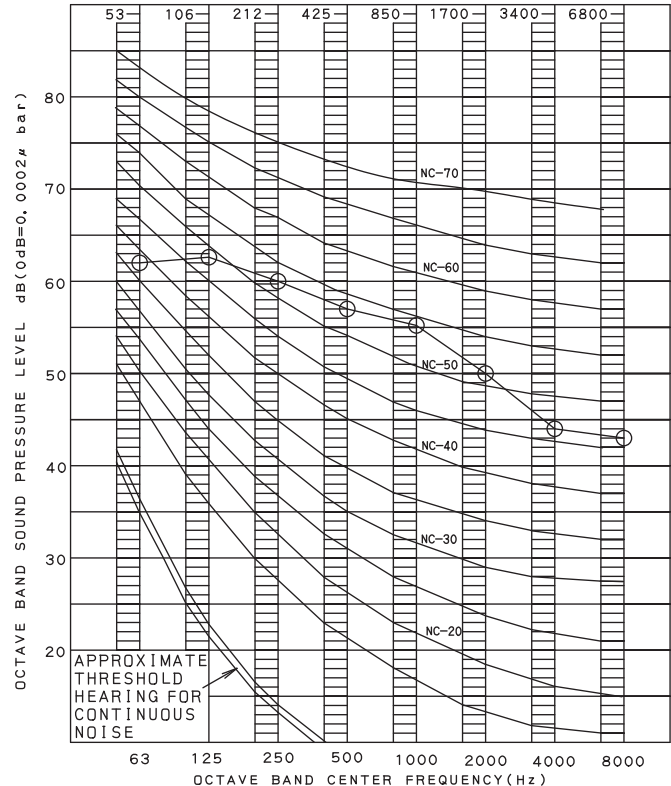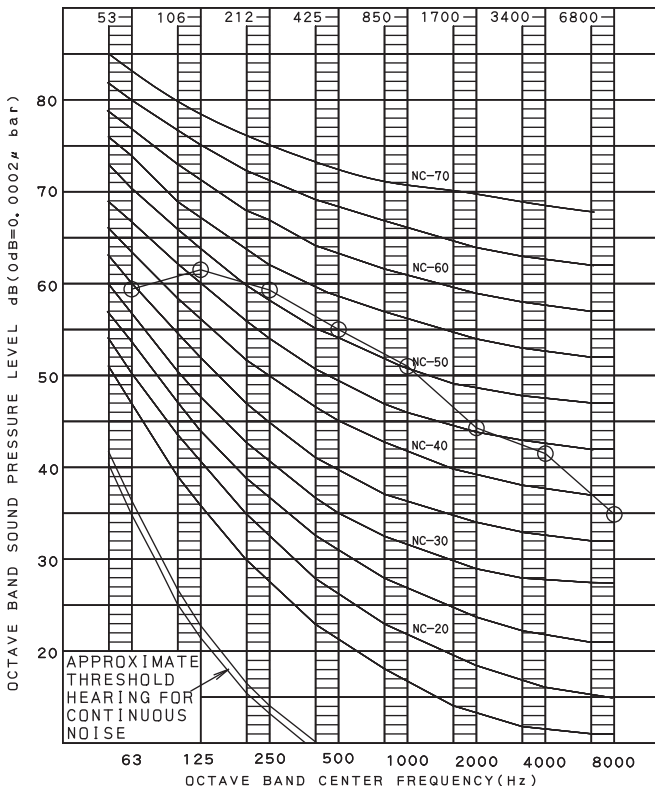

# 10. Operation Limits

RXYQ72PBYD / RXYQ96PBYD / RXYQ120PBYD / RXYQ144PBYD / RXYQ168PBYD / RXYQ192PBYD / RXYQ216PBYD / RXYQ240PBYD / RXYQ264PBYD / RXYQ288PBYD / RXYQ312PBYD / RXYQ336PBYD / RXYQ360PBYD

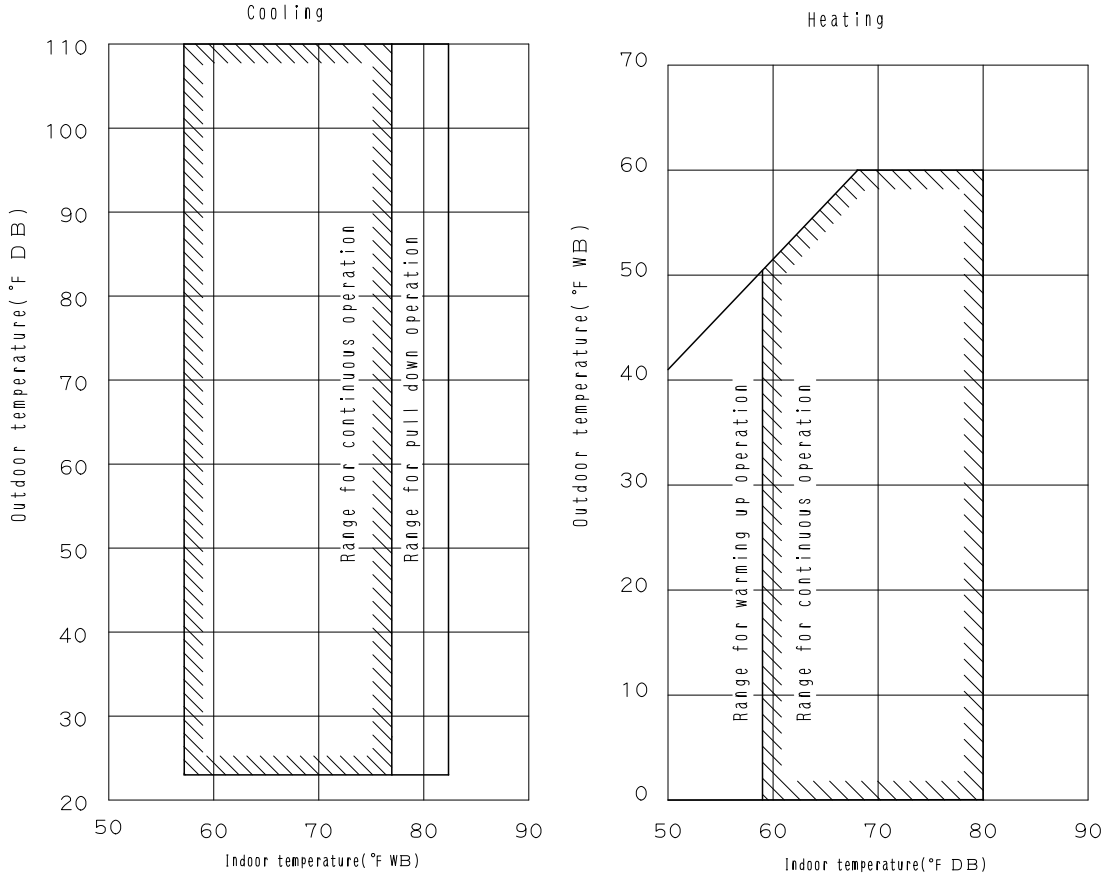

3D043026E











Note: These figures assume the following operating conditions:  
 Indoor and outdoor units:  
 Equivalent pipe length: 25ft  
 Level difference: 0

**NOTE: See Capacity Tables for Reference Cooling Capacities above 110°F.**

# 11. Accessories

## Standard Accessories

RXYQ72PBYD / RXYQ96PBYD / RXYQ120PBYD / RXYQ144PBYD / RXYQ168PBYD / RXYQ192PBYD / RXYQ216PBYD / RXYQ240PBYD / RXYQ264PBYD / RXYQ288PBYD / RXYQ312PBYD / RXYQ336PBYD / RXYQ360PBYD

Name	Clamp(1)	Clamp(2)	Clamp(3)	Vinyl tube	Conduit mounting plate		Manuals, etc.	
Quantity	9 pcs.	3 pcs.	1 pc.	4 pcs.	2 pcs.	2 pcs.	1 pc. each	
Shape	 (Small)		 (Large)				<ul style="list-style-type: none"> <li>Operation manual</li> <li>Installation manual</li> <li>"REQUEST FOR THE INDICATON" label (Installation records)</li> <li>Add additional refrigerant charge label</li> </ul>	
Name	Liquid side accessory pipe (1)		Liquid side accessory pipe (2)		Gas side accessory pipe (1)		Gas side accessory pipe (2)	
Quantity	1 pc.		1 pc.		1 pc.		1 pc.	
Shape								

C: 3P215731-10R

## Optional Accessories (For Unit)

RXYQ72PBYD / RXYQ96PBYD / RXYQ120PBYD / RXYQ144PBYD / RXYQ168PBYD / RXYQ192PBYD / RXYQ216PBYD / RXYQ240PBYD / RXYQ264PBYD / RXYQ288PBYD / RXYQ312PBYD / RXYQ336PBYD / RXYQ360PBYD

Series		VRV III					
Optional accessories		Models	RXYQ72PBYD RXYQ96PBYD	RXYQ120PBYD	RXYQ144PBYD RXYQ168PBYD	RXYQ192PBYD RXYQ216PBYD RXYQ240PBYD	RXYQ264PBYD RXYQ288PBYD RXYQ312PBYD RXYQ336PBYD RXYQ360PBYD
		Model	KHRP26M22H (Max. 4 branch) KHRP26M33H (Max. 8 branch)	KHRP26M22H (Max. 4 branch) KHRP26M33H (Max. 8 branch) KHRP26M72H (Max. 8 branch)	KHRP26M22H (Max. 4 branch) KHRP26M33H (Max. 8 branch) KHRP26M72H (Max. 8 branch) KHRP26M73HU (Max. 8 branch)		
Distributive piping	Refnet header	AS No.	AS3802560	AS3802560	AS3803567		
		Z No.	—	—	—		
		Model	KHRP26A22T KHRP26M33T	KHRP26A22T KHRP26A33T KHRP26M72TU	KHRP26A22T KHRP26A33T KHRP26M72TU KHRP26M73TU		
	Refnet joint	AS No.	AS3802560 (KHRP26A22T, KHRP26A33T)	AS3803118 (KHRP26M72TU)	AS3803566 (KHRP26M73TU)		
		Z No.	—	—	—		
		Model	—	—	BHFP22P100U	BHFP22P151U	
Outdoor unit multi connection piping kit	AS No.	—	—	—	—		
	Z No.	—	—	—	—		

C: 3D060089D



Warning



Daikin Industries, Ltd.'s products are manufactured for export to numerous countries throughout the world. Daikin Industries, Ltd. does not have control over which products are exported to and used in a particular country. Prior to purchase, please therefore confirm with your local authorized importer, distributor and/or retailer whether this product conforms to the applicable standards, and is suitable for use, in the region where the product will be used. This statement does not purport to exclude, restrict or modify the application of any local legislation.

Ask a qualified installer or contractor to install this product. Do not try to install the product yourself. Improper installation can result in water or refrigerant leakage, electrical shock, fire, or explosion.

Use only those parts and accessories supplied or specified by Daikin. Ask a qualified installer or contractor to install those parts and accessories. Use of unauthorized parts and accessories or improper installation of parts and accessories can result in water or refrigerant leakage, electrical shock, fire, or explosion.

Read the User's Manual carefully before using this product. The User's Manual provides important safety instructions and warnings. Be sure to follow these instructions and warnings.

If you have any inquiries, please contact your local importer, distributor, or retailer.



©2010 Daikin Industries, Limited.

Daikin® AC Absolute Comfort®, and its design, VRV®, REFNET™, and Quaternity™ are registered trademarks of Daikin Industries, Limited. All rights reserved. LonWorks® and LON® are registered trademarks of Echelon Corporation. BACnet® is a Data Communication Protocol for Building Automation and Control Networks, developed under the auspices of the American Society of Heating, Refrigeration, and Air-Conditioning Engineers (ASHRAE).



JMI-0107



JQA-1452

About ISO 9001

ISO 9001 is a plant certification system defined by the International Organization for Standardization (ISO) relating to quality assurance. ISO 9001 certification covers quality assurance aspects related to the "design, development, manufacture, installation, and supplementary service" of products manufactured at the plant.



EC99J2044

About ISO 14001

ISO 14001 is the standard defined by the International Organization for Standardization (ISO) relating to environmental management systems. Our group has been acknowledged by an internationally accredited program of environmental protection procedures and activities to meet the requirements of ISO 14001.

Dealer

**DAIKIN AC (AMERICAS), INC.**  
1645 Wallace Drive, Suite 110  
Carrollton, TX 75006  
info@daikinac.com  
www.daikinac.com

©All rights reserved

•Specifications, designs and other content appearing in this brochure are current as of March 2011 but subject to change without notice.