



EDUS 391005 - R2

R-410A

Engineering Data

VRV III®

REYQ-P(B)
3 phase
460V, 60Hz

DAIKIN AC (AMERICAS), INC.

REYQ-P

Heat Recovery

3 phase

460V, 60Hz

1. Specifications	2
2. Dimensions	6
3. Service Space	10
4. Piping Diagrams.....	11
5. Wiring Diagrams.....	14
6. Field Wiring	17
7. Electric Characteristics.....	20
8. Capacity Table (Reference Data).....	23
8.1 Cooling Capacity (REYQ-P)	23
8.2 Heating Capacity (REYQ-P).....	35
8.3 Capacity Correction Factor.....	47
9. Operation Limits	53
10. Low Ambient Cooling Enhancement.....	54
11. Accessories.....	55

1. Specifications

Model Name			REYQ72PYDN	REYQ96PYDN	REYQ120PYDN
Power Supply			3 phase, 460V, 60Hz	3 phase, 460V, 60Hz	3 phase, 460V, 60Hz
★1 Cooling Capacity	Nominal	Btu / h	72,000	96,000	120,000
	Rated		69,000	92,000	114,000
★2 Heating Capacity	Nominal	Btu / h	81,000	108,000	135,000
	Rated		77,000	103,000	129,000
Casing Color			Ivory White (5Y7.5/1)	Ivory White (5Y7.5/1)	Ivory White (5Y7.5/1)
Dimensions: (HxWxD)		in. (mm)	66-1/8 x 51-3/16 x 30-1/8 (1680 x 1300 x 765)	66-1/8 x 51-3/16 x 30-1/8 (1680 x 1300 x 765)	66-1/8 x 51-3/16 x 30-1/8 (1680 x 1300 x 765)
Heat Exchanger			Cross Fin Coil	Cross Fin Coil	Cross Fin Coil
Comp.	Type		Hermetically Sealed Scroll Type	Hermetically Sealed Scroll Type	Hermetically Sealed Scroll Type
	Displacement	m ³ /h	7.88+10.53	13.34+10.53	13.34+10.53
	Number of Revolutions	r/min	3720, 2900	6300, 2900	6300, 2900
	Motor Output×Number of Units	kW	(1.0+4.5) × 1	(2.2+4.5) × 1	(3.3+4.5) × 1
	Starting Method		Soft Start	Soft Start	Soft Start
Fan	Type		Propeller Fan	Propeller Fan	Propeller Fan
	Motor Output	kW	(0.35) × 2	(0.35) × 2	(0.35) × 2
	Airflow Rate	cfm	6,700	6,700	7,410
	Drive		Direct Drive	Direct Drive	Direct Drive
Connecting Pipes	Liquid Pipe	in. (mm)	φ 3/8 (9.5) C1220T (Brazing Connection)	φ 3/8 (9.5) C1220T (Brazing Connection)	φ 1/2 (12.7) C1220T (Brazing Connection)
	Suction Gas Pipe	in. (mm)	φ 3/4 (19.1) C1220T (Brazing Connection)	φ 7/8 (22.2) C1220T (Brazing Connection)	φ 1-1/8 (28.6) C1220T (Brazing Connection)
	High and Low Pressure Gas Pipe	in. (mm)	φ 5/8 (15.8) C1220T (Brazing Connection)	φ 3/4 (19.1) C1220T (Brazing Connection)	φ 3/4 (19.1) C1220T (Brazing Connection)
Mass	Lbs (kg)	732 (332)	732 (332)	732 (332)	
★3 Sound Level (Reference Value)		dBA	58	58	60
Safety Devices			High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector	High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector	High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector
Defrost Method			Deicer	Deicer	Deicer
Capacity Control		%	20~100	14~100	14~100
Refrigerant	Refrigerant Name		R-410A	R-410A	R-410A
	Charge	Lbs (kg)	22.7 (10.3)	23.4 (10.6)	23.8 (10.8)
	Control		Electronic Expansion Valve	Electronic Expansion Valve	Electronic Expansion Valve
Standard Accessories			Installation Manual, Operation Manual, Connection Pipes, Clamps	Installation Manual, Operation Manual, Connection Pipes, Clamps	Installation Manual, Operation Manual, Connection Pipes, Clamps
Drawing No.			C: 4D070746	C: 4D070747	C: 4D070748

Notes:

- ★1 Indoor temp. : 80°FDB(27°CDB), 67°FWB(19.4°CWB) / outdoor temp. : 95°FDB (35°CDB) / Equivalent piping length : 25ft (7.5 m), level difference : 0 ft.
- ★2 Indoor temp. : 70°FDB(21°CDB) / outdoor temp. : 47°FDB, 43°FWB (8.3° CDB, 6° CWB) / Equivalent piping length : 25ft (7.5 m), difference : 0 ft.
- ★3 Anechoic chamber conversion value, measure under JISB8616 conditions. During actual operation, these values are normally somewhat higher as a result of ambient conditions.

Model Name (Combination Unit)			REYQ144PBYD	REYQ168PBYD	REYQ192PBYD
Model Name (Independent Unit)			REMQ72PBYD REMQ72PBYD	REMQ72PBYD REMQ96PBYD	REMQ96PBYD REMQ96PBYD
Power Supply			3 phase, 460V, 60Hz	3 phase, 460V, 60Hz	3 phase, 460V, 60Hz
★1 Cooling Capacity	Nominal	Btu / h	144,000	168,000	192,000
	Rated		138,000	160,000	184,000
★2 Heating Capacity	Nominal	Btu / h	162,000	188,000	216,000
	Rated		154,000	180,000	206,000
Casing Color			Ivory White (5Y7.5/1)	Ivory White (5Y7.5/1)	Ivory White (5Y7.5/1)
Dimensions: (HxWxD)		in. (mm)	66-1/8 × 36-5/8 × 30-1/8 + 66-1/8 × 36-5/8 × 30-1/8 (1680 × 930 × 765 + 1680 × 930 × 765)	66-1/8 × 36-5/8 × 30-1/8 + 66-1/8 × 36-5/8 × 30-1/8 (1680 × 930 × 765 + 1680 × 930 × 765)	66-1/8 × 36-5/8 × 30-1/8 + 66-1/8 × 36-5/8 × 30-1/8 (1680 × 930 × 765 + 1680 × 930 × 765)
Heat Exchanger			Cross Fin Coil	Cross Fin Coil	Cross Fin Coil
Comp.	Type		Hermetically Sealed Scroll Type	Hermetically Sealed Scroll Type	Hermetically Sealed Scroll Type
	Displacement	m ³ /h	(16.90) × 2	16.90 + (10.53+13.34)	(10.53+13.34) × 2
	Number of Revolutions	r/min	(7980) × 2	7980, (2900, 6300)	(2900, 6300) × 2
	Motor Output×Number of Units	kW	(4.7) × 2	(4.7) × 1 + (2.2+4.5) × 1	(2.2+4.5) × 2
	Starting Method		Soft Start	Soft Start	Soft Start
Fan	Type		Propeller Fan	Propeller Fan	Propeller Fan
	Motor Output	kW	(0.75) × 1 + (0.75) × 1	(0.75) × 1 + (0.75) × 1	(0.75) × 1 + (0.75) × 1
	Airflow Rate	cfm	6,350+6,350	6,350+6,530	6,530+6,530
	Drive		Direct Drive	Direct Drive	Direct Drive
Connecting Pipes	Liquid Pipe	in. (mm)	φ1/2 (12.7) C1220T (Brazing Connection)	φ5/8 (15.8) C1220T (Brazing Connection)	φ5/8 (15.8) C1220T (Brazing Connection)
	Suction Gas Pipe	in. (mm)	φ1-1/8 (28.6) C1220T (Brazing Connection)	φ1-1/8 (28.6) C1220T (Brazing Connection)	φ1-1/8 (28.6) C1220T (Brazing Connection)
	High and Low Pressure Gas Pipe	in. (mm)	φ 7/8 (22.2) C1220T (Brazing Connection)	φ 7/8 (22.2) C1220T (Brazing Connection)	φ1-1/8 (28.6) C1220T (Brazing Connection)
	Pressure Equalizer tube	in. (mm)	φ 3/4 (19.1) C1220T (Brazing Connection)	φ 3/4 (19.1) C1220T (Brazing Connection)	φ 3/4 (19.1) C1220T (Brazing Connection)
Mass	Lbs (kg)	463+463 (210+210)	463+573 (210+260)	573+573 (260+260)	
★3 Sound Level (Reference Value)	dBA	60	61	62	
Safety Devices			High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector	High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector	High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector
Defrost Method			Deicer	Deicer	Deicer
Capacity Control		%	13-100	9-100	7-100
Refrigerant	Refrigerant Name		R-410A	R-410A	R-410A
	Charge	Lbs (kg)	18.1 + 18.1 (8.2 +8.2)	18.1 + 19.8 (8.2 + 9)	19.8 + 19.8 (9 +9)
	Control		Electronic Expansion Valve	Electronic Expansion Valve	Electronic Expansion Valve
Standard Accessories			Installation Manual, Operation Manual, Connection Pipes, Clamps	Installation Manual, Operation Manual, Connection Pipes, Clamps	Installation Manual, Operation Manual, Connection Pipes, Clamps
Drawing No.			C: 4D070887	C: 4D070888	C: 4D070889

Notes:

- ★1 Indoor temp. : 80°FDB (27°CDB), 67°FWB(19.4°CWB) / outdoor temp. : 95°FDB (35°CDB) / Equivalent piping length : 25ft (7.5 m), level difference : 0 ft.
- ★2 Indoor temp. : 70°FDB (21°CDB) / outdoor temp. : 47°FDB, 43°FWB (8.3° CDB, 6° CWB) / Equivalent piping length : 25ft (7.5 m), difference : 0 ft.
- ★3 Anechoic chamber conversion value, measure under JISB8616 conditions. During actual operation, these values are normally somewhat higher as a result of ambient conditions.

Model Name (Combination Unit)			REYQ216PBYD	REYQ240PBYD	REYQ264PBYD
Model Name (Independent Unit)			REM96PBYD REM96PBYD	REM120PBYD REM120PBYD	REM72PBYD REM96PBYD REM96PBYD
Power Supply			3 phase, 460V, 60Hz	3 phase, 460V, 60Hz	3 phase, 460V, 60Hz
★1 Cooling Capacity	Nominal	Btu / h	216,000	240,000	264,000
	Rated		206,000	240,000	251,000
★2 Heating Capacity	Nominal	Btu / h	243,000	270,000	297,000
	Rated		231,000	257,000	283,000
Casing Color			Ivory White (5Y7.5/1)	Ivory White (5Y7.5/1)	Ivory White (5Y7.5/1)
Dimensions: (H×W×D)		in. (mm)	66-1/8 × 36-5/8 × 30-1/8 + 66-1/8 × 36-5/8 × 30-1/8 (1680 × 930 × 765 + 1680 × 930 × 765)	66-1/8 × 36-5/8 × 30-1/8 + 66-1/8 × 36-5/8 × 30-1/8 (1680 × 930 × 765 + 1680 × 930 × 765)	66-1/8 × 36-5/8 × 30-1/8 + 66-1/8 × 36-5/8 × 30-1/8 + 66-1/8 × 36-5/8 × 30-1/8 (1680 × 930 × 765 + 1680 × 930 × 765 + 1680 × 930 × 765)
Heat Exchanger			Cross Fin Coil	Cross Fin Coil	Cross Fin Coil
Comp.	Type		Hermetically Sealed Scroll Type	Hermetically Sealed Scroll Type	Hermetically Sealed Scroll Type
	Displacement	m ³ /h	(10.53+13.34) × 2	(10.53+13.34) × 2	16.90 + (10.53+13.34) × 2
	Number of Revolutions	r/min	(2900, 6300) × 2	(2900, 6300) × 2	7980, (2900, 6300) × 2
	Motor Output×Number of Units	kW	(2.2+4.5) × 1 + (3.5+4.5) × 1	(3.5+4.5) × 2	(4.7) × 1 + (2.2+4.5) × 2
	Starting Method		Soft Start	Soft Start	Soft Start
Fan	Type		Propeller Fan	Propeller Fan	Propeller Fan
	Motor Output	kW	(0.75) × 1 + (0.75) × 1	(0.75) × 1 + (0.75) × 1	(0.75) × 1 + (0.75) × 1 + (0.75) × 1
	Airflow Rate	cfm	6,530+7,060	7,060+7,060	6,350+6,530+6,530
	Drive		Direct Drive	Direct Drive	Direct Drive
Connecting Pipes	Liquid Pipe	in. (mm)	φ5/8 (15.8) C1220T (Brazing Connection)	φ5/8 (15.8) C1220T (Brazing Connection)	φ3/4 (19.1) C1220T (Brazing Connection)
	Suction Gas Pipe	in. (mm)	φ 1-1/8 (28.6) C1220T (Brazing Connection)	φ1-3/8 (35) C1220T (Brazing Connection)	φ1-3/8 (35) C1220T (Brazing Connection)
	High and Low Pressure Gas Pipe	in. (mm)	φ 1-1/8 (28.6) C1220T (Brazing Connection)	φ 1-1/8 (28.6) C1220T (Brazing Connection)	φ 1-1/8 (28.6) C1220T (Brazing Connection)
	Pressure Equalizer tube	in. (mm)	φ 3/4 (19.1) C1220T (Brazing Connection)	φ 3/4 (19.1) C1220T (Brazing Connection)	φ 3/4 (19.1) C1220T (Brazing Connection)
Mass	Lbs (kg)	573 + 573 (260 + 260)	573 + 573 (260 + 260)	463 + 573 + 573 (210 + 260 + 260)	
★3 Sound Level (Reference Value)	dBA	62	63	62	
Safety Devices			High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector	High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector	High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector
Defrost Method			Deicer	Deicer	Deicer
Capacity Control		%	7~100	6~100	6~100
Refrigerant	Refrigerant Name		R-410A	R-410A	R-410A
	Charge	Lbs (kg)	19.8+20.1 (9 + 9.1)	20.1+20.1 (9.1 + 9.1)	18.1+19.8+19.8 (8.2 + 9 + 9)
	Control		Electronic Expansion Valve	Electronic Expansion Valve	Electronic Expansion Valve
Standard Accessories			Installation Manual, Operation Manual, Connection Pipes, Clamps	Installation Manual, Operation Manual, Connection Pipes, Clamps	Installation Manual, Operation Manual, Connection Pipes, Clamps
Drawing No.			C: 4D070890	C: 4D070891	C: 4D070902

Notes:

- ★1 Indoor temp. : 80°FDB (27°CDB), 67°FWB(19.4°CWB) / outdoor temp. : 95°FDB (35°CDB) / Equivalent piping length : 25ft (7.5 m), level difference : 0 ft.
- ★2 Indoor temp. : 70°FDB (21°CDB) / outdoor temp. : 47°FDB, 43°FWB (8.3° CDB, 6° CWB) / Equivalent piping length : 25ft (7.5 m), difference : 0 ft.
- ★3 Anechoic chamber conversion value, measure under JISB8616 conditions. During actual operation, these values are normally somewhat higher as a result of ambient conditions.

Model Name (Combination Unit)			REYQ288PBYD	REYQ312PBYD	REYQ336PBYD
Model Name (Independent Unit)			REM072PBYD REM096PBYD REM0120PBYD	REM096PBYD REM096PBYD REM0120PBYD	REM096PBYD REM0120PBYD REM0120PBYD
Power Supply			3 phase, 460V, 60Hz	3 phase, 460V, 60Hz	3 phase, 460V, 60Hz
★1 Cooling Capacity	Nominal	Btu / h	288,000	312,000	336,000
	Rated		274,000	297,000	320,000
★2 Heating Capacity	Nominal	Btu / h	324,000	351,000	378,000
	Rated		308,000	334,000	360,000
Casing Color			Ivory White (5Y7.5/1)	Ivory White (5Y7.5/1)	Ivory White (5Y7.5/1)
Dimensions: (H×W×D)		in. (mm)	66-1/8 × 36-5/8 × 30-1/8 + 66-1/8 × 36-5/8 × 30-1/8 + 66-1/8 × 36-5/8 × 30-1/8 (1680 × 930 × 765 + 1680 × 930 × 765 + 1680 × 930 × 765)	66-1/8 × 36-5/8 × 30-1/8 + 66-1/8 × 36-5/8 × 30-1/8 + 66-1/8 × 36-5/8 × 30-1/8 (1680 × 930 × 765 + 1680 × 930 × 765 + 1680 × 930 × 765)	66-1/8 × 36-5/8 × 30-1/8 + 66-1/8 × 36-5/8 × 30-1/8 + 66-1/8 × 36-5/8 × 30-1/8 (1680 × 930 × 765 + 1680 × 930 × 765 + 1680 × 930 × 765)
Heat Exchanger			Cross Fin Coil	Cross Fin Coil	Cross Fin Coil
Comp.	Type		Hermetically Sealed Scroll Type	Hermetically Sealed Scroll Type	Hermetically Sealed Scroll Type
	Displacement	m ³ /h	16.90 + (10.53+13.34) × 2	(10.53+13.34) × 3	(10.53+13.34) × 3
	Number of Revolutions	r/min	7980, (2900, 6300) × 2	(2900, 6300) × 3	(2900, 6300) × 3
	Motor Output×Number of Units	kW	(4.7) × 1 + (2.2+4.5) × 1 + (3.5+4.5) × 1	(2.2+4.5) × 2 + (3.5+4.5) × 1	(2.2+4.5) × 1 + (3.5+4.5) × 2
	Starting Method		Soft Start	Soft Start	Soft Start
Fan	Type		Propeller Fan	Propeller Fan	Propeller Fan
	Motor Output	kW	(0.75) × 1 + (0.75) × 1 + (0.75) × 1	(0.75) × 1 + (0.75) × 1 + (0.75) × 1	(0.75) × 1 + (0.75) × 1 + (0.75) × 1
	Airflow Rate	cfm	6,350+6,530+7,060	6,530+6,530+7,060	6,530+7,060+7,060
	Drive		Direct Drive	Direct Drive	Direct Drive
Connecting Pipes	Liquid Pipe	in. (mm)	φ3/4 (19.1) C1220T (Brazing Connection)	φ3/4 (19.1) C1220T (Brazing Connection)	φ3/4 (19.1)C1220T (Brazing Connection)
	Suction Gas Pipe	in. (mm)	φ1-3/8 (35)C1220T (Brazing Connection)	φ1-3/8 (35) C1220T (Brazing Connection)	φ1-3/8 (35) C1220T (Brazing Connection)
	High and Low Pressure Gas Pipe	in. (mm)	φ1-1/8 (28.6) C1220T (Brazing Connection)	φ1-1/8 (28.6) C1220T (Brazing Connection)	φ1-1/8 (28.6) C1220T (Brazing Connection)
	Pressure Equalizer tube	in. (mm)	φ3/4 (19.1) C1220T (Brazing Connection)	φ3/4 (19.1) C1220T (Brazing Connection)	φ3/4 (19.1) C1220T (Brazing Connection)
Mass	Lbs (kg)	463+573+573 (210+260+260)	573+573+573 (260+260+260)	573+573+573 (260+260+260)	
★3 Sound Level (Reference Value)	dBA	63	64	64	
Safety Devices			High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector	High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector	High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector
Defrost Method			Deicer	Deicer	Deicer
Capacity Control		%	5~100	5~100	4~100
Refrigerant	Refrigerant Name		R-410A	R-410A	R-410A
	Charge	Lbs (kg)	18.1 + 19.8 + 20.1 (8.2+9+9.1)	19.8 + 19.8 + 20.1 (9 + 9+ 9.1)	19.8 + 20.1 + 20.1 (9 +9.1 +9.1)
	Control		Electronic Expansion Valve	Electronic Expansion Valve	Electronic Expansion Valve
Standard Accessories			Installation Manual, Operation Manual, Connection Pipes, Clamps	Installation Manual, Operation Manual, Connection Pipes, Clamps	Installation Manual, Operation Manual, Connection Pipes, Clamps
Drawing No.			C: 4D070903	C: 4D070904	C: 4D070905


Notes:

- ★1 Indoor temp. : 80°FDB(27°CDB), 67°FWB(19.4°CWB) / outdoor temp. : 95°FDB (35°CDB) / Equivalent piping length : 25ft (7.5 m), level difference : 0 ft.
- ★2 Indoor temp. : 70°FDB(21°CDB) / outdoor temp. : 47°FDB, 43°FWB (8.3°CDB, 6°CWB) / Equivalent piping length : 25ft (7.5 m), difference : 0 ft.
- ★3 Anechoic chamber conversion value, measure under JISB8616 conditions. During actual operation, these values are normally somewhat higher as a result of ambient conditions.

2. Dimensions

REYQ72PYDN / REYQ96PYDN / REYQ120PYDN



19850861.C

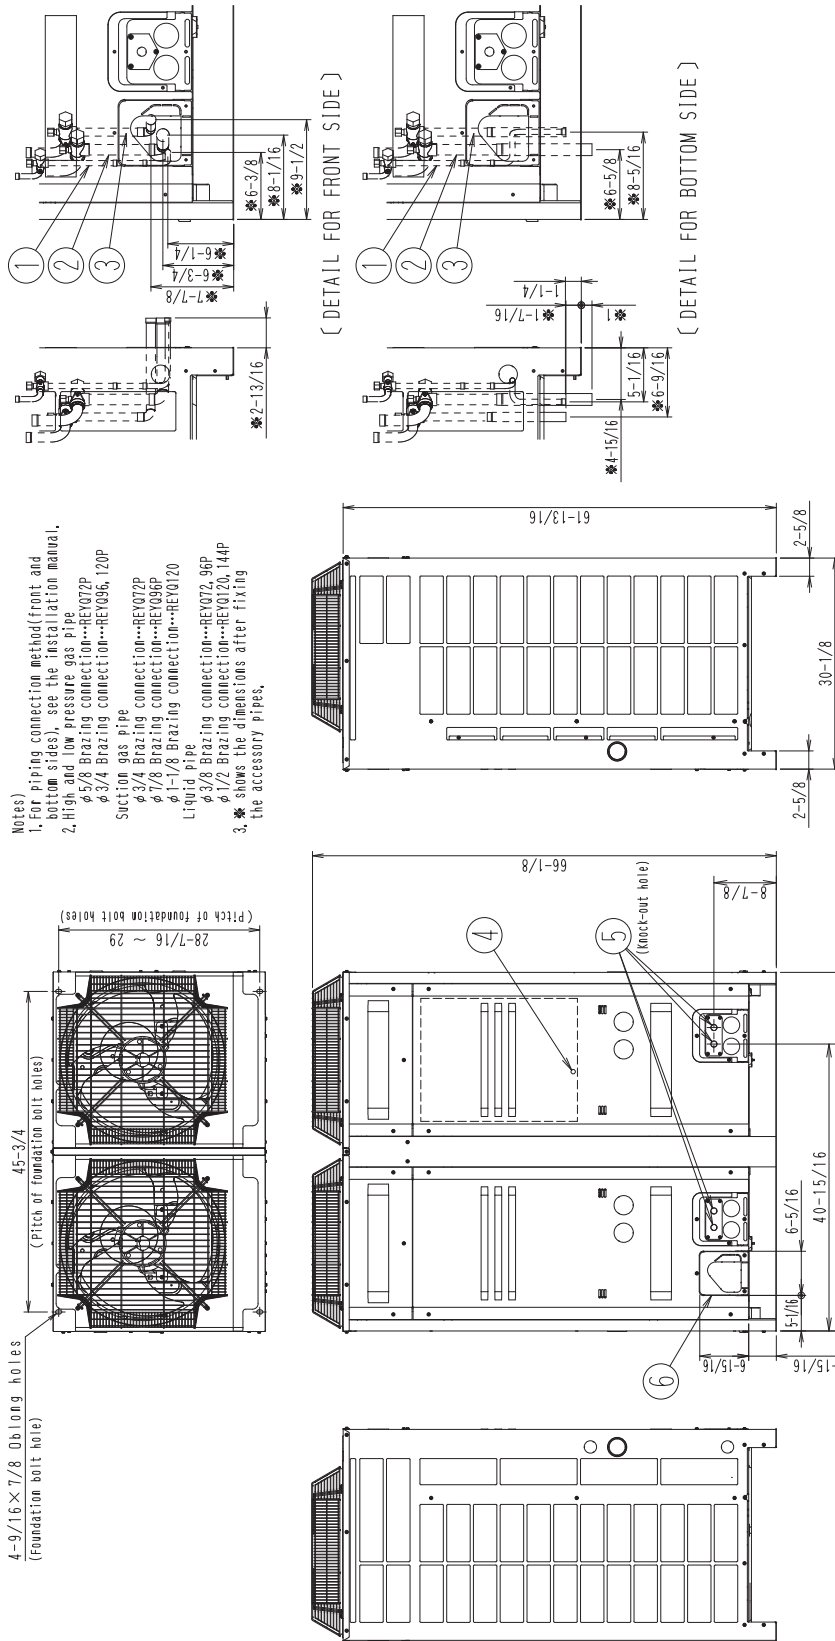

- Notes)
- For piping connection method (front and bottom sides), see the installation manual.
 - High and low pressure gas pipe
 - φ5/8 Brazing connection---REYQ72P
 - φ3/4 Brazing connection---REYQ96, 120P
 - Suction gas pipe
 - φ3/4 Brazing connection---REYQ72P
 - φ7/8 Brazing connection---REYQ96P
 - φ1-1/8 Brazing connection---REYQ120
 - Liquid pipe
 - φ3/8 Brazing connection---REYQ72, 96P
 - φ1/2 Brazing connection---REYQ120, 144P
3. * Shows the dimensions after fixing the accessory pipes.



No.	Parts name	Remarks
7	Pipe routing hole(bottom)	See note 1.
6	Pipe routing hole(front)	See note 1.
5	Power cord routing hole(front)	φ7/8 Inside of electrical components box(M8)
4	Grounding terminal	See note 2.
3	Gas pipe connection port (Only for REYQ14P)	See note 2.
3	High and low pressure gas pipe connection port	See note 2.
2	Suction gas pipe connection port	See note 2.
1	Liquid pipe connection port	See note 2.

REYQ144PBYD / REYQ168PBYD / REYQ192PBYD / REYQ216PBYD / REYQ240PBYD

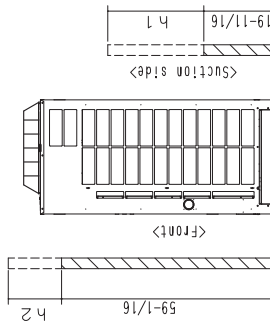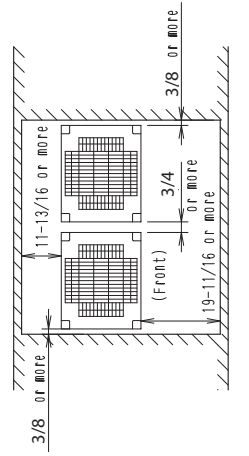

Outdoor Unit 2	
Model Name	REMQ72PBYD
Model Name	REMQ72PBYD
Model Name	REMQ96PBYD
Model Name	REMQ96PBYD
Model Name	REMQ120PBYD
Model Name	REMQ120PBYD


Outdoor Unit 1	
Model Name	REYQ144PBYD
Model Name	REYQ168PBYD
Model Name	REYQ192PBYD
Model Name	REYQ216PBYD
Model Name	REYQ240PBYD
Model Name	REYQ240PBYD

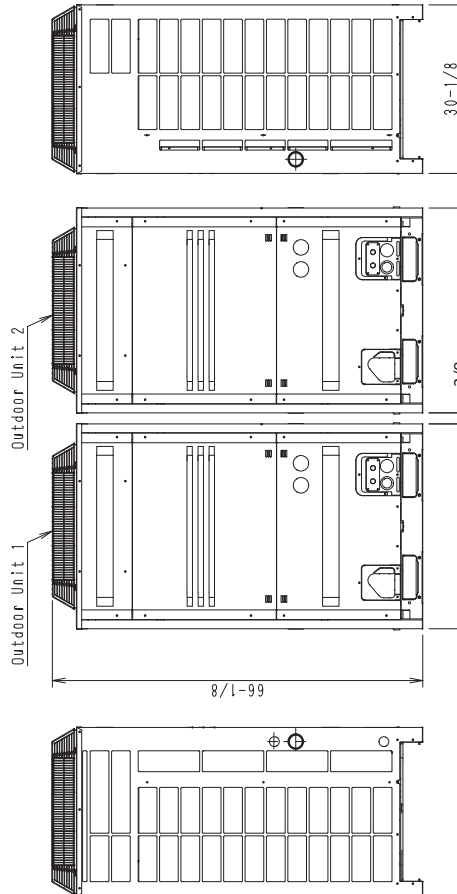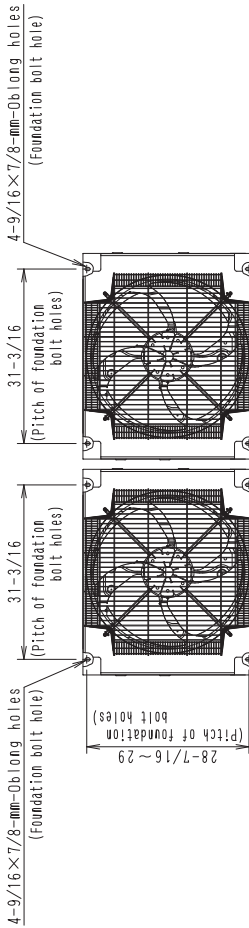

- Notes :
1. Heights of walls
 Suction side : 19-11/16in
 Front : 59-1/16in
 Side : Height unrestricted
 The installation space shown in this figure is based on the condition of cooling operation at the outdoor air temperature of 95°F.
 The installation space of suction side shown above must be expanded in the following case.
 • Design outdoor temperature becomes over 95°F.
 • Operating over Max. operating load (In case of causing a heavy heating load at indoor unit side)
 2. If the above wall heights are exceeded then h2/2 and h1/2 should be added to the front and suction side service spaces respectively as shown in the following figure.
 3. When installing the units the most appropriate pattern should be selected from those in Section 3. In order to obtain the best fit in the space available always bearing in mind the need to leave enough room for a person to pass between unit and wall and for the air to circulate freely.
 (If more units are to be installed than are catered for in the above patterns your layout should take account of the possibility of short circuiting.)
 4. The units should be installed to leave sufficient space at the front for the on site refrigerant piping work to be carried out comfortably.

C: 3D070788

REYQ264PBYD / REYQ288PBYD / REYQ312PBYD / REYQ336PBYD

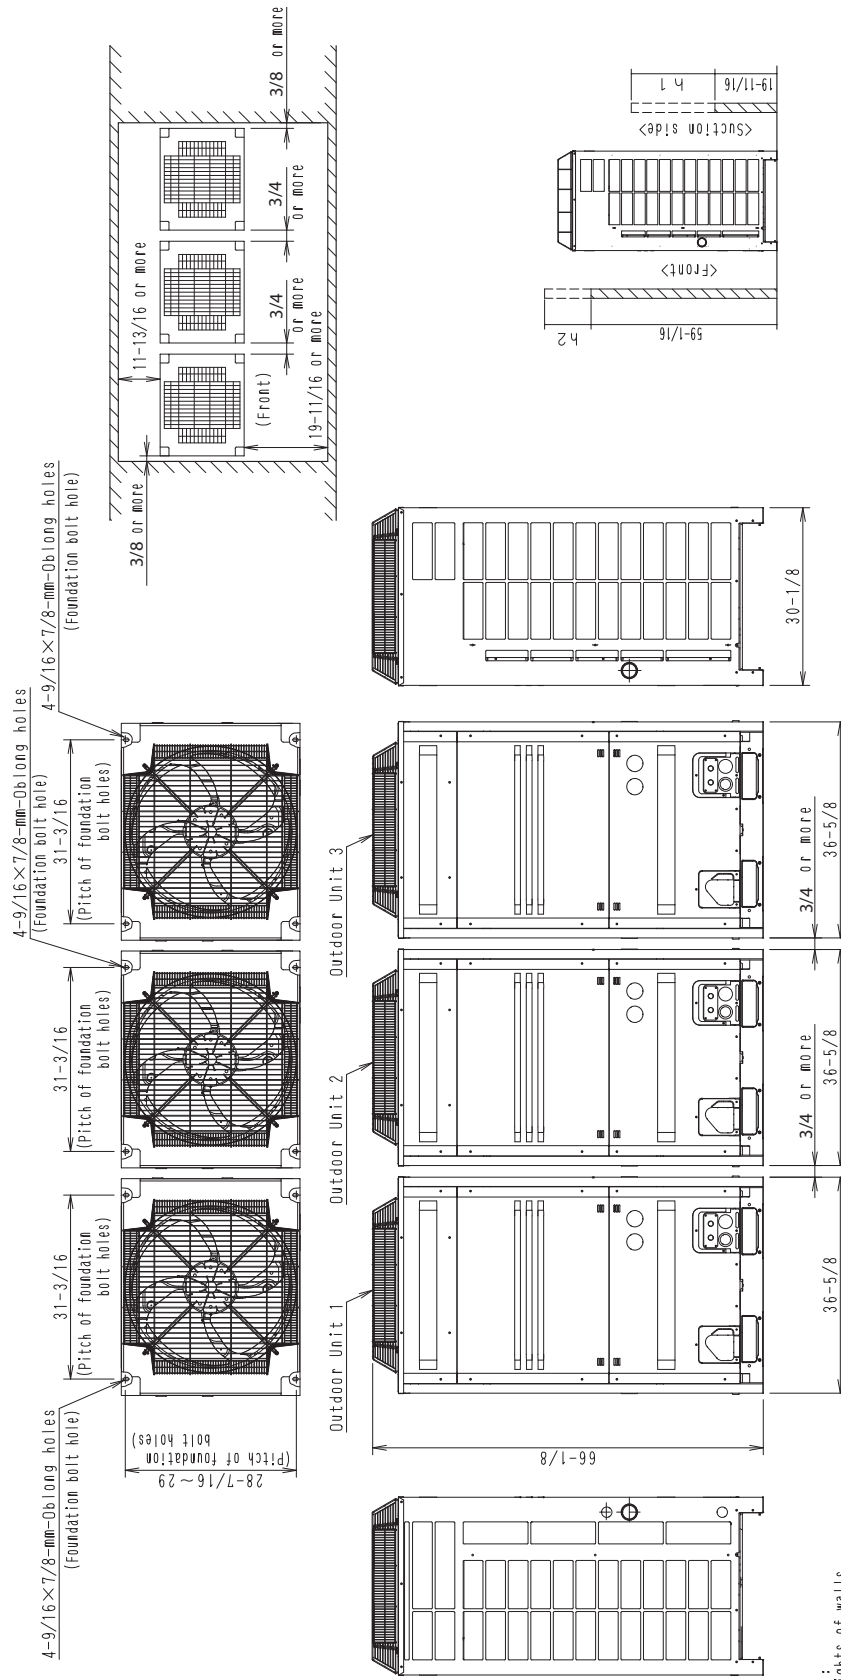


- Notes :
1. Heights of walls
 Suction side : 19-11/16in
 Side : Height unrestricted
 The installation space shown in this figure is based on the condition of cooling operation at the outdoor air temperature of 95°F.
 The installation space of suction side shown above must be expanded in the following case.
 • Operation over Max. operating load (In case of causing a heavy heating load at indoor unit side)
 • If the above wall heights are exceeded then k2/2 and h1/2 should be added to the front and suction side service spaces respectively as shown in the following figure.
 2. When installing the units the most appropriate pattern should be selected from those in Section 3. In order to obtain the best fit, the space available always be selected from those in Section 3. (If a person to pass between unit and wall and for the air to circulate freely).
 3. If more units are to be installed, than are catered for in the above patterns your layout should take account of the possibility of short circuiting).
 4. The units should be installed to leave sufficient space at the front for the on site refrigerant piping work to be carried out comfortably.

Model Name	Outdoor Unit 1	Outdoor Unit 2	Outdoor Unit 3
REYQ264PBYD	REMQ96PBYD	REMQ96PBYD	REMQ72PBYD
REYQ288PBYD	REMQ120PBYD	REMQ96PBYD	REMQ72PBYD
REYQ312PBYD	REMQ120PBYD	REMQ96PBYD	REMQ96PBYD
REYQ336PBYD	REMQ120PBYD	REMQ120PBYD	REMQ96PBYD

C: 3D070858

REM72PBYD / REM96PBYD / REM120PBYD

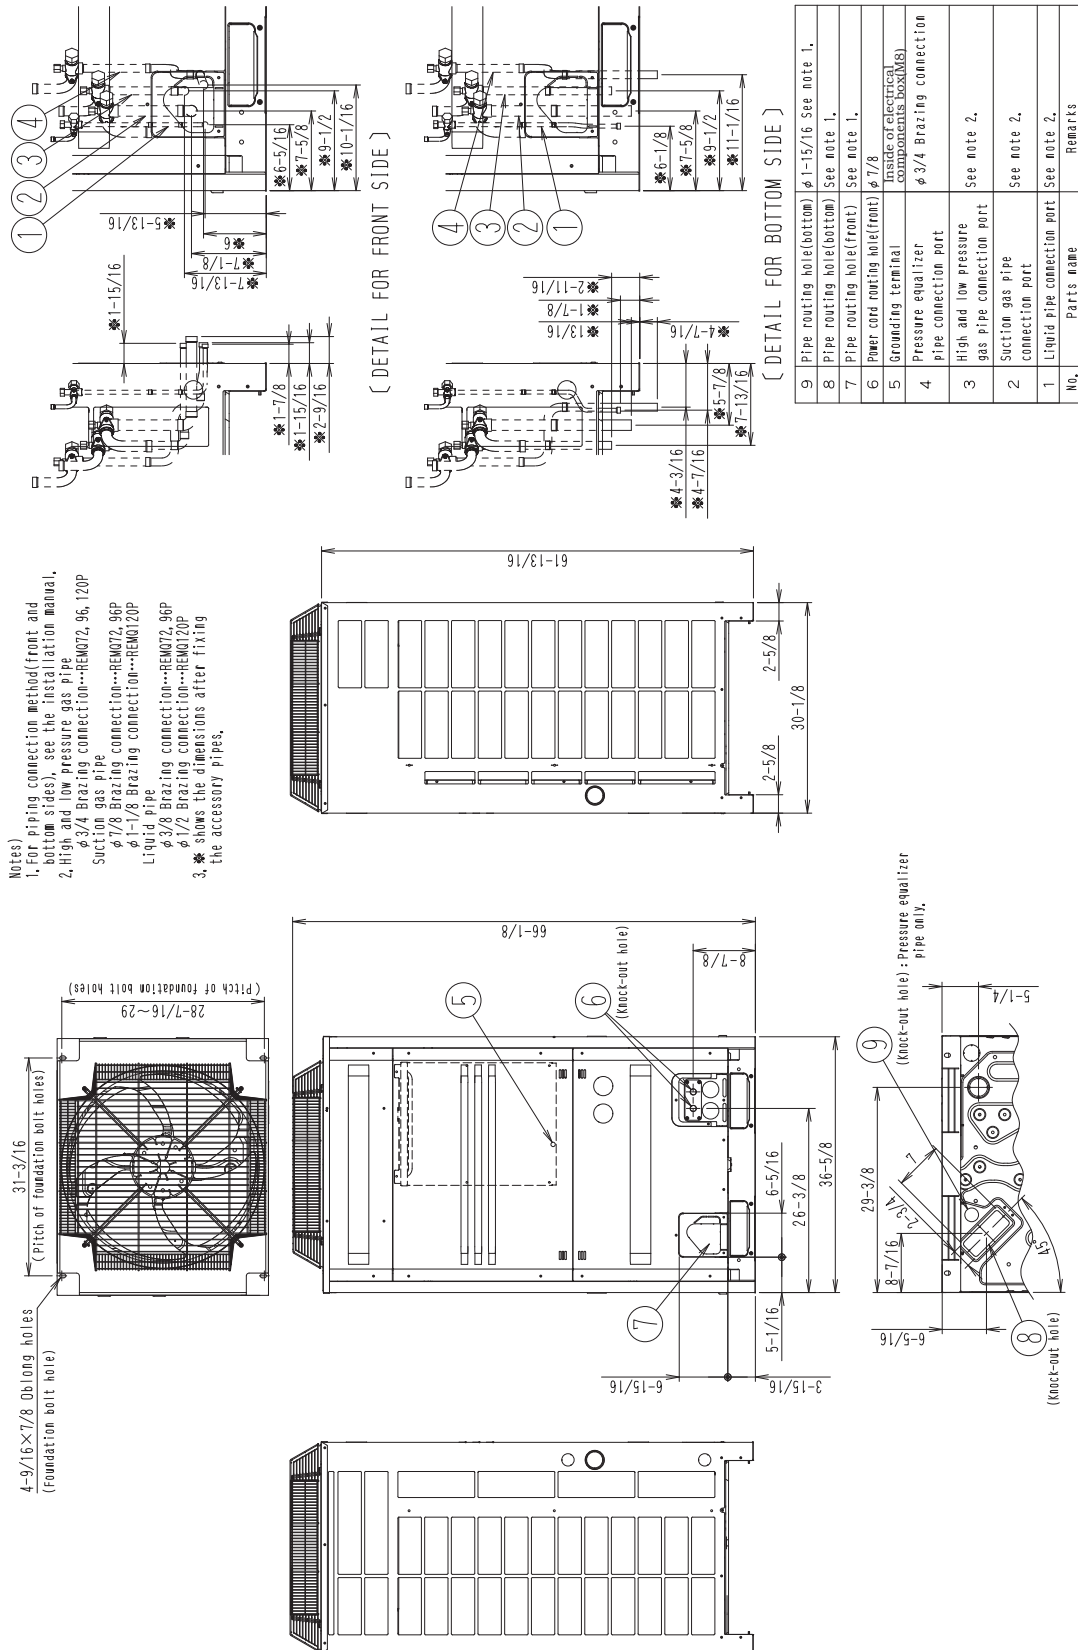


3D058617C


3. Service Space

REYQ72PYDN / REYQ96PYDN / REYQ120PYDN / REYQ144PBYD / REYQ168PBYD / REYQ192PBYD / REYQ216PBYD / REYQ240PBYD / REYQ264PBYD / REYQ288PBYD / REYQ312PBYD / REYQ336PBYD

3D058620B

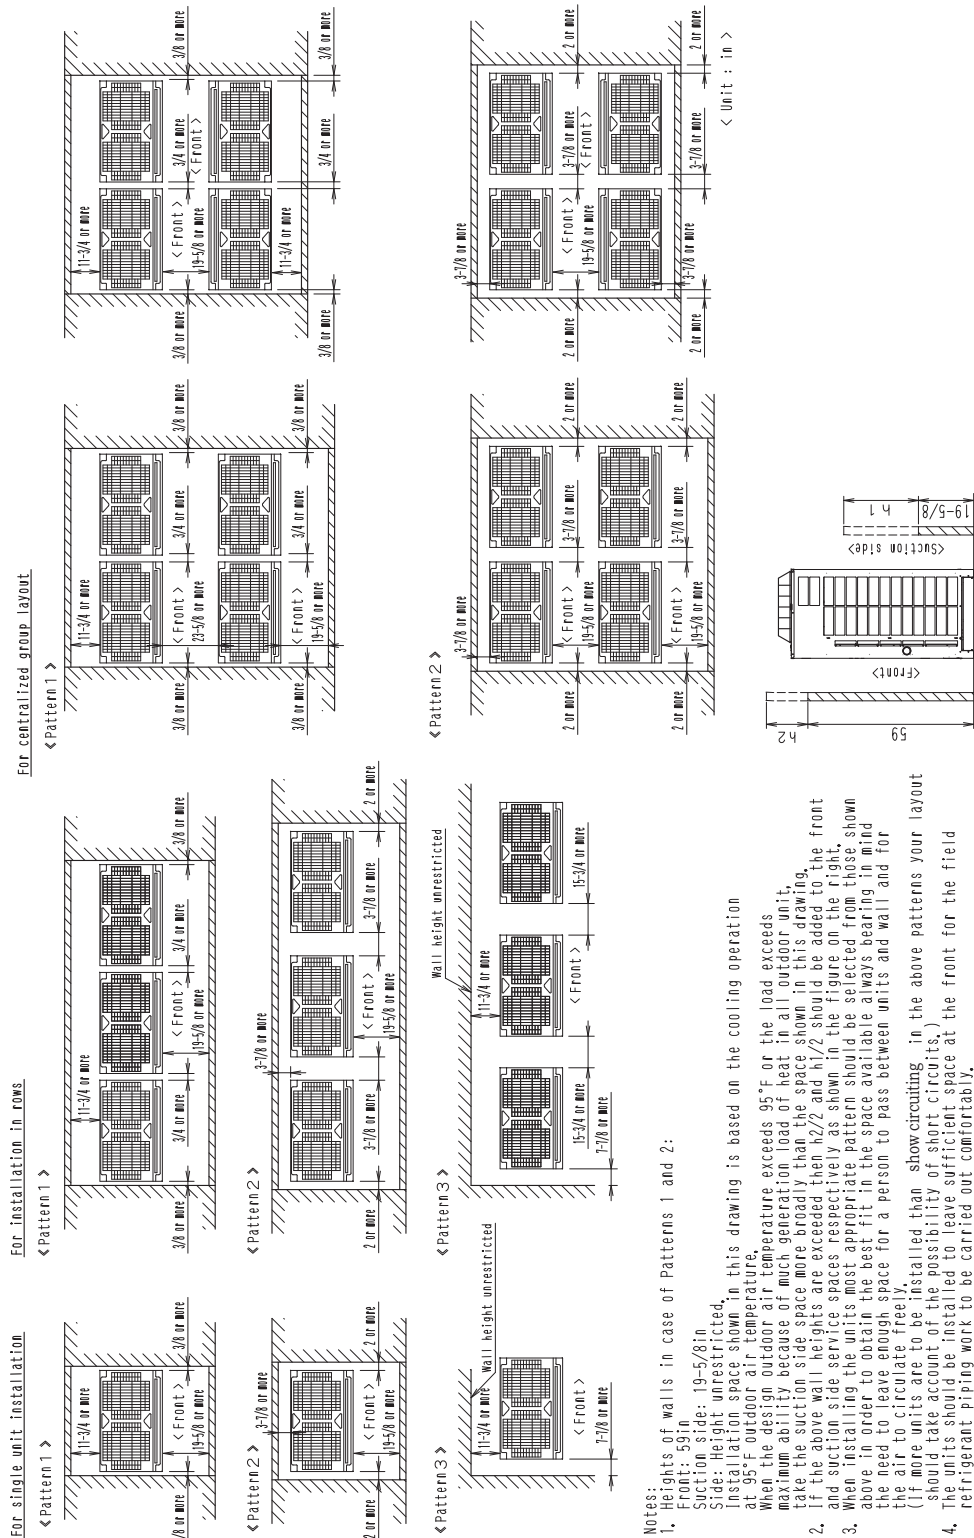


REM72PBYD

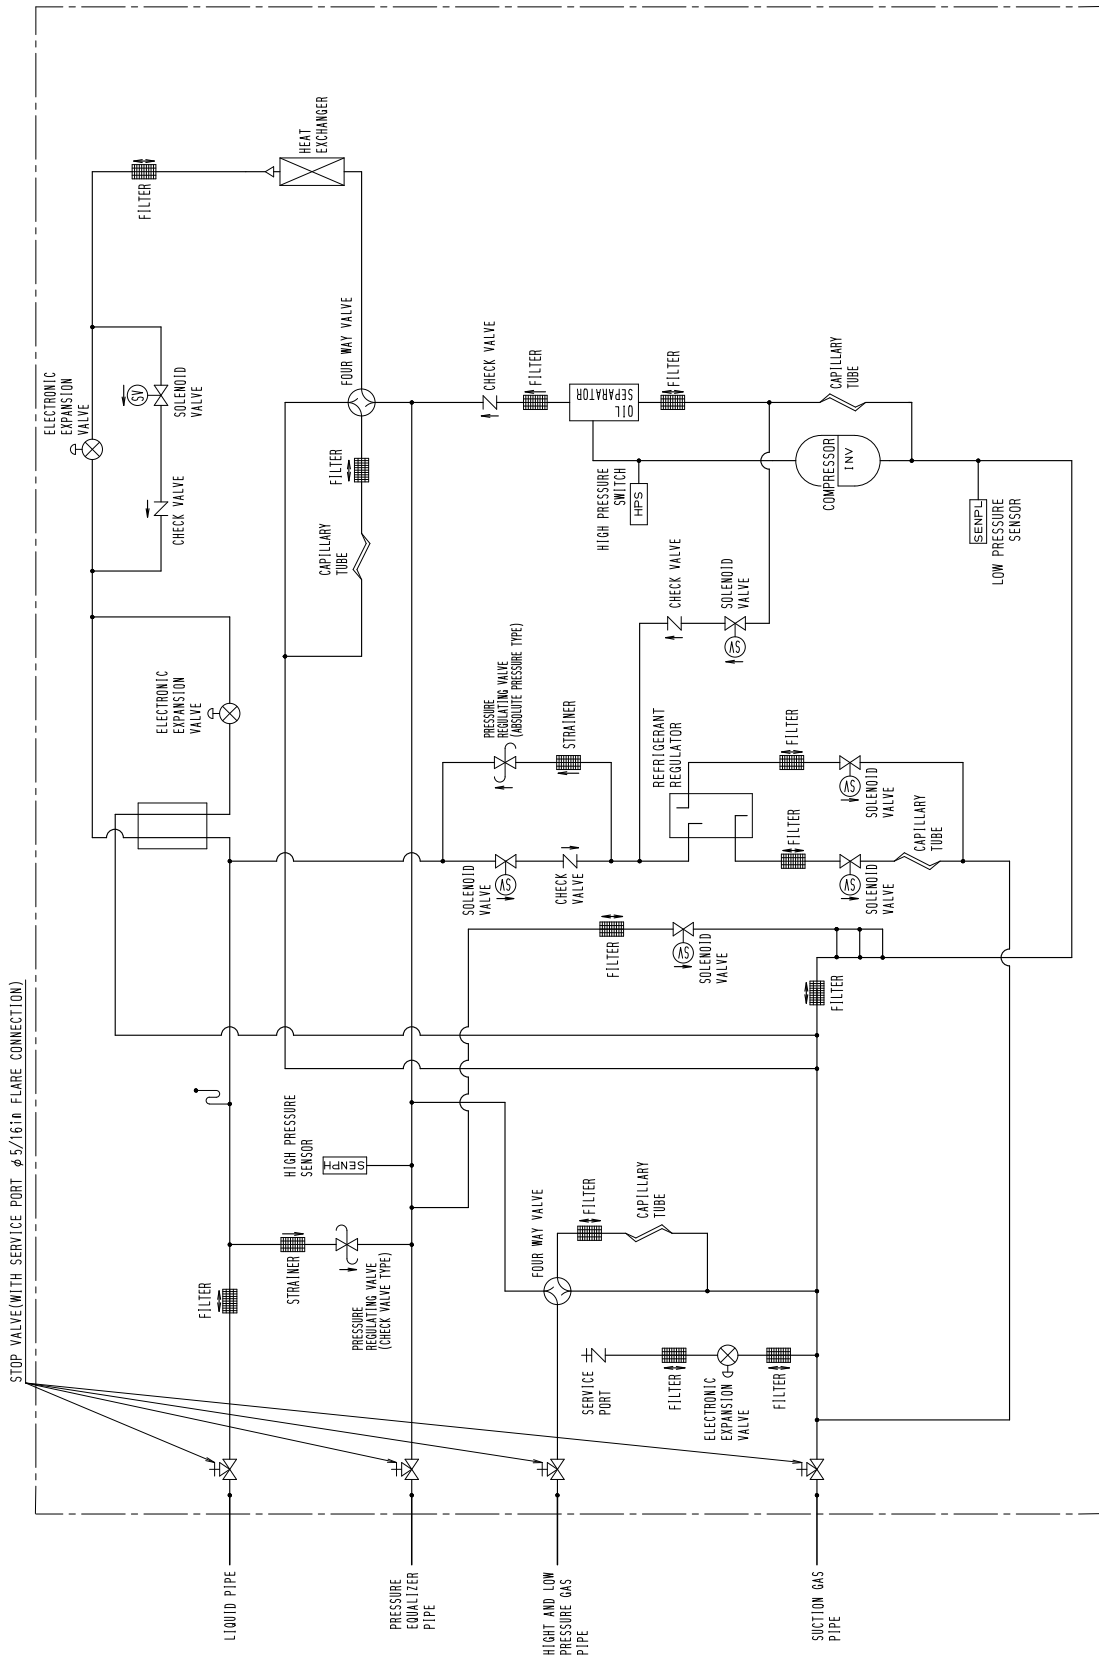

3D058637C





REM96PBYD / REMQ120PBYD

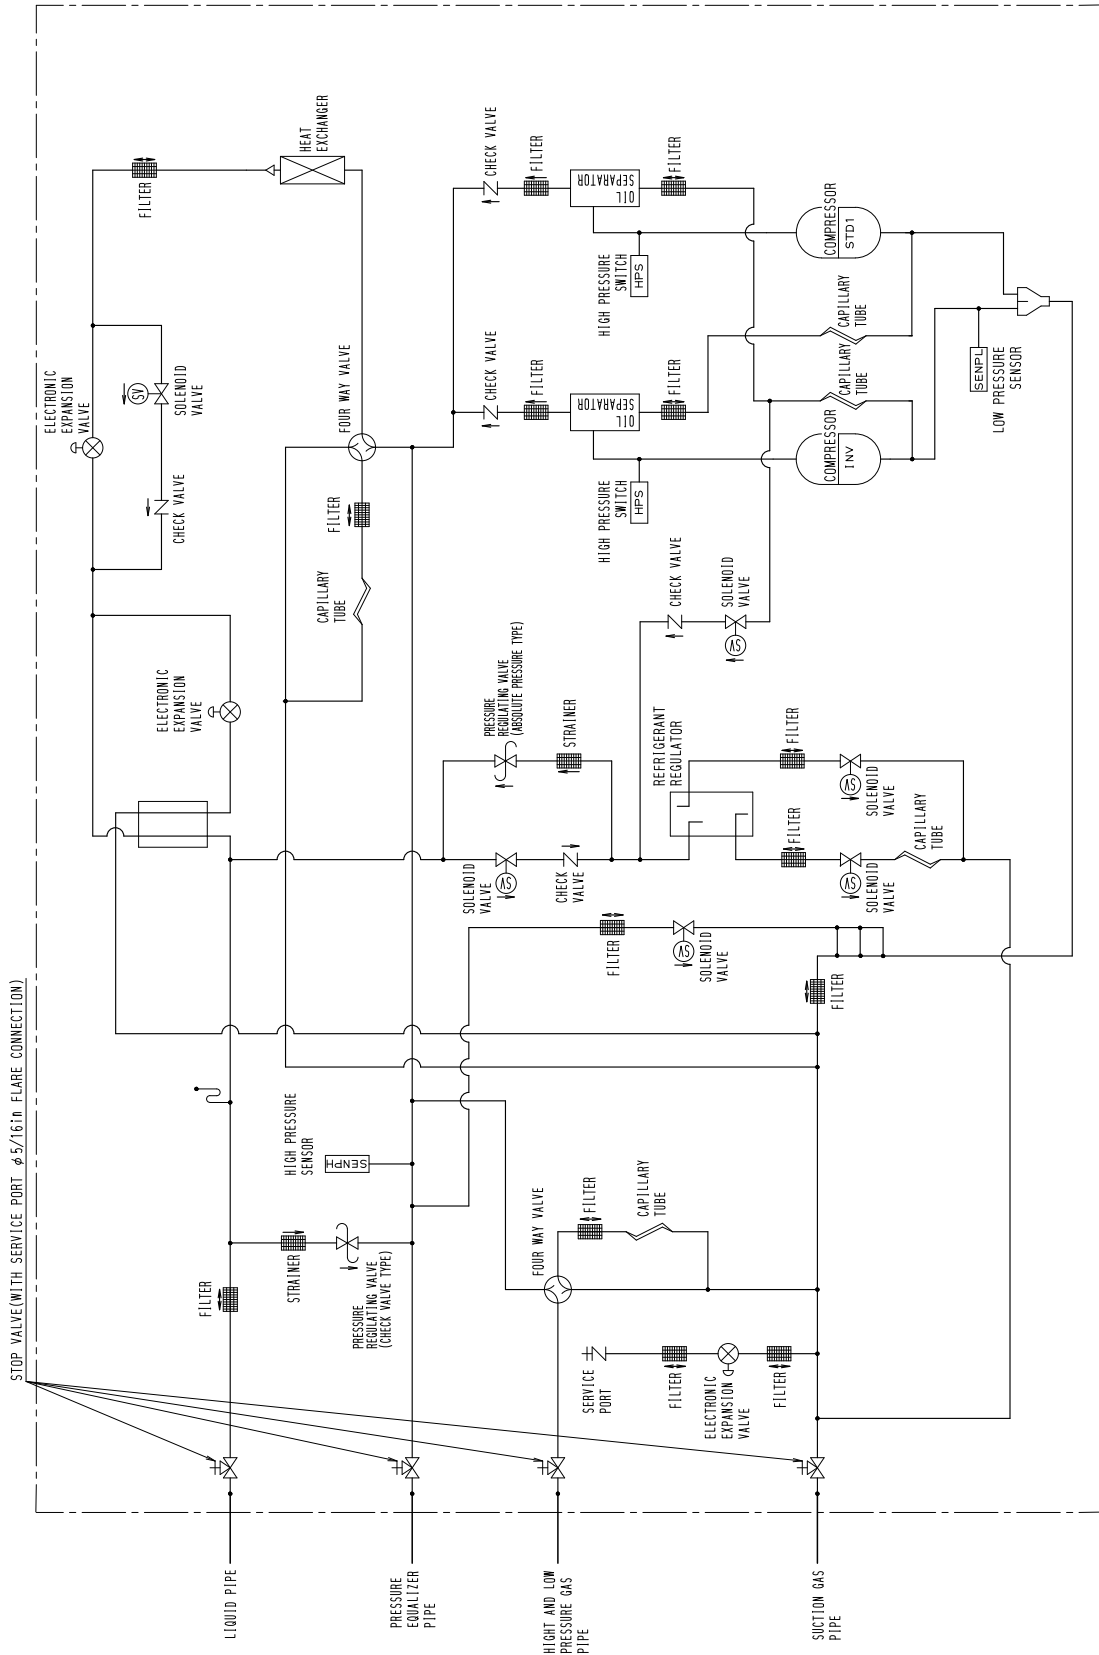

3D058638C

5. Wiring Diagrams


REYQ72PYDN / REYQ96PYDN / REYQ120PYDN

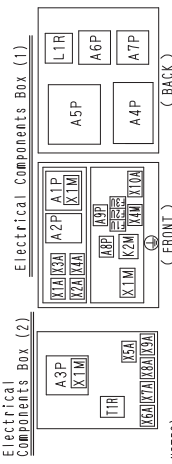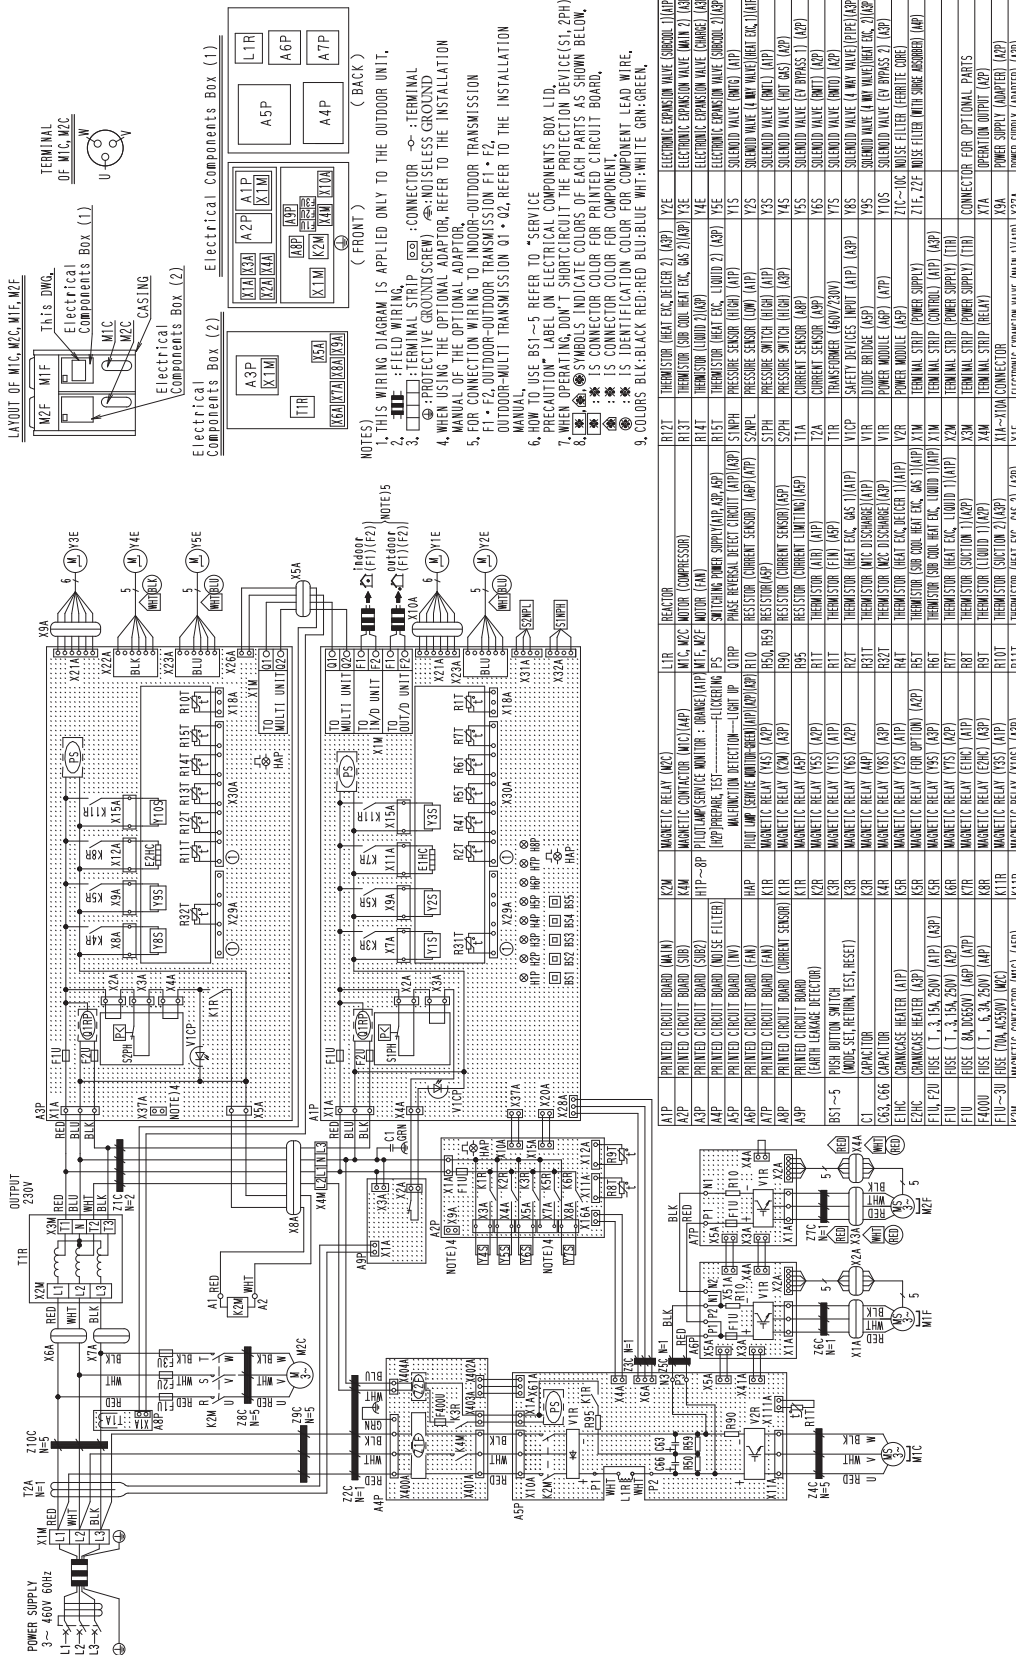

- NOTES
1. THIS WIRING DIAGRAM IS APPLIED ONLY TO THE OUTDOOR UNIT.
 2. **W**: FIELD WIRING.
 3. **+**: TERMINAL STRIP. **+**: CONNECTOR. **-**: TERMINAL.
 4. **⊕**: PROTECTIVE GROUNDING SCREW. **⊕**: NOISELESS GROUND.
 5. MANUAL OF THE OPTIONAL ADAPTOR, REFER TO THE INSTALLATION.
 6. FOR CONNECTION WIRING TO INDOOR-OUTDOOR TRANSMISSION UNIT, REFER TO THE INSTALLATION MANUAL.
 7. HOW TO USE BS1~5 REFER TO "SERVICE PRECAUTION" LABEL ON ELECTRICAL COMPONENTS BOX LID.
 8. WHEN OPERATING, DON'T SHORTCIRCUIT THE PROTECTION DEVICE (SI, 2PH).
 9. **⊕**: IS CONNECTOR COLOR FOR PRINTED CIRCUIT BOARD.
 10. **⊕**: IS IDENTIFICATION COLOR FOR COMPONENT.
 11. **⊕**: IS IDENTIFICATION COLOR FOR COMPONENT LEAD WIRE.
 12. COLORS: BLK:BLACK; RED:RED; BLU:BLUE; WHI:WHITE; GRN:GREEN.

R12T	TEHRMISTOR (HEAT EXC. DETEC. 2)	(ASP)	Y7E	ELECTRONIC EXPANSION VALVE (SHOUD. 1)	(ASP)
R13T	TEHRMISTOR (HEAT EXC. DETEC. GAS 2)	(ASP)	Y7E	ELECTRONIC EXPANSION VALVE (MAIN 2)	(ASP)
R14T	TEHRMISTOR (LIQUID 1)	(ASP)	Y4E	ELECTRONIC EXPANSION VALVE (SHOUD. 1)	(ASP)
R15T	TEHRMISTOR (HEAT EXC. LIQUID 2)	(ASP)	Y5E	ELECTRONIC EXPANSION VALVE (SHOUD. 2)	(ASP)
S10PH	PRESSURE SENSOR (HIGH)	(ASP)	Y1S	SOLENOID VALVE (HIGH)	(ASP)
S10PL	PRESSURE SENSOR (LOW)	(ASP)	Y2S	SOLENOID VALVE (LOW)	(ASP)
S10PH	PRESSURE SWITCH (HIGH)	(ASP)	Y4S	SOLENOID VALVE (HIGH)	(ASP)
S10PL	PRESSURE SWITCH (LOW)	(ASP)	Y5S	SOLENOID VALVE (LOW)	(ASP)
T1A	CURRENT SENSOR	(ASP)	Y6S	SOLENOID VALVE (MAIN)	(ASP)
T1R	TRANSFORMER (460V/230V)	(ASP)	Y7S	SOLENOID VALVE (MAIN)	(ASP)
V1C	SAFETY SWITCH (HIGH)	(ASP)	Y8S	SOLENOID VALVE (MAIN)	(ASP)
V1P	DIODE BRIDGE	(ASP)	Y9S	SOLENOID VALVE (MAIN)	(ASP)
V1R	POWER MODULE (ASP)	(ASP)	Y10S	SOLENOID VALVE (MAIN)	(ASP)
Y2R	POWER MODULE (ASP)	(ASP)	Z1C	NOISE FILTER (FERRITE CORE)	(ASP)
X1M	TERMINAL STRIP (POWER SUPPLY)	(ASP)	Z1F, Z2F	NOISE FILTER (WITH SHIELDING)	(ASP)
X1M	TERMINAL STRIP (CONTROL)	(ASP)			
X2M	TERMINAL STRIP (POWER SUPPLY)	(ASP)			
X3M	TERMINAL STRIP (POWER SUPPLY)	(ASP)			
X4M	TERMINAL STRIP (POWER SUPPLY)	(ASP)			
X5M	TERMINAL STRIP (RELAY)	(ASP)			
X6M	CONNECTOR	(ASP)			
Y9A	POWER SUPPLY (ADAPTER)	(ASP)			
Y10A	POWER SUPPLY (ADAPTER)	(ASP)			

REM72PBYD

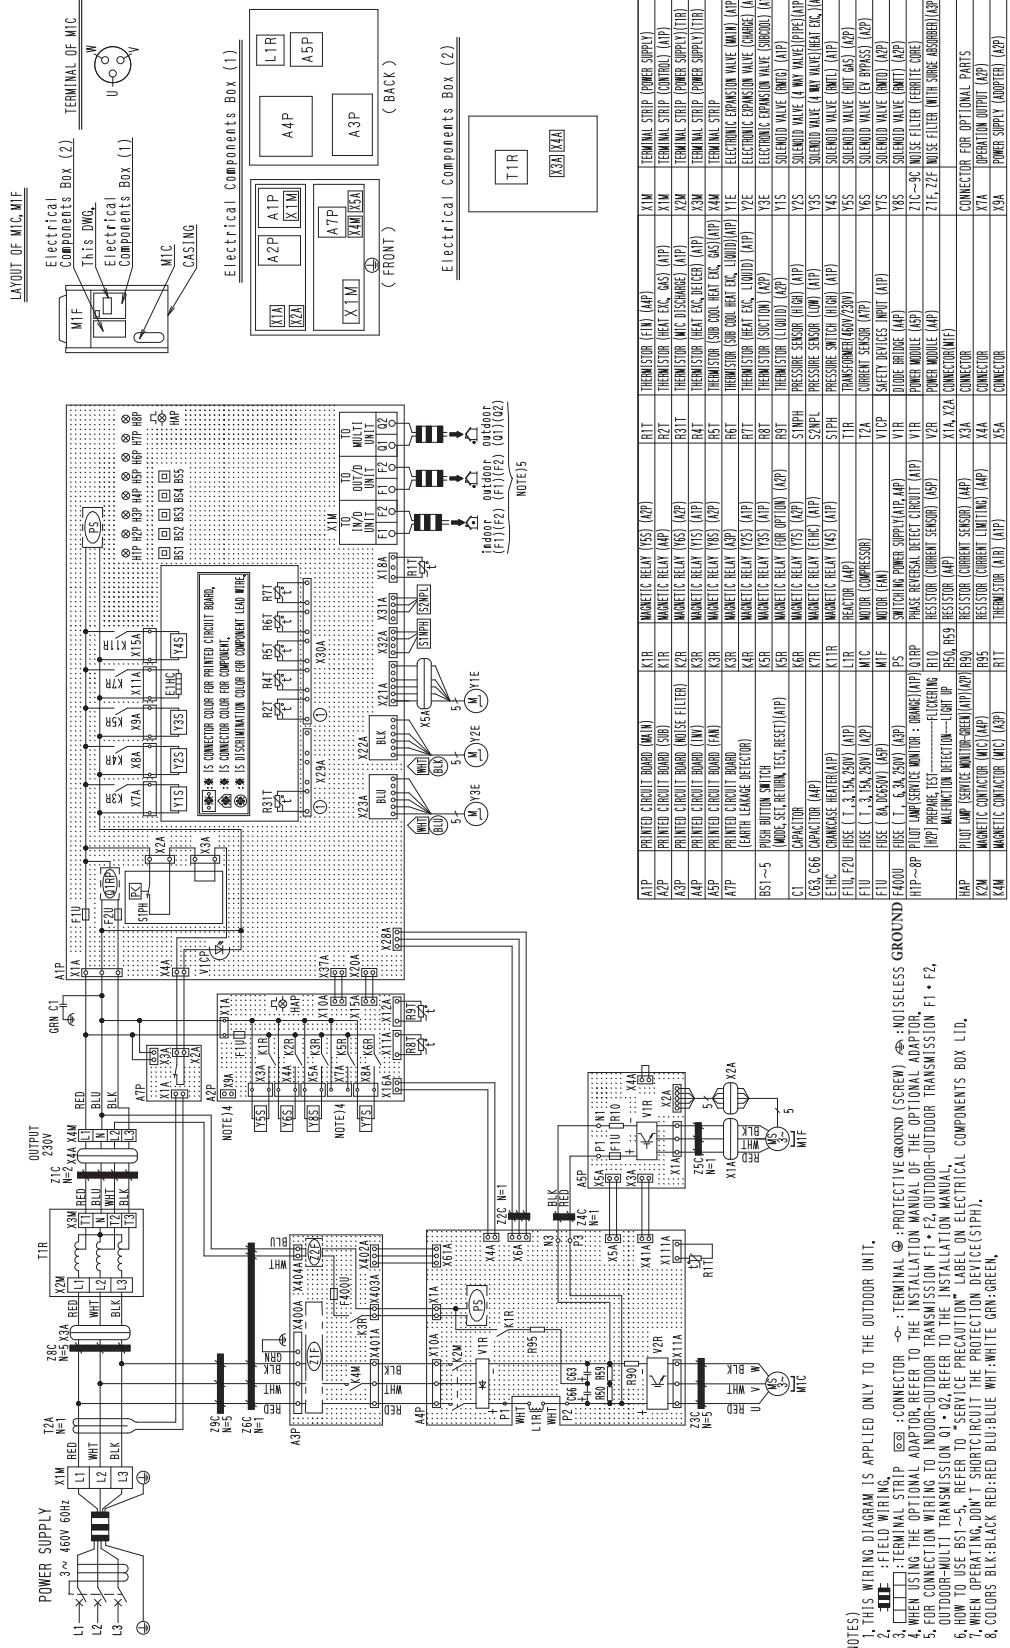


- NOTES
1. THIS WIRING DIAGRAM IS APPLIED ONLY TO THE OUTDOOR UNIT.
 2. **FIELD WIRING.**
 3. **CONNECTOR** : PROTECTIVE GROUND (SCREW) : TERMINAL
 4. WHEN USING THE OPTIONAL ADAPTOR, REFER TO THE INSTALLATION MANUAL OF THE OPTIONAL ADAPTOR.
 5. FOR CONNECTION FROM INDOOR-OUTDOOR TO INDOOR-OUTDOOR TRANSMISSION F1 + F2, OUTDOOR-OUTDOOR TRANSMISSION F1 + F2, FOR CONNECTION FROM INDOOR-OUTDOOR TO INDOOR-OUTDOOR TRANSMISSION F1 + F2, REFER TO "SERVISE PRECAUTION" IN THE ELECTRICAL COMPONENTS BOX LTD.
 6. WHEN OPERATING DOWN T-SHORT CIRCUIT THE PROTECTION DEVICE (SPH).
 7. WHEN OPERATING DOWN T-SHORT CIRCUIT THE PROTECTION DEVICE (SPH).
 8. COLORS: BLK:BLACK; RED:RED; BLU:BLUE; WHT:WHITE; GRN:GREEN.

6. Field Wiring

REYQ72PYDN / REYQ96PYDN / REYQ120PYDN

- 5) Unit shall be grounded in compliance with the applicable local and national codes.
 - 6) Wiring shown are general points-of-connection guides only and are not intended for or to include all details for a specific installation.
 - 7) Be sure to install the switch and the breaker/fuse to the power line of each piece of equipment.
 - 8) Install the main switch that can interrupt all the power sources in an integrated manner because this system consists of the equipment utilizing multiple power sources.
 - 9) If there exists the possibility of reversed phase, lost phase, momentary blackout or power goes on and off while the product is operating, attach a reversed phase protection circuit locally.
- Running the product in reversed phase may break the compressor and other parts.


- Notes 1) All wiring, components and materials to be procured on the site must comply with the applicable local and national codes.
- 2) Use copper conductors only.
- 3) As for details, see wiring diagram.
- 4) Field wiring diagram is to be used as a guideline only. Wiring should comply with applicable local and national codes.

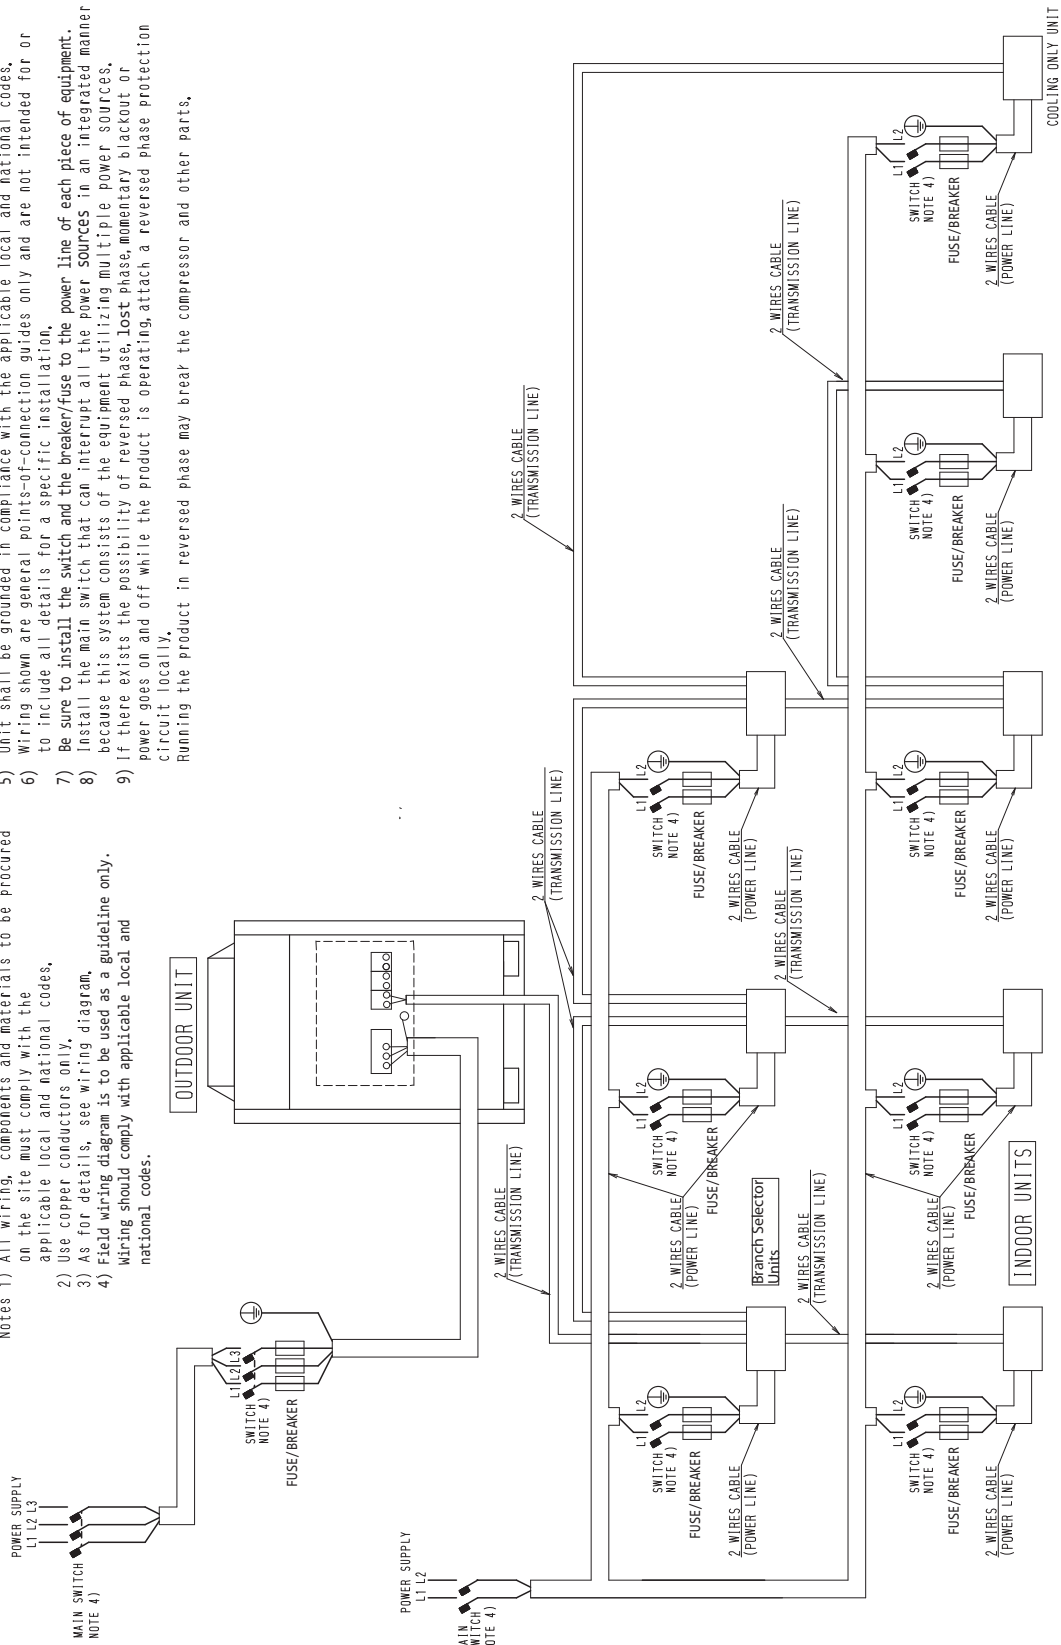

C: 3D058622D

REYQ144PBYD / REYQ168PBYD / REYQ192PBYD / REYQ216PBYD / REYQ240PBYD

- Notes 1) All wiring, components and materials to be procured on the site must comply with the applicable local and national codes, to include all details for a specific installation.
- 2) Use copper conductors only.
- 3) As for details, see wiring diagram.
- 4) Field wiring diagram is to be used as a guideline only. Wiring should comply with applicable local and national codes.
- 5) Unit shall be grounded in compliance with the applicable local and national codes.
- 6) Wiring shown are general points-of-connection guides only and are not intended for or to include all details for a specific installation.
- 7) Be sure to install the switch and the breaker/fuse to the power line of each piece of equipment.
- 8) Install the main switch that can interrupt all the power sources in an integrated manner because this system consists of the equipment utilizing multiple power sources.
- 9) If there exists the possibility of reversed phase, lost phase, momentary blackout or the power goes on and off while the product is operating, attach a reversed phase protection circuit locally.
- Running the product in reversed phase may break the compressor and other parts.

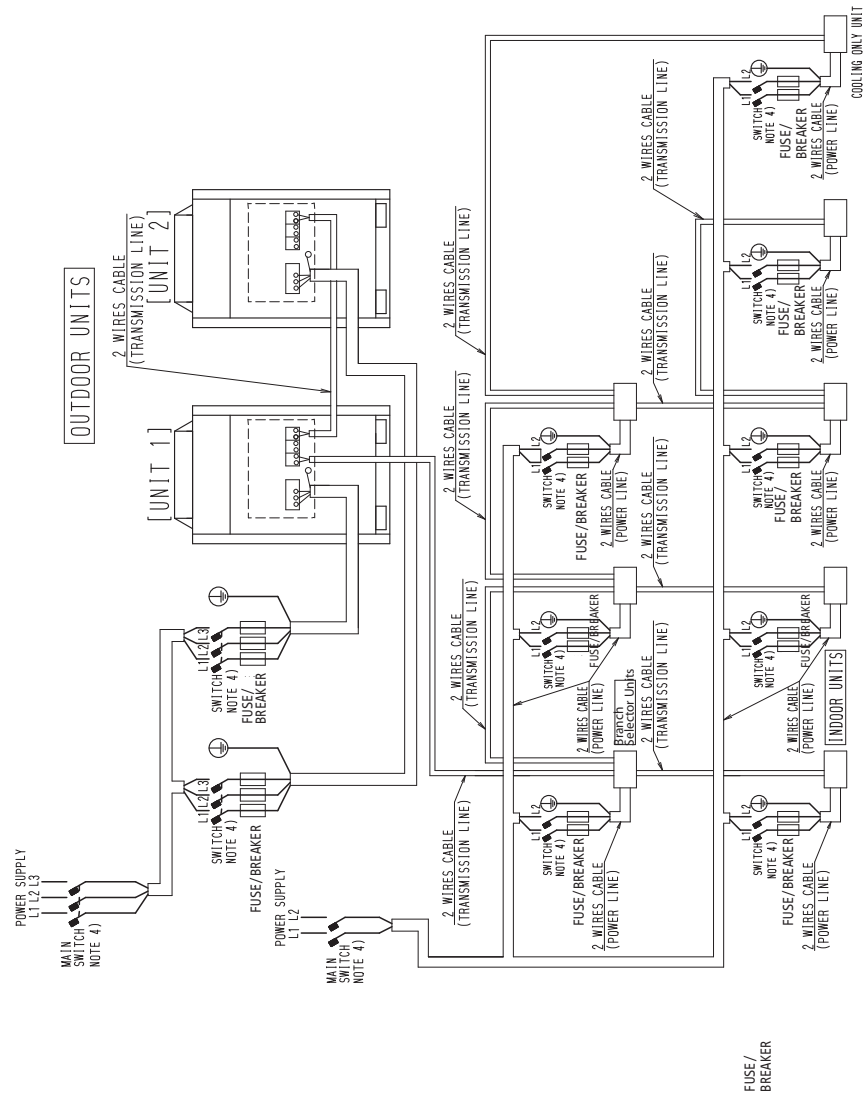


3D059671D

REYQ264PBYD / REYQ288PBYD / REYQ312PBYD / REYQ336PBYD

3D070845


- Notes 1) All wiring, components and materials to be procured on the site must comply with the applicable local and national codes, to include all details for a specific installation.
 2) Use copper conductors only.
 3) As for details, see wiring diagram.
 4) Field wiring diagram is to be used as a guideline only. Wiring should comply with applicable local and national codes.
- 5) Unit shall be grounded in compliance with the applicable local and national codes.
 6) Wiring shown are general points-of-connection guides only and are not intended for or to include all details for a specific installation.
 7) Be sure to install the switch and the breaker/fuse to the power line of each piece of equipment.
 8) Install the main switch that can interrupt all the power sources in an integrated manner because this system consists of the equipment utilizing multiple power sources.
 9) If there exists the possibility of reversed phase, lost phase, momentary blackout or the power goes on and off while the product is operating, attach a reversed phase protection circuit locally.
 Running the product in reversed phase may break the compressor and other parts.

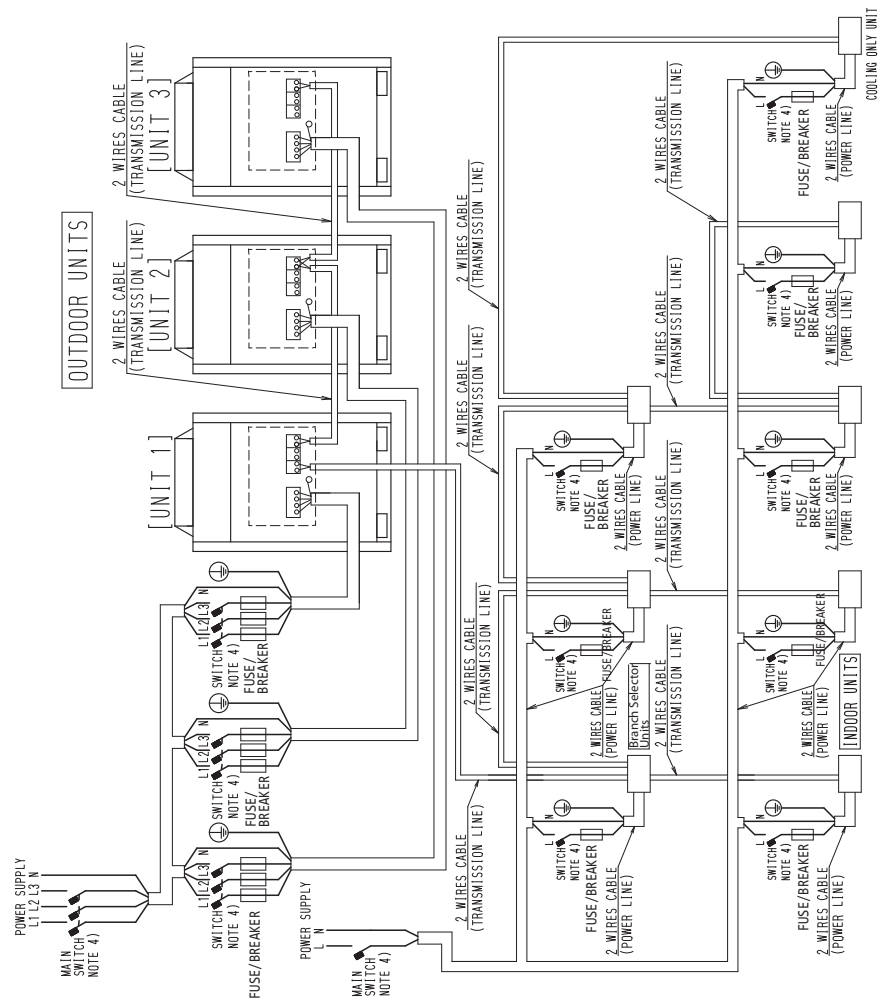

7. Electric Characteristics

REYQ72PYDN / REYQ96PYDN / REYQ120PYDN

Model Name	Units				Power Supply		Comp.		OFM	
	Hz	Volt	Min	Max	MCA	MOP	MSC	RLA	KW	FLA
REYQ72PYDN	60	460	416	508	16.0	20	65	2.4 + 7.0	0.35 x 2	0.6 x 2
REYQ96PYDN	60	460	416	508	20.4	25	65	4.2 + 7.0	0.35 x 2	0.6 x 2
REYQ120PYDN	60	460	416	508	20.5	25	65	6.0 + 6.8	0.35 x 2	0.7 x 2

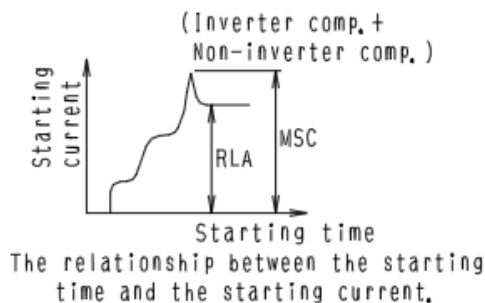

NOTES:

- RLA is based on the following conditions:
Indoor temp: 80° FDB / 67° FWB
Outdoor temp: 95° FDB
- MSC means the maximum current during the starting of the compressor.
- Voltage range:
Units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits.
- Maximum allowable voltage variation between phases is 2%.
- Select wire size based on the value of MCA.
- MOP is used to select the fuse, circuit breaker or the ground fault circuit interrupter (ground leakage circuit breaker).


SYMBOLS:

- MCA: Minimum Circuit Amps. (A)
MOP: Maximum Overcurrent Protective Device (A) (See Note 6)
MSC: Maximum current when starting the compressor. (A)
RLA: Rate Load Amps (A)
OFM: Outdoor Fan Motor (A)
FLA: Full Load Amps (A)
KW: Fan Motor Rated Output

REYQ144PBYD / REYQ168PBYD / REYQ192PBYD / REYQ216PBYD / REYQ240PBYD

Model Name			Units				Power Supply		Comp.		OFM	
Combination Unit	Independent Units		Hz	Volt	Min	Max	MCA	MOP	MSC	RLA	KW	FLA
REYQ144PBYD	REMQ72PBYD	REMQ72PBYD	60	460	416	508	16.7 + 16.7	25+25	-	7.1+7.1	0.75+0.75	0.6+ 0.6
REYQ168PBYD	REMQ72PBYD	REMQ96PBYD	60	460	416	508	16.7 + 20.3	25+25	69	7.1+3.9+8.4	0.75+0.75	0.6+ 0.8
REYQ192PBYD	REMQ96PBYD	REMQ96PBYD	60	460	416	508	20.3 + 20.3	25+25	77	3.9+8.4+3.9 +8.4	0.75+0.75	0.8+ 0.8
REYQ216PBYD	REMQ96PBYD	REMQ120PBYD	60	460	416	508	20.3 + 20.5	25+30	77	3.9+8.4+6.1 +8.4	0.75+0.75	0.8+ 1.0
REYQ240PBYD	REMQ120PBYD	REMQ120PBYD	60	460	416	508	20.5 + 20.5	30+30	78	6.1+8.4+6.1 +8.4	0.75+0.75	1.0+ 1.0

The relationship between the starting time and the starting current:

**NOTES:**

- RLA is based on the following conditions:
Indoor temp: 80° FDB / 67° FWB
Outdoor temp: 95° FDB
- MSC means the maximum current during the starting of the compressor.
- Voltage range:
Units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits.
- Maximum allowable voltage variation between phases is 2%.
- Select wire size based on the value of MCA.
- MOP is used to select the circuit breaker and the ground fault circuit interrupter (ground leakage circuit breaker).


SYMBOLS:

- MCA: Minimum Circuit Amps. (A)
MOP: Maximum Overcurrent Protective Device (A) (See Note 7)
MSC: Maximum current when starting the compressor. (A)
RLA: Rate Load Amps (A)
OFM: Outdoor Fan Motor (A)
FLA: Full Load Amps (A)
KW: Fan Motor Rated Output

REYQ264PBYD / REYQ288PBYD / REYQ312PBYD / REYQ336PBYD

Model Name				Units				Power Supply		Comp.		OFM	
Combination Unit	Independent Units			Hz	Volt	Min	Max	MCA	MOP	MSC	RLA	KW	FLA
REYQ264PBYD	REMQ72PBYD	REMQ96PBYD	REMQ96PBYD	60	460	416	508	16.7 + 20.3 + 20.3	25+25+25	80	7.1 + (3.9+8.4) x2	0.75 x 3	0.6+ 0.8+ 0.8
REYQ288PBYD	REMQ72PBYD	REMQ96PBYD	REMQ120PBYD	60	460	416	508	16.7 + 20.3 + 20.5	25+25+30	81	7.1 + 3.9 + 8.4 + 6.1 + 8.4	0.75 x 3	0.6+ 0.8+ 0.1
REYQ312PBYD	REMQ96PBYD	REMQ96PBYD	REMQ120PBYD	60	460	416	508	20.3 + 20.3 + 20.5	25+25+30	89	(3.9+8.4) x 2 + (6.1+ 8.4)	0.75 x 3	0.8 + 0.8 + 0.1
REYQ336PBYD	REMQ96PBYD	REMQ120PBYD	REMQ120PBYD	60	460	416	508	20.3 + 20.5 + 20.5	25+30+30	90	3.9 + 8.4 + (6.1+8.4) x 2	0.75 x 3	0.6 + 0.1 + 0.1

The relationship between the starting time and the starting current:



NOTES:

1. RLA is based on the following conditions:
 Indoor temp: 80° FDB / 67° FWB
 Outdoor temp: 95° FDB
2. MSC means the maximum current during the starting of the compressor.
3. Voltage range:
 Units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits.
4. Maximum allowable voltage variation between phases is 2%.
5. Select wire size based on the value of MCA.
6. MOP is used to select the circuit breaker and the ground fault circuit interrupter (ground leakage circuit breaker).

SYMBOLS:

- MCA: Minimum Circuit Amps. (A)
- MOP: Maximum Overcurrent Protective Device (A) (See Note 7)
- MSC: Maximum current when starting the compressor. (A)
- RLA: Rate Load Amps (A)
- OFM: Outdoor Fan Motor (A)
- FLA: Full Load Amps (A)
- KW: Fan Motor Rated Output

7. Capacity Table (Reference Data)

7.1 Cooling Capacity (REYQ-P)

These tables are based on projection. Actual results may vary according to conditions of use.

REYQ72PYDN

Combination	Outdoor air temp.	Indoor air temp. °FWB												Combination	Outdoor air temp.	Indoor air temp. °FWB														
		57		61		64		67		70		72				75		57		61		64		67		70		72		75
%	*FDB	MBH	kW	MBH	kW	MBH	kW	MBH	kW	MBH	kW	MBH	kW	MBH	kW	MBH	kW	MBH	kW	MBH	kW	MBH	kW	MBH	kW	MBH	kW			
130	23	60.7	1.75	73.9	2.19	83.7	2.53	93.6	2.87	101	3.11	103	3.05	104	2.95	30	42.0	1.20	51.1	1.46	58.0	1.67	64.8	1.89	71.6	2.11	76.2	2.26	83.0	2.50
	30	60.7	1.81	73.9	2.26	83.7	2.61	93.6	2.97	99.0	3.08	100	3.02	102	2.92	40	42.0	1.23	51.1	1.50	58.0	1.72	64.8	1.95	71.6	2.18	76.2	2.34	83.0	2.58
	40	60.7	1.90	73.9	2.37	83.7	2.74	93.6	3.11	95.8	3.04	97.0	2.97	98.9	2.87	50	42.0	1.28	51.1	1.57	58.0	1.80	64.8	2.04	71.6	2.29	76.2	2.45	83.0	2.71
	50	60.7	1.99	73.9	2.49	83.7	2.86	90.7	3.09	92.5	2.99	93.8	2.92	95.6	2.82	60	42.0	1.34	51.1	1.65	58.0	1.89	64.8	2.14	71.6	2.40	76.2	2.58	83.0	2.85
	54	60.7	2.03	73.9	2.54	83.7	2.94	89.4	3.08	91.2	2.97	92.5	2.90	94.3	2.85	70	42.0	1.36	51.1	1.68	58.0	1.93	64.8	2.19	71.6	2.45	76.2	2.63	83.0	2.91
	58	60.7	2.07	73.9	2.60	83.7	3.00	88.1	3.06	89.9	2.99	91.2	3.00	93.0	3.03	80	42.0	1.39	51.1	1.71	58.0	1.97	64.8	2.23	71.6	2.51	76.2	2.69	83.0	2.97
	62	60.7	2.12	73.9	2.65	83.7	3.07	86.8	3.14	88.6	3.17	89.9	3.18	91.7	3.21	90	42.0	1.42	51.1	1.75	58.0	2.01	64.8	2.28	71.6	2.56	76.2	2.75	83.0	3.04
	66	60.7	2.16	73.9	2.74	83.6	3.29	85.5	3.32	87.3	3.34	88.6	3.36	90.4	3.39	100	42.0	1.45	51.1	1.78	58.0	2.05	64.8	2.33	71.6	2.62	76.2	2.86	83.0	3.25
	70	60.7	2.24	73.9	2.96	82.3	3.46	84.2	3.49	86.0	3.52	87.2	3.54	89.1	3.57	70	42.0	1.47	51.1	1.82	58.0	2.10	64.8	2.45	71.6	2.83	76.2	3.10	82.2	3.46
	72	60.7	2.32	73.9	3.08	81.7	3.55	83.5	3.58	85.4	3.61	86.6	3.63	88.4	3.66	80	42.0	1.49	51.1	1.84	58.0	2.18	64.8	2.54	71.6	2.94	76.2	3.22	81.5	3.55
	75	60.7	2.46	73.9	3.26	80.7	3.68	82.5	3.71	84.4	3.74	85.6	3.77	87.5	3.80	90	42.0	1.52	51.1	1.94	58.0	2.30	64.8	2.69	71.6	3.11	76.2	3.41	80.6	3.68
	79	60.7	2.64	73.9	3.51	79.4	3.86	81.2	3.89	83.1	3.92	84.3	3.95	86.2	3.98	100	42.0	1.63	51.1	2.09	58.0	2.48	64.8	2.90	71.6	3.35	76.2	3.68	79.3	3.86
	83	60.7	2.84	73.9	3.78	78.1	4.04	79.9	4.07	81.8	4.11	83.0	4.13	84.9	4.16	80	42.0	1.74	51.1	2.24	58.0	2.66	64.8	3.12	71.6	3.61	76.2	3.96	78.0	4.03
	87	60.7	3.05	73.9	4.07	76.8	4.21	78.6	4.25	80.5	4.29	81.7	4.31	83.6	4.35	90	42.0	1.86	51.1	2.40	58.0	2.86	64.8	3.35	71.6	3.88	75.4	4.18	76.7	4.21
	91	60.7	3.28	73.9	4.35	75.5	4.39	77.3	4.43	79.2	4.47	80.4	4.50	82.1	4.53	100	42.0	1.99	51.1	2.58	58.0	3.07	64.8	3.60	71.6	4.18	71.4	4.36	75.4	4.39
	93	60.7	3.39	73.0	4.44	74.8	4.48	76.7	4.52	78.5	4.56	79.8	4.59	80.5	4.60	90	42.0	2.06	51.1	2.67	58.0	3.17	64.8	3.73	71.6	4.33	73.4	4.45	74.7	4.48
	95	60.7	3.51	72.4	4.53	74.2	4.57	76.0	4.61	77.9	4.65	78.8	4.68	80.9	4.68	100	42.0	2.13	51.1	2.76	58.0	3.29	64.8	3.78	71.6	4.48	72.8	4.54	74.1	4.57
	99	60.7	3.77	71.1	4.71	72.9	4.75	74.7	4.79	76.6	4.82	75.7	4.82	75.7	4.82	90	42.0	2.27	51.1	2.95	58.0	3.52	64.8	4.14	70.6	4.70	71.5	4.72	72.8	4.75
	103	60.7	4.04	69.7	4.88	71.6	4.93	72.4	4.95	72.5	4.95	72.5	4.95	72.5	4.95	100	42.0	2.43	51.1	3.16	58.0	3.77	64.8	4.44	69.3	4.87	70.2	4.82	71.8	4.93
	106	60.7	4.31	68.8	5.09	70.0	5.12	70.1	5.12	70.1	5.12	70.1	5.12	70.1	5.12	100	42.0	2.58	51.1	3.37	58.0	4.02	64.8	4.74	68.4	5.07	69.2	5.10	70.1	5.12
110	60.7	4.47	68.8	5.35	66.8	5.35	66.9	5.35	66.9	5.35	66.9	5.35	66.9	5.35	110	42.0	2.81	51.1	3.67	58.0	4.39	64.8	5.18	66.9	5.35	66.9	5.35	66.9	5.35	
115	57.6	5.39	57.7	5.40	57.9	5.41	58.0	5.41	58.1	5.42	58.2	5.42	58.3	5.43	115	42.0	3.11	51.1	4.08	57.9	5.41	58.0	5.41	58.1	5.42	58.2	5.42	58.3	5.43	
118	50.0	6.56	50.2	6.57	50.4	6.58	50.5	6.59	50.6	6.60	50.7	6.61	50.8	6.62	118	42.0	3.31	50.2	4.57	50.3	6.58	50.4	6.59	50.5	6.60	50.6	6.61	50.7	6.62	
122	39.9	3.46	40.1	3.47	40.2	3.47	40.3	3.48	40.4	3.49	40.5	3.49	40.7	3.50	122	39.9	3.46	40.1	3.47	40.2	3.47	40.3	3.48	40.4	3.49	40.5	3.49	40.7	3.50	
120	23	56.1	1.61	68.2	2.00	77.3	2.30	86.4	2.62	95.5	2.94	101	3.12	103	3.04	23	37.4	1.07	45.5	1.29	51.5	1.47	57.6	1.66	63.7	1.85	67.7	1.98	73.8	2.18
	30	56.1	1.66	68.2	2.06	77.3	2.38	86.4	2.71	95.5	3.04	98.7	3.10	100	3.01	30	37.4	1.10	45.5	1.33	51.5	1.51	57.6	1.73	63.7	1.91	67.7	2.04	73.8	2.25
	40	56.1	1.73	68.2	2.16	77.3	2.50	86.4	2.84	94.3	3.12	95.4	3.06	97.1	2.97	40	37.4	1.14	45.5	1.39	51.5	1.58	57.6	1.79	63.7	2.00	67.7	2.14	73.8	2.36
	50	56.1	1.82	68.2	2.27	77.3	2.62	86.4	2.99	91.0	3.07	92.2	3.01	93.9	2.92	50	37.4	1.19	45.5	1.45	51.5	1.66	57.6	1.88	63.7	2.10	67.7	2.25	73.8	2.49
	54	56.1	1.86	68.2	2.32	77.3	2.68	86.4	3.05	89.7	3.06	90.9	2.99	92.6	2.89	60	37.4	1.21	45.5	1.48	51.5	1.69	57.6	1.91	63.7	2.14	67.7	2.30	73.8	2.54
	58	56.1	1.90	68.2	2.37	77.3	2.74	86.4	3.11	88.4	3.04	89.6	2.98	91.3	2.91	70	37.4	1.23	45.5	1.51	51.5	1.73	57.6	1.95	63.7	2.19	67.7	2.35	73.8	2.59
	62	56.1	1.94	68.2	2.42	77.3	2.80	85.4	3.12	87.1	3.15	88.3	3.16	90.0	3.18	80	37.4	1.26	45.5	1.54	51.5	1.76	57.6	1.99	63.7	2.24	67.7	2.40	73.8	2.65
	66	56.1	1.98	68.2	2.47	77.3	2.92	84.1	3.30	85.8	3.32	87.0	3.34	88.7	3.36	90	37.4	1.28	45.5	1.57	51.5	1.80	57.6	2.04	63.7	2.28	67.7	2.45	73.8	2.73
	70	56.1	2.02	68.2	2.53	77.3	3.17	82.8	3.47	84.5	3.50	85.7	3.52	87.4	3.54	100	37.4	1.31	45.5	1.60	51.5	1.84	57.6	2.08	63.7	2.39	67.7	2.53	73.8	2.85
	72	56.1	2.08	68.2	2.74	77.3	3.29	82.2	3.56	83.9	3.59	85.0	3.60	86.7	3.63	70	37.4	1.32	45.5	1.62	51.5	1.86	57.6	2.16	63.7	2.48	67.7	2.71	73.8	3.07
	75	56.1	2.20	68.2	2.90	77.3	3.49	81.2	3.69	82.9	3.72	84.0	3.74	85.7	3.77	80	37.4	1.34	45.5	1.67	51.5	1.96	57.6	2.28	63.7	2.63	67.7	2.87	73.8	3.25
	79	56.1	2.37	68.2	3.12	77.3	3.76	79.9	3.87	81.6	3.90	82.7	3.92	84.4	3.95	90	37.4	1.41	45.5	1.79	51.5	2.11	57.6	2.46	63.7	2.83	67.7	3.09	73.8	3.51
	83	56.1	2.54	68.2	3.36	76.9	4.01	78.6	4.05	80.3	4.08	81.4	4.10	83.1	4.13	100	37.4	1.51	45.5	1.92	51.5	2.27	57.6	2.64	63.7	3.04	67.7	3.32	73.8	3.78
	87	56.1	2.73	68.2	3.61	75.6	4.19	77.3	4.22	79.0	4.26	80.1	4.28	81.8	4.31	80	37.4	1.61	45.5	2.06	51.5	2.43	57.6	2.83	63.7	3.27	67.7	3.57	73.8	4.06
	91	56.1	2.92	68.2	3.88	74.3	4.37	76.0	4.40	77.7	4.44	78.8	4.46	80.5	4.48	90	37.4	1.72	45.5	2.20	51.5	2.60	57.6	3.04	63.7	3.51	67.7	3.84	73.8	4.35
	93	56.1	3.03	68.2	4.02	73.6	4.45	75.3	4.49	77.0	4.53	78.2	4.55	79.9	4.59	100	37.4	1.78	45.5	2.28	51.5	2.69	57.6	3.15	63.7	3.63	67.7	3.98	73.8	4.54
	95	56.1	3.13	68.2	4.17	73.0	4.54	74.7	4.58	76.4	4.62	77.5	4.65	79.9	4.68	90	37.4	1.86	45.5	2.36	51.5	2.79	57.6	3.26	63.7	3.76	67.7	4.12	72.3	4.43
	99	56.1	3.36	68.2	4.47	71.7	4.72	73.4	4.76	75.1	4.80	75.7	4.82	75.7	4.82	100	37.4	1.98	45.5	2.52	51.5	2.98	57.6	3.49	63.7	4.04	67.7	4.42	71.0	4.70
	103	56.1	3.59	68.2	4.80	70.4	4.90	72.1	4.97	73.2	4.9																			

REYQ96PYDN

Table with columns for Combination, Outdoor air temp., Indoor air temp. °FWB, and Capacity (TC, PI, MBH, kW) for various conditions. The table is organized into four main sections based on outdoor air temperature (23, 30, 40, 50, 58, 62, 66, 70, 72, 75) and indoor air temperature (57, 61, 64, 67, 70, 72, 75). Each section contains a grid of values for different combinations of conditions.

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

REYQ120PYDN

Table with columns for Combination, Outdoor air temp., Indoor air temp. °FWB, and Capacity (TC, PI, MBH, kW) for various conditions. Includes sub-sections for 130, 120, 110, and 100.

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

REYQ144PBYD

Table with columns for Combination, Outdoor air temp., Indoor air temp. °FWB, and Capacity (TC), Power Input (PI), and MBH. The table is organized into four main sections (130, 120, 110, 100) and further subdivided by indoor air temperature (57, 61, 64, 67, 70, 72, 75).

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.
Note2: The above table shows the average value of conditions which may occur.

REYQ168PBYD

Capacity table for REYQ168PBYD. The table is organized into four main sections based on indoor air temperature (°FWB) and outdoor air temperature (°FDB). Each section contains a grid of data points for various combinations of indoor and outdoor temperatures, with columns for Total Capacity (TC) and Power Input (PI) in MBH and kW. The data is presented in a structured grid format with rows and columns corresponding to different temperature conditions.

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

REYQ192PBYD

Large table with columns for Combination, Outdoor air temp., Indoor air temp. °FWB, and various capacity metrics (TC, PI, MBH, kW) for different indoor air temperatures (57, 61, 64, 67, 70, 72, 75).

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.
Note2: The above table shows the average value of conditions which may occur.

REYQ216PBYD

Capacity table with columns for Combination, Outdoor air temp., Indoor air temp. °FWB, and various capacity metrics (TC, PI, MBH, kW) for different indoor air temperatures (57, 61, 64, 67, 70, 72, 75).

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

REYQ240PBYD

Table with columns for Combination, Outdoor air temp., Indoor air temp. °FWB, and various capacity metrics (TC, PI, MBH, kW) for different indoor air temperatures (57, 61, 64, 67, 70, 72, 75).

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

REYQ264PBYD

Large data table with columns for Combination, Outdoor air temp., Indoor air temp. °FWB, and various capacity values (TC, PI, MBH, kW) for different indoor air temperatures (57, 61, 64, 67, 70, 72, 75) and combinations (90, 80, 70, 60).

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

REYQ312PBYD

Capacity table with columns for Outdoor air temp., Indoor air temp. °FWB, and various capacity metrics (TC, PI, MBH, kW) for different combinations of conditions. The table is organized into sections for different indoor air temperatures (130, 120, 110, 100) and outdoor air temperatures (23, 30, 40, 50, 54, 58, 62, 66, 70, 72, 75, 83, 87, 91, 93, 95, 99, 103, 106, 110, 115, 118, 122).

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

REYQ336PBYD

Main capacity table with columns for Combination, Outdoor air temp., Indoor air temp. °FWB, and various capacity metrics (TC, PI, MBH, kW) for different conditions (57, 61, 64, 67, 70, 72, 75).

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.
Note2: The above table shows the average value of conditions which may occur.

7.2 Heating Capacity (REYQ-P)

REYQ72PYDN

Combi- nation	Outdoor air temp.	Indoor air temp. °FDB																																		
		61				65				68				70				72				75														
		TC	PI	MBH	kW	TC	PI	MBH	kW	TC	PI	MBH	kW	TC	PI	MBH	kW	TC	PI	MBH	kW	TC	PI	MBH	kW	TC	PI	MBH	kW							
%	*FDB	*FWB	MBH	kW	MBH	kW	MBH	kW	MBH	kW	MBH	kW	MBH	kW	MBH	kW	MBH	kW	MBH	kW	MBH	kW	MBH	kW	MBH	kW	MBH	kW								
130	-3.64	-4.0	69.7	5.87	69.5	6.12	69.4	6.30	69.3	6.43	69.1	6.55	69.0	6.74	-1.84	-2.2	69.0	7.19	68.9	6.85	68.7	7.03	68.6	7.17	68.6	7.27	68.5	7.36	68.2	7.11	68.5	7.36	68.2	7.11		
	-1.84	-2.2	70.4	5.57	70.2	5.84	70.0	6.04	69.9	6.17	69.8	6.31	69.6	6.51	-1.84	-2.2	69.3	6.87	69.2	7.05	69.0	7.19	69.0	7.28	68.9	7.37	68.9	7.37	68.9	7.37	68.9	7.37	68.9	7.37		
	9.5	8.5	74.2	5.90	74.0	6.06	73.8	6.25	73.7	6.37	73.6	6.50	73.5	6.69	9.5	8.5	73.1	7.03	73.0	7.20	72.9	7.34	72.8	7.42	72.8	7.42	72.8	7.42	72.8	7.42	72.8	7.42	72.8	7.42		
	13.0	12.0	76.0	5.90	75.8	6.15	75.6	6.33	75.5	6.46	75.4	6.58	75.2	6.77	13.0	12.0	74.9	7.10	74.8	7.27	74.6	7.40	74.2	7.51	74.2	7.51	74.2	7.51	74.2	7.51	74.2	7.51	74.2	7.51	74.2	7.51
	15.0	14.0	77.1	5.96	76.9	6.20	76.7	6.39	76.6	6.51	76.5	6.63	76.3	6.81	15.0	14.0	76.0	7.14	75.9	7.31	75.6	7.41	75.2	7.49	75.2	7.49	75.2	7.49	75.2	7.49	75.2	7.49	75.2	7.49	75.2	7.49
	17.0	15.5	78.0	6.01	77.8	6.25	77.6	6.43	77.5	6.55	77.4	6.67	77.2	6.85	17.0	15.5	76.9	7.17	76.8	7.34	76.6	7.30	76.2	7.39	76.2	7.39	76.2	7.39	76.2	7.39	76.2	7.39	76.2	7.39	76.2	7.39
	19.0	18.0	79.6	6.09	79.4	6.32	79.2	6.50	79.1	6.62	79.0	6.74	78.8	6.91	19.0	18.0	78.5	7.23	78.4	7.39	78.4	7.56	78.1	7.71	78.1	7.71	78.1	7.71	78.1	7.71	78.1	7.71	78.1	7.71	78.1	7.71
	22.0	20.0	81.0	6.16	80.8	6.39	80.6	6.56	80.5	6.68	80.4	6.79	80.2	6.96	22.0	20.0	79.9	7.28	79.6	7.42	79.6	7.65	79.6	7.65	79.6	7.65	79.6	7.65	79.6	7.65	79.6	7.65	79.6	7.65	79.6	7.65
	26.0	24.0	84.0	6.29	83.8	6.52	83.6	6.68	83.5	6.79	83.4	6.90	83.2	7.07	26.0	24.0	82.9	7.37	82.6	7.48	82.6	7.63	82.6	7.63	82.6	7.63	82.6	7.63	82.6	7.63	82.6	7.63	82.6	7.63	82.6	7.63
	30.0	28.0	87.3	6.43	87.1	6.65	86.9	6.81	86.8	6.91	86.7	7.02	86.5	7.18	30.0	28.0	85.0	7.30	84.7	7.42	84.7	7.56	84.7	7.56	84.7	7.56	84.7	7.56	84.7	7.56	84.7	7.56	84.7	7.56	84.7	7.56
	35.0	32.0	91.0	6.58	90.7	6.78	90.6	6.93	90.5	7.04	90.4	7.14	90.2	7.29	35.0	32.0	85.0	7.93	84.9	8.06	84.9	8.22	84.9	8.22	84.9	8.22	84.9	8.22	84.9	8.22	84.9	8.22	84.9	8.22	84.9	8.22
	39.0	36.0	95.0	6.72	94.7	6.91	94.6	7.06	94.5	7.16	94.3	7.26	94.2	7.40	39.0	36.0	85.0	8.55	84.9	8.68	84.9	8.87	84.9	8.87	84.9	8.87	84.9	8.87	84.9	8.87	84.9	8.87	84.9	8.87	84.9	8.87
	44.0	40.0	99.3	6.86	99.0	7.05	98.9	7.19	98.8	7.28	98.7	7.37	98.6	7.46	44.0	40.0	85.0	9.20	84.8	9.32	84.8	9.51	84.8	9.51	84.8	9.51	84.8	9.51	84.8	9.51	84.8	9.51	84.8	9.51	84.8	9.51
47.0	43.0	103	6.96	103	7.14	102	7.28	102	7.37	101	7.38	95.6	6.85	47.0	43.0	85.0	9.94	84.8	10.06	84.8	10.25	84.8	10.25	84.8	10.25	84.8	10.25	84.8	10.25	84.8	10.25	84.8	10.25	84.8	10.25	
51.0	47.0	108	7.10	107	7.27	107	7.40	105	7.28	101	6.95	95.6	6.45	51.0	47.0	85.0	10.60	84.8	10.72	84.8	10.91	84.8	10.91	84.8	10.91	84.8	10.91	84.8	10.91	84.8	10.91	84.8	10.91	84.8	10.91	
54.0	50.0	112	7.20	111	7.37	109	7.28	105	6.96	101	6.64	95.6	6.17	54.0	50.0	85.0	11.19	84.8	11.31	84.8	11.50	84.8	11.50	84.8	11.50	84.8	11.50	84.8	11.50	84.8	11.50	84.8	11.50	84.8	11.50	
57.0	53.0	116	7.30	115	7.42	109	6.95	105	6.64	101	6.34	95.6	5.90	57.0	53.0	85.0	11.78	84.8	11.90	84.8	12.09	84.8	12.09	84.8	12.09	84.8	12.09	84.8	12.09	84.8	12.09	84.8	12.09	84.8	12.09	
60.0	56.0	120	7.39	115	7.48	109	6.64	105	6.35	101	6.06	95.6	5.64	60.0	56.0	85.0	12.46	84.8	12.58	84.8	12.79	84.8	12.79	84.8	12.79	84.8	12.79	84.8	12.79	84.8	12.79	84.8	12.79	84.8	12.79	

TC: Total capacity ; MBH
 PI: Power Input ; kW (Comp.+Outdoor fan motor)
 Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

REYQ96PYDN

Table with columns for Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and Capacity/Power (TC, PI, MBH, kW). Includes sub-tables for 130, 120, 110, and 100 capacity units.

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

REYQ120PYDN

Combination	Outdoor air temp.	Indoor air temp. °FDB																											
		61				65				68				72				75											
		TC	PI	MBH	kW	TC	PI	MBH	kW	TC	PI	MBH	kW	TC	PI	MBH	kW	TC	PI	MBH	kW								
130	%	-3.64	-4.0	78.2	4.65	77.8	5.29	77.6	5.78	77.4	6.10	77.2	6.42	76.9	6.90	-3.64	-4.0	76.4	4.65	76.1	5.29	75.8	5.78	75.6	6.10	75.4	6.42	75.1	6.90
90	%	-1.84	-2.2	79.5	4.84	79.2	5.47	78.9	5.94	78.7	6.26	78.5	6.57	78.2	7.05	-1.84	-2.2	77.7	4.84	77.4	5.47	77.1	5.94	76.8	6.26	76.5	6.57	76.2	7.05
80	%	9.5	8.5	89.4	6.02	89.0	6.57	88.8	6.99	88.6	7.27	88.4	7.55	88.1	7.97	9.5	8.5	87.6	6.02	87.3	6.57	87.0	6.99	86.8	7.27	86.5	7.55	86.2	7.97
70	%	13.0	12.0	93.3	6.41	93.0	6.94	92.7	7.34	92.5	7.61	92.3	7.88	92.0	8.28	13.0	12.0	91.5	6.41	91.2	6.94	90.9	7.34	90.6	7.61	90.3	7.88	90.0	8.28
60	%	15.0	14.0	95.8	6.64	95.4	7.16	95.1	7.54	94.9	7.80	94.7	8.06	94.4	8.45	15.0	14.0	93.9	6.64	93.6	7.16	93.3	7.54	93.0	7.80	92.7	8.06	92.4	8.45
50	%	17.0	15.5	97.6	6.81	97.3	7.31	97.0	7.69	96.8	7.95	96.6	8.20	96.3	8.58	17.0	15.5	95.8	6.81	95.5	7.31	95.2	7.69	94.9	7.95	94.6	8.20	94.3	8.58
40	%	19.0	18.0	101	7.08	101	7.57	100	7.94	100	8.19	99.9	8.43	100	8.80	19.0	18.0	99.1	7.08	98.8	7.57	98.5	7.94	98.2	8.19	97.9	8.43	97.6	8.80
30	%	22.0	20.0	104	7.30	103	7.78	103	8.14	103	8.37	103	8.61	102	8.97	22.0	20.0	102	7.30	101	7.78	101	8.14	101	8.37	101	8.61	100	8.97
20	%	26.0	24.0	110	7.73	109	8.18	109	8.51	109	8.74	108	8.96	108	9.30	26.0	24.0	108	7.73	107	8.18	107	8.51	107	8.74	106	8.96	106	9.30
10	%	30.0	28.0	116	8.14	115	8.56	115	8.88	115	9.09	115	9.30	115	9.62	30.0	28.0	114	8.14	113	8.56	113	8.88	113	9.09	112	9.30	112	9.62
5	%	35.0	32.0	123	8.53	122	8.93	122	9.23	122	9.43	122	9.62	121	9.92	35.0	32.0	121	8.53	120	8.93	120	9.23	120	9.43	119	9.62	119	9.92
0	%	39.0	36.0	130	8.90	129	9.27	129	9.55	129	9.74	129	9.93	129	10.2	39.0	36.0	128	8.90	127	9.27	127	9.55	127	9.74	126	9.93	126	10.2
	%	44.0	40.0	138	9.24	137	9.60	137	9.86	137	10.0	137	10.2	136	10.5	44.0	40.0	136	9.24	135	9.60	135	9.86	135	10.0	134	10.2	134	10.5
	%	47.0	43.0	144	9.49	143	9.83	143	10.1	143	10.3	143	10.4	142	10.7	47.0	43.0	142	9.49	141	9.83	141	10.1	141	10.3	140	10.4	140	10.7
	%	51.0	47.0	152	9.81	152	10.1	151	10.4	151	10.5	151	10.7	151	10.9	51.0	47.0	150	9.81	149	10.1	149	10.4	149	10.5	148	10.7	148	10.9
	%	54.0	50.0	159	10.0	158	10.3	158	10.6	158	10.7	158	10.9	157	11.1	54.0	50.0	158	10.0	157	10.3	157	10.6	157	10.7	156	10.9	156	11.1
	%	57.0	53.0	166	10.2	165	10.5	165	10.7	165	10.9	165	11.0	164	11.2	57.0	53.0	166	10.2	165	10.5	165	10.7	165	10.9	164	11.0	164	11.2
	%	60.0	56.0	173	10.4	173	10.7	172	10.9	172	11.1	169	10.9	169	11.2	60.0	56.0	173	10.4	172	10.7	172	10.9	172	11.1	171	11.0	171	11.2

TC: Total capacity ; MBH
 PI: Power Input ; kW (Comp.+Outdoor fan motor)
 Note1: is shown as reference.
 Note2: The above table shows the average value of conditions which may occur.

REYQ144PBYD

Table with columns for Combi-nation, Outdoor air temp., Indoor air temp. °FDB, and performance metrics (TC, PI, MBH) across various conditions (61, 65, 68, 70, 72, 75).

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: [shaded] is shown as reference.
Note2: The above table shows the average value of conditions which may occur.

REYQ168PBYD

Table with columns for Combination, Outdoor air temp., Indoor air temp. °FDB, and Capacity (TC, PI, MBH) for various conditions across different percentages and temperature ranges.

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.
Note2: The above table shows the average value of conditions which may occur.

REYQ192PBYD

Table with columns for Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75) and rows for 130, 120, 110, 100 capacity levels.

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.
Note2: The above table shows the average value of conditions which may occur.

REYQ216PBYD

Main capacity table with columns for Combi-nation, Outdoor air temp., Indoor air temp. °FDB, and performance metrics like TC and PI. Includes sub-sections for 130, 120, 110, and 100 units.

TC: Total capacity ; MBH

PI: Power Input ; kW (Comp.+Outdoor fan motor)

Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

REYQ240PBYD

Combination %	Outdoor air temp. °F		Indoor air temp. °FDB																									
			61			65			68			72			75													
			TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	TC	PI													
130	-3.64	-4.0	166	12.9	165	14.2	165	15.1	165	15.8	164	16.4	164	17.4	-3.64	-4.0	163	19.1	162	20.0	162	20.7	162	21.1	161	21.6	161	22.2
	-1.84	-2.2	169	13.3	168	14.5	168	15.5	167	16.1	167	16.7	167	17.7	-1.84	-2.2	166	19.4	165	20.3	165	20.9	165	21.3	164	21.8	164	22.4
	9.5	8.5	180	14.8	182	16.0	181	16.8	181	17.5	181	18.0	180	18.9	9.5	8.5	177	20.5	179	21.3	178	21.9	178	22.3	178	22.7	177	23.3
	13.0	12.0	199	16.4	198	17.6	197	18.3	197	18.8	197	19.3	196	20.1	13.0	12.0	195	21.6	195	22.3	194	22.9	194	23.2	194	23.6	193	24.1
	15.0	14.0	204	16.9	203	17.9	203	18.7	202	19.2	202	19.7	201	20.5	15.0	14.0	200	21.9	200	22.6	199	23.1	199	23.5	199	23.9	199	24.4
	17.0	15.5	208	17.2	207	18.2	207	19.0	206	19.5	206	20.0	205	20.8	17.0	15.5	204	22.1	204	22.8	204	23.3	203	23.7	203	24.0	203	24.6
	19.0	18.0	215	17.8	214	18.7	214	19.5	213	20.0	213	20.5	212	21.2	19.0	18.0	211	22.5	211	23.2	211	23.7	210	24.0	210	24.4	210	24.9
	22.0	20.0	221	18.2	220	19.1	220	19.9	219	20.3	219	20.8	218	21.5	22.0	20.0	217	22.8	217	23.5	216	24.0	216	24.3	216	24.6	216	25.1
	26.0	24.0	233	19.0	233	19.9	232	20.6	232	21.1	231	21.5	231	22.2	26.0	24.0	230	23.4	229	24.0	229	24.5	229	24.8	229	25.1	229	25.6
	30.0	28.0	247	19.9	246	20.7	246	21.3	245	21.8	245	22.2	244	22.8	30.0	28.0	243	24.0	243	24.6	243	25.0	242	25.3	242	25.6	242	26.1
	35.0	32.0	261	20.6	261	21.4	260	22.0	260	22.4	259	22.8	259	23.4	35.0	32.0	258	24.5	257	25.1	252	24.7	243	23.6	234	22.6	221	21.0
	39.0	36.0	277	21.4	276	22.1	276	22.7	275	23.1	275	23.4	274	24.0	39.0	36.0	273	25.0	265	24.5	252	23.0	243	22.0	234	21.0	221	19.6
	44.0	40.0	293	22.1	293	22.8	292	23.3	292	23.7	291	24.0	291	24.6	44.0	40.0	283	24.6	265	22.7	252	21.4	243	20.5	234	19.6	221	18.3
	47.0	43.0	306	22.6	306	23.3	305	23.8	305	24.1	304	24.4	304	24.9	47.0	43.0	283	23.3	265	21.6	252	20.3	243	19.4	234	18.6	221	17.4
	51.0	47.0	325	23.2	324	23.8	323	24.3	323	24.6	323	25.0	319	25.0	51.0	47.0	283	21.7	265	20.1	252	18.9	243	18.1	234	17.4	221	16.2
	54.0	50.0	339	23.6	338	24.3	338	24.7	337	25.0	337	25.3	319	23.7	54.0	50.0	283	20.6	265	19.1	252	18.0	243	17.2	234	16.5	221	15.5
	57.0	53.0	354	24.1	353	24.6	352	25.1	351	25.3	338	24.1	319	22.4	57.0	53.0	283	19.6	265	18.1	252	17.1	243	16.4	234	15.7	221	14.7
	60.0	56.0	369	24.5	368	25.0	364	25.0	351	23.9	338	22.9	319	21.3	60.0	56.0	283	18.6	265	17.2	252	16.3	243	15.6	234	15.0	221	14.0

Combination %	Outdoor air temp. °F		Indoor air temp. °FDB																									
			61			65			68			72			75													
			TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	TC	PI													
90	-3.64	-4.0	166	12.9	165	14.2	165	15.1	165	15.8	164	16.4	164	17.4	-3.64	-4.0	162	20.7	161	21.5	161	22.1	161	22.5	161	22.9	160	23.4
	-1.84	-2.2	169	13.3	168	14.5	168	15.5	167	16.1	167	16.7	167	17.7	-1.84	-2.2	165	20.9	164	21.7	164	22.3	164	22.7	164	23.0	163	23.6
	9.5	8.5	180	14.8	182	16.0	181	16.8	181	17.5	181	18.0	180	18.9	9.5	8.5	178	21.9	178	22.6	177	23.1	177	23.5	177	23.8	177	24.4
	13.0	12.0	199	16.4	198	17.6	197	18.3	197	18.8	197	19.3	196	20.1	13.0	12.0	194	22.9	194	23.5	194	24.0	193	24.3	193	24.7	193	25.1
	15.0	14.0	204	16.9	203	17.9	203	18.7	202	19.2	202	19.7	201	20.5	15.0	14.0	199	23.1	199	23.8	199	24.3	199	24.6	198	24.9	196	25.0
	17.0	15.5	208	17.2	207	18.2	207	19.0	206	19.5	206	20.0	205	20.8	17.0	15.5	204	23.3	203	24.0	203	24.4	203	24.7	202	25.1	196	24.3
	19.0	18.0	215	17.8	214	18.7	214	19.5	213	20.0	213	20.5	212	21.2	19.0	18.0	211	23.7	210	24.3	210	24.7	210	25.0	208	25.1	196	23.3
	22.0	20.0	221	18.2	220	19.1	220	19.9	219	20.3	219	20.8	218	21.5	22.0	20.0	216	24.0	216	24.5	216	25.0	215	25.3	208	24.2	196	22.5
	26.0	24.0	233	19.0	233	19.9	232	20.6	232	21.1	231	21.5	231	22.2	26.0	24.0	229	24.5	229	25.0	224	24.7	216	23.6	208	22.6	196	21.0
	30.0	28.0	247	19.9	246	20.7	246	21.3	245	21.8	245	22.2	244	22.8	30.0	28.0	243	25.0	236	24.5	224	23.0	216	22.0	208	21.1	196	19.6
	35.0	32.0	261	20.6	261	21.4	260	22.0	260	22.4	259	22.8	259	23.4	35.0	32.0	252	24.7	236	22.8	224	21.4	216	20.5	208	19.6	196	18.3
	39.0	36.0	277	21.4	276	22.1	276	22.7	275	23.1	275	23.4	274	24.0	39.0	36.0	252	23.0	236	21.2	224	20.0	216	19.1	208	18.3	196	17.1
	44.0	40.0	293	22.1	293	22.8	292	23.3	292	23.7	291	24.0	291	24.6	44.0	40.0	252	21.4	236	19.8	224	18.6	216	17.9	208	17.1	196	16.0
	47.0	43.0	306	22.6	306	23.3	305	23.8	305	24.1	304	24.4	304	24.9	47.0	43.0	252	20.3	236	18.8	224	17.7	216	17.0	208	16.3	196	15.2
	51.0	47.0	325	23.2	324	23.8	323	24.3	323	24.6	323	25.0	319	25.0	51.0	47.0	252	18.9	236	17.5	224	16.5	216	15.9	208	15.2	196	14.3
	54.0	50.0	339	23.6	338	24.3	338	24.7	337	25.0	337	25.3	319	23.7	54.0	50.0	252	18.0	236	16.7	224	15.7	216	15.1	208	14.5	196	13.6
	57.0	53.0	354	24.1	353	24.6	352	25.1	351	25.3	338	24.1	319	22.4	57.0	53.0	252	17.1	236	15.9	224	15.0	216	14.4	208	13.8	196	13.0
	60.0	56.0	369	24.5	368	25.0	364	25.0	351	23.9	338	22.9	319	21.3	60.0	56.0	252	16.3	236	15.1	224	14.3	216	13.7	208	13.2	196	12.4

Combination %	Outdoor air temp. °F		Indoor air temp. °FDB																									
			61			65			68			72			75													
			TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	TC	PI													
80	-3.64	-4.0	166	12.9	165	14.2	165	15.1	165	15.8	164	16.4	164	17.4	-3.64	-4.0	161	22.2	161	22.9	160	23.4	160	23.8	160	24.1	160	24.7
	-1.84	-2.2	169	13.3	168	14.5	168	15.5	167	16.1	167	16.7	167	17.7	-1.84	-2.2	164	22.4	164	23.1	163	23.6	163	24.0	163	24.3	163	24.8
	9.5	8.5	180	14.8	182	16.0	181	16.8	181	17.5	181	18.0	180	18.9	9.5	8.5	177	23.3	177	23.9	177	24.4	176	24.7	176	25.0	172	24.5
	13.0	12.0	199	16.4	198	17.6	197	18.3	197	18.8	197	19.3	196	20.1	13.0	12.0	193	24.1	193	24.7	193	25.1	189	24.7	189	25.1	184	24.8
	15.0	14.0	204	16.9	203	17.9	203	18.7	202	19.2	202	19.7	201	20.5	15.0	14.0	199	24.4	198	24.9	196	25.0	189	23.9	189	24.3	182	22.8
	17.0	15.5	208	17.2	207	18.2	207	19.0	206	19.5	206	20.0	205	20.8	17.0	15.5	203	24.6	202	25.1	196	24.3	189	23.3	182	22.3	172	20.3
	19.0	18.0	215	17.8	214	18.7	214	19.5	213	20.0	213	20.5	212	21.2	19.0	18.0	210	24.9	206	24.9	196	23.3	189	22.3	182	21.3	172	19.9
	22.0	20.0	221	18.2	220	19.1	220	19.9	219	20.3	219	20.8	218	21.5	22.0	20.0	216	25.1	206	24.0	196	22.5	189	21.6	182	20.6	172	19.3
	26.0	24.0	233	19.0	233	19.9	232	20.6	232	21.1	231	21.5	231	22.2	26.0	24.0	220	24.2	206	22.4	196	21.0	189	20.2	182	19.3	172	18.0
	30.0	28.0	247	19.9	246	20.7	246	21.3	245	21.8	245	22.2	244	22.8	30.0	28.0	220	22.6	206	20.9	196	19.6	189	18.8	182	18.0	172	16.8
	35.0	32.0	261	20.6	261																							

REYQ264PBYD

Table with columns for Combination, Outdoor air temp., Indoor air temp. °FDB, and Capacity (TC, PI, MBH, kW) for various conditions (61, 65, 68, 70, 72, 75) across different load percentages (90, 80, 70, 60, 100).

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

REYQ288PBYD

Combi- nation	Outdoor air temp.		Indoor air temp. °FDB																			
			61				65				68				72				75			
			TC	PI	MBH	kW	TC	PI	MBH	kW	TC	PI	MBH	kW	TC	PI	MBH	kW				
%	*FDB	*FWB	TC	PI	MBH	kW	TC	PI	MBH	kW	TC	PI	MBH	kW	TC	PI	MBH	kW				
90	-3.64	-4.0	211	17.9	211	19.4	210	20.5	210	21.2	209	22.0	208	23.1								
	-1.84	-2.2	215	18.3	214	19.8	214	20.9	213	21.6	213	22.3	212	23.4								
	5.5	5.0	232	20.1	231	21.5	231	22.5	230	23.1	230	23.8	229	24.8								
	9.5	8.5	242	21.0	241	22.3	241	23.3	240	23.9	240	24.6	239	25.5								
	13.0	12.0	253	22.0	252	23.2	251	24.1	251	24.7	251	25.3	250	26.3								
	15.0	14.0	260	22.5	259	23.7	258	24.6	258	25.2	257	25.8	257	26.7								
	17.0	15.5	265	22.9	264	24.0	263	24.9	263	25.5	262	26.1	262	27.0								
	19.0	18.0	274	23.5	273	24.6	272	25.5	272	26.0	271	26.6	271	27.5								
	22.0	20.0	281	24.0	280	25.1	280	25.9	279	26.5	279	27.0	278	27.9								
	30.0	24.0	297	25.0	296	26.0	296	26.8	295	27.3	295	27.8	294	28.6								
	35.0	32.0	333	26.8	332	27.8	332	28.5	331	28.9	331	29.4	330	30.1								
	39.0	36.0	353	27.7	352	28.6	351	29.2	351	29.7	351	30.1	350	30.7								
	44.0	40.0	374	28.5	373	29.3	372	29.9	372	30.3	372	30.8	371	31.4								
	47.0	43.0	391	29.1	390	29.9	389	30.4	389	30.8	388	31.2	382	31.1								
51.0	47.0	414	29.8	413	30.5	412	31.1	412	31.5	406	31.1	382	28.9									
54.0	50.0	432	30.3	431	31.0	431	31.5	421	30.8	406	29.4	382	27.4									
57.0	53.0	451	30.8	450	31.5	437	30.6	421	29.2	406	27.9	382	26.0									
60.0	56.0	471	31.3	460	30.9	437	28.9	421	27.7	406	26.5	382	24.6									

TC: Total capacity ; MBH
 PI: Power Input ; kW (Comp.+Outdoor fan motor)
 Note1: ■ is shown as reference.
 Note2: The above table shows the average value of conditions which may occur.

REYQ312PBYD

Table with columns for Combination, Outdoor air temp., Indoor air temp. *FDB, and Capacity (TC, PI, MBH) for various conditions. The table is organized into four main sections (90, 100, 110, 120) and further subdivided by indoor air temperature (61, 65, 68, 70, 72, 75).

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

REYQ336PBYD


Combi- nation	Outdoor air temp.		Indoor air temp. °FDB																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																											
			61				65				68				72				75																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																											
			TC	PI	MBH	kW	TC	PI	MBH	kW	TC	PI	MBH	kW	TC	PI	MBH	kW	TC	PI	MBH	kW																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																								
130	%	*FDB	*FWB	238	239	240	241	242	243	244	245	246	247	248	249	250	251	252	253	254	255	256	257	258	259	260	261	262	263	264	265	266	267	268	269	270	271	272	273	274	275	276	277	278	279	280	281	282	283	284	285	286	287	288	289	290	291	292	293	294	295	296	297	298	299	300	301	302	303	304	305	306	307	308	309	310	311	312	313	314	315	316	317	318	319	320	321	322	323	324	325	326	327	328	329	330	331	332	333	334	335	336	337	338	339	340	341	342	343	344	345	346	347	348	349	350	351	352	353	354	355	356	357	358	359	360	361	362	363	364	365	366	367	368	369	370	371	372	373	374	375	376	377	378	379	380	381	382	383	384	385	386	387	388	389	390	391	392	393	394	395	396	397	398	399	400	401	402	403	404	405	406	407	408	409	410	411	412	413	414	415	416	417	418	419	420	421	422	423	424	425	426	427	428	429	430	431	432	433	434	435	436	437	438	439	440	441	442	443	444	445	446	447	448	449	450	451	452	453	454	455	456	457	458	459	460	461	462	463	464	465	466	467	468	469	470	471	472	473	474	475	476	477	478	479	480	481	482	483	484	485	486	487	488	489	490	491	492	493	494	495	496	497	498	499	500	501	502	503	504	505	506	507	508	509	510	511	512	513	514	515	516	517	518	519	520	521	522	523	524	525	526	527	528	529	530	531	532	533	534	535	536	537	538	539	540	541	542	543	544	545	546	547	548	549	550	551	552	553	554	555	556	557	558	559	560	561	562	563	564	565	566	567	568	569	570	571	572	573	574	575	576	577	578	579	580	581	582	583	584	585	586	587	588	589	590	591	592	593	594	595	596	597	598	599	600	601	602	603	604	605	606	607	608	609	610	611	612	613	614	615	616	617	618	619	620	621	622	623	624	625	626	627	628	629	630	631	632	633	634	635	636	637	638	639	640	641	642	643	644	645	646	647	648	649	650	651	652	653	654	655	656	657	658	659	660	661	662	663	664	665	666	667	668	669	670	671	672	673	674	675	676	677	678	679	680	681	682	683	684	685	686	687	688	689	690	691	692	693	694	695	696	697	698	699	700	701	702	703	704	705	706	707	708	709	710	711	712	713	714	715	716	717	718	719	720	721	722	723	724	725	726	727	728	729	730	731	732	733	734	735	736	737	738	739	740	741	742	743	744	745	746	747	748	749	750	751	752	753	754	755	756	757	758	759	760	761	762	763	764	765	766	767	768	769	770	771	772	773	774	775	776	777	778	779	780	781	782	783	784	785	786	787	788	789	790	791	792	793	794	795	796	797	798	799	800	801	802	803	804	805	806	807	808	809	810	811	812	813	814	815	816	817	818	819	820	821	822	823	824	825	826	827	828	829	830	831	832	833	834	835	836	837	838	839	840	841	842	843	844	845	846	847	848	849	850	851	852	853	854	855	856	857	858	859	860	861	862	863	864	865	866	867	868	869	870	871	872	873	874	875	876	877	878	879	880	881	882	883	884	885	886	887	888	889	890	891	892	893	894	895	896	897	898	899	900	901	902	903	904	905	906	907	908	909	910	911	912	913	914	915	916	917	918	919	920	921	922	923	924	925	926	927	928	929	930	931	932	933	934	935	936	937	938	939	940	941	942	943	944	945	946	947	948	949	950	951	952	953	954	955	956	957	958	959	960	961	962	963	964	965	966	967	968	969	970	971	972	973	974	975	976	977	978	979	980	981	982	983	984	985	986	987	988	989	990	991	992	993	994	995	996	997	998	999	1000

TC: Total capacity; MBH
 PI: Power Input; kW (Comp.+Outdoor fan motor)
 Note1: is shown as reference.
 Note2: The above table shows the average value of conditions which may occur.


7.3 Capacity Correction Factor

REYQ72PYDN / REYQ216PBYD

1. Rate of change in cooling capacity

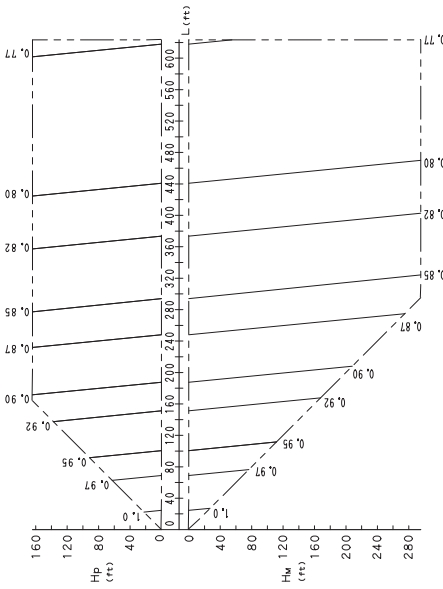

2. Rate of change in heating capacity

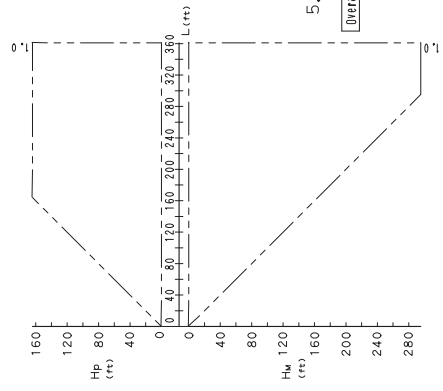

[Explanation of symbols]

Hp : level difference(ft)between indoor and outdoor units where indoor unit in inferior position

Hm: level difference(ft)between indoor and outdoor units where indoor unit in superior position

L : Equivalent pipe length(ft)

α : Capacity correction factor

[Diameter of pipe(Standard size)]


Model	liquid
REYQ72PYDN	φ 3/8
REYQ216PBYD	φ 5/8

5. When the main sections of the intermit liquid pipe diameters are increased the overall equivalent length should be calculated as follows. (Heating ONLY)
 Overall equivalent length=Equivalent length to main pipe+Correction factor×Equivalent length after branching

[Choose a correction factor from the following table]

Model	Correction factor
REYQ72PYDN	0.2
REYQ216PBYD	0.4

(Example) In case of REYQ216PBYD

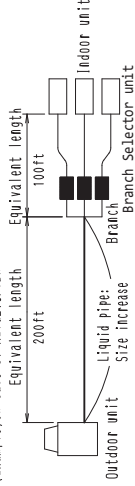

In the above case(Heating)
 Overall equivalent length=200ft×0.4+100ft=80ft


The correction factor in capacity when Hp=0ft is thus approximately 1.0.

6. In the combination which does not include cooling only indoor unit.

Calculate the equivalent length pipe by the following when you calculate cooling capacity.

Overall equivalent length=Equivalent length to main pipe×0.5+Equivalent length after branching

(Example) In case of REYQ216PBYD



In the above case(Cooling)
 Overall equivalent length=200ft×0.5+100ft=200ft

The correction factor in capacity when Hp=0m is thus approximately 0.89.

[Notes]


- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
- Method of calculating A/C (cooling/heating) capacity:
 The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.
 Calculating A/C capacity of outdoor units:
 • Condition: Indoor unit combination ratio does not exceed 100%.
 Maximum A/C capacity of outdoor units = A/C capacity of outdoor units obtained from capacity characteristic table at the 100% combination
 X Capacity change rate due to piping length to the farthest indoor unit
 • Condition: Indoor unit combination ratio exceeds 100%.
 Maximum A/C capacity of outdoor units = A/C capacity of outdoor units obtained from capacity characteristic table at the combination
 X Capacity change rate due to piping length to the farthest indoor unit

- When overall equivalent pipe length is 295.3ft or more, the diameter of the main liquid pipes (outdoor unit-branch sections) must be increased. When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased. [Diameter of above case]


Model	liquid
REYQ72PYDN	φ 1/2
REYQ216PBYD	φ 3/4

REYQ96PYDN

1. Rate of change in cooling capacity

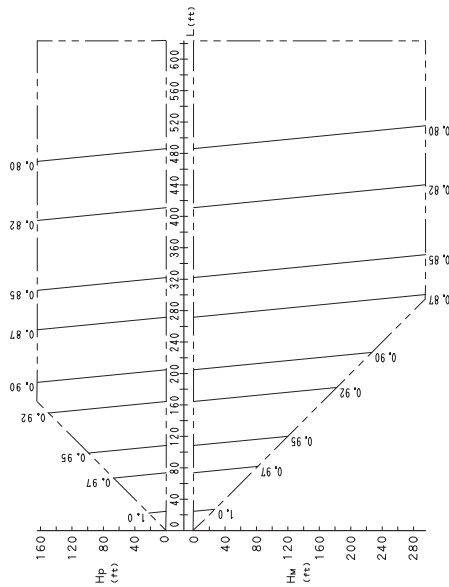

2. Rate of change in heating capacity

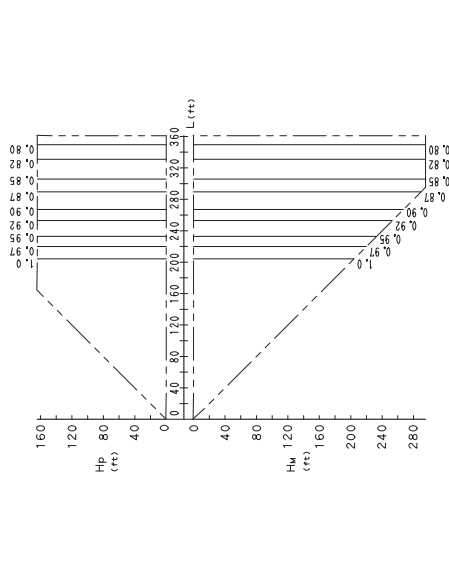

[Explanation of symbols]
 Hp : Level difference(ft)between indoor and outdoor units where indoor unit in inferior position
 Hm : Level difference(ft)between indoor and outdoor units where indoor unit in superior position
 L : Equivalent pipe length(ft)
 α : Capacity correction factor
 [Diameter of pipe(Standard size)]

Model	Liquid
REYQ96PYDN	φ3/8

[Notes]

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
- Method of calculating A/C (cooling/heating) capacity:
 The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.
 Calculating A/C capacity of outdoor units
 - Condition: Indoor unit combination ratio does not exceed 100%.

$$\text{Maximum A/C capacity of outdoor units} = \frac{A/C \text{ capacity of outdoor units}}{A/C \text{ capacity of indoor unit}}$$
 x (Capacity change rate due to piping length to the farthest indoor unit)
 - Condition: Indoor unit combination ratio exceeds 100%.

$$\text{Maximum A/C capacity of outdoor units} = \frac{A/C \text{ capacity of outdoor units}}{A/C \text{ capacity of indoor unit}}$$
 x (Capacity change rate due to piping length to the farthest indoor unit-branch sections)
 must be increased.
 When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.
 [Diameter of above case]

Model	Liquid
REYQ96PYDN	φ1/2

- When the main sections of the intermit liquid pipe diameters are increased the overall equivalent length should be calculated as follows, (Heating only)

$$\text{Overall equivalent length} = \text{Equivalent length to main pipe} \times 0.2 + \text{Equivalent length after branching}$$
 (Example)

 In the above case (Heating)

$$\text{Overall equivalent length} = 200\text{ft} \times 0.2 + 100\text{ft} = 140\text{ft}$$
 The correction factor in capacity when Hp=0ft is thus approximately 1.0.
 6. In the combination which does not include cooling only indoor unit, calculate the equivalent length pipe by the following when you calculate cooling capacity.


$$\text{Overall equivalent length} = \text{Equivalent length to main pipe} \times 0.5 + \text{Equivalent length after branching}$$
 (Example)

 In the above case (Cooling)


$$\text{Overall equivalent length} = 200\text{ft} \times 0.5 + 100\text{ft} = 200\text{ft}$$
 The correction factor in capacity when Hp=0ft is thus approximately 0.90.

REYQ120PYDN / REYQ168PBYD / REYQ264PBYD / REYQ288PBYD

1. Rate of change in cooling capacity

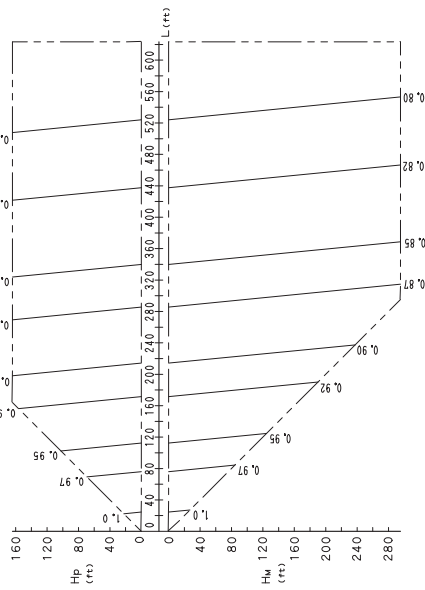

2. Rate of change in heating capacity

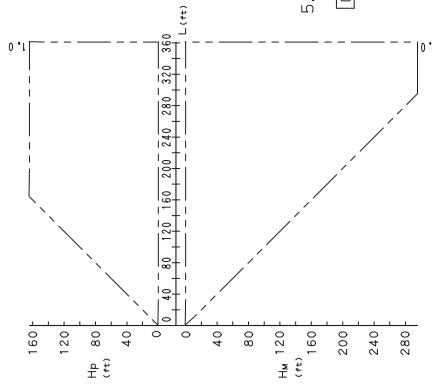

[Explanation of symbols]

- Hp : Level difference(ft)between indoor and outdoor units where indoor unit in inferior position
- Hw : Level difference(ft)between indoor and outdoor units where indoor unit in superior position
- L : Equivalent pipe length(ft)
- α : Capacity correction factor

[Diameter of pipe(Standard size)]

Model	Liquid
REYQ120PYDN	φ 1/2
REYQ168PBYD	φ 5/8
REYQ264PBYD	φ 3/4
REYQ288PBYD	φ 3/4

- When the main sections of the intermit liquid pipe diameters are increased the overall equivalent length should be calculated as follows, (heating only)
 Overall equivalent length=Equivalent length to main pipe×Correction factor+Equivalent length after branching
 [Choose a correction factor from the following table]

Model	Correction factor
REYQ120PYDN	0.3
REYQ168PBYD	0.4
REYQ264PBYD	0.4
REYQ288PBYD	0.4


[Notes]

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
- Method of calculating A/C (cooling/heating) capacity:
 The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.
 Calculating A/C capacity of outdoor units
 • Condition: Indoor unit combination ratio does not exceed 100%.

$$\text{Maximum A/C capacity of outdoor units} = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the 100\% combination}}{\text{Maximum A/C capacity of outdoor units}} \times \text{A/C capacity of outdoor units}$$
 • Condition: Indoor unit combination ratio exceeds 100%.


$$\text{Maximum A/C capacity of outdoor units} = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the combination}}{\text{Maximum A/C capacity of outdoor units}} \times \text{A/C capacity of outdoor units}$$
 x [Capacity change rate due to piping length to the farthest indoor unit]
 x [Capacity change rate due to piping length to the farthest outdoor unit-branch sections]
 x [Capacity change rate due to piping length to the farthest indoor unit-branch sections]
- When overall equivalent pipe length is 295.3ft or more, the diameter of the main liquid pipes (outdoor unit-branch sections) must be increased.
 When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.
 [Diameter of above case]

Model	Liquid
REYQ120PYDN	φ 5/8
REYQ264PBYD	φ 7/8
REYQ168PBYD	φ 3/4

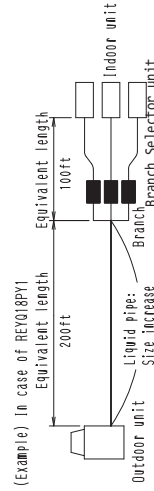

(Example) In case of REYQ18PYI

- In the above case (heating)
 Overall equivalent length=200ft×0.4+100ft=180ft
 The correction factor in capacity when Hp=0ft is thus approximately 1.0.
 In the combination which does not include cooling only indoor unit, calculate the equivalent length pipe by the following when you calculate cooling capacity.
 Overall equivalent length=Equivalent length to main pipe×0.5+Equivalent length after branching

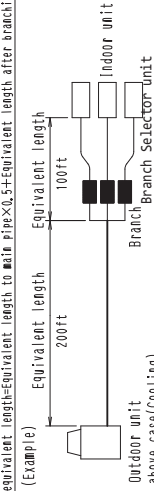


(Example) In case of REYQ18PYI


- In the above case (cooling)
 Overall equivalent length=200ft×0.5+100ft=200ft
 The correction factor in capacity when Hp=0ft is thus approximately 0.91.

REYQ144PBYD

1. Rate of change in cooling capacity

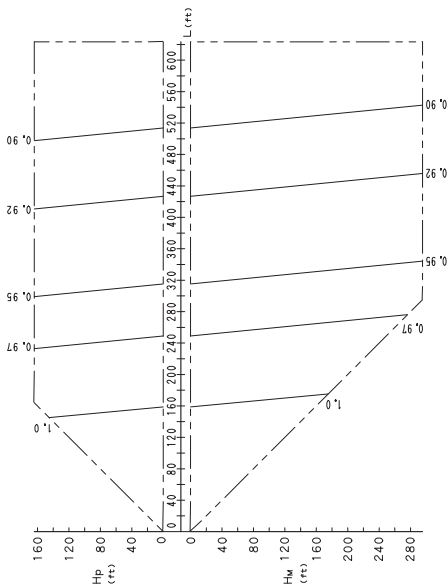

2. Rate of change in heating capacity

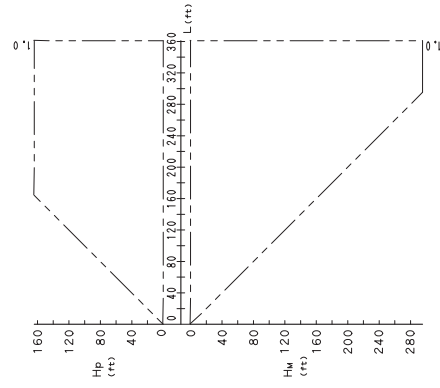

[Explanation of symbols]

Hp : Level difference(ft)between indoor and outdoor units where indoor unit in inferior position
 Hw: Level difference(ft)between indoor and outdoor units where indoor unit in superior position

L : Equivalent pipe length(ft)

α : Capacity correction factor

[Diameter of pipe(Standard size)]

Model	Liquid
REYQ144PBYD	ϕ 1/2

[Notes]

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
- Method of calculating A/C (cooling/heating) capacity:
 The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.
 Calculating A/C capacity of outdoor units
 • Condition: Indoor unit combination ratio does not exceed 100%.
 [Maximum A/C capacity of outdoor units] = $\frac{A/C \text{ capacity of outdoor units obtained from capacity characteristic table at the 100\% combination}}{x}$
 x [Capacity change rate due to piping length to the farthest indoor unit]
 • Condition: Indoor unit combination ratio exceeds 100%.
 [Maximum A/C capacity of outdoor units] = $\frac{A/C \text{ capacity of outdoor units obtained from capacity characteristic table at the combination}}{x}$
 x [Capacity change rate due to piping length to the farthest indoor unit]
- When overall equivalent pipe length is 295.3ft or more, the diameter of the main liquid pipes (outdoor unit-branch sections) must be increased.
 When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.
 [Diameter of above case]


Model	Liquid
REYQ144PBYD	ϕ 5/8
- When the main sections of the intermit liquid pipe diameters are increased the overall equivalent length should be calculated as follows. (Heating only)
 Overall equivalent length=Equivalent length to main pipe $\times 0.3$ +Equivalent length after branching
 (Example)

In the above case (heating)
 Overall equivalent length=200ft $\times 0.3$ +100ft=160ft
 The correction factor in capacity when Hp=0ft is thus approximately 1.0.
 In the combination which does not include cooling only indoor unit,
 Calculate the equivalent length pipe by the following when you calculate cooling capacity,
 Overall equivalent length=Equivalent length to main pipe $\times 0.5$ +Equivalent length after branching
 (Example)


In the above case (cooling)
 Overall equivalent length=200ft $\times 0.5$ +100ft=250ft
 The correction factor in capacity when Hp=0ft is thus approximately 0.98.

REYQ192PBYD / REYQ312PBYD / REYQ336PBYD

1. Rate of change in cooling capacity

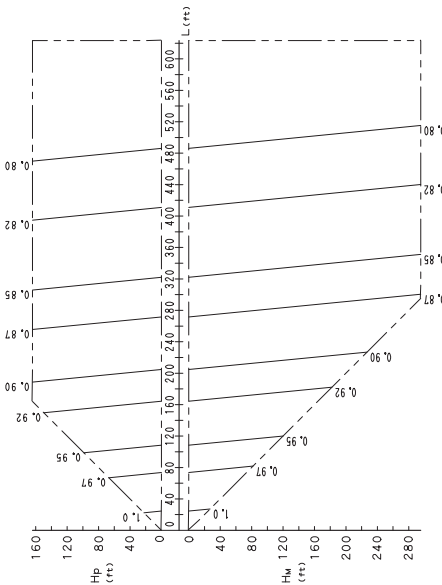

2. Rate of change in heating capacity

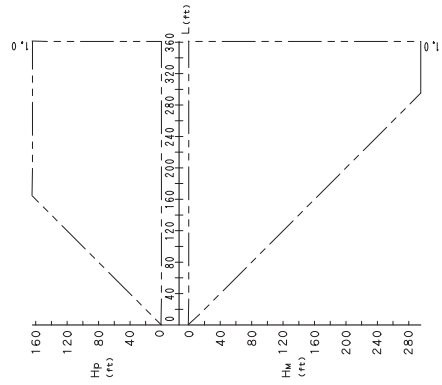

[Explanation of symbols]

Hp : Level difference (ft) between indoor and outdoor units where indoor unit in inferior position

Hw : Level difference (ft) between indoor and outdoor units where indoor unit in superior position

L : Equivalent pipe length (ft)

α : Capacity correction factor

[Diameter of pipe (Standard size)]

Model	Liquid
REYQ192PBYD	φ 5/8
REYQ312PBYD	φ 3/4
REYQ336PBYD	φ 3/4

[Notes]

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
- Method of calculating A/C (cooling/heating) capacity: The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.
Calculating A/C capacity of outdoor units
 - Condition: Indoor unit combination ratio does not exceed 100%.

$$\text{Maximum A/C capacity of outdoor units} = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the 100\% combination}}{\text{Capacity change rate due to piping length to the farthest indoor unit}}$$
 - Condition: Indoor unit combination ratio exceeds 100%.

$$\text{Maximum A/C capacity of outdoor units} = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the combination}}{\text{Capacity change rate due to piping length to the farthest indoor unit}}$$
- When overall equivalent pipe length is 295,3ft or more, the diameter of the main liquid pipes (outdoor unit-branch sections) must be increased. When level difference is 164,0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.
 [Diameter of above case]

Model	Liquid
REYQ192PBYD	φ 3/4
REYQ312PBYD	φ 7/8
REYQ336PBYD	φ 7/8




(Example) Equivalent length = 200ft + 100ft + 100ft = 400ft

In the above case (Heating)
Overall equivalent length = 200ft x 0.4 + 100ft = 180ft

The correction factor in capacity when Hp=0ft is thus approximately 1.0.

In the combination which does not include cooling only indoor unit,
Calculate the equivalent length pipe by the following when you calculate cooling capacity,
Overall equivalent length = Equivalent length to main pipe x 0.5 + Equivalent length after branching




(Example) Equivalent length = 200ft + 100ft + 100ft = 400ft

In the above case (Cooling)
Overall equivalent length = 200ft x 0.5 + 100ft = 200ft


The correction factor in capacity when Hp=0ft is thus approximately 0.90.

REYQ240PBYD

1. Rate of change in cooling capacity

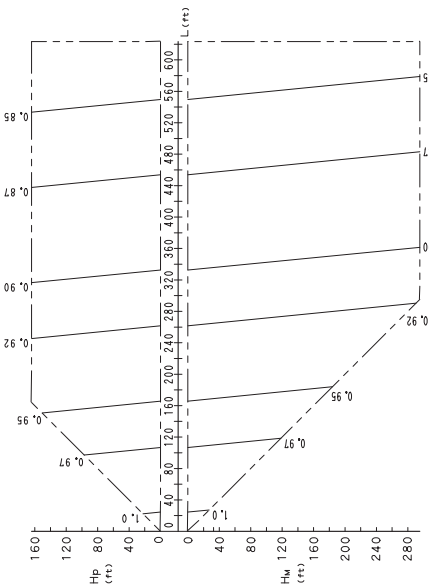

2. Rate of change in heating capacity

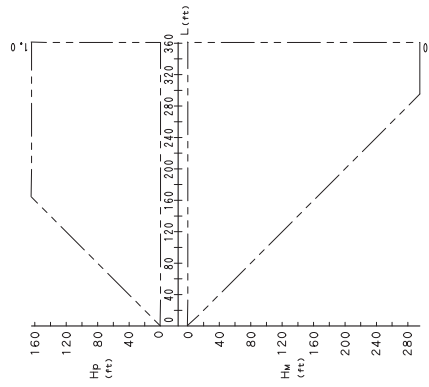

[Explanation of symbols]

Hp : Level difference(ft)between indoor and outdoor units where indoor unit in inferior position

Hw : Level difference(ft)between indoor and outdoor units where indoor unit in superior position

L : Equivalent pipe length(ft)

α : Capacity correction factor

[Diameter of pipe(Standard size)]

Model	Liquid
REYQ240PBYD	ϕ 5/8

[Notes]

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
- Method of calculating A/C (cooling/heating) capacity:
The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.
Calculating A/C capacity of outdoor units
 - Condition: Indoor unit combination ratio does not exceed 100%.


$$\text{Maximum A/C capacity of outdoor units} = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the 100\% combination}}{\text{Capacity change rate due to piping length to the farthest indoor unit}}$$
 - Condition: Indoor unit combination ratio exceeds 100%.

$$\text{Maximum A/C capacity of outdoor units} = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the combination}}{\text{Capacity change rate due to piping length to the farthest indoor unit}}$$
- When overall equivalent pipe length is 295.3ft or more, the diameter of the main liquid pipes (outdoor unit-branch sections) must be increased.
When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.
[Diameter of above case]

Model	Liquid
REYQ240PBYD	ϕ 3/4

5. When the main sections of the interunit liquid pipe diameters are increased the overall equivalent length should be calculated as follows. (Heating only)


$$\text{Overall equivalent length} = \text{Equivalent length to main pipe} \times 0.4 + \text{Equivalent length after branching}$$

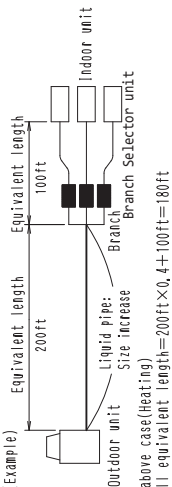

In the above case (heating)
Overall equivalent length = 200ft × 0.4 + 100ft = 180ft

6. In the combination which does not include cooling only indoor unit, Calculate the equivalent length pipe by the following when you calculate cooling capacity.

$$\text{Overall equivalent length} = \text{Equivalent length to main pipe} \times 0.5 + \text{Equivalent length after branching}$$

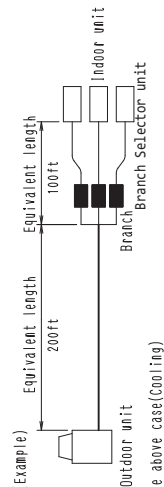


In the above case (cooling)
Overall equivalent length = 200ft × 0.5 + 100ft = 200ft

The correction factor in capacity when Hp=0ft is thus approximately 0.94.

8. Operation Limits

REYQ72PYDN / REYQ96PYDN / REYQ120PYDN / REYQ144PBYD / REYQ168PBYD / REYQ192PBYD / REYQ216PBYD / REYQ240PBYD / REYQ264PBYD / REYQ288PBYD / REYQ312PBYD / REYQ336PBYD

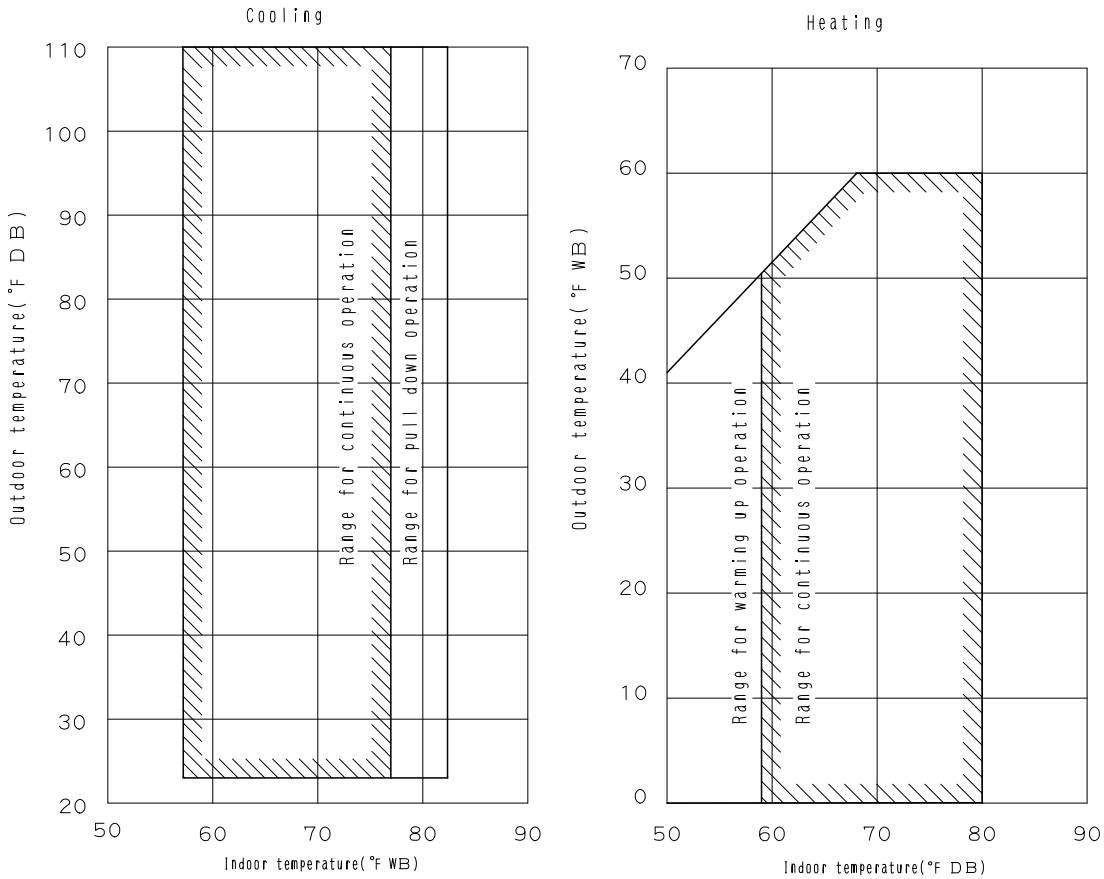


3D043026E

Note: These figures assume the following operating conditions:
 Indoor and outdoor units:
 Equivalent pipe length: 25ft
 Level difference: 0

Note : See capacity Tables for Reference Cooling Capacities above 110°F.

9. Low Ambient Cooling Enhancement

- The VRV III PB product will include a new feature for Low Ambient Cooling
- The function enhances VRV III PB Heat Recovery systems as follows:
 - Allows Operation to -4°F (-20°C) in Cooling Mode Normal limit is 23°F (-5°C)
 - Operation below 23°F (-5°C) ambient temperature requires the addition of wind covers onto the condensing unit.*

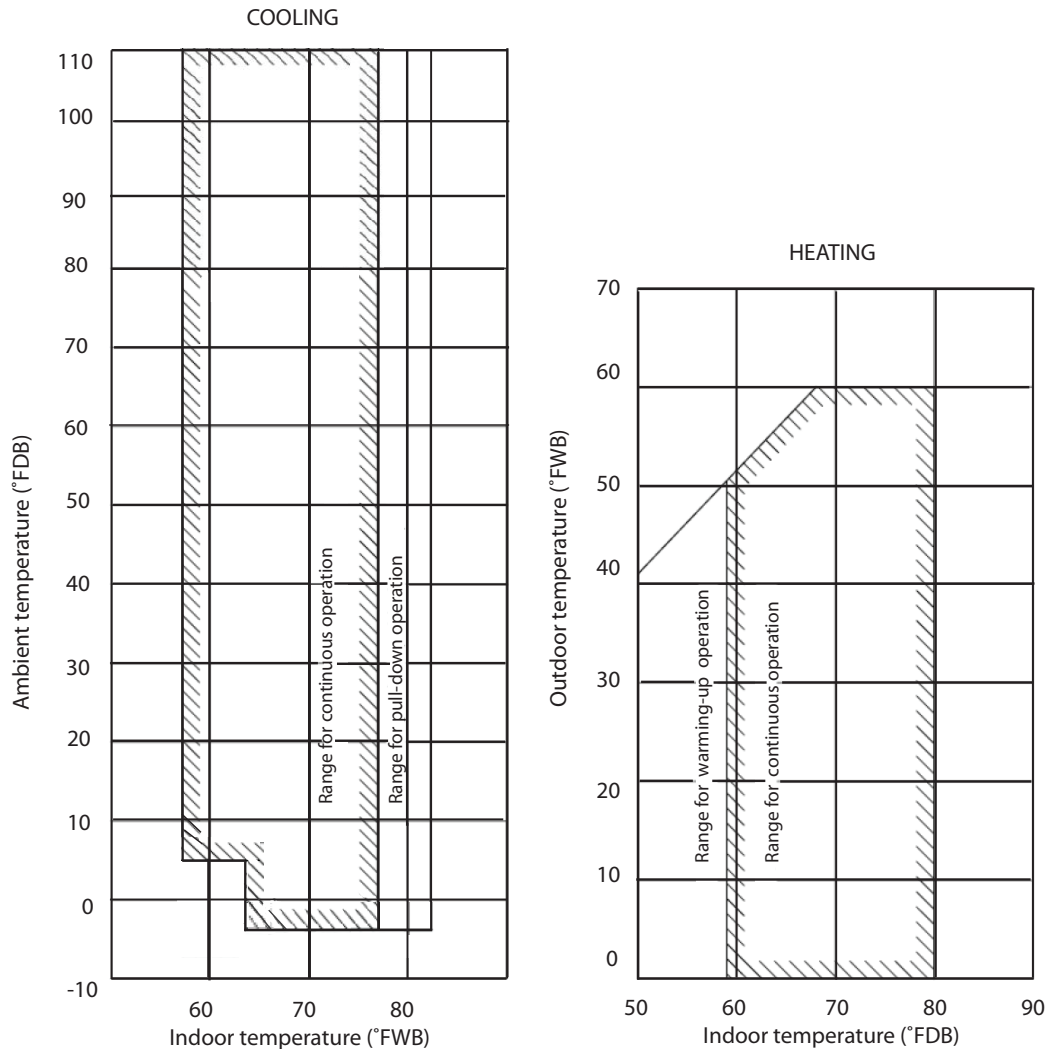






Application Rules:









- Indoor Units assigned for low ambient cooling CANNOT exceed 50% of the Nominal Rating of the Condensing Unit
 - Total Connection index of each system is limited to 60 –130%
 - Function is engaged by a field setting on the condensing unit (to enable Low Ambient Cooling) and a dip switch setting is necessary on the BSVQ units serving Indoor Units NOT subject to Low Ambient Cooling Requirements
 - During operation below 23°F (-5°C), the available cooling capacity decreases as follows: -
 - 14°F (-10°C) - Reduces to 80% of Nominal
 - 5°F (-15°C) - Reduces to 65% of Nominal
 - 4°F (-20°C) - Reduces to 60% of Nominal
 - During operation the operating Sound Level of the BSVQ unit can increase (Max + 3dB(A)) thus it is encouraged to locate units away from sound sensitive zones.
 - The vertical separation of Outdoor to Indoor unit (when Outdoor below) is limited to 164ft (normal = 295ft)
- * Contact your local Daikin representative for wind cover specification requirements.**









10. Accessories

Standard Accessories

REYQ72PYDN / REYQ96PYDN / REYQ120PYDN







Name	Clamp(1)	Clamp(2)	Vinyl tube	Conduit mounting plate		Manuals, etc.
Quantity	9 pcs.	3 pcs.	4 pcs.	2 pcs.	2 pcs.	1 pc. each
Shape						<ul style="list-style-type: none"> • Operation manual • Installation manual • "REQUEST FOR THE INDICATON" label (Installation records)










Name		Liquid side accessory pipe (1)	Liquid side accessory pipe (2)	Suction gas side accessory pipe (1)			Suction gas side accessory pipe (2)		
Quantity	72P type	1 pc.	1 pc.	1 pc.	/	/	1 pc.	/	/
	96P type			/	/	1 pc.	/	1 pc.	/
	120P type			/	/	1 pc.	/	1 pc.	/
Shape									
				φ7/8	φ7/8	φ1-1/8	φ3/4	φ7/8	φ1-1/8





Name		HP / LP gas side accessory pipe (1)		HP / LP gas side accessory pipe (2)			L type accessory joint (1)	L type accessory joint (2)	accessory joint (2)	
Quantity	72P type	1 pc.	/	1 pc.	/	/	1 pc.	1 pc.	1 pc.	
	96P type	/	1 pc.	/	1 pc.	/			/	/
	120P type	/	1 pc.	/	1 pc.	/			/	/
Shape										
		φ5/8	φ3/4	φ7/8	φ5/8	φ3/4	φ7/8	φ1	φ3/4	

C: 3P215731-12R

REM72PBYD / REM96PBYD / REM120PBYD

Name	Clamp(1)	Clamp(2)	Clamp(3)	Vinyl tube
Quantity	8 pcs.	2 pcs.	1 pc.	4 pcs.
Shape	 (Small)		 (Large)	
Name	Conduit mounting plate		Manuals, etc.	
Quantity	2 pcs.	2 pcs.	1 pc. each	
Shape			<ul style="list-style-type: none"> · Operation manual · Installation manual · “REQUEST FOR THE INDICATON” label (Installation records) · Add additional refrigerant charge label 	

Name		Liquid side accessory pipe (1)	Liquid side accessory pipe (2)	Suction gas side accessory pipe (1)		Suction gas side accessory pipe (2)		HP / LP gas side accessory pipe (1)		HP / LP gas side accessory pipe (2)							
Quantity	72 · 96P type	1 pc.	1 pc.	1 pc.			1 pc.	2 pcs.									
	120P type						1 pc.				1 pc.	2 pcs.					
Shape						$\phi 7/8$	$\phi 1-1/8$			$\phi 7/8$	$\phi 1-1/8$			$\phi 3/4$	$\phi 7/8$		$\phi 7/8$

Name		Equalizer side accessory pipe (1)	Equalizer side accessory pipe (2)	L type accessory joint (1)	L type accessory joint (2)			
Quantity	72 · 96P type	1 pc.			1 pc.	2 pcs.		
	120P type							
Shape				$\phi 3/4$		$\phi 1$		$\phi 3/4$

3P215731-11R

Optional Accessories (For Unit)

**REYQ72PYDN / REYQ96PYDN / REYQ120PYDN / REYQ144PBYD / REYQ168PBYD / REYQ192PBYD /
REYQ216PBYD / REYQ240PBYD / REYQ264PBYD / REYQ288PBYD / REYQ312PBYD / REYQ336PBYD**

Series		VRV III				
Models		REYQ72PYDN	REYQ96PYDN REYQ120PYDN	REYQ144PBYD REYQ168PBYD	REYQ192PBYD REYQ216PBYD REYQ240PBYD	REYQ264PBYD REYQ288PBYD REYQ312PBYD REYQ336PBYD
Optional accessories						
Distributive piping	Refnet header	Model	KHRP25M33H (Max. 8 branch)	KHRP25M33H (Max. 8 branch) KHRP25M72H (Max. 8 branch)	KHRP25M33H (Max. 8 branch) KHRP25M72H (Max. 8 branch) KHRP25M73HU (Max. 8 branch)	
		AS No.	—	—	—	
		Z No.	—	—	—	
	Refnet joint	Model	KHRP25A22T KHRP25A33T	KHRP25A22T KHRP25A33T KHRP25M72TU	KHRP25A22T KHRP25A33T KHRP25M72TU KHRP25M73TU	
		AS No.	—	AS3803118 (KHRP25M72TU)	AS3803566 (KHRP25M73TU)	
		Z No.	—	—	—	
Outdoor unit multi connection piping kit	Model	—	BHFP26P90U		BHFP26P136U	
	AS No.	—	—		—	
	Z No.	—	—		—	

C: 3D059681C

Warning



Daikin Industries, Ltd.'s products are manufactured for export to numerous countries throughout the world. Daikin Industries, Ltd. does not have control over which products are exported to and used in a particular country. Prior to purchase, please therefore confirm with your local authorized importer, distributor and/or retailer whether this product conforms to the applicable standards, and is suitable for use, in the region where the product will be used. This statement does not purport to exclude, restrict or modify the application of any local legislation.

Ask a qualified installer or contractor to install this product. Do not try to install the product yourself. Improper installation can result in water or refrigerant leakage, electrical shock, fire, or explosion.

Use only those parts and accessories supplied or specified by Daikin. Ask a qualified installer or contractor to install those parts and accessories. Use of unauthorized parts and accessories or improper installation of parts and accessories can result in water or refrigerant leakage, electrical shock, fire, or explosion.

Read the User's Manual carefully before using this product. The User's Manual provides important safety instructions and warnings. Be sure to follow these instructions and warnings.

If you have any inquiries, please contact your local importer, distributor, or retailer.



©2010 Daikin Industries, Limited.

Daikin® AC Absolute Comfort®, and its design, VRV®, REFNET™, and Quaternity™ are registered trademarks of Daikin Industries, Limited. All rights reserved. LonWorks® and LON® are registered trademarks of Echelon Corporation. BACnet® is a Data Communication Protocol for Building Automation and Control Networks, developed under the auspices of the American Society of Heating, Refrigeration, and Air-Conditioning Engineers (ASHRAE).



JMI-0107



JQA-1452

About ISO 9001

ISO 9001 is a plant certification system defined by the International Organization for Standardization (ISO) relating to quality assurance. ISO 9001 certification covers quality assurance aspects related to the "design, development, manufacture, installation, and supplementary service" of products manufactured at the plant.



EC99J2044

About ISO 14001

ISO 14001 is the standard defined by the International Organization for Standardization (ISO) relating to environmental management systems. Our group has been acknowledged by an internationally accredited program of environmental protection procedures and activities to meet the requirements of ISO 14001.

Dealer

DAIKIN AC (AMERICAS), INC.
1645 Wallace Drive, Suite 110
Carrollton, TX 75006
info@daikinac.com
www.daikinac.com

©All rights reserved

•Specifications, designs and other content appearing in this brochure are current as of March 2011 but subject to change without notice.