



EDUS 391006 - R1

R-410A

Engineering Data



RXYQ-PBTJ
3 phase
208/230V, 60Hz

DAIKIN AC (AMERICAS), INC.

RXYQ-PBTJ

Heat Pump

3 phase

208/230V, 60Hz

| | |
|--|----|
| 1. Specifications | 2 |
| 2. Dimensions | 7 |
| 3. Service Space | 14 |
| 4. Piping Diagrams..... | 15 |
| 5. Wiring Diagrams..... | 18 |
| 6. Field Wiring | 21 |
| 7. Electric Characteristics..... | 24 |
| 8. Capacity Tables (Reference Data)..... | 27 |
| 8.1 Cooling Capacity (RXYQ-PBTJ)..... | 27 |
| 8.2 Heating Capacity (RXYQ-PBTJ) | 40 |
| 8.3 Capacity Correction Factor..... | 53 |
| 9. Sound Levels (Reference) | 59 |
| 9.1 Overall | 59 |
| 9.2 Octave Band Level..... | 59 |
| 10.Operation Limits | 60 |
| 11.Accessories..... | 61 |

1. Specifications

| Model Name | | | RXYQ72PBTJ | RXYQ96PBTJ | RXYQ120PBTJ |
|----------------------------------|------------------------------|-------------------|--|--|--|
| Power Supply | | | 3 phase, 208/230V, 60Hz | 3 phase, 208/230V, 60Hz | 3 phase, 208/230V, 60Hz |
| ★1 Cooling Capacity | Nominal | Btu / h | 72,000 | 96,000 | 120,000 |
| | Rated | | 69,000 | 92,000 | 114,000 |
| ★2 Heating Capacity | Nominal | Btu / h | 81,000 | 108,000 | 135,000 |
| | Rated | | 77,000 | 103,000 | 129,000 |
| Casing Color | | | Ivory White (5Y7.5/1) | Ivory White (5Y7.5/1) | Ivory White (5Y7.5/1) |
| Dimensions: (H×W×D) | | in. (mm) | 66-1/8 × 36-5/8 × 30-1/8 (1680 × 930 × 765) | 66-1/8 × 48-7/8 × 30-1/8 (1680 × 1241 × 765) | 66-1/8 × 48-7/8 × 30-1/8 (1680 × 1241 × 765) |
| Heat Exchanger | | | Cross Fin Coil | Cross Fin Coil | Cross Fin Coil |
| Comp. | Type | | Hermetically Sealed Scroll Type | Hermetically Sealed Scroll Type | Hermetically Sealed Scroll Type |
| | Displacement | m ³ /h | 16.90 | 10.53+13.34 | 10.53+13.34 |
| | Number of Revolutions | r/min | 7980 | 2900, 6300 | 2900, 6300 |
| | Motor Output×Number of Units | kW | 4.5 × 1 | (2.2+4.5) × 1 | (3.5+4.5) × 1 |
| | Starting Method | | Soft Start | Soft Start | Soft Start |
| Fan | Type | | Propeller Fan | Propeller Fan | Propeller Fan |
| | Motor Output | kW | 0.75 × 1 | 0.35 × 2 | 0.35 × 2 |
| | Airflow Rate | cfm | 6,350 | 8,230 | 8,230 |
| | Drive | | Direct Drive | Direct Drive | Direct Drive |
| Connecting Pipes | Liquid Pipe | in. (mm) | φ 3/8 (9.5) C1220T (Brazeing Connection) | φ 3/8 (9.5) C1220T (Brazeing Connection) | φ 1/2 (12.7) C1220T (Brazeing Connection) |
| | Gas Pipe | in. (mm) | φ 3/4 (19.1) C1220T (Brazeing Connection) | φ 7/8 (22.2) C1220T (Brazeing Connection) | φ 1-1/8 (28.6) C1220T (Brazeing Connection) |
| | Discharge Gas Pipe | in. (mm) | — | — | — |
| Mass | Lbs (kg) | 420 (191) | 620 (281) | 620 (281) | |
| ★3 Sound Level (Reference Value) | dBA | 57 | 60 | 60 | |
| Safety Devices | | | High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector | High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector | High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector |
| Defrost Method | | | Deicer | Deicer | Deicer |
| Capacity Control | | % | 20~100 | 14~100 | 14~100 |
| Refrigerant | Refrigerant Name | | R-410A | R-410A | R-410A |
| | Charge | Lbs (kg) | 16.5 (7.4) | 21.4 (9.7) | 22.1 (10) |
| | Control | | Electronic Expansion Valve | Electronic Expansion Valve | Electronic Expansion Valve |
| Standard Accessories | | | Installation Manual, Operation Manual, Connection Pipes, Clamps | Installation Manual, Operation Manual, Connection Pipes, Clamps | Installation Manual, Operation Manual, Connection Pipes, Clamps |
| Drawing No. | | | C: 4D070501 | C: 4D070502 | C: 4D070503 |

Notes:

- ★1 Indoor temp. : 80°FDB(27°CDB), 67°F WB(19.4°CWB) / outdoor temp. : 95°FDB (35°CDB) / Equivalent piping length : 25ft (7.5 m), level difference : 0 ft.
- ★2 Indoor temp. : 70°FDB(21°CDB) / outdoor temp. : 47°FDB, 43°F WB (8.3°CDB, 6°CWB) / Equivalent piping length : 25ft (7.5 m), difference : 0 ft.
- ★3 Anechoic chamber conversion value, measure under JISB8616 conditions. During actual operation, these values are normally somewhat higher as a result of ambient conditions.

| Model Name (Combination Unit) | | RX YQ144PBTJ | | RX YQ168PBTJ | | RX YQ192PBTJ | | |
|----------------------------------|------------------------------|--|--|--|--|--|----------------------------|--|
| Model Name (Independent Unit) | | — | | RX YQ72PBTJ RX YQ96PBTJ | | RX YQ72PBTJ RX YQ120PBTJ | | |
| Power Supply | | 3 phase, 208/230V, 60Hz | | 3 phase, 208/230V, 60Hz | | 3 phase, 208/230V, 60Hz | | |
| ★1 Cooling Capacity | Nominal | Btu / h | 144,000 | 168,000 | 192,000 | | | |
| | Rated | | 138,000 | 160,000 | 184,000 | | | |
| ★2 Heating Capacity | Nominal | Btu / h | 162,000 | 188,000 | 216,000 | | | |
| | Rated | | 154,000 | 180,000 | 206,000 | | | |
| Casing Color | | Ivory White (5Y7.5/1) | | Ivory White (5Y7.5/1) | | Ivory White (5Y7.5/1) | | |
| Dimensions: (HxWxD) | | in. (mm) | 66-1/8 × 51-3/16 × 30-1/8 (1680 × 1300 × 765) | 66-1/8 × 36-5/8 × 30-1/8 + 66-1/8 × 48-7/8 × 30-1/8 (1680 × 930 × 765)+ (1680 × 1241 × 765) | 66-1/8 × 36-5/8 × 30-1/8 + 66-1/8 × 48-7/8 × 30-1/8 (1680 × 930 × 765)+ (1680 × 1241 × 765) | | | |
| Heat Exchanger | | Cross Fin Coil | | Cross Fin Coil | | Cross Fin Coil | | |
| Comp. | Type | Hermetically Sealed Scroll Type | | Hermetically Sealed Scroll Type | | Hermetically Sealed Scroll Type | | |
| | Displacement | m ³ /h | 16.90 + 16.90 | 16.90 + (10.53+13.34) | 16.90 + (10.53+13.34) | | | |
| | Number of Revolutions | r/min | 7980, 7980 | 7980, (2900, 6300) | 7980, (2900, 6300) | | | |
| | Motor Output×Number of Units | kW | (3.8+3.8) × 1 | (4.5) × 1 + (2.2+4.5) × 1 | (4.5) × 1 + (3.5+4.5) × 1 | | | |
| Starting Method | | Soft Start | | Soft Start | | Soft Start | | |
| Fan | Type | Propeller Fan | | Propeller Fan | | Propeller Fan | | |
| | Motor Output | kW | 0.75 × 2 | (0.75) × 1 + (0.35) × 2 | (0.75) × 1 + (0.35) × 2 | | | |
| | Airflow Rate | cfm | 8,300 | 6,350+8,230 | 6,350+8,230 | | | |
| | Drive | | Direct Drive | | Direct Drive | | Direct Drive | |
| Connecting Pipes | Liquid Pipe | in. (mm) | φ1/2 (12.7) C1220T (Brazing Connection) | φ5/8 (15.8) C1220T (Brazing Connection) | φ5/8 (15.8) C1220T (Brazing Connection) | | | |
| | Gas Pipe | in. (mm) | φ1-1/8 (28.6) C1220T (Brazing Connection) | φ1-1/8 (28.6)C1220T (Brazing Connection) | φ1-1/8 (28.6) C1220T (Brazing Connection) | | | |
| Mass | Lbs | 747 | 420+620 | 420+620 | | | | |
| ★3 Sound Level (Reference Value) | dBA | 62 | 62 | 62 | | | | |
| Safety Devices | | High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector | | High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector | | High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector | | |
| Defrost Method | | Deicer | | Deicer | | Deicer | | |
| Capacity Control | | % | 10~100 | 9~100 | 8~100 | | | |
| Refrigerant | Refrigerant Name | | R-410A | | R-410A | | R-410A | |
| | Charge | Lbs (kg) | 24.5 (11.1) | 16.5 + 21.4 (7.5 + 9.7) | 16.5+22.1 (7.5 + 10) | | | |
| | Control | | Electronic Expansion Valve | | Electronic Expansion Valve | | Electronic Expansion Valve | |
| Standard Accessories | | Installation Manual, Operation Manual, Connection Pipes, Clamps | | Installation Manual, Operation Manual, Connection Pipes, Clamps | | Installation Manual, Operation Manual, Connection Pipes, Clamps | | |
| Drawing No. | | C: 4D070759 | | C: 4D070868 | | C: 4D070869 | | |

Notes:

- ★1 Indoor temp. : 80°FDB(27°CDB), 67°FWB(19.4°CWB) / outdoor temp. : 95°FDB (35°CDB) / Equivalent piping length : 25ft (7.5 m), level difference : 0 ft.
- ★2 Indoor temp. : 70°FDB(21°CDB) / outdoor temp. : 47°FDB, 43°FWB (8.3°CDB, 6°CWB) / Equivalent piping length : 25ft (7.5 m), difference : 0 ft.
- ★3 Anechoic chamber conversion value, measure under JISB8616 conditions. During actual operation, these values are normally somewhat higher as a result of ambient conditions.

| Model Name (Combination Unit) | | | RXYQ216PBTJ | RXYQ240PBTJ | RXYQ264PBTJ |
|----------------------------------|------------------------------|-------------------|--|--|--|
| Model Name (Independent Unit) | | | RXYQ96PBTJ RXYQ120PBTJ | RXYQ120PBTJ RXYQ120PBTJ | RXYQ72PBTJ RXYQ96PBTJ RXYQ96PBTJ |
| Power Supply | | | 3 phase, 208/230V, 60Hz | 3 phase, 208/230V, 60Hz | 3 phase, 208/230V, 60Hz |
| ★1 Cooling Capacity | Nominal | Btu / h | 216,000 | 240,000 | 264,000 |
| | Rated | | 206,000 | 228,000 | 251,000 |
| ★2 Heating Capacity | Nominal | Btu / h | 243,000 | 270,000 | 297,000 |
| | Rated | | 231,000 | 257,000 | 283,000 |
| Casing Color | | | Ivory White (5Y7.5/1) | Ivory White (5Y7.5/1) | Ivory White (5Y7.5/1) |
| Dimensions: (H×W×D) | | in. (mm) | 66-1/8 × 48-7/8 × 30-1/8 + 66-1/8 × 48-7/8 × 30-1/8 (1680 × 1241 × 765) + (1680 × 1241 × 765) | 66-1/8 × 48-7/8 × 30-1/8 + 66-1/8 × 48-7/8 × 30-1/8 (1680 × 1241 × 765) + (1680 × 1241 × 765) | 66-1/8 × 36-5/8 × 30-1/8 + 66-1/8 × 48-7/8 × 30-1/8 + 66-1/8 × 48-7/8 × 30-1/8 (1680 × 930 × 765) + (1680 × 1241 × 765) (1680 × 1241 × 765) |
| Heat Exchanger | | | Cross Fin Coil | Cross Fin Coil | Cross Fin Coil |
| Comp. | Type | | Hermetically Sealed Scroll Type | Hermetically Sealed Scroll Type | Hermetically Sealed Scroll Type |
| | Displacement | m ³ /h | (10.53+13.34) × 2 | (10.53+13.34) × 2 | 16.90 + (10.53+13.34) × 2 |
| | Number of Revolutions | r/min | (2900, 6300) × 2 | (2900, 6300) × 2 | 7980, (2900, 6300) × 2 |
| | Motor Output×Number of Units | kW | (2.2+4.5) × 1 + (3.5+4.5) × 1 | (3.5+4.5) × 2 | (4.5) × 1 + (2.2+4.5) × 2 |
| Starting Method | | | Soft Start | Soft Start | Soft Start |
| Fan | Type | | Propeller Fan | Propeller Fan | Propeller Fan |
| | Motor Output | kW | (0.35) × 2 + (0.35) × 2 | (0.35) × 2 + (0.35) × 2 | (0.75) × 1 + (0.35) × 2 + (0.35) × 2 |
| | Airflow Rate | cfm | 8,230+8,230 | 8,230+8,230 | 6,350+8,230+8,230 |
| | Drive | | Direct Drive | Direct Drive | Direct Drive |
| Connecting Pipes | Liquid Pipe | in. (mm) | φ5/8 (15.8) C1220T (Brazing Connection) | φ5/8 (15.8) C1220T (Brazing Connection) | φ3/4 (19.1) C1220T (Brazing Connection) |
| | Gas Pipe | in. (mm) | φ1-1/8 (28.6) C1220T (Brazing Connection) | φ1-3/8 (34.9) C1220T (Brazing Connection) | φ1-3/8 (34.9) C1220T (Brazing Connection) |
| Mass | | Lbs (kg) | 620+620 (281+281) | 620+620 (281+281) | 420+620+620 (190.5+281+281) |
| ★3 Sound Level (Reference Value) | | dBA | 63 | 63 | 64 |
| Safety Devices | | | High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector | High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector | High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector |
| Defrost Method | | | Deicer | Deicer | Deicer |
| Capacity Control | | % | 7~100 | 6~100 | 6~100 |
| Refrigerant | Refrigerant Name | | R-410A | R-410A | R-410A |
| | Charge | Lbs (kg) | 21.4+22.1(9.7 + 10) | 22.1+22.1(10 + 10) | 16.5+21.4+21.4(7.5 + 9.7+ 9.7) |
| | Control | | Electronic Expansion Valve | Electronic Expansion Valve | Electronic Expansion Valve |
| Standard Accessories | | | Installation Manual, Operation Manual, Connection Pipes, Clamps | Installation Manual, Operation Manual, Connection Pipes, Clamps | Installation Manual, Operation Manual, Connection Pipes, Clamps |
| Drawing No. | | | C: 4D070870 | C: 4D070871 | C: 4D070872 |

Notes:

- ★1 Indoor temp. : 80°FDB (27°CDB), 67°FWB(19.4°CWB) / outdoor temp. : 95°FDB (35°CDB) / Equivalent piping length : 25ft (7.5 m), level difference : 0 ft.
- ★2 Indoor temp. : 70°FDB (21°CDB) / outdoor temp. : 47°FDB, 43°FWB (8.3° CDB, 6° CWB) / Equivalent piping length : 25ft (7.5 m), difference : 0 ft.
- ★3 Anechoic chamber conversion value, measure under JISB8616 conditions. During actual operation, these values are normally somewhat higher as a result of ambient conditions.

| Model Name (Combination Unit) | | | RXYQ288PBTJ | RXYQ312PBTJ | RXYQ336PBTJ |
|----------------------------------|------------------------------|-------------------|--|--|---|
| Model Name (Independent Unit) | | | RXYQ72PBTJ RXYQ96PBTJ RXYQ120PBTJ | RXYQ72PBTJ RXYQ120PBTJ RXYQ120PBTJ | RXYQ96PBTJ RXYQ120PBTJ RXYQ120PBTJ |
| Power Supply | | | 3 phase, 208/230V, 60Hz | 3 phase, 208/230V, 60Hz | 3 phase, 208/230V, 60Hz |
| ★1 Cooling Capacity | Nominal | Btu / h | 288,000 | 312,000 | 336,000 |
| | Rated | | 274,000 | 297,000 | 320,000 |
| ★2 Heating Capacity | Nominal | Btu / h | 324,000 | 351,000 | 378,000 |
| | Rated | | 308,000 | 334,000 | 360,000 |
| Casing Color | | | Ivory White (5Y7.5/1) | Ivory White (5Y7.5/1) | Ivory White (5Y7.5/1) |
| Dimensions: (H×W×D) | | in | 66-1/8 × 36-5/8 × 30-1/8 + 66-1/8 × 48-7/8 × 30-1/8 + 66-1/8 × 48-7/8 × 30-1/8 (1680 × 930 × 765) + (1680 × 1241 × 765) + (1680 × 1241 × 765) | 66-1/8 × 36-5/8 × 30-1/8 + 66-1/8 × 48-7/8 × 30-1/8 + 66-1/8 × 48-7/8 × 30-1/8 (1680 × 930 × 765) + (1680 × 1241 × 765) + (1680 × 1241 × 765) | 66-1/8 × 48-7/8 × 30-1/8 + 66-1/8 × 48-7/8 × 30-1/8 + 66-1/8 × 48-7/8 × 30-1/8 (1680 × 1241 × 765) + (1680 × 1241 × 765) + (1680 × 1241 × 765) |
| Heat Exchanger | | | Cross Fin Coil | Cross Fin Coil | Cross Fin Coil |
| Comp. | Type | | Hermetically Sealed Scroll Type | Hermetically Sealed Scroll Type | Hermetically Sealed Scroll Type |
| | Displacement | m ³ /h | 16.90 + (10.53+13.34) × 2 | 16.90 + (10.53+13.34) × 2 | (10.53+13.34) × 3 |
| | Number of Revolutions | r/min | 7980, (2900, 6300) × 2 | 7980, (2900, 6300) × 2 | (2900, 6300) × 3 |
| | Motor Output×Number of Units | kW | (4.5) × 1 + (2.2+4.5) × 1 + (3.5+4.5) × 1 | (4.5) × 1 + (3.5+4.5) × 2 | (2.2+4.5) × 1 + (3.5+4.5) × 2 |
| Starting Method | | | Soft Start | Soft Start | Soft Start |
| Fan | Type | | Propeller Fan | Propeller Fan | Propeller Fan |
| | Motor Output | kW | (0.75) × 1 + (0.35) × 2 + (0.35) × 2 | (0.75) × 1 + (0.35) × 2 + (0.35) × 2 | (0.35) × 2 + (0.35) × 2 + (0.35) × 2 |
| | Airflow Rate | cfm | 6,350+8,230+8,230 | 6,350+8,230+8,230 | 8,230+8,230+8,230 |
| | Drive | | | Direct Drive | Direct Drive |
| Connecting Pipes | Liquid Pipe | in | φ3/4 (19.1) C1220T (Brazing Connection) | φ3/4 (19.1) C1220T (Brazing Connection) | φ3/4 (19.1) C1220T (Brazing Connection) |
| | Gas Pipe | in | φ1-3/8 (34.9) C1220T (Brazing Connection) | φ1-3/8 (34.9) C1220T (Brazing Connection) | φ1-3/8 (34.9)C1220T (Brazing Connection) |
| Mass | | Lbs | 420 + 620 + 620 (190.5 + 281 + 281) | 420+620+620 (190.5 + 281 + 281) | 620+620+620 (281 + 281 + 281) |
| ★3 Sound Level (Reference Value) | | dBA | 64 | 64 | 65 |
| Safety Devices | | | High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector | High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector | High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector |
| Defrost Method | | | Deicer | Deicer | Deicer |
| Capacity Control | | % | 5~100 | 5~100 | 4~100 |
| Refrigerant | Refrigerant Name | | R-410A | R-410A | R-410A |
| | Charge | Lbs | 16.5 + 21.4 + 22.1 (7.5 + 9.7 + 10) | 16.5 + 22.1+ 22.1 (7.5 + 10 + 10) | 21.4 + 22.1+ 22.1(9.7 + 10 + 10) |
| | Control | | Electronic Expansion Valve | Electronic Expansion Valve | Electronic Expansion Valve |
| Standard Accessories | | | Installation Manual, Operation Manual, Connection Pipes, Clamps | Installation Manual, Operation Manual, Connection Pipes, Clamps | Installation Manual, Operation Manual, Connection Pipes, Clamps |
| Drawing No. | | | C: 4D070873 | C: 4D070874 | C: 4D070875 |

Notes:

- ★1 Indoor temp. : 80°FDB (27°CDB), 67°FWB(19.4°CWB) / outdoor temp. : 95°FDB (35°CDB) / Equivalent piping length : 25ft (7.5 m), level difference : 0 ft.
- ★2 Indoor temp. : 70°FDB (21°CDB) / outdoor temp. : 47°FDB, 43°FWB (8.3° CDB, 6° CWB) / Equivalent piping length : 25ft (7.5 m), difference : 0 ft.
- ★3 Anechoic chamber conversion value, measure under JISB8616 conditions. During actual operation, these values are normally somewhat higher as a result of ambient conditions.


| | | | |
|--------------------------------------|------------------------------|-------------------|---|
| Model Name (Combination Unit) | | | RXYQ360PBTJ |
| Model Name (Independent Unit) | | | RXYQ120PBTJ RXYQ120PBTJ RXYQ120PBTJ |
| Power Supply | | | 3 phase, 208/230V, 60Hz |
| ★1 Cooling Capacity | Nominal | Btu / h | 360,000 |
| | Rated | | 342,000 |
| ★2 Heating Capacity | Nominal | Btu / h | 405,000 |
| | Rated | | 385,000 |
| Casing Color | | | Ivory White (5Y7.5/1) |
| Dimensions: (HxWxD) | | in. (mm) | 66-1/8 x 48-7/8 x 30-1/8 + 66-1/8 x 48-7/8 x 30-1/8 + 66-1/8 x 48-7/8 x 30-1/8 (1680 x 1241 x 765) + (1680 x 1241 x 765) + (1680 x 1241 x 765) |
| Heat Exchanger | | | Cross Fin Coil |
| Comp. | Type | | Hermetically Sealed Scroll Type |
| | Displacement | m ³ /h | (10.53+13.34) × 3 |
| | Number of Revolutions | r/min | (2900, 6300) × 3 |
| | Motor Output×Number of Units | kW | (3.5+4.5) × 3 |
| Starting Method | | | Soft Start |
| Fan | Type | | Propeller Fan |
| | Motor Output | kW | (0.35) × 2 + (0.35) × 2 + (0.35) × 2 |
| | Airflow Rate | cfm | 8,230+8,230+8,230 |
| | Drive | | Direct Drive |
| Connecting Pipes | Liquid Pipe | in. (mm) | φ3/4 (19.1) C1220T (Brazing Connection) |
| | Gas Pipe | in. (mm) | φ1-5/8 (41.3) C1220T (Brazing Connection) |
| Mass | | Lbs (kg) | 620 + 620 + 620 (281 + 281 + 281) |
| ★3 Sound Level (Reference Value) | | dBA | 65 |
| Safety Devices | | | High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector |
| Defrost Method | | | Deicer |
| Capacity Control | | % | 5~100 |
| Refrigerant | Refrigerant Name | | R-410A |
| | Charge | Lbs (kg) | 22.1 + 22.1 + 22.1 (10 + 10 + 10) |
| | Control | | Electronic Expansion Valve |
| Standard Accessories | | | Installation Manual, Operation Manual, Connection Pipes, Clamps |
| Drawing No. | | | C: 4D070876 |

Notes:

- ★1 Indoor temp. : 80°FDB (27°CDB), 67°FWB(19.4°CWB) / outdoor temp. : 95°FDB (35°CDB) / Equivalent piping length : 25ft (7.5 m), level difference : 0 ft.
- ★2 Indoor temp. : 70°FDB (21°CDB) / outdoor temp. : 47°FDB, 43°FWB (8.3° CDB, 6° CWB) / Equivalent piping length : 25ft (7.5 m), difference : 0 ft.
- ★3 Anechoic chamber conversion value, measure under JISB8616 conditions. During actual operation, these values are normally somewhat higher as a result of ambient conditions.

2. Dimensions

RXYQ72PBTJ

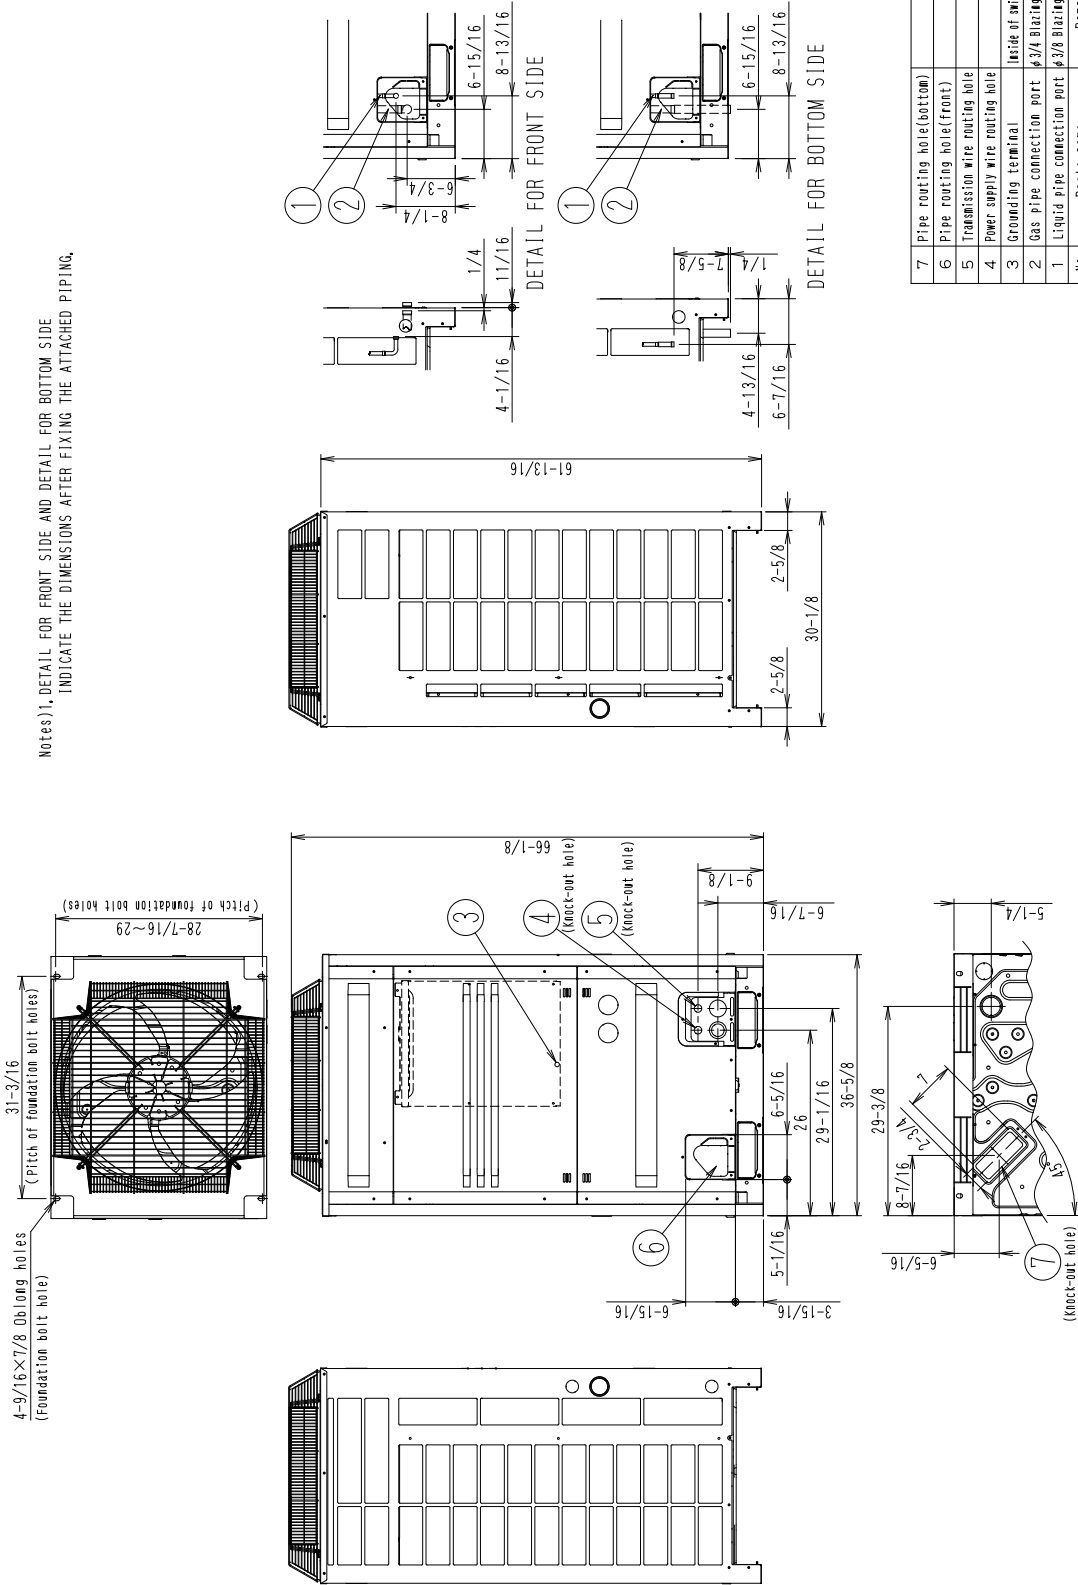


| No. | Parts Name | Remarks |
|-----|--------------------------------|--------------------------|
| 7 | Pipe routing hole(bottom) | |
| 6 | Pipe routing hole(front) | |
| 5 | Transmission wire routing hole | |
| 4 | Power supply wire routing hole | |
| 3 | Grounding terminal | Inside of switch box(NG) |
| 2 | Gas pipe connection port | φ3/4 Blazing connection |
| 1 | Liquid pipe connection port | φ3/8 Blazing connection |

3D070517

RXYQ96PBTJ / RXYQ120PBTJ


| MODEL | AA | BB |
|-------------|--------|---------|
| RXYQ96PBD | 4-1/16 | 7-11/16 |
| RXYQ96PBTJ | | |
| RXYQ120PBD | 3-1/4 | 6-7/8 |
| RXYQ120PBTJ | | |

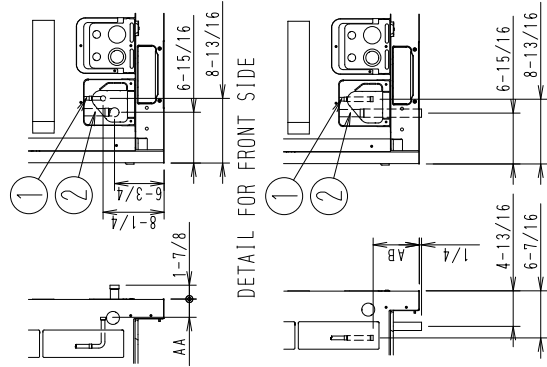

| No. | Parts name | Remarks |
|-----|--------------------------------|-------------------------|
| 7 | Pipe routing hole(bottom) | |
| 6 | Pipe routing hole(front) | |
| 5 | Transmission wire routing hole | |
| 4 | Power supply wire routing hole | |
| 3 | Grounding terminal | Inside of switch box(W) |
| 2 | Gas pipe connection port | See note 2. |
| 1 | Liquid pipe connection port | See note 2. |

4-9/16×7/8 Oblong holes
(Foundation bolt holes)


28-7/16~29
(Pitch of foundation bolt holes)

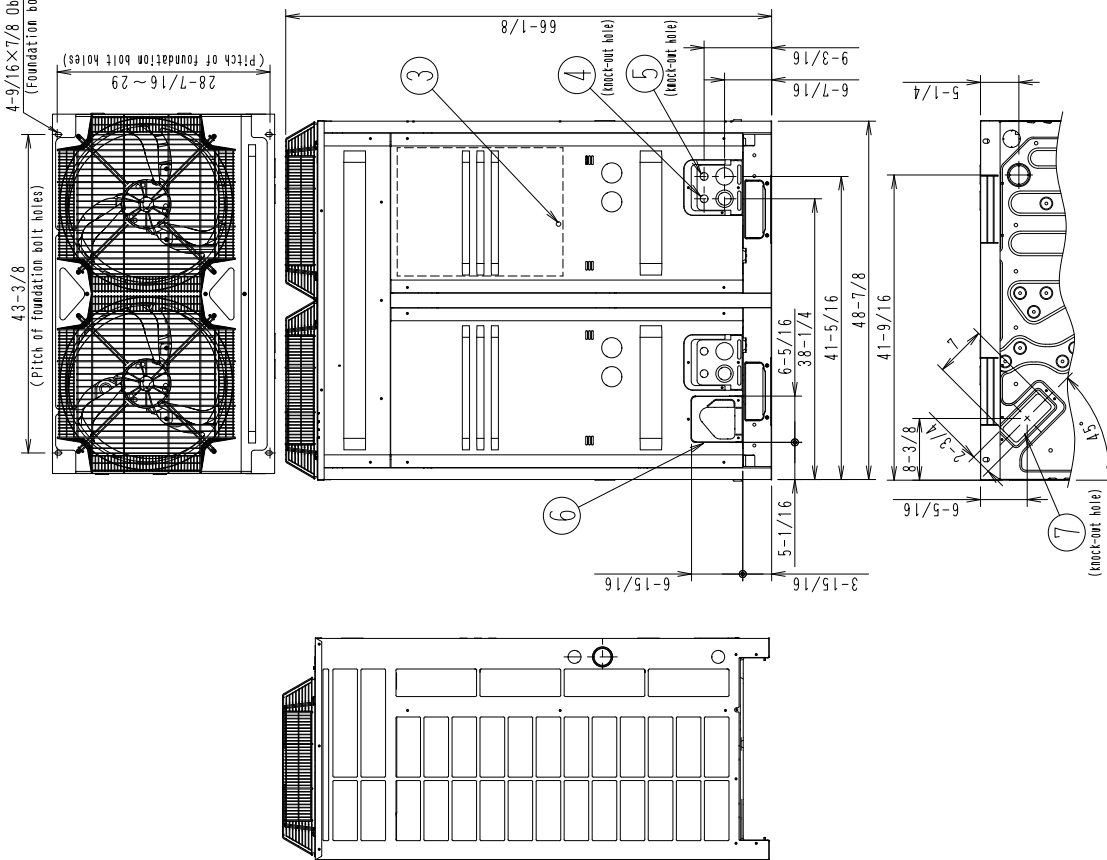

Notes)
1. DETAIL FOR FRONT SIDE AND DETAIL FOR BOTTOM SIDE
INDICATE THE DIMENSIONS AFTER FIXING THE ATTACHED PIPING.
2. Gas pipe
φ 1-1/8 Brazing connection--RXYQ120PBD, TJ
φ 7/8 Brazing connection--RXYQ96PBD, TJ
Liquid pipe
φ 3/8 Brazing connection--RXYQ120PBD, TJ
φ 3/8 Brazing connection--RXYQ96PBD, TJ

3D070518A

RXYQ144PBTJ



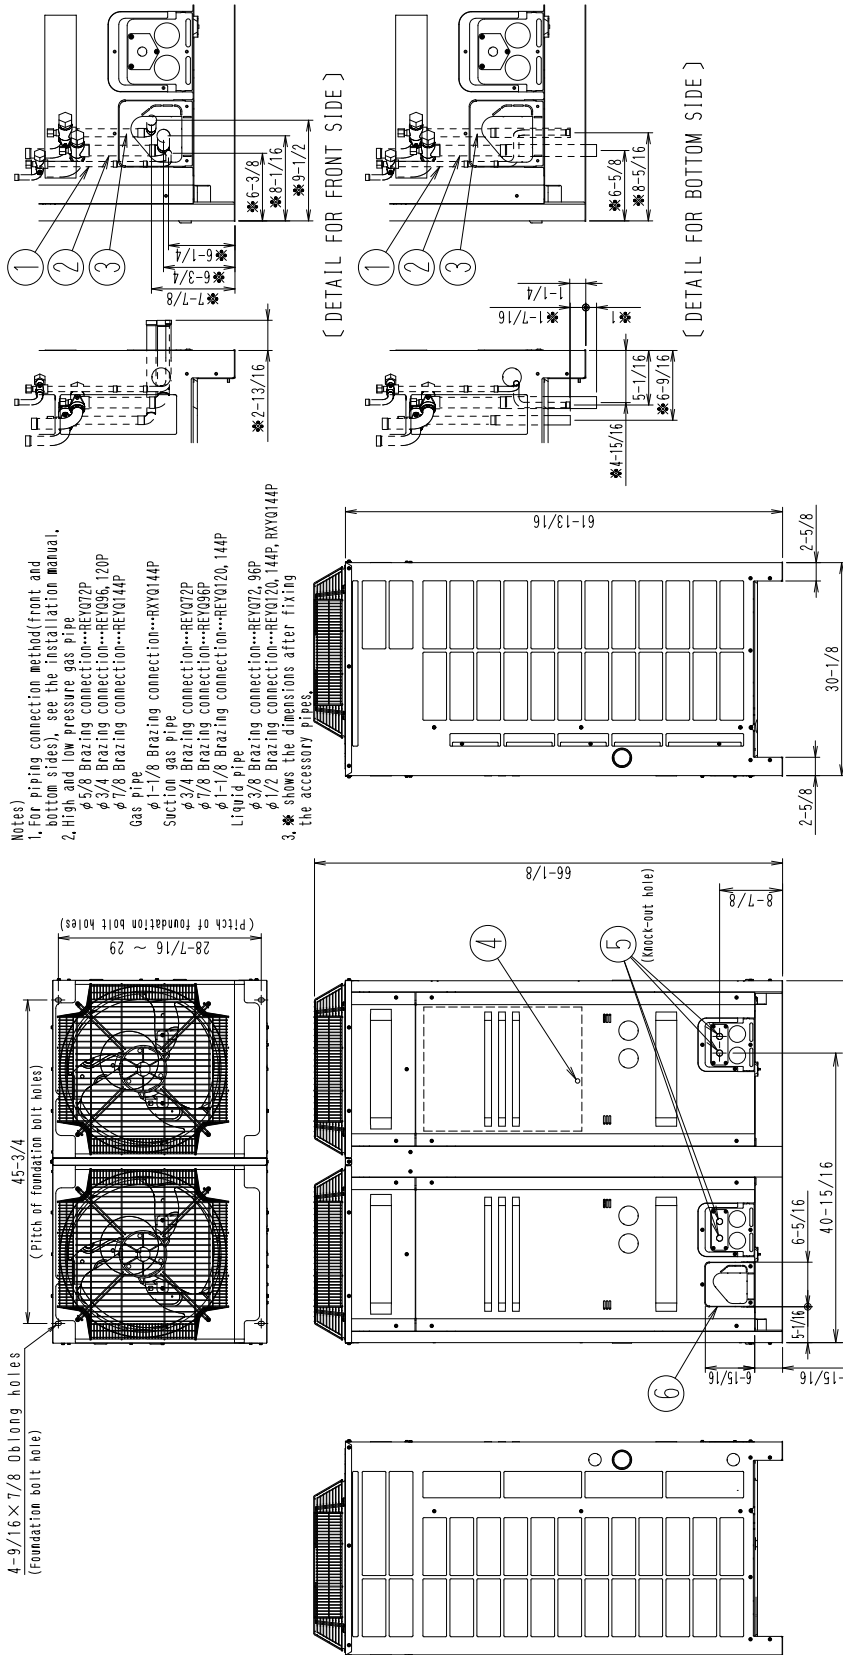


- (Notes)
- For piping connection method (front and bottom sides), see the installation manual.
 - High and low pressure gas pipe
 φ5/8 Brazing connection--REY072P
 φ3/4 Brazing connection--REY096, 120P
 φ7/8 Brazing connection--REY0144P
 Gas pipe
 φ1-1/8 Brazing connection--RXY0144P
 Suction gas pipe
 φ3/4 Brazing connection--REY072P
 φ7/8 Brazing connection--REY096P
 φ1-1/8 Brazing connection--REY020, 144P
 Liquid pipe
 φ3/8 Brazing connection--REY072, 96P
 φ1/2 Brazing connection--REY020, 144P, RXY0144P
 - * shows the dimensions after fixing the accessory pipes.

| No. | Parts Name | Remarks |
|-----|--|----------------------------|
| 7 | Pipe routing hole(bottom) | See note 1. |
| 6 | Pipe routing hole(front) | See note 1. |
| 5 | Power cord routing hole(front) | φ 7/8 |
| 4 | Grounding terminal | Inside of el. comp. bot(W) |
| 3 | Gas pipe connection port (Only for RXY0144P) | See note 2. |
| 3 | High and low pressure gas pipe connection port | See note 2. |
| 2 | Suction gas pipe connection port | See note 2. |
| 1 | Liquid pipe connection port | See note 2. |

3D058618D

RXYQ168PBTJ / RXYQ192PBTJ

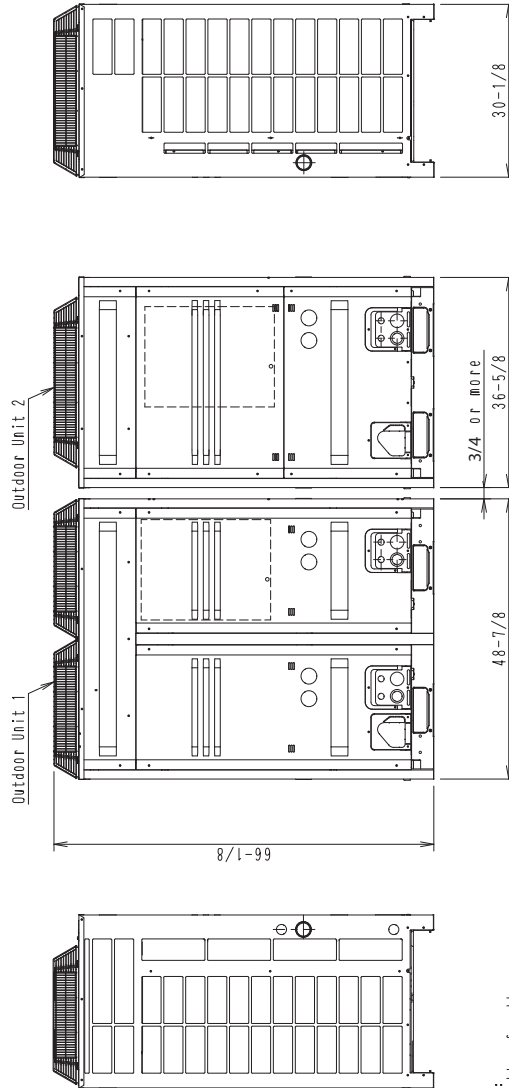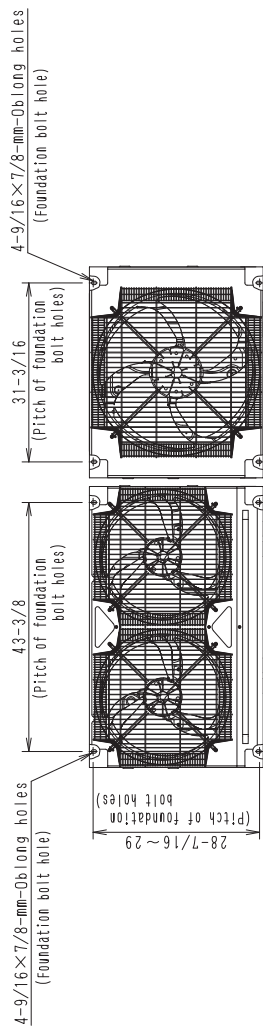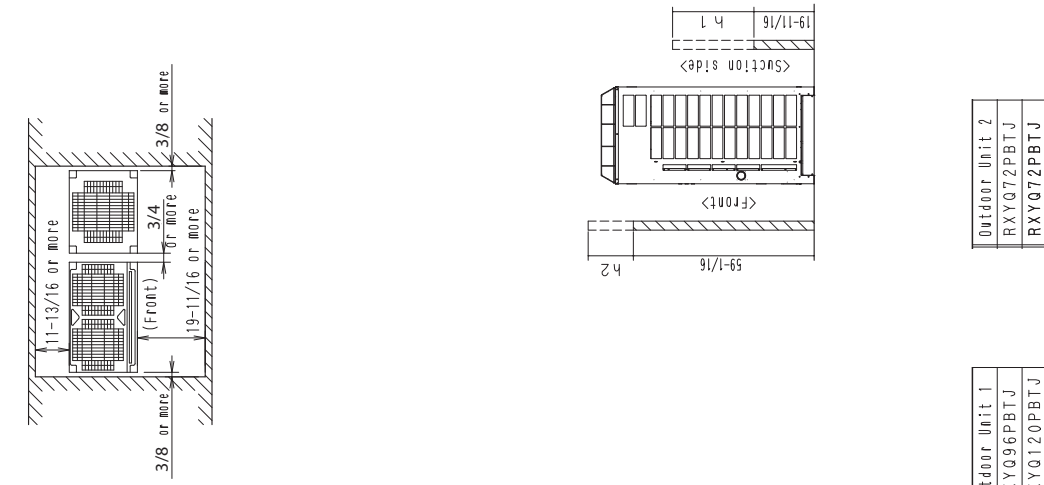


| Model Name | Outdoor Unit 1 |
|-------------|----------------|
| RXYQ168PBTJ | RXYQ96PBTJ |
| RXYQ192PBTJ | RXYQ120PBTJ |

| Model Name | Outdoor Unit 2 |
|-------------|----------------|
| RXYQ168PBTJ | RXYQ72PBTJ |
| RXYQ192PBTJ | RXYQ72PBTJ |

- Notes:
1. Heights of walls
 Suction side: 19-11/16in
 Side: Height unrestricted
 The installation space should be sufficient for the air temperature of 95°F.
 The installation space of suction side shown above must be expanded in the following case.
 • Operation over Max. operating load (in case of causing a heavy heating load at indoor unit side)
 2. If the above wall heights are exceeded, then h1/2 and h1/2 should be added to the front and suction side service spaces respectively as shown in the following figure.
 3. When installing the units, the most appropriate pattern should be selected from Section 3 in order to obtain the best fit in the space available always bearing in mind the need to leave enough room for a person to pass between units and wall and for the air to circulate freely.
 NOTE: If more units are to be installed than are shown in Section 3, your layout should take account of the possibility of short circuiting.
 4. The units should be installed to leave sufficient space at the front for the on site refrigerant piping work to be carried out comfortably.

C: 3D070851

RXYQ216PBTJ / RXYQ240PBTJ

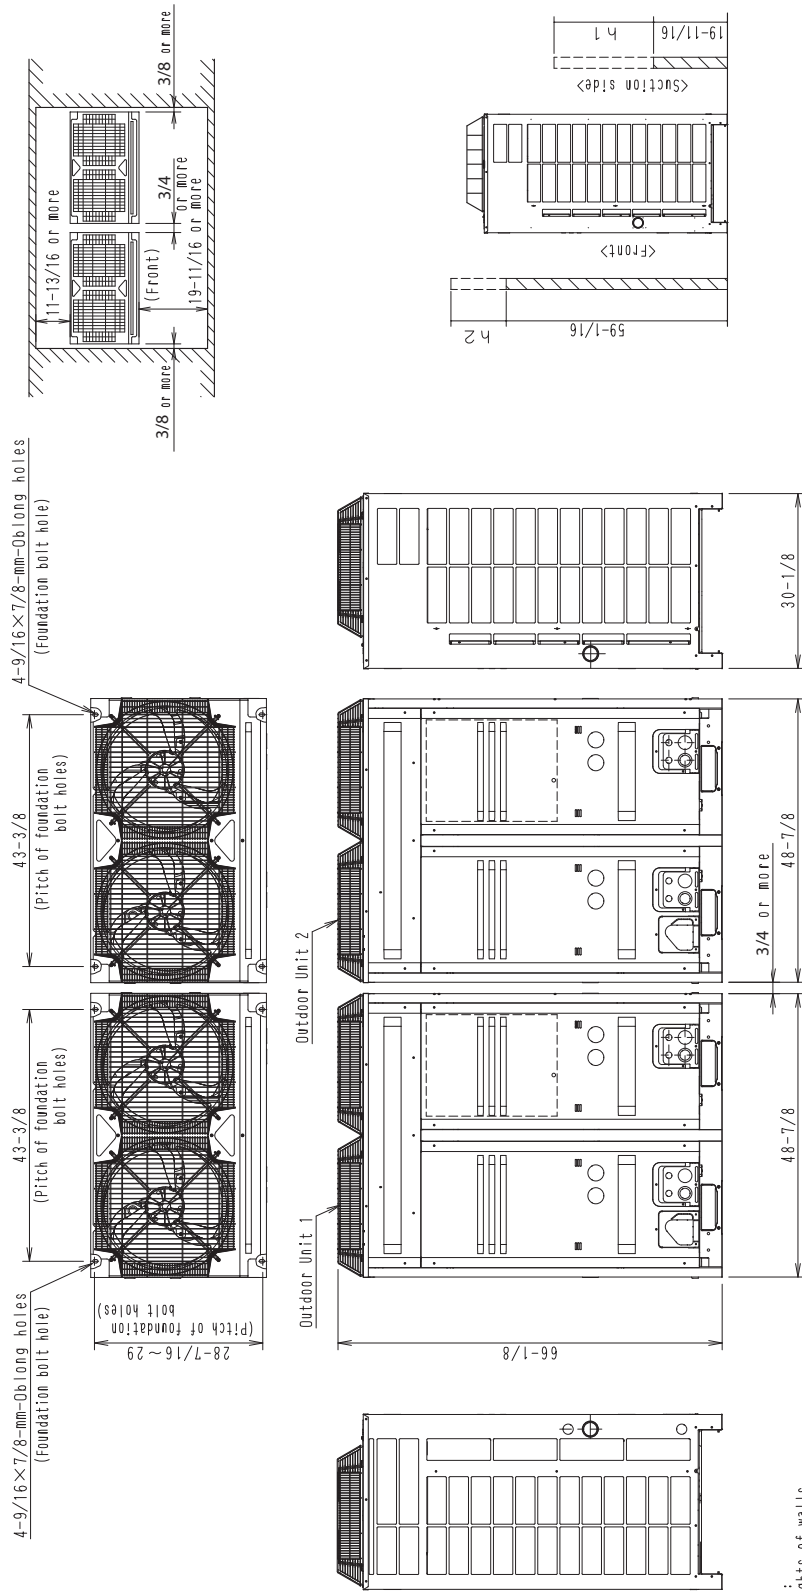

| |
|----------------|
| Outdoor Unit 2 |
| RXYQ96PBTJ |
| RXYQ120PBTJ |

| | |
|----------------|----------------|
| Outdoor Unit 1 | Outdoor Unit 2 |
| RXYQ216PBTJ | RXYQ120PBTJ |
| RXYQ240PBTJ | RXYQ120PBTJ |

Notes :


- Heights of walls
 - Front : 59-1/16in
 - Suction side : 19-11/16in
 - Side : Height unrestricted
- The installation space shown in this figure is based on the condition of cooling operation at the outdoor air temperature of 95°F.
 - The installation space of suction side shown above must be expanded in the following case.
 - Design outdoor temperature becomes over 95°F.
 - Operating over Max. operating load (In case of causing a heavy heating load at indoor unit side)
 - 2. If the above wall heights are exceeded then h2/2 and h1/2 should be added to the front and suction side service spaces respectively as shown in the following figure.
 - 3. When installing the units the most appropriate pattern should be selected from Section 3 in order to obtain the best fit in the space available always bearing in mind the need to leave enough room for a person to pass between units and wall and for the air to circulate freely.

NOTE: If more units are to be installed than are shown in Section 3, your layout should take account of the possibility of short circuiting.

4. The units should be installed to leave sufficient space at the front for the on site refrigerant piping work to be carried out comfortably.

C: 3D070852

RXYQ264PBTJ / RXYQ288PBTJ / RXYQ312PBTJ

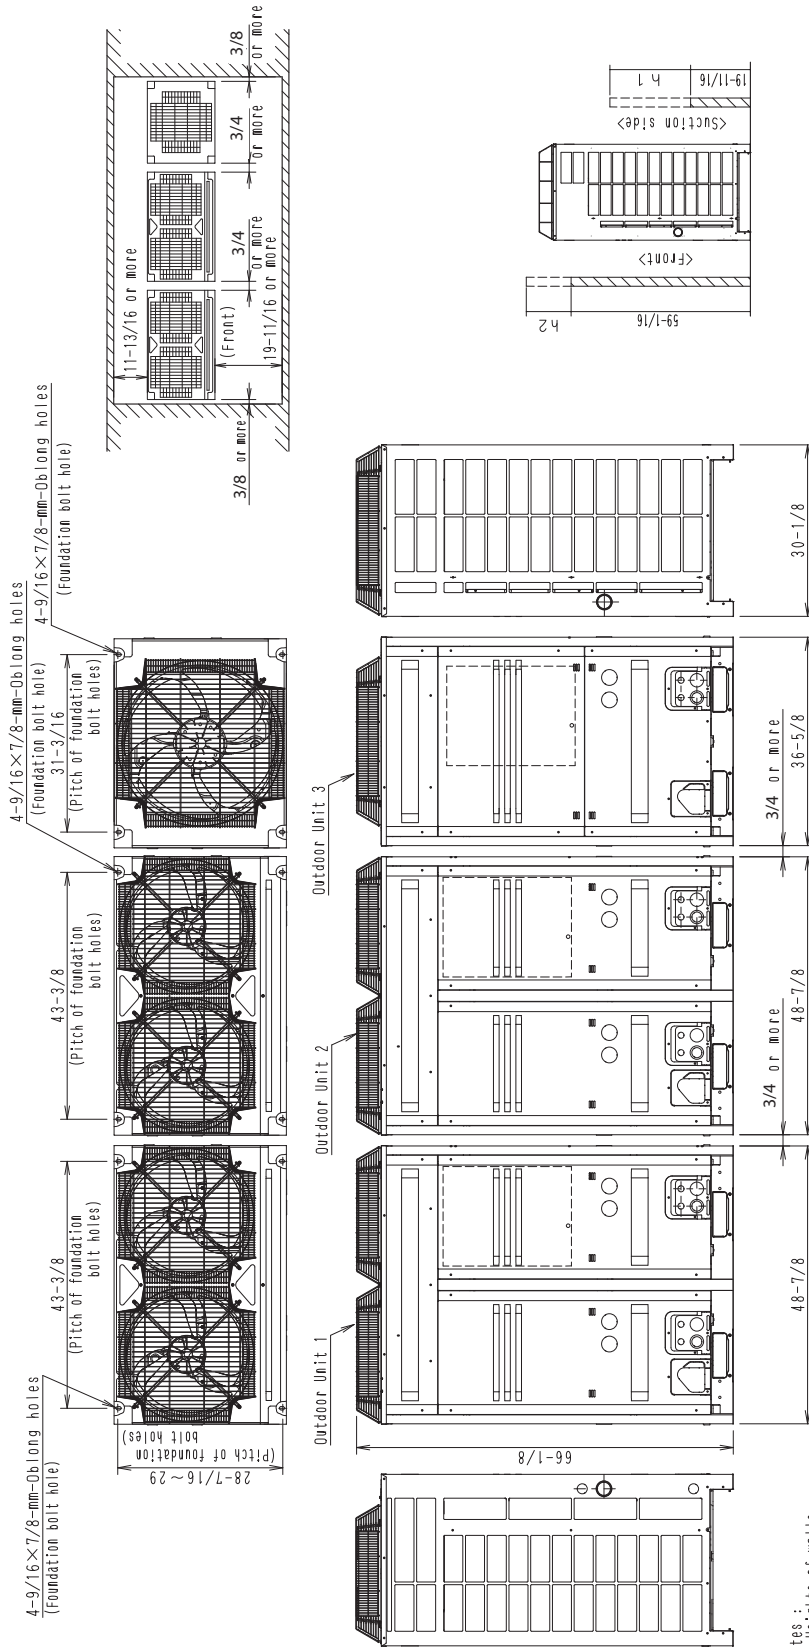

| Outdoor Unit 3 |
|----------------|
| RXYQ264PBTJ |
| RXYQ288PBTJ |
| RXYQ312PBTJ |

| Outdoor Unit 2 |
|----------------|
| RXYQ264PBTJ |
| RXYQ288PBTJ |
| RXYQ312PBTJ |


| Outdoor Unit 1 |
|----------------|
| RXYQ264PBTJ |
| RXYQ288PBTJ |
| RXYQ312PBTJ |

- Notes:
1. Heights of walls
 Front: 59-1/16in
 Suction side: 19-11/16in
 Side: Height unrestricted
 The installation space shown in this figure is based on the condition of cooling operation at the outdoor air temperature of 95°F.
 The installation space of suction side shown above must be expanded in the following case.
 • Design outdoor temperature becomes over 95°F.
 • Operating over Max. operating load (in case of causing a heavy heating load at indoor unit side)
 front and suction side service spaces respectively as shown in the following figure.
 2. When installing the units the most appropriate pattern should be selected from Section 3 in order to obtain the best fit in the space available always bearing in mind the need to leave enough room for a person to pass between units and wall and for the air to circulate freely.
 3. NOTE: If more units are to be installed than are shown in Section 3, your layout should take account of the possibility of short circuiting.
 4. The units should be installed to leave sufficient space at the front for the on site refrigerant piping work to be carried out comfortably.

C: 3D070854

3. Service Space


RXYQ72PBTJ / RXYQ96PBTJ / RXYQ120PBTJ / RXYQ144PBTJ / RXYQ168PBTJ / RXYQ192PBTJ / RXYQ216PBTJ / RXYQ240PBTJ / RXYQ264PBTJ / RXYQ288PBTJ / RXYQ312PBTJ / RXYQ336PBTJ / RXYQ360PBTJ

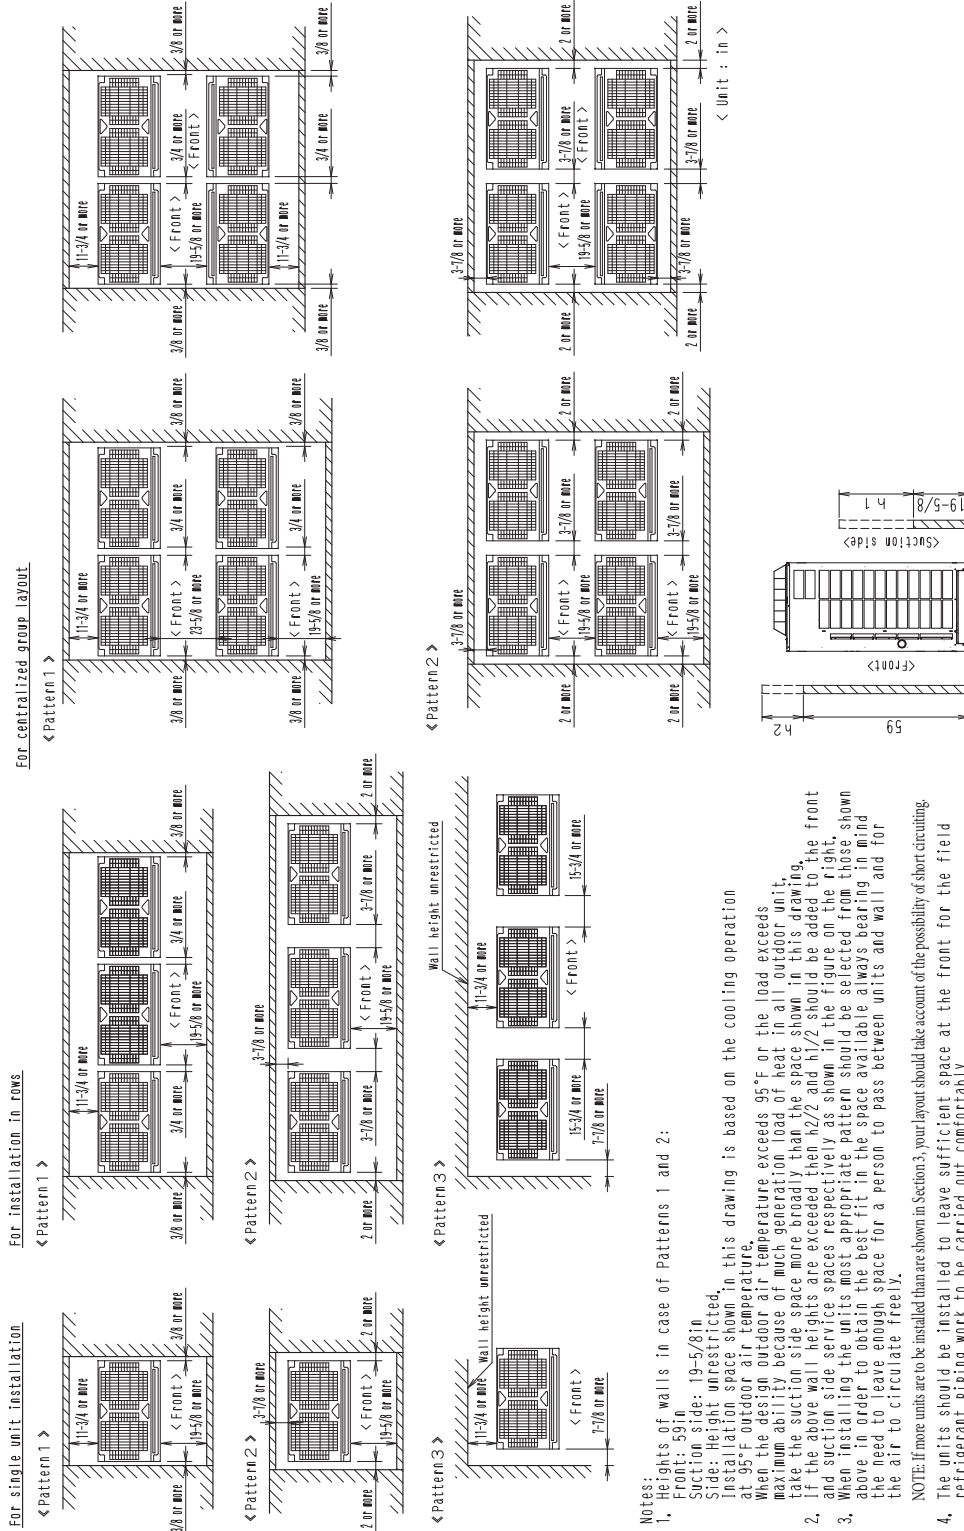


4. Piping Diagrams

RXYQ72PBTJ

3D070507

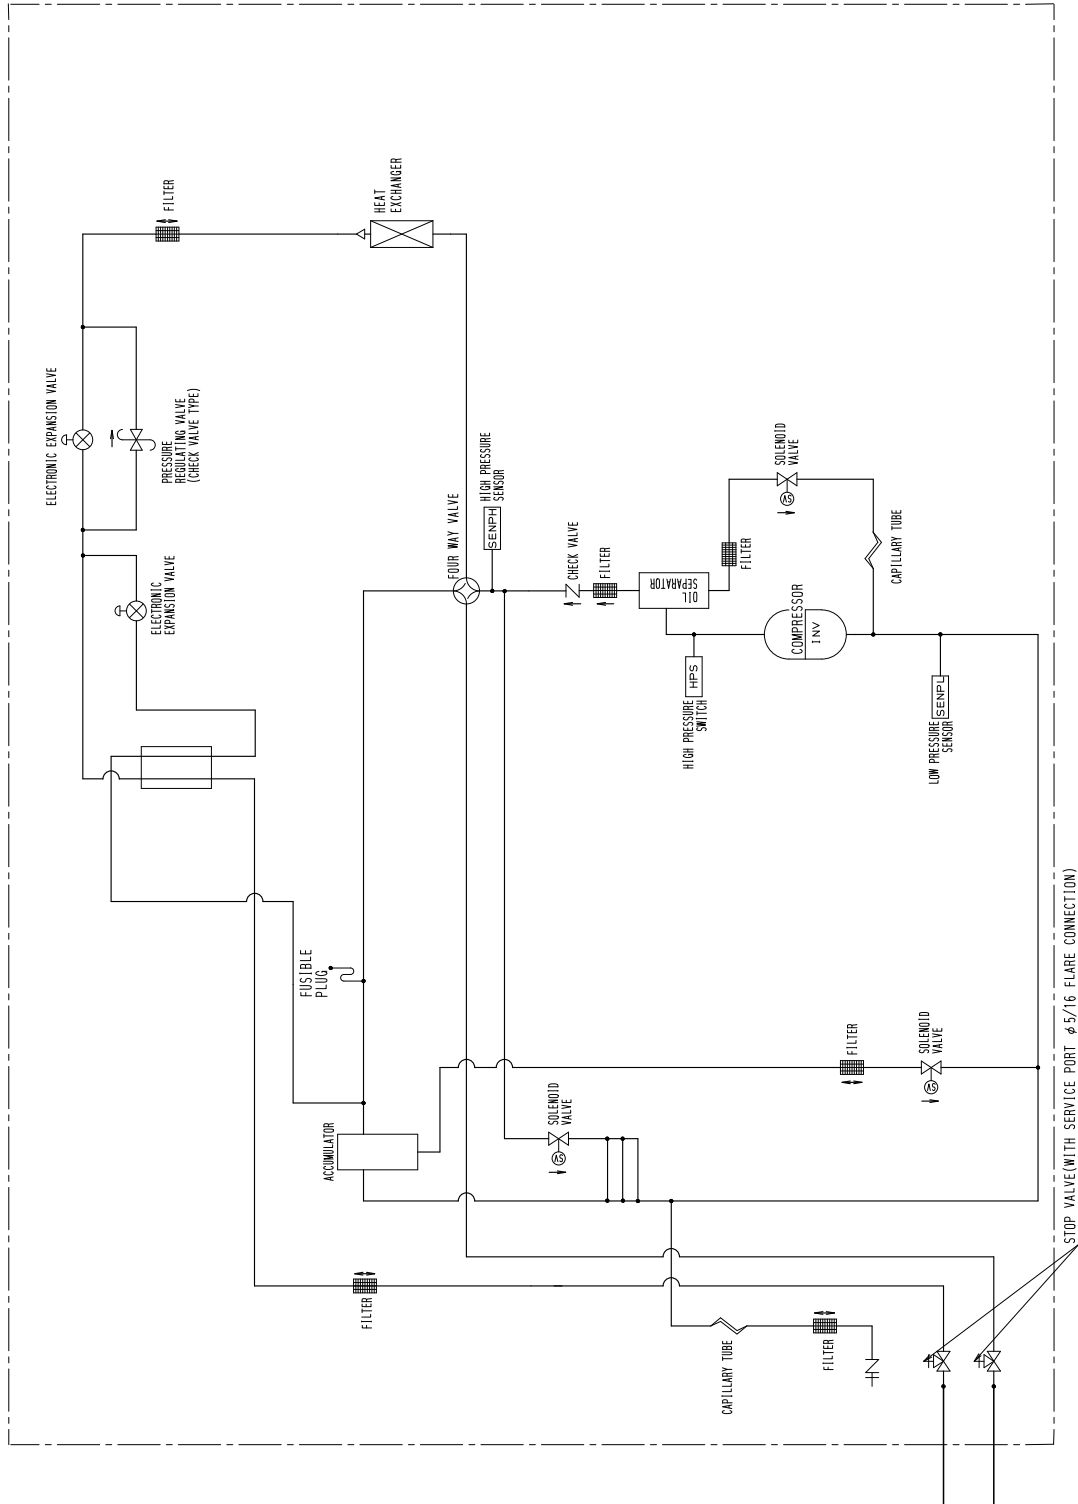


RXYQ96PBTJ / RXYQ120PBTJ

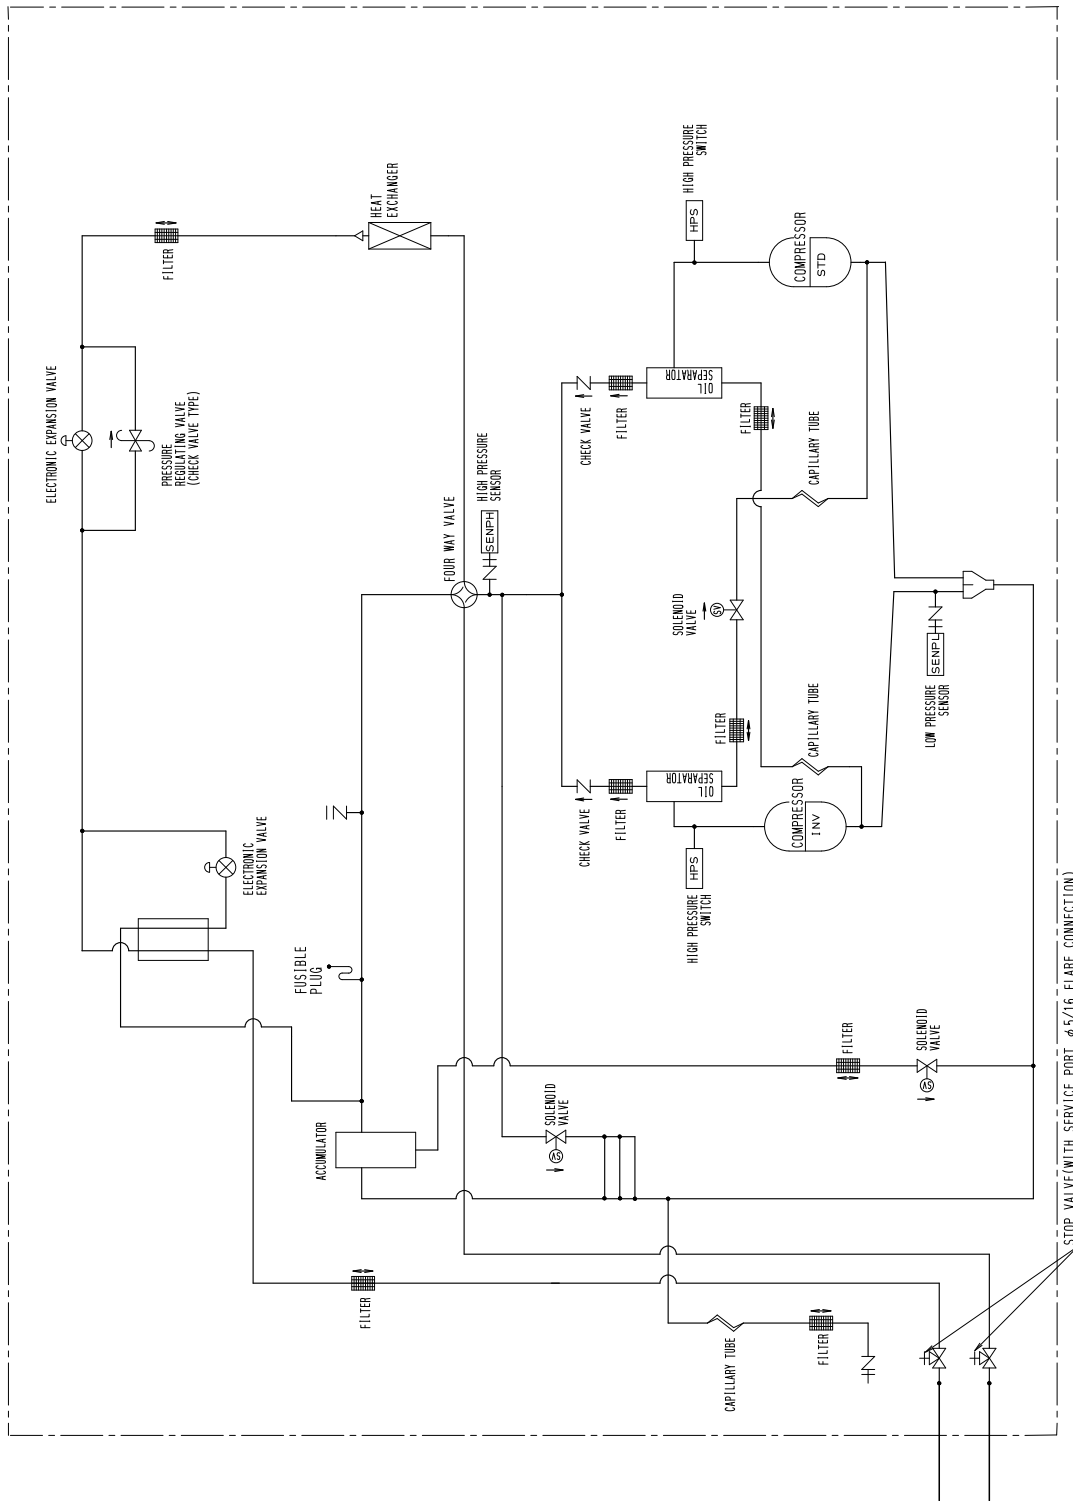

3D070508


RXYQ144PBTJ

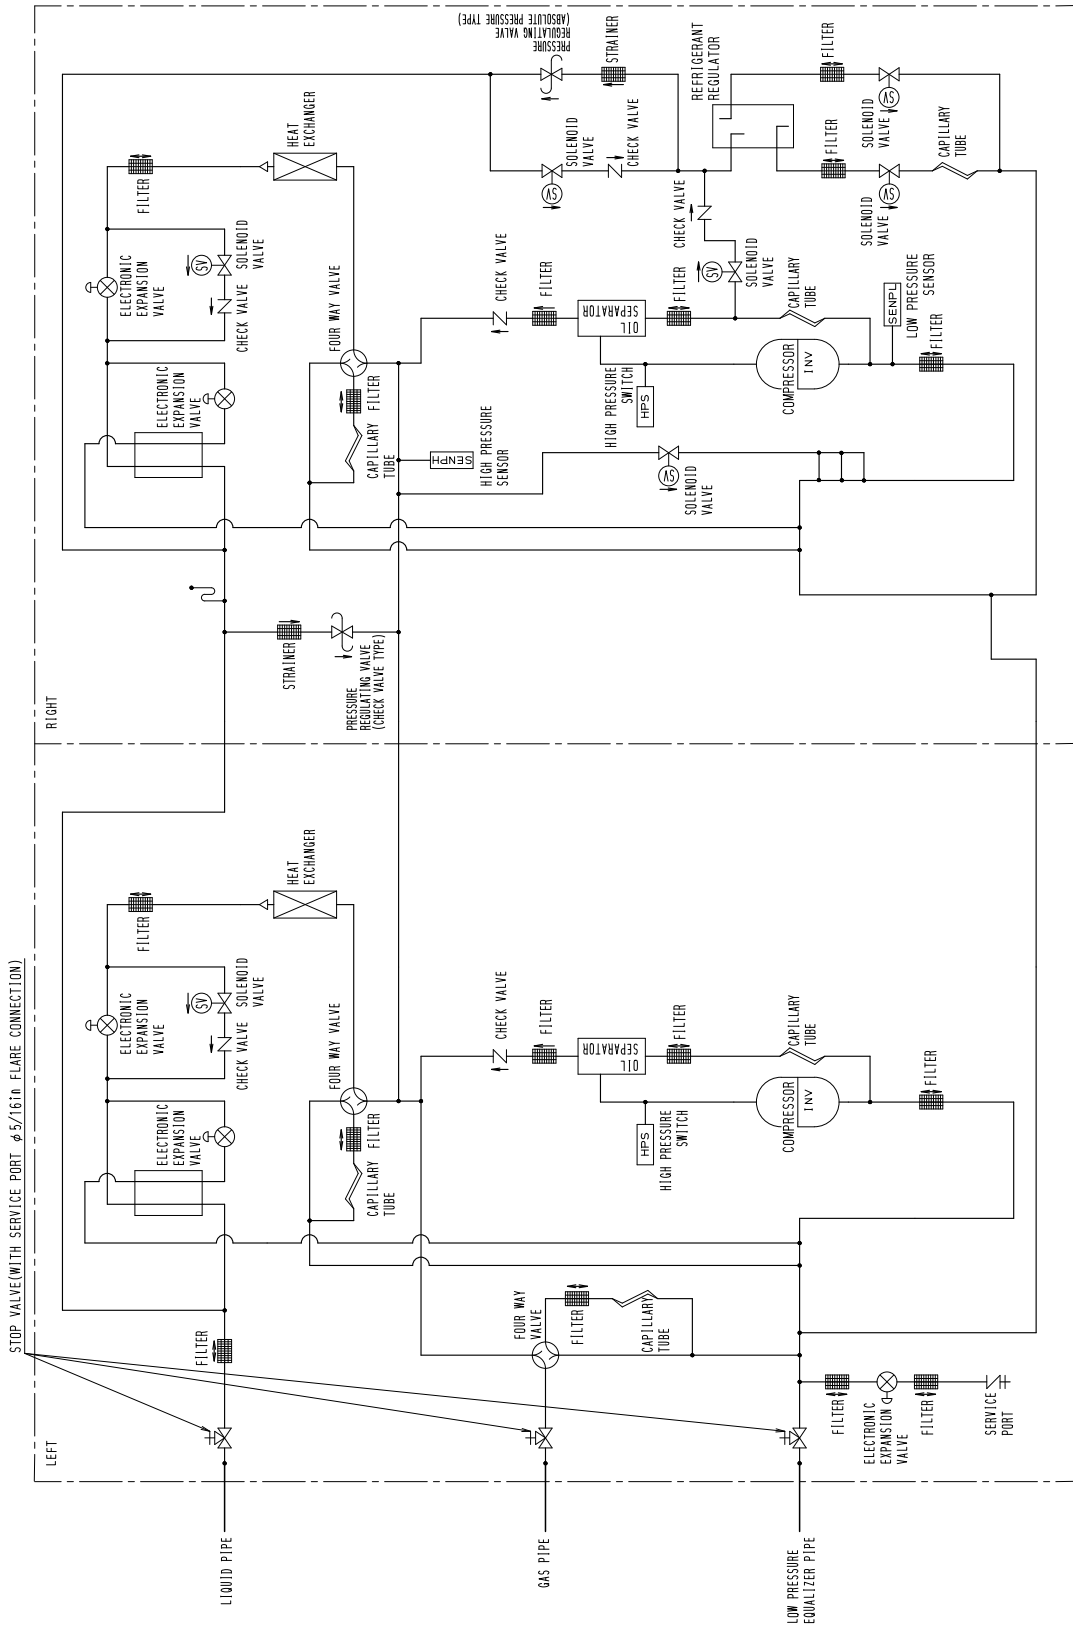



3D058640A

5. Wiring Diagrams

RXYQ72PBTJ

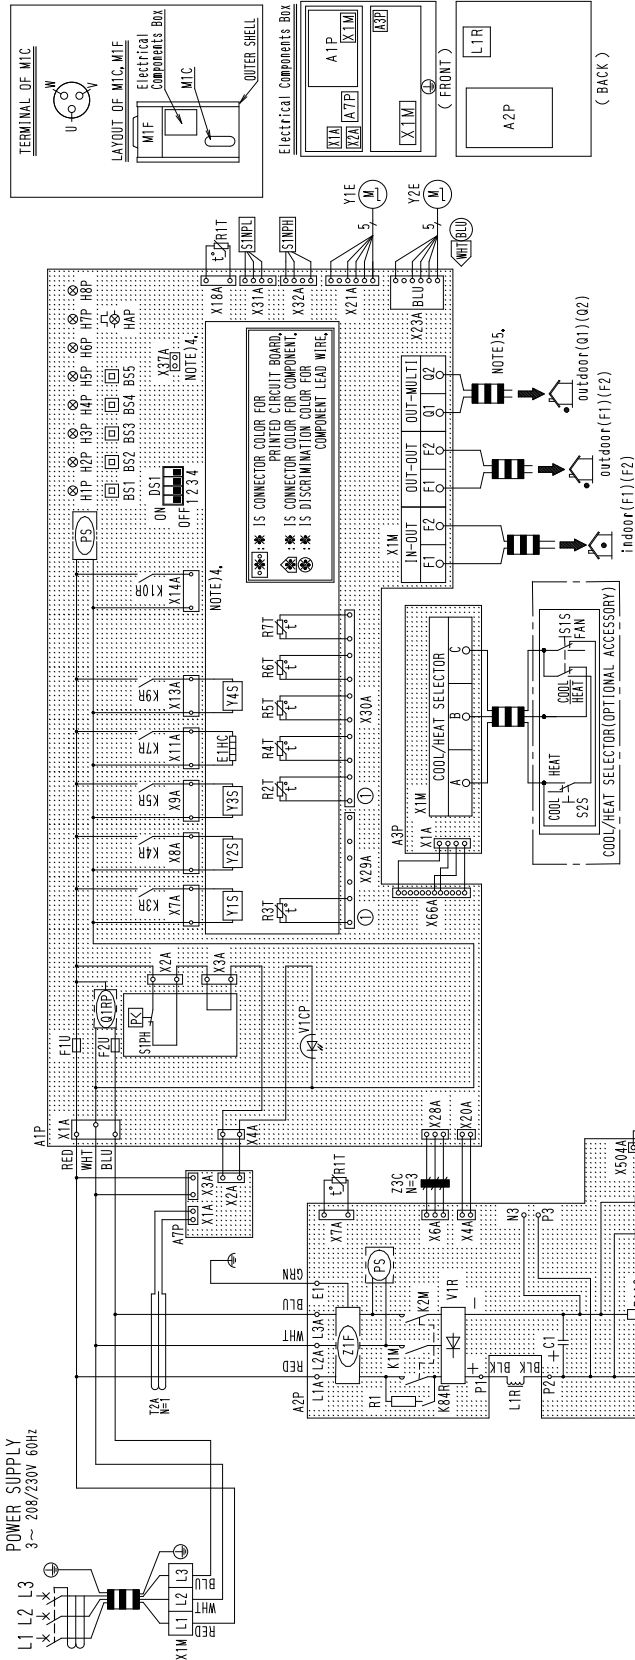

POWER SUPPLY
3~208/230V 60Hz

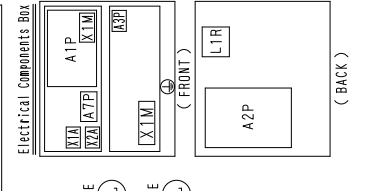


| | | | | | |
|----------|---|-------|-----------------------------------|----------|--------------------------------------|
| A1P | PRINTED CIRCUIT BOARD (MAIN) | K84R | MAGNETIC RELAY (CURRENT LIMITING) | V1R | DIODE BRIDGE (A2P) |
| A2P | PRINTED CIRCUIT BOARD (HW) | L1R | REACTOR | V2R, V3R | POWER MODULE (A2P) |
| A3P | PRINTED CIRCUIT BOARD (ABC./P) | M1C | MOTOR (COMPRESSOR) | X1A, X2A | CONNECTOR (MTF) |
| A7P | PRINTED CIRCUIT BOARD (EARTH LEAK DETECTOR) | MTF | MOTOR (FAN) | X1M | TERMINAL STRIP (POWER SUPPLY) |
| B51~5 | PUSH BUTTON SWITCH (MODE, SET, RETURN, TEST, RESET) | P5 | SWITCHING POWER SUPPLY (A1P, A2P) | X1M | TERMINAL STRIP (CONTROL) (A1P) |
| C1 | CAPACITOR | R1 | PHASE REVERSAL DETECT CIRCUIT | X1M | TERMINAL STRIP (ABC./P) (A3P) |
| D51 | DIP SWITCH | R112 | RESISTOR (CURRENT LIMITING) | Y1E | ELECTRONIC EXPANSION VALVE (SUBCOOL) |
| E1HC | CRANKCASE HEATER | R502 | RESISTOR (CURRENT SENSOR) (A2P) | Y2E | ELECTRONIC EXPANSION VALVE (MAIN) |
| F1U, F2U | FUSE (1.25A, 2.50V) (A1P) | R11 | RESISTOR (CURRENT SENSOR) (A3P) | Y2S | SOLENOID VALVE (HOT GAS) |
| F1U, F2U | FUSE (1.25A, 2.50V) (A1P) | R11 | THERMISTOR (A1P) (A2P) | Y3S | SOLENOID VALVE (4-WAY VALVE) |
| H1P~8P | PUSH BUTTON SWITCH (FOR SERVICE MONITOR-BRANK) | R21 | THERMISTOR (SUCTION) | Y4S | SOLENOID VALVE (OLI) |
| HAP | PILOT AMP/SERVICE MONITOR-GREEN | R31 | THERMISTOR (MTC DISCHARGE) | Z1C~3C | NOISE FILTER (FERRITE CORE) |
| K1M, K2M | MAGNETIC CONTACTOR (MTC) (A2P) | R41 | THERMISTOR (HEAT EXC. OUTLET) | Z1F | NOISE FILTER (WITH SURGE ABSORBER) |
| K3R | MAGNETIC RELAY (Y1S) | R61 | THERMISTOR (L1/G, PIPE) | X37A | CONNECTOR (FOR OPTION) |
| K4R | MAGNETIC RELAY (Y2S) | R71 | THERMISTOR (ACCUMULATOR) | X37A | CONNECTOR (FOR POWER SUPPLY) |
| K5R | MAGNETIC RELAY (Y3S) | STNPH | PRESSURE SENSOR (HIGH) | | |
| K7R | MAGNETIC RELAY (ETHC) | STNPL | PRESSURE SENSOR (LOW) | | |
| K9R | MAGNETIC RELAY (Y4S) | ST1S | CURRENT SENSOR (HIGH) | | |
| K10R | MAGNETIC RELAY (FOR OPTION) | V1CP | SAFETY DEVICES INPUT | S2S | SELECTOR SWITCH (FAN/COOL/HEAT) |
| | | S2S | SAFETY DEVICES INPUT | | SELECTOR SWITCH (COOL/HEAT) |

- NOTES)
1. THIS WIRING DIAGRAM IS APPLIED ONLY TO THE OUTDOOR UNIT.
 2. : FIELD WIRING.
 3. : TERMINAL STRIP.
 4. WHEN USING THE OPTIONAL ADAPTOR, REFER TO THE INSTALLATION MANUAL OF THE OPTIONAL ADAPTOR.
 5. FOR CONNECTION WIRING TO INDOOR-OUTDOOR TRANSMISSION F1 • F2, OUTDOOR-OUTDOOR TRANSMISSION F1 • F2, OUTDOOR-MULTI TRANSMISSION Q1 • Q2, REFER TO THE INSTALLATION MANUAL.
 6. HOW TO USE B51~5 AND D51 SWITCH, REFER TO "SERVICE PRECAUTION" LABEL ON ELECTRICAL COMPONENTS BOX LID.
 7. WHEN OPERATING, DON'T SHORT CIRCUIT THE PROTECTION DEVICES (STPH).
 8. COLORS: BLK:BLACK; RED:RED; BLU:BLUE; WHT:WHITE; GRN:GREEN.


3D070455B

RXYQ96PBTJ / RXYQ120PBTJ

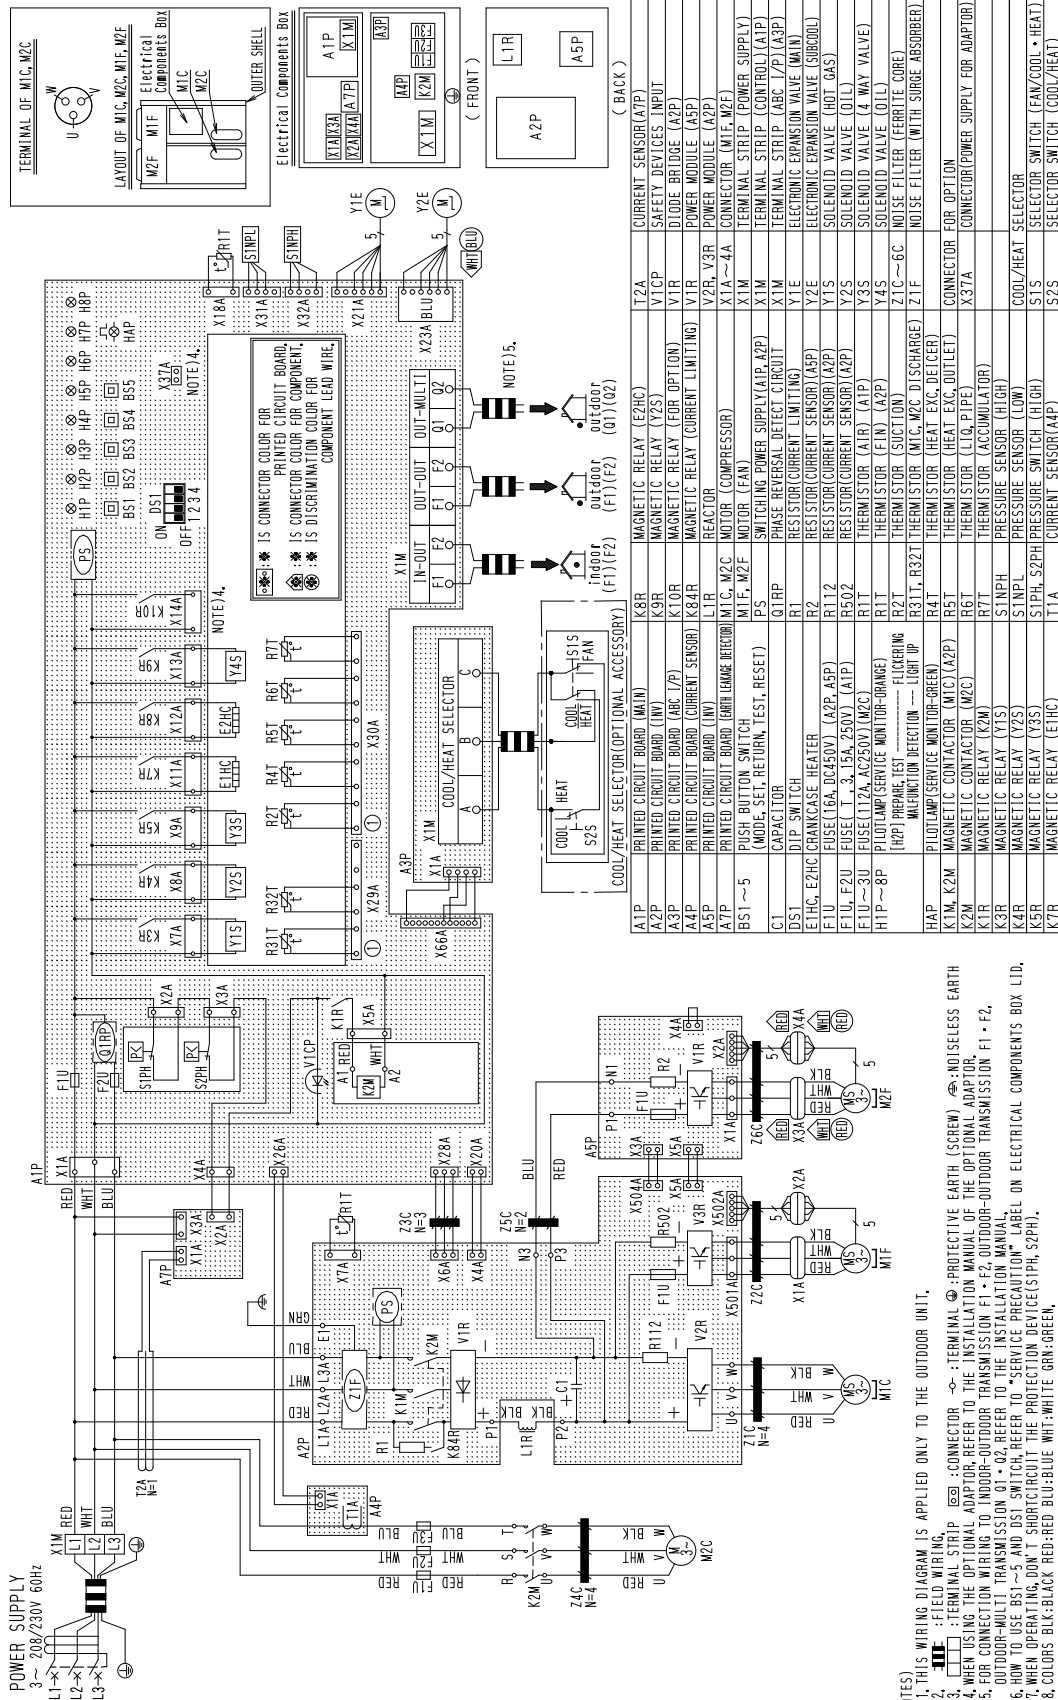

3D070456B

RXYQ144PBTJ

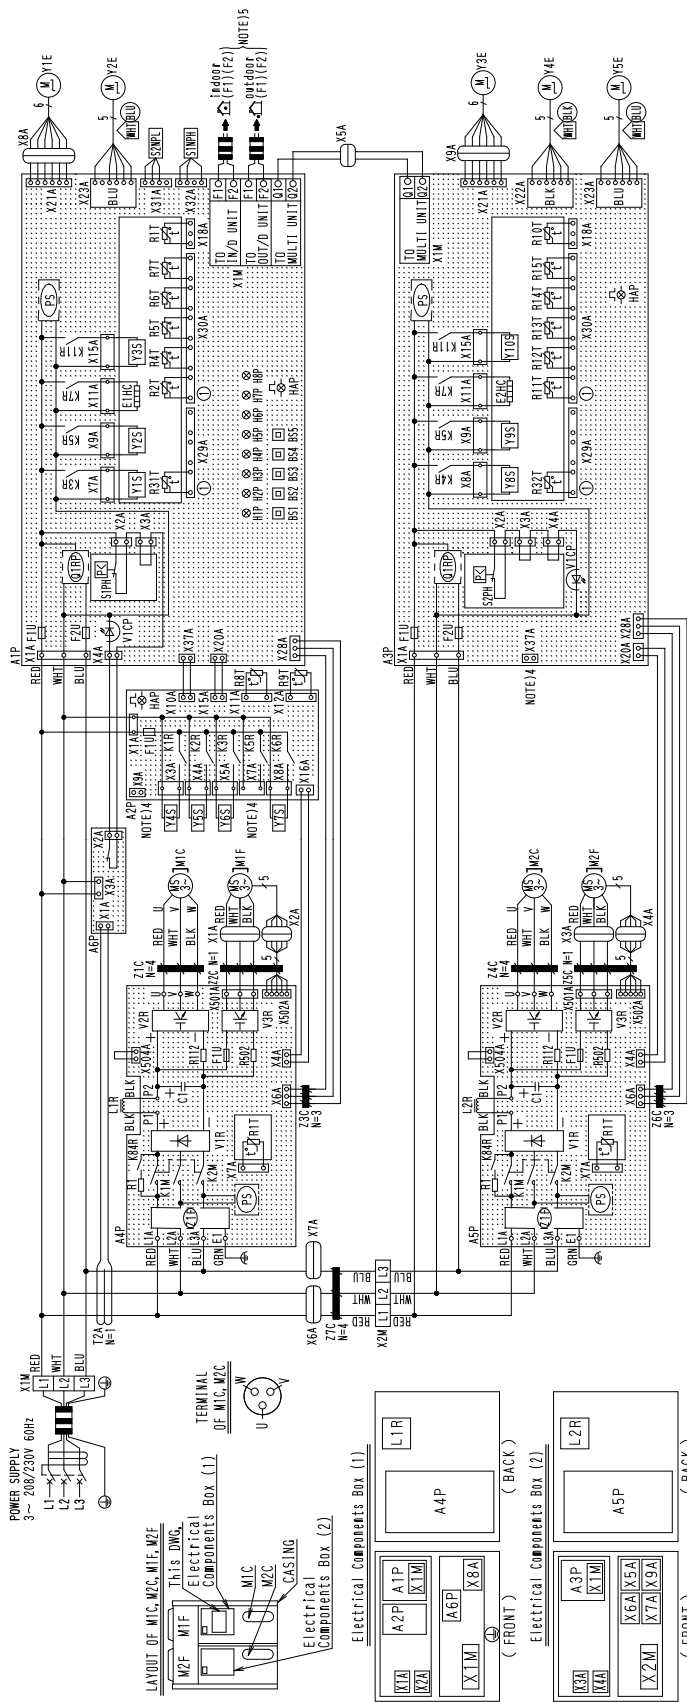

| | | | | | | | |
|------------|--|----------|--|----------|--|--------|---|
| A1P | PRINTED CIRCUIT BOARD (MAIN) | Y2R | MAGNETIC RELAY (YES) (ASP) | R15 | RESISTOR (CURRENT SENSOR) (ASP) (ASP) | Y2S | SOLENOID VALVE (4 WAY VALVE HEAT E.C. 1) |
| A2P | PRINTED CIRCUIT BOARD (SUB 1) | Y2R | MAGNETIC RELAY (YES) (ASP) | R12, R50 | RESISTOR (AMP) (ASP) | Y2S | SOLENOID VALVE (RMT) |
| A3P | PRINTED CIRCUIT BOARD (SUB 2) | K3R | MAGNETIC RELAY (YES) (ASP) | R17 | THEMISTOR (AIR) (AP) | Y4S | SOLENOID VALVE (HOT GAS) |
| A4P | PRINTED CIRCUIT BOARD (INV) | K3R | MAGNETIC RELAY (YES) (ASP) | S2APL | SPRNG. PRESSURE SWITCH (HIGH) (ASP) | Y5S | SOLENOID VALVE (EV BYPASS 1) |
| A5P | PRINTED CIRCUIT BOARD (EARTH LEAKAGE DETECTOR) | K3R | MAGNETIC RELAY (YES) (ASP) | S2APL | SPRNG. PRESSURE SWITCH (HIGH) (ASP) | Y6S | SOLENOID VALVE (RMT) |
| B51~5 | PUSH BUTTON SWITCH | K3R | MAGNETIC RELAY (FOR OPTION) (ASP) | T2A | CURRENT SENSOR (ASP) | Y7S | SOLENOID VALVE (RMT) |
| C1 | CAPACITOR (AP) (ASP) | K3R | MAGNETIC RELAY (YES) (ASP) | V1CP | SAFETY DEVICES INPUT (ASP) (ASP) | Y8S | SOLENOID VALVE (4 WAY VALVE-PIPE) |
| E1UC, E2UC | EMERGENCY CHARGING HEATER (AP) (ASP) | K3R | MAGNETIC RELAY (YES) (ASP) | V1R | DIODE BRIDGE (AP) (ASP) | Y9S | SOLENOID VALVE (4 WAY VALVE HEAT E.C. 2) |
| F1U, F2U | FUSE (T, 2, 15A, 50A) (ASP) | K7R | MAGNETIC RELAY (E.C.H) (ASP) | V2R, X3R | POWER MODULE (AP) (ASP) | Y10S | SOLENOID VALVE (LEAKAGE CORB) |
| F1P~8P | PILOT AMP (SPRING MONITOR) (ASP) | K11R | MAGNETIC RELAY (YES) (ASP) | X1A~X9A | CONNECTOR | Z1C~Z6 | NOISE FILTER (ELECTRIC CORD) |
| H1P | PILOT LAMP (SPRING MONITOR) (ASP) | K11R | MAGNETIC RELAY (YES) (ASP) | X1M | TERMINAL STRIP (POWER SUPPLY) | Z1F | NOISE FILTER (WITH SMOKE ASSEMBLY) (AP) (ASP) |
| H1P | PILOT LAMP (SPRING MONITOR) (ASP) | K3AR | MAGNETIC RELAY (CURRENT LIMITING) (AP) (ASP) | X1M | TERMINAL STRIP (RELAY) | | |
| H1P | PILOT LAMP (SPRING MONITOR) (ASP) | K3AR | MAGNETIC RELAY (CURRENT LIMITING) (AP) (ASP) | Y1E | ELECTRONIC EXPANSION VALVE (MAIN 1) | | |
| H1P | PILOT LAMP (SPRING MONITOR) (ASP) | M1C, M2C | MOTOR (COMPRESSOR) | Y2E | ELECTRONIC EXPANSION VALVE (SUBSIDE 1) | | |
| H1P | PILOT LAMP (SPRING MONITOR) (ASP) | M1F, M2F | MOTOR (FAN) | Y3E | ELECTRONIC EXPANSION VALVE (MAIN 2) | | |
| K1M, C2M | MAGNETIC RELAY (W/C) (W/C) (ASP) | R12T | THEMISTOR (SUB COOL. HEAT E.C. 2) | Y4E | ELECTRONIC EXPANSION VALVE (SUBSIDE 2) | X7A | OPERATION OUTPUT (ASP) |
| K1R | MAGNETIC RELAY (YES) (ASP) | R13T | THEMISTOR (SUB COOL. HEAT E.C. 2) | Y5E | ELECTRONIC EXPANSION VALVE (SUBSIDE 2) | X9A | POWER SUPPLY (ADAPTER) (ASP) |
| | | R14T | THEMISTOR (LIQUID 2) (ASP) | Y1S | SOLENOID VALVE (RMT) | X37A | POWER SUPPLY (ADAPTER) (ASP) |

- NOTES
1. THIS WIRING DIAGRAM IS APPLIED ONLY TO THE OUTDOOR UNIT.
 2. : FIELD WIRING.
 3. : TERMINAL STRIP. : CONNECTOR. : TERMINAL. : PROTECTIVE EARTH (SCREW). : NOISELESS EARTH.
 4. WHEN USING THE OPTIONAL ADAPTOR, REFER TO THE INSTALLATION MANUAL OF THE OPTIONAL ADAPTOR.
 5. FOR CONNECTION WIRING TO INDOOR-OUTDOOR TRANSMISSION FT + F2, OUTDOOR-OUTDOOR TRANSMISSION FT + F2, OUTDOOR-MULTI TRANSMISSION Q1 + Q2, REFER TO THE INSTALLATION MANUAL.
 6. HOW TO USE B51~5, REFER TO "SERVICE PRECAUTION".
 7. LABEL ON ELECTRICAL COMPONENTS BOX LID.
 8. WHEN OPERATING, DON'T SHORT-CIRCUIT THE PROTECTION DEVICE (S1, 2PH).
 9. SYMBOLS INDICATE COLORS OF EACH PARTS AS SHOWN BELOW.
 10. IS CONNECTOR COLOR FOR PRINTED CIRCUIT BOARD.
 11. IS IDENTIFICATION COLOR FOR COMPONENT.
 12. IS IDENTIFICATION COLOR FOR COMPONENT LEAD WIRE.
 13. COLORS: BLK:BLACK; RED:RED; BLU:BLUE; WHI:WHITE; GRN:GREEN.


3D070279B

6. Field Wiring

RXYQ72PBTJ / RXYQ96PBTJ / RXYQ120PBTJ / RXYQ144PBTJ

- 5) Unit shall be grounded in compliance with the applicable local and national codes.
 - 6) Wiring shown are general points-of-connection guides only and are not intended for or to include all details for a specific installation.
 - 7) Be sure to install the switch and the breaker/fuse to the power line of each piece of equipment.
 - 8) Install the main switch that can interrupt all the power sources in an integrated manner because this system consists of the equipment utilizing multiple power sources.
 - 9) If there exists the possibility of reversed phase, lost phase, momentary blackout or power goes on and off while the product is operating, attach a reversed phase protection circuit locally.
- Running the product in reversed phase may break the compressor and other parts.


- Notes 1) All wiring, components and materials to be procured on the site must comply with the applicable local and national codes.
- 2) Use copper conductors only.
 - 3) As for details, see wiring diagram.
 - 4) Field wiring diagram is to be used as a guideline only. Wiring should comply with applicable local and national codes.

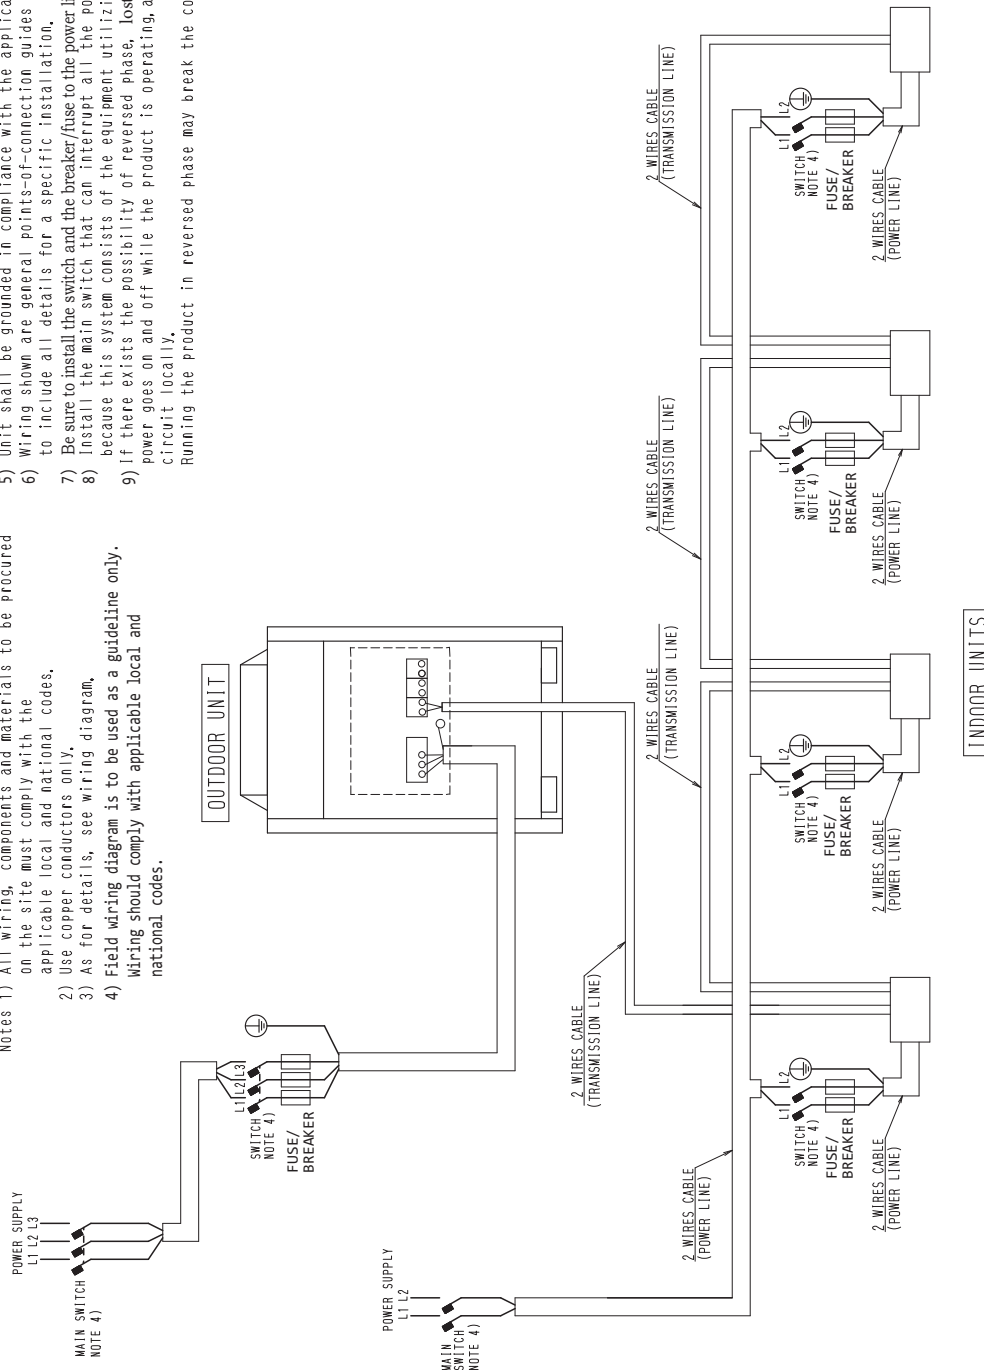

C: 3D058621D

RXYQ168PBTJ / RXYQ192PBTJ / RXYQ216PBTJ / RXYQ240PBTJ


- Notes 1) All wiring, components and materials to be procured on the site must comply with the applicable local and national codes, use copper conductors only.
- 2) As for details, see wiring diagram.
- 3) Field wiring diagram is to be used as a guideline only. Wiring should comply with applicable local and national codes.
- 4) Unit shall be grounded in compliance with the applicable local and national codes, to include all details for a specific installation.
- 5) Be sure to install the switch and the breaker/fuse to the power line of each piece of equipment.
- 6) Install the main switch that can interrupt all the power sources in an integrated manner because this system consists of the equipment utilizing multiple power sources.
- 7) If there exists the possibility of reversed phase, momentary blackout or power goes on and off while the product is operating, attach a reversed phase protection circuit locally.
- 8) Running the product in reversed phase may break the compressor and other parts.

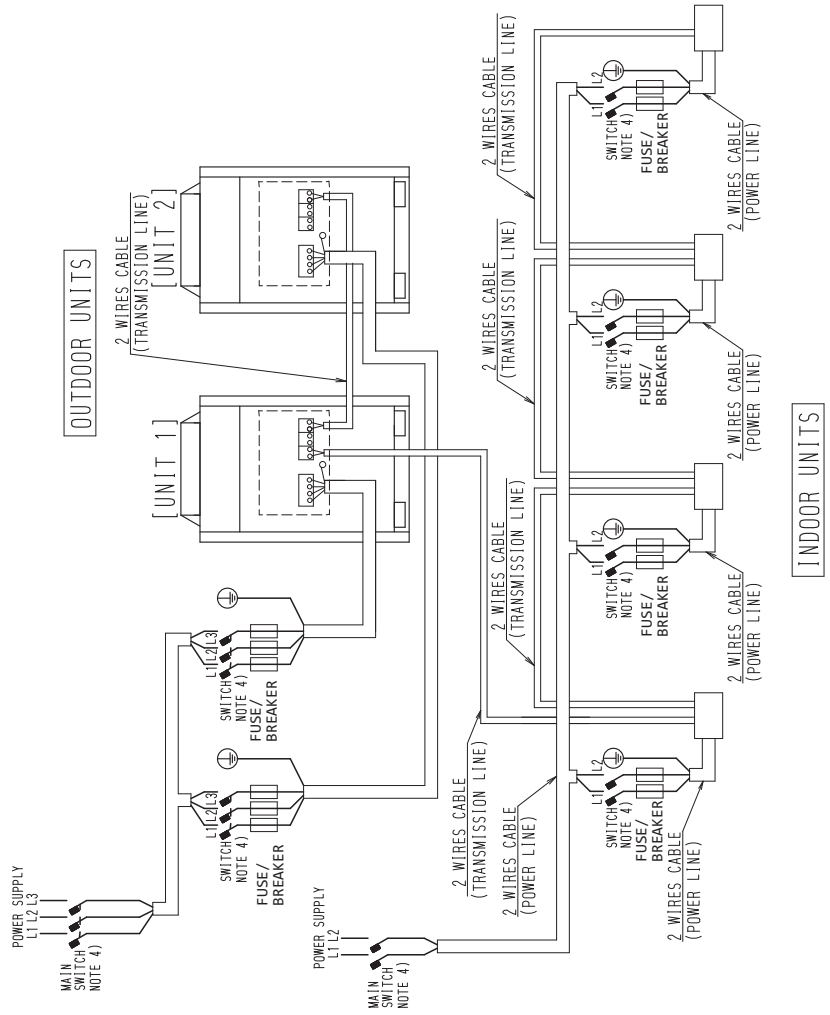

C: 3D059672D

RXYQ264PBTJ / RXYQ288PBTJ / RXYQ312PBTJ / RXYQ336PBTJ / RXYQ360PBTJ

- Notes 1) All wiring, components and materials to be procured on the site must comply with the applicable local and national codes, use copper conductors only.
- 2) Use copper conductors only.
- 3) As for details, see wiring diagram.
- 4) Field wiring diagram is to be used as a guideline only. Wiring should comply with applicable local and national codes.
- 5) Unit shall be grounded in compliance with the applicable local and national codes.
- 6) Wiring shown are general points-of-connection guides only and are not intended for or to include all details for a specific installation.
- Be sure to install the switch and the breaker/fuse to the power line of each piece of equipment.
- 7) Install the main switch that can interrupt all the power sources in an integrated manner.
- 8) Because this system consists of the equipment utilizing the multiple power sources.
- 9) If there exists the possibility of reversed phase, lost phase, momentary blackout or power goes on and off while the product is operating, attach a reversed phase protection circuit locally.
- Running the product in reversed phase may break the compressor and other parts,

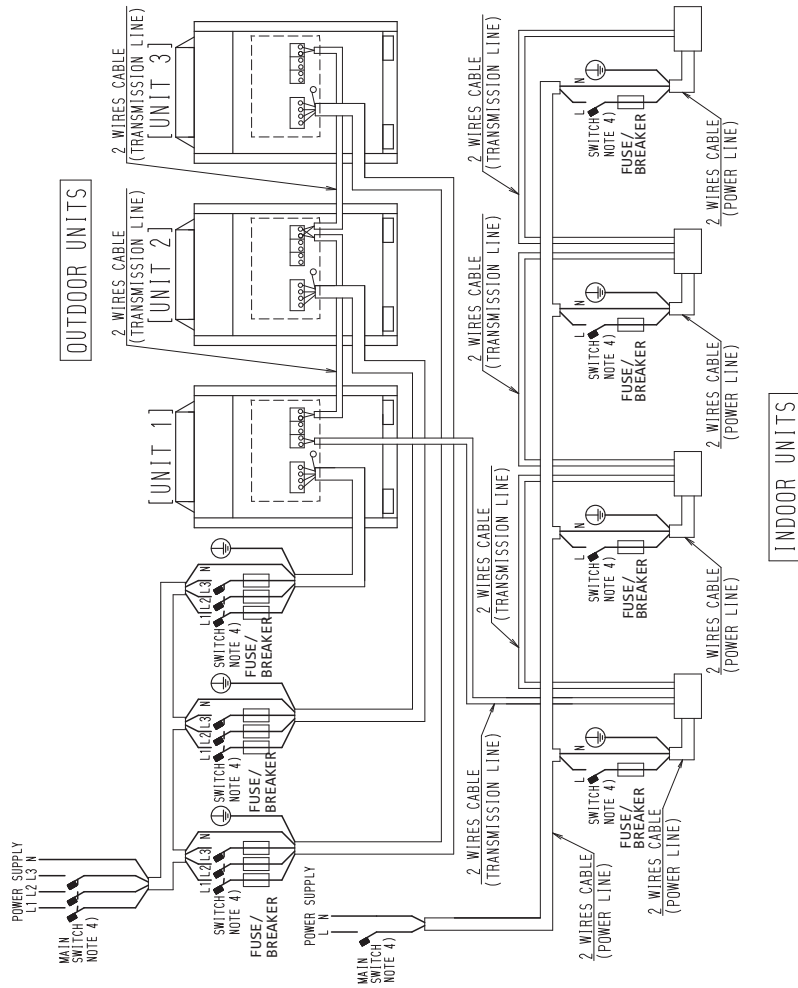


3D070846

7. Electric Characteristics

| Model Name | Units | | | | Power Supply | | Comp. | | OFM | |
|-------------|-------|---------|-----|-----|--------------|-----|-------|-------------|----------|---------|
| | Hz | Volts | Min | Max | MCA | MOP | MSC | RLA | KW | FLA |
| RXYQ72PBTJ | 60 | 208/230 | 187 | 253 | 30 | 35 | - | 14.2 | 0.75 | 1.2 |
| RXYQ96PBTJ | 60 | 208/230 | 187 | 253 | 43 | 50 | 131 | 7.8 + 16.8 | 0.35 x 2 | 1.0 x 2 |
| RXYQ120PBTJ | 60 | 208/230 | 187 | 253 | 43 | 50 | 131 | 10.8 + 16.8 | 0.35 x 2 | 1.0 x 2 |
| RXYQ144PBTJ | 60 | 208/230 | 187 | 253 | 72.2 | 80 | - | 14.3 + 14.3 | 0.75 x 2 | 2.0 x 2 |

The relationship between the starting time and the starting current:



NOTES:


- RLA is based on the following conditions:
Indoor temp: 80° FDB / 67° FWB
Outdoor temp: 95° FDB
- MSC means the maximum current during the starting of the compressor.
- Voltage range:
Units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits.
- Maximum allowable voltage variation between phases is 2%.
- Select wire size based on the value of MCA.
- MOP is used to select the fuse, circuit breaker, or the ground fault circuit interrupter (ground leakage circuit breaker).

SYMBOLS:

- MCA: Minimum Circuit Amps. (A)
MOP: Maximum Overcurrent Protective Device (A) (See Note 6)
MSC: Maximum current when starting the compressor. (A)
RLA: Rate Load Amps (A)
OFM: Outdoor Fan Motor (A)
FLA: Full Load Amps (A)
KW: Fan Motor Rated Output

| Model Name | | | Units | | | | Power Supply | | Comp. | | OFM | |
|------------------|-------------------|-------------|-------|---------|-----|-----|--------------|-------|-------|---------------------------|-------------------------|-----------------------|
| Combination Unit | Independent Units | | Hz | Volt | Min | Max | MCA | MOP | MSC | RLA | KW | FLA |
| RXYQ168PBTJ | REYQ72PBTJ | REYQ96PBTJ | 60 | 208/230 | 187 | 253 | 30 + 43 | 35+50 | 139 | 14.2 + 7.8 + 16.8 | 0.75 + (0.35 x 2) | 1.2 + (1.0 x 2) |
| RXYQ192PBTJ | REYQ72PBTJ | REYQ120PBTJ | 60 | 208/230 | 187 | 253 | 30 + 43 | 35+50 | 140 | 14.2 + 10.8 + 16.8 | 0.75 + (0.35 x 2) | 1.2 + (1.0 x 2) |
| REYQ216PBTJ | REYQ96PBTJ | REYQ120PBTJ | 60 | 208/230 | 187 | 253 | 43 + 43 | 50+50 | 158 | 7.8 + 16.8 + 10.8 + 16.8 | (0.35 x 2) + (0.35 x 2) | (1.0 x 2) + (1.0 x 2) |
| RXYQ240PBTJ | REYQ120PBTJ | REYQ120PBTJ | 60 | 208/230 | 187 | 253 | 43 + 43 | 50+50 | 159 | 10.8 + 16.8 + 10.8 + 16.8 | (0.35 x 2) + (0.35 x 2) | (1.0 x 2) + (1.0 x 2) |

The relationship between the starting time and the starting current:



NOTES:


1. RLA is based on the following conditions:
Indoor temp: 80° FDB / 67° FWB
Outdoor temp: 95° FDB
2. MSC means the maximum current during the starting of the compressor.
3. Voltage range:
Units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits.
4. Maximum allowable voltage variation between phases is 2%.
5. Select wire size based on the value of MCA.
6. MOP is used to select the fuse, circuit breaker, or the ground fault circuit interrupter (ground leakage circuit breaker).

SYMBOLS:

- MCA: Minimum Circuit Amps. (A)
MOP: Maximum Overcurrent Protective Device (A) (See Note 6)
MSC: Maximum current when starting the compressor. (A)
RLA: Rate Load Amps (A)
OFM: Outdoor Fan Motor (A)
FLA: Full Load Amps (A)
KW: Fan Motor Rated Output

| Model Name | | | | Units | | | | Power Supply | | | Comp. | | OFM | |
|------------------|-------------------|-------------|-------------|-------|-------------|-----|-----|-----------------|----------|-----|--|-----------------------------------|---------------------------------|--|
| Combination Unit | Independent Units | | | Hz | Volts | Min | Max | MCA | MOP | MSC | RLA | KW | FLA | |
| RXYQ264PBTJ | RXYQ72PBTJ | RXYQ96PBTJ | RXYQ96PBTJ | 60 | 208/ 230 | 187 | 253 | 30 + 43 + 43 | 35+50+50 | 165 | $14.2 + (7.8 + 16.8) \times 2$ | $0.75 + (0.35 \times 2) \times 2$ | $1.2 + (1.0 \times 2) \times 2$ | |
| RXYQ288PBTJ | RXYQ72PBTJ | RXYQ96PBTJ | RXYQ120PBTJ | 60 | 208/ 230 | 187 | 253 | 30 + 43 + 43 | 35+50+50 | 166 | $14.2 + 7.8 + 16.8 + 10.8 + 16.8$ | $0.75 + (0.35 \times 2) \times 2$ | $1.2 + (1.0 \times 2) \times 2$ | |
| RXYQ312PBTJ | RXYQ72PBTJ | RXYQ120PBTJ | RXYQ120PBTJ | 60 | 208/ 230 | 187 | 253 | 30 + 43 + 43 | 35+50+50 | 167 | $14.2 + \frac{(10.8 + 16.8)}{2}$ | $0.75 + (0.35 \times 2) \times 2$ | $1.2 + (1.0 \times 2) \times 2$ | |
| RXYQ336PBTJ | RXYQ96PBTJ | RXYQ120PBTJ | RXYQ120PBTJ | 60 | 208/ 230 | 187 | 253 | 43 + 43 + 43 | 50+50+50 | 184 | $7.8 + 16.8 + \frac{(10.8 + 16.8)}{2}$ | $(0.35 \times 2) \times 3$ | $(1.0 \times 2) \times 3$ | |
| RXYQ360PBTJ | RXYQ120PBTJ | RXYQ120PBTJ | RXYQ120PBTJ | 60 | 208/ 230 | 187 | 253 | 43 + 43 + 43 | 50+50+50 | 186 | $(10.8 + (16.8) \times 3)$ | $(0.35 \times 2) \times 3$ | $(1.0 \times 2) \times 3$ | |

The relationship between the starting time and the starting current:



NOTES:

- RLA is based on the following conditions:
Indoor temp: 80° FDB / 67° FWB
Outdoor temp: 95° FDB
- MSC means the maximum current during the starting of the compressor.
- Voltage range:
Units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits.
- Maximum allowable voltage variation between phases is 2%.
- Select wire size based on the value of MCA.
- MOP is used to select the fuse, circuit breaker or the ground fault circuit interrupter (ground leakage circuit breaker).

SYMBOLS:

- MCA: Minimum Circuit Amps. (A)
MOP: Maximum Overcurrent Protective Device (A) (See Note 6)
MSC: Maximum current when starting the compressor. (A)
RLA: Rate Load Amps (A)
OFM: Outdoor Fan Motor (A)
FLA: Full Load Amps (A)
KW: Fan Motor Rated Output

7. Capacity Tables (Reference Data)

7.1 Cooling Capacity (RXYQ-PBTJ)

These tables are based on projection. Actual results may vary according to conditions of use.

RXYQ72PBTJ

| Combination | Outdoor air temp. | Indoor air temp. °FWB | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|-------------|-------------------|-----------------------|------|------|------|------|------|------|------|------|------|------|------|------|----|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| | | 57 | | | | 61 | | | | 64 | | | | 67 | | | | 70 | | | | 72 | | | | 75 | | | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | | | | |
| % | *FDB | MBH | KW | MBH | KW | MBH | KW | MBH | KW | MBH | KW | MBH | KW | MBH | KW | MBH | KW | MBH | KW | MBH | KW | MBH | KW | MBH | KW | | | | |
| 23 | 60.7 | 1.79 | 73.9 | 2.23 | 83.7 | 2.58 | 93.6 | 2.94 | 101 | 3.18 | 103 | 3.11 | 104 | 3.02 | 30 | 42.0 | 1.22 | 51.1 | 1.49 | 58.0 | 1.70 | 64.8 | 1.93 | 71.6 | 2.16 | 76.2 | 2.31 | 83.0 | 2.55 |
| 30 | 60.7 | 1.85 | 73.9 | 2.31 | 83.7 | 2.67 | 93.6 | 3.03 | 99.0 | 3.15 | 100 | 3.08 | 102 | 2.99 | 30 | 42.0 | 1.26 | 51.1 | 1.54 | 58.0 | 1.76 | 64.8 | 1.99 | 71.6 | 2.23 | 76.2 | 2.39 | 83.0 | 2.64 |
| 40 | 60.7 | 1.94 | 73.9 | 2.42 | 83.7 | 2.80 | 93.6 | 3.18 | 95.8 | 3.10 | 97.0 | 3.04 | 98.9 | 2.94 | 30 | 42.0 | 1.31 | 51.1 | 1.61 | 58.0 | 1.84 | 64.8 | 2.08 | 71.6 | 2.34 | 76.2 | 2.51 | 83.0 | 2.77 |
| 50 | 60.7 | 2.03 | 73.9 | 2.55 | 83.7 | 2.94 | 90.7 | 3.16 | 92.5 | 3.06 | 93.8 | 2.99 | 95.6 | 2.88 | 30 | 42.0 | 1.37 | 51.1 | 1.68 | 58.0 | 1.93 | 64.8 | 2.19 | 71.6 | 2.46 | 76.2 | 2.64 | 83.0 | 2.91 |
| 54 | 60.7 | 2.08 | 73.9 | 2.60 | 83.7 | 3.01 | 89.4 | 3.14 | 91.2 | 3.04 | 92.5 | 2.97 | 94.3 | 2.91 | 30 | 42.0 | 1.39 | 51.1 | 1.72 | 58.0 | 1.97 | 64.8 | 2.24 | 71.6 | 2.51 | 76.2 | 2.69 | 83.0 | 2.97 |
| 58 | 60.7 | 2.12 | 73.9 | 2.65 | 83.7 | 3.07 | 88.1 | 3.13 | 89.9 | 3.06 | 91.2 | 3.07 | 93.0 | 3.09 | 30 | 42.0 | 1.42 | 51.1 | 1.75 | 58.0 | 2.01 | 64.8 | 2.28 | 71.6 | 2.56 | 76.2 | 2.75 | 83.0 | 3.04 |
| 62 | 60.7 | 2.17 | 73.9 | 2.71 | 83.7 | 3.14 | 86.8 | 3.21 | 88.6 | 3.24 | 89.9 | 3.25 | 91.7 | 3.28 | 30 | 42.0 | 1.45 | 51.1 | 1.79 | 58.0 | 2.05 | 64.8 | 2.33 | 71.6 | 2.62 | 76.2 | 2.81 | 83.0 | 3.10 |
| 66 | 60.7 | 2.21 | 73.9 | 2.80 | 83.6 | 3.26 | 85.3 | 3.29 | 87.3 | 3.42 | 88.6 | 3.43 | 90.4 | 3.46 | 30 | 42.0 | 1.48 | 51.1 | 1.82 | 58.0 | 2.10 | 64.8 | 2.38 | 71.6 | 2.67 | 76.2 | 2.93 | 83.0 | 3.33 |
| 70 | 60.7 | 2.29 | 73.9 | 3.03 | 82.3 | 3.54 | 84.2 | 3.57 | 86.0 | 3.60 | 87.2 | 3.62 | 89.1 | 3.65 | 30 | 42.0 | 1.51 | 51.1 | 1.86 | 58.0 | 2.14 | 64.8 | 2.50 | 71.6 | 2.89 | 76.2 | 3.17 | 82.2 | 3.54 |
| 72 | 60.7 | 2.37 | 73.9 | 3.15 | 81.7 | 3.63 | 83.5 | 3.66 | 85.4 | 3.69 | 86.6 | 3.71 | 88.4 | 3.74 | 30 | 42.0 | 1.52 | 51.1 | 1.88 | 58.0 | 2.23 | 64.8 | 2.60 | 71.6 | 3.00 | 76.2 | 3.29 | 81.5 | 3.63 |
| 75 | 60.7 | 2.51 | 73.9 | 3.33 | 80.7 | 3.76 | 82.5 | 3.80 | 84.4 | 3.83 | 85.6 | 3.85 | 87.5 | 3.88 | 30 | 42.0 | 1.55 | 51.1 | 1.99 | 58.0 | 2.35 | 64.8 | 2.75 | 71.6 | 3.18 | 76.2 | 3.49 | 80.6 | 3.76 |
| 79 | 60.7 | 2.70 | 73.9 | 3.59 | 79.4 | 3.94 | 81.2 | 3.98 | 83.1 | 4.01 | 84.3 | 4.03 | 86.2 | 4.07 | 30 | 42.0 | 1.58 | 51.1 | 2.14 | 58.0 | 2.53 | 64.8 | 2.96 | 71.6 | 3.43 | 76.2 | 3.76 | 79.3 | 3.94 |
| 83 | 60.7 | 2.91 | 73.9 | 3.87 | 78.1 | 4.12 | 79.9 | 4.16 | 81.8 | 4.20 | 83.0 | 4.22 | 84.9 | 4.26 | 30 | 42.0 | 1.78 | 51.1 | 2.29 | 58.0 | 2.72 | 64.8 | 3.19 | 71.6 | 3.69 | 76.2 | 4.05 | 78.0 | 4.12 |
| 87 | 60.7 | 3.12 | 73.9 | 4.16 | 76.8 | 4.31 | 78.6 | 4.34 | 80.5 | 4.38 | 81.7 | 4.41 | 83.6 | 4.45 | 30 | 42.0 | 1.90 | 51.1 | 2.46 | 58.0 | 2.92 | 64.8 | 3.43 | 71.6 | 3.97 | 75.4 | 4.28 | 76.7 | 4.30 |
| 91 | 60.7 | 3.35 | 73.9 | 4.45 | 75.5 | 4.49 | 77.3 | 4.53 | 79.2 | 4.57 | 80.4 | 4.60 | 81.1 | 4.61 | 30 | 42.0 | 2.04 | 51.1 | 2.63 | 58.0 | 3.13 | 64.8 | 3.68 | 71.6 | 4.27 | 74.1 | 4.46 | 75.4 | 4.49 |
| 93 | 60.7 | 3.47 | 73.9 | 4.54 | 74.8 | 4.58 | 76.7 | 4.62 | 78.5 | 4.66 | 79.5 | 4.68 | 79.5 | 4.69 | 30 | 42.0 | 2.11 | 51.1 | 2.72 | 58.0 | 3.24 | 64.8 | 3.81 | 71.6 | 4.42 | 73.4 | 4.55 | 74.7 | 4.58 |
| 95 | 60.7 | 3.59 | 73.9 | 4.63 | 74.2 | 4.67 | 76.0 | 4.71 | 77.9 | 4.76 | 78.0 | 4.76 | 78.0 | 4.76 | 30 | 42.0 | 2.18 | 51.1 | 2.82 | 58.0 | 3.36 | 64.8 | 3.95 | 71.6 | 4.58 | 72.8 | 4.64 | 74.1 | 4.67 |
| 99 | 60.7 | 3.85 | 71.1 | 4.81 | 72.9 | 4.86 | 74.7 | 4.90 | 74.9 | 4.90 | 74.9 | 4.90 | 74.9 | 4.91 | 30 | 42.0 | 2.32 | 51.1 | 3.02 | 58.0 | 3.60 | 64.8 | 4.23 | 70.6 | 4.80 | 71.5 | 4.82 | 72.8 | 4.84 |
| 103 | 60.7 | 4.12 | 69.7 | 4.99 | 71.6 | 5.04 | 71.8 | 5.05 | 71.8 | 5.05 | 71.8 | 5.05 | 71.8 | 5.05 | 30 | 42.0 | 2.48 | 51.1 | 3.23 | 58.0 | 3.85 | 64.8 | 4.54 | 69.3 | 4.98 | 70.2 | 5.00 | 71.5 | 5.04 |
| 106 | 60.7 | 4.34 | 68.8 | 5.13 | 69.5 | 5.15 | 69.5 | 5.15 | 69.5 | 5.15 | 69.5 | 5.15 | 69.5 | 5.15 | 30 | 42.0 | 2.60 | 51.1 | 3.39 | 58.0 | 4.06 | 64.8 | 4.74 | 68.4 | 5.12 | 69.2 | 5.14 | 69.5 | 5.15 |
| 110 | 60.7 | 4.66 | 66.4 | 5.29 | 66.4 | 5.29 | 66.4 | 5.29 | 66.4 | 5.29 | 66.4 | 5.29 | 66.4 | 5.29 | 30 | 42.0 | 2.79 | 51.1 | 3.64 | 58.0 | 4.36 | 64.8 | 5.18 | 66.4 | 5.10 | 66.5 | 5.30 | 66.5 | 5.30 |
| 115 | 56.1 | 5.54 | 56.2 | 5.54 | 56.3 | 5.55 | 56.5 | 5.56 | 56.6 | 5.56 | 56.7 | 5.57 | 56.8 | 5.57 | 30 | 42.0 | 3.09 | 51.1 | 4.04 | 56.3 | 5.55 | 56.5 | 5.56 | 56.6 | 5.56 | 56.7 | 5.57 | 56.8 | 5.57 |
| 118 | 49.0 | 4.73 | 49.1 | 4.74 | 49.3 | 4.75 | 49.4 | 4.75 | 49.5 | 4.76 | 49.6 | 4.77 | 49.7 | 4.77 | 30 | 42.0 | 3.28 | 49.1 | 4.74 | 49.3 | 4.75 | 49.4 | 4.75 | 49.5 | 4.76 | 49.6 | 4.77 | 49.7 | 4.77 |
| 122 | 39.5 | 3.67 | 39.7 | 3.67 | 39.8 | 3.68 | 39.9 | 3.69 | 40.1 | 3.69 | 40.1 | 3.69 | 40.1 | 3.69 | 30 | 42.0 | 3.67 | 39.7 | 3.67 | 39.8 | 3.68 | 39.9 | 3.69 | 40.1 | 3.69 | 40.1 | 3.70 | 40.3 | 3.70 |

TC: Total capacity; MBH
 PI: Power Input; kW (Comp.+Outdoor fan motor)
 Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

RXYQ96PBTJ

| Combi- nation | Outdoor air temp. | Indoor air temp. °FWB | | | | | | | | | | | | | | | | | | | | | | | | Combi- nation | Outdoor air temp. | Indoor air temp. °FWB | | | | | | | | | | | | | | | | | | | | | | | |
|------------------|----------------------|-----------------------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------------------|----------------------|-----------------------|------|------|--|--|--|--|--|--|--|--|--|--|--|--|--|--|--|--|--|--|--|--|--|
| | | 57 | | 61 | | 64 | | 67 | | 70 | | 72 | | 75 | | 57 | | 61 | | 64 | | 67 | | 70 | | | | 72 | | 75 | | | | | | | | | | | | | | | | | | | | | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | | | TC | PI | | | | | | | | | | | | | | | | | | | | | | |
| 130 | 23 | 81.0 | 2.55 | 98.5 | 2.55 | 112 | 2.55 | 125 | 2.55 | 135 | 2.55 | 137 | 2.55 | 139 | 2.55 | 23 | 56.1 | 2.55 | 68.2 | 2.55 | 77.3 | 2.55 | 86.4 | 2.55 | 95.5 | 2.55 | 102 | 2.55 | 111 | 2.55 | | | | | | | | | | | | | | | | | | | | | |
| | 30 | 81.0 | 3.05 | 98.5 | 3.05 | 112 | 3.05 | 125 | 3.05 | 132 | 3.05 | 134 | 3.05 | 136 | 3.05 | 30 | 56.1 | 3.05 | 68.2 | 3.05 | 77.3 | 3.05 | 86.4 | 3.05 | 95.5 | 3.05 | 102 | 3.05 | 111 | 3.05 | | | | | | | | | | | | | | | | | | | | | |
| | 40 | 81.0 | 3.75 | 98.5 | 3.75 | 112 | 3.75 | 125 | 3.75 | 128 | 3.75 | 129 | 3.75 | 132 | 3.75 | 40 | 56.1 | 3.75 | 68.2 | 3.75 | 77.3 | 3.75 | 86.4 | 3.75 | 95.5 | 3.75 | 102 | 3.75 | 111 | 3.75 | | | | | | | | | | | | | | | | | | | | | |
| | 50 | 81.0 | 4.43 | 98.5 | 4.43 | 112 | 4.43 | 121 | 4.43 | 123 | 4.43 | 125 | 4.43 | 127 | 4.43 | 50 | 56.1 | 4.43 | 68.2 | 4.43 | 77.3 | 4.43 | 86.4 | 4.43 | 95.5 | 4.43 | 102 | 4.43 | 111 | 4.43 | | | | | | | | | | | | | | | | | | | | | |
| | 54 | 81.0 | 4.70 | 98.5 | 4.70 | 112 | 4.70 | 119 | 4.70 | 122 | 4.70 | 123 | 4.70 | 126 | 4.70 | 54 | 56.1 | 4.70 | 68.2 | 4.70 | 77.3 | 4.70 | 86.4 | 4.70 | 95.5 | 4.70 | 102 | 4.70 | 111 | 4.70 | | | | | | | | | | | | | | | | | | | | | |
| | 58 | 81.0 | 4.96 | 98.5 | 4.96 | 112 | 4.96 | 117 | 4.96 | 120 | 4.97 | 122 | 4.97 | 124 | 4.97 | 58 | 56.1 | 4.96 | 68.2 | 4.96 | 77.3 | 4.96 | 86.4 | 4.96 | 95.5 | 4.97 | 102 | 4.97 | 111 | 4.97 | | | | | | | | | | | | | | | | | | | | | |
| | 62 | 81.0 | 5.22 | 98.5 | 5.23 | 112 | 5.23 | 116 | 5.23 | 118 | 5.23 | 120 | 5.23 | 122 | 5.23 | 62 | 56.1 | 5.22 | 68.2 | 5.23 | 77.3 | 5.23 | 86.4 | 5.23 | 95.5 | 5.23 | 102 | 5.23 | 111 | 5.23 | | | | | | | | | | | | | | | | | | | | | |
| | 66 | 81.0 | 5.48 | 98.5 | 5.48 | 112 | 5.48 | 114 | 5.48 | 116 | 5.48 | 118 | 5.48 | 121 | 5.49 | 66 | 56.1 | 5.48 | 68.2 | 5.48 | 77.3 | 5.48 | 86.4 | 5.48 | 95.5 | 5.48 | 102 | 5.48 | 111 | 5.49 | | | | | | | | | | | | | | | | | | | | | |
| | 70 | 81.0 | 5.74 | 98.5 | 5.74 | 112 | 5.74 | 114 | 5.74 | 115 | 5.74 | 116 | 5.74 | 119 | 5.74 | 70 | 56.1 | 5.74 | 68.2 | 5.74 | 77.3 | 5.74 | 86.4 | 5.74 | 95.5 | 5.74 | 102 | 5.74 | 111 | 5.74 | | | | | | | | | | | | | | | | | | | | | |
| | 72 | 81.0 | 5.86 | 98.5 | 5.86 | 109 | 5.86 | 111 | 5.86 | 114 | 5.86 | 115 | 5.86 | 118 | 5.86 | 72 | 56.1 | 5.86 | 68.2 | 5.86 | 77.3 | 5.86 | 86.4 | 5.86 | 95.5 | 5.86 | 102 | 5.86 | 109 | 5.86 | | | | | | | | | | | | | | | | | | | | | |
| | 75 | 81.0 | 6.05 | 98.5 | 6.05 | 108 | 6.05 | 110 | 6.05 | 113 | 6.05 | 114 | 6.05 | 117 | 6.05 | 75 | 56.1 | 6.05 | 68.2 | 6.05 | 77.3 | 6.05 | 86.4 | 6.05 | 95.5 | 6.05 | 102 | 6.05 | 107 | 6.05 | | | | | | | | | | | | | | | | | | | | | |
| | 79 | 81.0 | 6.29 | 98.5 | 6.29 | 106 | 6.29 | 108 | 6.29 | 111 | 6.29 | 112 | 6.29 | 115 | 6.30 | 79 | 56.1 | 6.29 | 68.2 | 6.29 | 77.3 | 6.29 | 86.4 | 6.29 | 95.5 | 6.29 | 102 | 6.29 | 106 | 6.30 | | | | | | | | | | | | | | | | | | | | | |
| 83 | 81.0 | 6.53 | 98.5 | 6.53 | 104 | 6.53 | 107 | 6.53 | 109 | 6.53 | 111 | 6.53 | 113 | 6.54 | 83 | 56.1 | 6.53 | 68.2 | 6.53 | 77.3 | 6.53 | 86.4 | 6.53 | 95.5 | 6.53 | 102 | 6.53 | 104 | 6.54 | | | | | | | | | | | | | | | | | | | | | | |
| 87 | 81.0 | 6.77 | 98.5 | 6.77 | 102 | 6.77 | 105 | 6.77 | 107 | 6.77 | 109 | 6.77 | 111 | 6.77 | 87 | 56.1 | 6.77 | 68.2 | 6.77 | 77.3 | 6.77 | 86.4 | 6.77 | 95.5 | 6.77 | 101 | 6.77 | 102 | 6.77 | | | | | | | | | | | | | | | | | | | | | | |
| 91 | 81.0 | 7.00 | 98.2 | 7.00 | 101 | 7.00 | 103 | 7.00 | 106 | 7.00 | 107 | 7.00 | 110 | 7.00 | 91 | 56.1 | 7.00 | 68.2 | 7.00 | 77.3 | 7.00 | 86.4 | 7.00 | 95.5 | 7.00 | 98.8 | 7.00 | 100 | 7.00 | | | | | | | | | | | | | | | | | | | | | | |
| 93 | 81.0 | 7.11 | 97.3 | 7.11 | 99.8 | 7.11 | 102 | 7.11 | 105 | 7.11 | 106 | 7.11 | 108 | 7.11 | 93 | 56.1 | 7.11 | 68.2 | 7.11 | 77.3 | 7.11 | 86.4 | 7.11 | 95.5 | 7.11 | 98.7 | 7.11 | 99.6 | 7.11 | | | | | | | | | | | | | | | | | | | | | | |
| 95 | 81.0 | 7.22 | 96.5 | 7.22 | 98.9 | 7.22 | 101 | 7.22 | 104 | 7.22 | 105 | 7.22 | 108 | 7.22 | 95 | 56.1 | 7.22 | 68.2 | 7.22 | 77.3 | 7.22 | 86.4 | 7.22 | 95.5 | 7.22 | 97.2 | 7.22 | 98.7 | 7.22 | | | | | | | | | | | | | | | | | | | | | | |
| 99 | 81.0 | 7.44 | 94.7 | 7.44 | 97.2 | 7.44 | 99.7 | 7.44 | 102 | 7.44 | 104 | 7.44 | 106 | 7.44 | 99 | 56.1 | 7.44 | 68.2 | 7.44 | 77.3 | 7.44 | 86.4 | 7.44 | 94.2 | 7.44 | 95.3 | 7.44 | 97.0 | 7.44 | | | | | | | | | | | | | | | | | | | | | | |
| 103 | 81.0 | 7.65 | 93.0 | 7.65 | 95.5 | 7.65 | 97.5 | 7.65 | 97.5 | 7.65 | 97.5 | 7.65 | 97.5 | 7.66 | 103 | 56.1 | 7.65 | 68.2 | 7.65 | 77.3 | 7.65 | 86.4 | 7.65 | 92.4 | 7.65 | 93.6 | 7.65 | 95.3 | 7.66 | | | | | | | | | | | | | | | | | | | | | | |
| 106 | 81.0 | 7.91 | 91.7 | 7.91 | 94.2 | 7.91 | 94.3 | 7.91 | 94.3 | 7.91 | 94.3 | 7.91 | 94.4 | 7.92 | 106 | 56.1 | 7.91 | 68.2 | 7.91 | 77.3 | 7.91 | 86.4 | 7.91 | 91.1 | 7.91 | 92.3 | 7.91 | 94.0 | 7.92 | | | | | | | | | | | | | | | | | | | | | | |
| 110 | 81.0 | 8.27 | 90.0 | 8.27 | 90.0 | 8.27 | 90.0 | 8.27 | 90.0 | 8.27 | 90.0 | 8.27 | 90.0 | 8.28 | 110 | 56.1 | 8.27 | 68.2 | 8.27 | 77.3 | 8.27 | 86.4 | 8.27 | 89.4 | 8.27 | 90.1 | 8.27 | 90.1 | 8.28 | | | | | | | | | | | | | | | | | | | | | | |
| 115 | 81.0 | 8.16 | 81.8 | 8.16 | 81.8 | 8.16 | 82.0 | 8.16 | 82.4 | 8.16 | 82.4 | 8.16 | 82.8 | 8.16 | 115 | 56.1 | 8.16 | 68.2 | 8.16 | 77.3 | 8.16 | 82.4 | 8.16 | 82.3 | 8.16 | 82.4 | 8.16 | 82.8 | 8.16 | | | | | | | | | | | | | | | | | | | | | | |
| 118 | 71.5 | 7.16 | 71.7 | 7.19 | 71.9 | 7.21 | 72.0 | 7.23 | 72.2 | 7.26 | 72.3 | 7.27 | 72.5 | 7.30 | 118 | 56.1 | 7.16 | 68.2 | 7.19 | 71.9 | 7.21 | 72.0 | 7.23 | 72.2 | 7.26 | 72.3 | 7.27 | 72.5 | 7.30 | | | | | | | | | | | | | | | | | | | | | | |
| 122 | 58.1 | 5.79 | 58.3 | 5.82 | 58.4 | 5.84 | 58.6 | 5.86 | 58.8 | 5.89 | 58.9 | 5.90 | 59.0 | 5.92 | 122 | 56.1 | 5.79 | 58.3 | 5.82 | 58.4 | 5.84 | 58.6 | 5.86 | 58.8 | 5.89 | 58.9 | 5.90 | 59.0 | 5.92 | | | | | | | | | | | | | | | | | | | | | | |

TC: Total capacity ; MBH
 PI: Power Input ; kW (Comp.+Outdoor fan motor)
 Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

RXYQ120PBTJ

Main capacity table with columns for Combination, Outdoor air temp., Indoor air temp. °FWB, and various capacity/PI values for different indoor temperatures (57, 61, 64, 67, 70, 72, 75) and combinations (90, 80, 70, 100).

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

RXYQ168PBTJ

Table with columns for Combination, Outdoor air temp., Indoor air temp. °FWB, and Capacity (TC, PI, MBH, kW) for various conditions. The table is organized into four main sections based on indoor air temperature (70, 72, 75, 77) and outdoor air temperature (57, 61, 64, 67, 70, 72, 75).

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

RXYQ192PBTJ

| Combi- nation | Outdoor air temp. °F | Indoor air temp. °FWB | | | | | | | | | | | | Combi- nation | Outdoor air temp. °F | Indoor air temp. °FWB | | | | | | | | | | | | | | | |
|------------------|----------------------------|-----------------------|------|------|------|------|------|------|------|------|------|------|------|------------------|----------------------------|-----------------------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|----|
| | | 57 | | | | 61 | | | | 64 | | | | | | 67 | | | | 70 | | | | 72 | | | | 75 | | | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 130 | 23 | 162 | 5.32 | 197 | 6.63 | 223 | 7.65 | 250 | 8.71 | 270 | 9.42 | 273 | 9.23 | 278 | 8.95 | 23 | 112 | 3.62 | 136 | 4.42 | 155 | 5.05 | 173 | 5.71 | 191 | 6.40 | 203 | 6.86 | 221 | 7.58 | |
| | 30 | 162 | 5.49 | 197 | 6.84 | 223 | 7.91 | 250 | 9.00 | 264 | 9.33 | 267 | 9.14 | 272 | 8.86 | 30 | 112 | 3.73 | 136 | 4.55 | 155 | 5.21 | 173 | 5.90 | 191 | 6.61 | 203 | 7.09 | 221 | 7.83 | |
| | 40 | 162 | 5.75 | 197 | 7.18 | 223 | 8.30 | 250 | 9.44 | 255 | 9.21 | 259 | 9.01 | 264 | 8.71 | 40 | 112 | 3.88 | 136 | 4.76 | 155 | 5.46 | 173 | 6.18 | 191 | 6.93 | 203 | 7.44 | 221 | 8.21 | |
| | 50 | 162 | 6.03 | 197 | 7.55 | 223 | 8.73 | 242 | 9.36 | 247 | 9.07 | 250 | 8.96 | 255 | 8.54 | 50 | 112 | 4.06 | 136 | 4.99 | 155 | 5.73 | 173 | 6.49 | 191 | 7.28 | 203 | 7.82 | 221 | 8.64 | |
| | 54 | 162 | 6.16 | 197 | 7.71 | 223 | 8.91 | 238 | 9.32 | 243 | 9.01 | 247 | 8.79 | 251 | 8.63 | 54 | 112 | 4.13 | 136 | 5.09 | 155 | 5.84 | 173 | 6.63 | 191 | 7.44 | 203 | 7.99 | 221 | 8.82 | |
| | 58 | 162 | 6.29 | 197 | 7.87 | 223 | 9.10 | 235 | 9.27 | 240 | 9.06 | 243 | 9.11 | 248 | 9.17 | 58 | 112 | 4.21 | 136 | 5.19 | 155 | 5.96 | 173 | 6.77 | 191 | 7.59 | 203 | 8.16 | 221 | 9.01 | |
| | 62 | 162 | 6.42 | 197 | 8.04 | 223 | 9.30 | 231 | 9.52 | 236 | 9.60 | 240 | 9.64 | 245 | 9.72 | 62 | 112 | 4.29 | 136 | 5.30 | 155 | 6.09 | 173 | 6.91 | 191 | 7.76 | 203 | 8.33 | 221 | 9.21 | |
| | 66 | 162 | 6.56 | 197 | 8.29 | 223 | 9.97 | 228 | 10.1 | 233 | 10.1 | 236 | 10.2 | 241 | 10.3 | 66 | 112 | 4.38 | 136 | 5.41 | 155 | 6.22 | 173 | 7.07 | 191 | 7.93 | 203 | 8.67 | 221 | 9.86 | |
| | 70 | 162 | 6.78 | 197 | 8.97 | 220 | 10.5 | 226 | 10.6 | 229 | 10.7 | 233 | 10.7 | 238 | 10.8 | 70 | 112 | 4.47 | 136 | 5.53 | 155 | 6.36 | 173 | 7.42 | 191 | 8.57 | 203 | 9.39 | 219 | 10.5 | |
| | 72 | 162 | 7.04 | 197 | 9.33 | 218 | 10.8 | 223 | 10.9 | 228 | 10.9 | 231 | 11.0 | 236 | 11.1 | 72 | 112 | 4.52 | 136 | 5.59 | 155 | 6.60 | 173 | 7.71 | 191 | 8.91 | 203 | 9.76 | 217 | 10.8 | |
| | 75 | 162 | 7.45 | 197 | 9.88 | 215 | 11.2 | 220 | 11.3 | 225 | 11.4 | 228 | 11.4 | 233 | 11.5 | 75 | 112 | 4.59 | 136 | 5.89 | 155 | 6.98 | 173 | 8.16 | 191 | 9.43 | 203 | 10.3 | 215 | 11.2 | |
| | 79 | 162 | 8.01 | 197 | 10.6 | 212 | 11.7 | 217 | 11.8 | 222 | 11.9 | 225 | 12.0 | 230 | 12.1 | 79 | 112 | 4.93 | 136 | 6.33 | 155 | 7.51 | 173 | 8.79 | 191 | 10.2 | 203 | 11.1 | 211 | 11.7 | |
| | 83 | 162 | 8.62 | 197 | 11.5 | 208 | 12.2 | 213 | 12.3 | 218 | 12.4 | 221 | 12.5 | 226 | 12.6 | 83 | 112 | 5.28 | 136 | 6.80 | 155 | 8.07 | 173 | 9.45 | 191 | 10.9 | 203 | 12.0 | 208 | 12.2 | |
| | 87 | 162 | 9.25 | 197 | 12.3 | 205 | 12.8 | 210 | 12.9 | 215 | 13.0 | 218 | 13.1 | 223 | 13.2 | 87 | 112 | 5.65 | 136 | 7.29 | 155 | 8.66 | 173 | 10.2 | 191 | 11.8 | 201 | 12.7 | 204 | 12.8 | |
| | 91 | 162 | 9.93 | 196 | 13.2 | 201 | 13.3 | 206 | 13.4 | 211 | 13.5 | 214 | 13.6 | 219 | 13.7 | 91 | 112 | 6.04 | 136 | 7.81 | 155 | 9.29 | 173 | 10.9 | 191 | 12.7 | 198 | 13.2 | 201 | 13.3 | |
| 93 | 162 | 10.3 | 195 | 13.5 | 203 | 13.6 | 205 | 13.7 | 209 | 13.8 | 213 | 13.9 | 218 | 14.0 | 93 | 112 | 6.24 | 136 | 8.08 | 155 | 9.62 | 173 | 11.3 | 191 | 13.1 | 196 | 13.5 | 199 | 13.6 | | |
| 95 | 162 | 10.6 | 193 | 13.7 | 198 | 13.9 | 203 | 14.0 | 208 | 14.1 | 210 | 14.2 | 210 | 14.2 | 95 | 112 | 6.45 | 136 | 8.36 | 155 | 9.96 | 173 | 11.7 | 191 | 13.6 | 194 | 13.8 | 197 | 13.8 | | |
| 99 | 162 | 11.4 | 189 | 14.3 | 194 | 14.4 | 199 | 14.5 | 202 | 14.6 | 202 | 14.6 | 202 | 14.6 | 99 | 112 | 6.89 | 136 | 8.95 | 155 | 10.7 | 173 | 12.6 | 188 | 14.2 | 191 | 14.3 | 194 | 14.4 | | |
| 103 | 162 | 12.2 | 186 | 14.8 | 191 | 14.9 | 193 | 15.0 | 193 | 15.0 | 193 | 15.0 | 193 | 15.0 | 103 | 112 | 7.35 | 136 | 9.57 | 155 | 11.4 | 173 | 13.5 | 185 | 14.8 | 187 | 14.8 | 191 | 14.9 | | |
| 106 | 162 | 13.1 | 183 | 15.4 | 187 | 15.5 | 187 | 15.5 | 187 | 15.5 | 187 | 15.5 | 187 | 15.5 | 106 | 112 | 7.83 | 136 | 10.2 | 155 | 12.2 | 173 | 14.4 | 182 | 15.4 | 185 | 15.5 | 187 | 15.5 | | |
| 110 | 162 | 14.3 | 178 | 16.2 | 178 | 16.2 | 178 | 16.2 | 178 | 16.2 | 178 | 16.2 | 178 | 16.2 | 110 | 112 | 8.51 | 136 | 11.1 | 155 | 13.3 | 173 | 15.7 | 178 | 16.2 | 178 | 16.2 | 178 | 16.2 | | |
| 115 | 162 | 15.3 | 164 | 16.4 | 164 | 16.4 | 164 | 16.4 | 164 | 16.4 | 164 | 16.4 | 164 | 16.4 | 115 | 112 | 9.44 | 136 | 12.4 | 154 | 16.4 | 164 | 16.4 | 164 | 16.4 | 164 | 16.4 | 164 | 16.4 | | |
| 118 | 133 | 13.8 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 | 135 | 13.9 | 135 | 13.9 | 135 | 13.9 | 118 | 112 | 10.0 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 | 135 | 13.9 | 135 | 13.9 | 135 | 13.9 | | |
| 122 | 107 | 10.5 | 107 | 10.5 | 107 | 10.5 | 108 | 10.5 | 108 | 10.6 | 108 | 10.6 | 108 | 10.6 | 122 | 107 | 10.5 | 107 | 10.5 | 107 | 10.5 | 108 | 10.5 | 108 | 10.6 | 108 | 10.6 | 108 | 10.6 | | |
| 120 | 23 | 150 | 4.87 | 182 | 6.05 | 206 | 6.98 | 230 | 7.94 | 255 | 8.91 | 269 | 9.47 | 274 | 9.21 | 23 | 99.7 | 3.24 | 121 | 3.92 | 137 | 4.46 | 154 | 5.02 | 170 | 5.80 | 181 | 6.00 | 197 | 6.82 | |
| | 30 | 150 | 5.02 | 182 | 6.25 | 206 | 7.21 | 230 | 8.20 | 255 | 9.21 | 263 | 9.39 | 268 | 9.13 | 30 | 99.7 | 3.33 | 121 | 4.03 | 137 | 4.59 | 154 | 5.17 | 170 | 5.78 | 181 | 6.20 | 197 | 6.83 | |
| | 40 | 150 | 5.26 | 182 | 6.55 | 206 | 7.56 | 230 | 8.61 | 251 | 9.44 | 254 | 9.26 | 259 | 8.99 | 40 | 99.7 | 3.46 | 121 | 4.21 | 137 | 4.80 | 154 | 5.42 | 170 | 6.06 | 181 | 6.50 | 197 | 7.17 | |
| | 50 | 150 | 5.52 | 182 | 6.88 | 206 | 7.95 | 230 | 9.05 | 243 | 9.32 | 246 | 9.13 | 250 | 8.84 | 50 | 99.7 | 3.61 | 121 | 4.40 | 137 | 5.03 | 154 | 5.69 | 170 | 6.36 | 181 | 6.83 | 197 | 7.54 | |
| | 54 | 150 | 5.63 | 182 | 7.03 | 206 | 8.12 | 230 | 9.24 | 239 | 9.26 | 242 | 9.07 | 247 | 8.77 | 54 | 99.7 | 3.67 | 121 | 4.48 | 137 | 5.13 | 154 | 5.80 | 170 | 6.50 | 181 | 6.97 | 197 | 7.70 | |
| | 58 | 150 | 5.74 | 182 | 7.18 | 206 | 8.30 | 230 | 9.44 | 236 | 9.21 | 239 | 9.05 | 243 | 9.11 | 58 | 99.7 | 3.74 | 121 | 4.57 | 137 | 5.23 | 154 | 5.92 | 170 | 6.63 | 181 | 7.12 | 197 | 8.06 | |
| | 62 | 150 | 5.87 | 182 | 7.33 | 206 | 8.48 | 228 | 9.47 | 232 | 9.54 | 235 | 9.58 | 240 | 9.65 | 62 | 99.7 | 3.81 | 121 | 4.66 | 137 | 5.34 | 154 | 6.05 | 170 | 6.78 | 181 | 7.27 | 197 | 8.03 | |
| | 66 | 150 | 5.99 | 182 | 7.50 | 206 | 8.67 | 224 | 9.99 | 229 | 10.1 | 232 | 10.1 | 236 | 10.2 | 66 | 99.7 | 3.88 | 121 | 4.76 | 137 | 5.45 | 154 | 6.18 | 170 | 6.92 | 181 | 7.43 | 197 | 8.28 | |
| | 70 | 150 | 6.12 | 182 | 7.98 | 206 | 9.59 | 221 | 10.5 | 225 | 10.6 | 228 | 10.7 | 233 | 10.7 | 70 | 99.7 | 4.06 | 121 | 4.86 | 137 | 5.57 | 154 | 6.31 | 170 | 7.24 | 181 | 7.90 | 197 | 8.65 | |
| | 72 | 150 | 6.31 | 182 | 8.30 | 206 | 9.97 | 219 | 10.9 | 224 | 10.9 | 227 | 10.9 | 231 | 11.0 | 72 | 99.7 | 4.00 | 121 | 4.91 | 137 | 5.63 | 154 | 6.54 | 170 | 7.52 | 181 | 8.21 | 197 | 9.31 | |
| | 75 | 150 | 6.67 | 182 | 8.78 | 206 | 10.6 | 217 | 11.2 | 221 | 11.3 | 224 | 11.3 | 229 | 11.4 | 75 | 99.7 | 4.06 | 121 | 5.06 | 137 | 5.95 | 154 | 6.92 | 170 | 7.96 | 181 | 8.69 | 197 | 9.86 | |
| | 79 | 150 | 7.17 | 182 | 9.46 | 206 | 11.4 | 213 | 11.7 | 218 | 11.8 | 221 | 11.9 | 225 | 12.0 | 79 | 99.7 | 4.28 | 121 | 5.43 | 137 | 6.40 | 154 | 7.44 | 170 | 8.57 | 181 | 9.36 | 197 | 10.6 | |
| | 83 | 150 | 7.70 | 182 | 10.2 | 205 | 12.2 | 210 | 12.3 | 214 | 12.4 | 217 | 12.4 | 222 | 12.5 | 83 | 99.7 | 4.58 | 121 | 5.83 | 137 | 6.87 | 154 | 8.00 | 170 | 9.21 | 181 | 10.1 | 197 | 11.4 | |
| | 87 | 150 | 8.27 | 182 | 10.9 | 202 | 12.7 | 206 | 12.8 | 211 | 12.9 | 214 | 13.0 | 218 | 13.1 | 87 | 99.7 | 4.89 | 121 | 6.24 | 137 | 7.36 | 154 | 8.58 | 170 | 9.90 | 181 | 10.8 | 197 | 12.3 | |
| | 91 | 150 | 8.86 | 182 | 11.8 | 198 | 13.2 | 203 | 13.3 | 207 | 13.5 | 210 | 13.5 | 215 | 13.6 | 91 | 99.7 | 5.22 | 121 | 6.68 | 137 | 7.89 | 154 | 9.21 | 170 | 10.6 | 181 | 11.6 | 196 | 13.2 | |
| 93 | 150 | 9.18 | 182 | 12.2 | 196 | 13.5 | 201 | 13.6 | 205 | 13.7 | 208 | 13.8 | 213 | 13.9 | 93 | 99.7 | 5.39 | 121 | 6.90 | 137 | 8.16 | 154 | 9.53 | 170 | 11.0 | 181 | 12.1 | 195 | 13.5 | | |
| 95 | 150 | 9.50 | 182 | 12.6 | 195 | 13.8 | 199 | 13.9 | 204 | 14.0 | 207 | 14.1 | 210 | 14.2 | 95 | 99.7 | 5.57 | 121 | 7.14 | 137 | 8.45 | 154 | 9.87 | 170 | 11.4 | 181 | 12.5 | 195 | 13.7 | | |
| 99 | 150 | 10.2 | 182 | 13.5 | 191 | 14.3 | 196 | 14.4 | 200 | 14.6 | 202 | 14.6 | 202 | 14.6 | 99 | 99.7 | 5.94 | 121 | 7.63 | 137 | 9.04 | 154 | 10.6 | 170 | 12.2 | 181 | 13.4 | 189 | 14.3 | | |
| 103 | 150 | 10.9 | 182 | 14.5 | 188 | 14.9 | 192 | 15.0 | 193 | 15.0 | 193 | 15.0 | 193 | 15.0 | 103 | 99.7 | 6.33 | 121 | 8.15 | 137 | 9.67 | 154 | 11.3 | 170 | 13.1 | 181 | 14.4 | 192 | 14.8 | | |
| 106 | 150 | 11.6 | 181 | 15.3 | 185 | 15.5 | 187 | 15.5 | 187 | 15.5 | 187 | 15.5 | 187 | 15.5 | 106 | 99.7 | 6.73 | 121 | 8.68 | 137 | 10.3 | 154 | 12.1 | 170 | 14.0 | 180 | 15.3 | 183 | 15.4 | | |
| 110 | 150 | 12.7 | 177 | 16.2 | 178 | 16.2 | 178 | 16.2 | 178 | 16.2 | 178 | 16.2 | 178 | 16.2 | 110 | 99.7 | 7.31 | 121 | 9.45 | 137 | 11.2 | 154 | 13.2 | 170 | 15.3 | 177 | 16.2 | 178 | 16.2 | | |
| 115 | 150 | 14.1 | 154 | 16.4 | 154 | 16.4 | 155 | 16.4 | 155 | 16.4 | 155 | 16.4 | 155 | 16.5 | 115 | 99.7 | 8.09 | 121 | 10.5 | 137 | 12.5 | 154 | 14.7 | 155 | 16 | | | | | | |

RXYQ216PBTJ

Capacity tables for RXYQ216PBTJ heat pump. The table is organized into four main sections based on indoor air temperature (°FWB) and outdoor air temperature (°FDB). Each section contains a grid of data points for various indoor and outdoor conditions, showing capacity (TC) and power input (PI) for different fan motor configurations (MBH, kW).

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

RXYQ240PBTJ

| Combination | Outdoor air temp. | Indoor air temp. °FWB | | | | | | | | | | | | | | | Combination | Outdoor air temp. | Indoor air temp. °FWB | | | | | | | | | | | | | | | | | | | | | | | | | | |
|-------------|-------------------|-----------------------|------|------|------|------|------|------|------|------|------|------|------|------|------|-----|-------------|-------------------|-----------------------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| | | 57 | | | 61 | | | 64 | | | 67 | | | 70 | | | | | 72 | | | 75 | | | 57 | | | 61 | | | 64 | | | 67 | | | 70 | | | 72 | | | 75 | | |
| | | TC | PI | MBH | TC | PI | MBH | TC | PI | MBH | TC | PI | MBH | TC | PI | MBH | | | TC | PI | MBH | TC | PI | MBH | TC | PI | MBH | TC | PI | MBH | TC | PI | MBH | TC | PI | MBH | | | | | | | | | |
| 130 | 23 | 202 | 7.05 | 246 | 8.78 | 279 | 10.1 | 312 | 11.5 | 338 | 12.5 | 342 | 12.2 | 348 | 11.9 | 23 | 140 | 4.80 | 170 | 5.86 | 193 | 6.70 | 216 | 7.57 | 239 | 8.48 | 254 | 9.10 | 277 | 10.0 | 23 | 140 | 4.80 | 170 | 5.86 | 193 | 6.70 | 216 | 7.57 | 239 | 8.48 | 254 | 9.10 | 277 | 10.0 |
| | 30 | 202 | 7.27 | 246 | 9.07 | 279 | 10.5 | 312 | 11.9 | 330 | 12.4 | 334 | 12.1 | 340 | 11.7 | 40 | 140 | 4.94 | 170 | 6.04 | 193 | 6.91 | 216 | 7.82 | 239 | 8.76 | 254 | 9.40 | 277 | 10.4 | 40 | 140 | 5.15 | 170 | 6.31 | 193 | 7.23 | 216 | 8.19 | 239 | 9.18 | 254 | 9.86 | 277 | 10.9 |
| | 40 | 202 | 7.62 | 246 | 9.52 | 279 | 11.0 | 312 | 12.5 | 319 | 12.2 | 323 | 11.9 | 330 | 11.5 | 50 | 140 | 5.38 | 170 | 6.61 | 193 | 7.59 | 216 | 8.61 | 239 | 9.65 | 254 | 10.4 | 277 | 11.5 | 50 | 140 | 5.81 | 170 | 7.17 | 193 | 8.25 | 216 | 9.37 | 239 | 10.5 | 254 | 11.5 | 277 | 13.1 |
| | 50 | 202 | 8.00 | 246 | 10.0 | 279 | 11.6 | 302 | 12.4 | 308 | 12.0 | 313 | 11.7 | 319 | 11.3 | 54 | 140 | 5.48 | 170 | 6.74 | 193 | 7.75 | 216 | 8.79 | 239 | 9.86 | 254 | 10.6 | 277 | 11.9 | 54 | 140 | 5.99 | 170 | 7.40 | 193 | 8.75 | 216 | 10.2 | 239 | 11.5 | 254 | 12.9 | 272 | 14.3 |
| | 58 | 202 | 8.33 | 246 | 10.4 | 279 | 12.1 | 294 | 12.3 | 300 | 12.0 | 304 | 12.1 | 310 | 12.2 | 58 | 140 | 5.58 | 170 | 6.88 | 193 | 7.91 | 216 | 8.97 | 239 | 10.1 | 254 | 10.8 | 277 | 11.9 | 62 | 140 | 5.89 | 170 | 7.02 | 193 | 8.07 | 216 | 9.10 | 239 | 10.2 | 254 | 11.0 | 272 | 12.2 |
| | 62 | 202 | 8.51 | 246 | 10.7 | 279 | 12.3 | 289 | 12.6 | 295 | 12.7 | 300 | 12.8 | 306 | 12.7 | 66 | 140 | 5.81 | 170 | 7.17 | 193 | 8.25 | 216 | 9.37 | 239 | 10.5 | 254 | 11.5 | 277 | 13.1 | 70 | 140 | 5.93 | 170 | 7.32 | 193 | 8.43 | 216 | 9.84 | 239 | 11.4 | 254 | 12.4 | 274 | 13.9 |
| | 66 | 202 | 8.70 | 246 | 11.0 | 279 | 13.2 | 285 | 13.3 | 291 | 13.4 | 295 | 13.5 | 301 | 13.6 | 72 | 140 | 5.99 | 170 | 7.40 | 193 | 8.75 | 216 | 10.2 | 239 | 11.5 | 254 | 12.9 | 272 | 14.3 | 75 | 140 | 6.09 | 170 | 7.81 | 193 | 9.25 | 216 | 10.8 | 239 | 12.5 | 254 | 13.7 | 269 | 14.8 |
| | 70 | 202 | 8.98 | 246 | 11.9 | 274 | 13.9 | 281 | 14.0 | 287 | 14.1 | 291 | 14.2 | 297 | 14.3 | 72 | 140 | 5.99 | 170 | 7.40 | 193 | 8.75 | 216 | 10.2 | 239 | 11.5 | 254 | 12.9 | 272 | 14.3 | 75 | 140 | 6.09 | 170 | 7.81 | 193 | 9.25 | 216 | 10.8 | 239 | 12.5 | 254 | 13.7 | 269 | 14.8 |
| | 72 | 202 | 9.33 | 246 | 12.4 | 272 | 14.3 | 278 | 14.4 | 285 | 14.5 | 289 | 14.6 | 295 | 14.7 | 75 | 140 | 6.09 | 170 | 7.81 | 193 | 9.25 | 216 | 10.8 | 239 | 12.5 | 254 | 13.7 | 269 | 14.8 | 79 | 140 | 6.53 | 170 | 8.40 | 193 | 9.95 | 216 | 11.6 | 239 | 13.5 | 254 | 14.8 | 264 | 15.5 |
| | 75 | 202 | 9.87 | 246 | 13.1 | 269 | 14.8 | 275 | 14.9 | 281 | 15.0 | 285 | 15.1 | 292 | 15.3 | 83 | 140 | 7.00 | 170 | 9.01 | 193 | 10.7 | 216 | 12.5 | 239 | 14.5 | 254 | 15.9 | 260 | 16.2 | 87 | 140 | 7.49 | 170 | 9.68 | 193 | 11.5 | 216 | 13.5 | 239 | 15.6 | 251 | 16.8 | 256 | 16.9 |
| | 79 | 202 | 10.6 | 246 | 14.1 | 265 | 15.5 | 271 | 15.6 | 277 | 15.8 | 281 | 15.9 | 287 | 16.0 | 83 | 140 | 7.00 | 170 | 9.01 | 193 | 10.7 | 216 | 12.5 | 239 | 14.5 | 254 | 15.9 | 260 | 16.2 | 91 | 140 | 8.00 | 170 | 10.4 | 193 | 12.3 | 216 | 14.5 | 239 | 16.8 | 247 | 17.5 | 251 | 17.6 |
| | 83 | 202 | 11.4 | 246 | 15.2 | 260 | 16.2 | 266 | 16.4 | 273 | 16.5 | 277 | 16.6 | 283 | 16.7 | 93 | 140 | 8.27 | 170 | 10.7 | 193 | 12.8 | 216 | 15.0 | 239 | 17.4 | 245 | 17.9 | 249 | 18.0 | 95 | 140 | 8.55 | 170 | 11.1 | 193 | 13.2 | 216 | 15.5 | 239 | 18.0 | 243 | 18.2 | 247 | 18.3 |
| | 87 | 202 | 12.3 | 246 | 16.4 | 256 | 16.9 | 262 | 17.1 | 268 | 17.2 | 272 | 17.3 | 279 | 17.5 | 99 | 140 | 9.13 | 170 | 11.9 | 193 | 14.1 | 216 | 16.6 | 239 | 18.5 | 238 | 18.9 | 243 | 19.1 | 103 | 140 | 9.75 | 170 | 12.7 | 193 | 15.2 | 216 | 17.8 | 231 | 19.6 | 234 | 19.7 | 238 | 19.8 |
| | 91 | 202 | 13.2 | 246 | 17.5 | 252 | 17.6 | 258 | 17.8 | 264 | 18.0 | 268 | 18.1 | 274 | 18.2 | 106 | 140 | 10.4 | 170 | 13.5 | 193 | 16.2 | 216 | 19.1 | 228 | 20.4 | 231 | 20.5 | 234 | 20.6 | 110 | 140 | 11.3 | 170 | 14.7 | 193 | 17.6 | 216 | 20.8 | 223 | 21.5 | 223 | 21.5 | 223 | 21.5 |
| | 93 | 202 | 13.6 | 243 | 17.8 | 249 | 18.0 | 256 | 18.2 | 262 | 18.3 | 266 | 18.4 | 268 | 18.5 | 110 | 140 | 11.5 | 170 | 16.4 | 193 | 21.7 | 193 | 21.7 | 194 | 21.8 | 194 | 21.8 | 194 | 21.8 | 194 | 21.8 | 115 | 140 | 12.5 | 170 | 17.3 | 193 | 21.7 | 193 | 21.7 | 193 | 21.7 | 193 | 21.8 |
| | 95 | 202 | 14.1 | 241 | 18.2 | 247 | 18.4 | 253 | 18.5 | 260 | 18.7 | 263 | 18.8 | 263 | 18.8 | 115 | 140 | 12.5 | 170 | 17.3 | 193 | 21.7 | 193 | 21.7 | 193 | 21.7 | 193 | 21.8 | 194 | 21.8 | 118 | 140 | 13.3 | 167 | 18.4 | 168 | 18.4 | 168 | 18.4 | 168 | 18.4 | 168 | 18.5 | | |
| | 99 | 202 | 15.1 | 237 | 18.9 | 243 | 19.1 | 249 | 19.3 | 252 | 19.4 | 252 | 19.4 | 252 | 19.4 | 118 | 140 | 13.3 | 167 | 18.4 | 168 | 18.4 | 168 | 18.4 | 168 | 18.4 | 168 | 18.4 | 168 | 18.5 | 122 | 133 | 13.9 | 134 | 13.9 | 134 | 14.0 | 135 | 14.0 | 135 | 14.0 | 135 | 14.0 | | |
| 103 | 202 | 16.2 | 232 | 19.6 | 239 | 19.8 | 241 | 19.9 | 242 | 19.9 | 242 | 19.9 | 242 | 19.9 | 122 | 133 | 13.9 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 |
| 106 | 202 | 17.3 | 229 | 20.4 | 233 | 20.6 | 233 | 20.6 | 234 | 20.6 | 234 | 20.6 | 234 | 20.6 | 122 | 133 | 13.9 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 |
| 110 | 202 | 18.9 | 223 | 21.5 | 223 | 21.5 | 223 | 21.5 | 223 | 21.5 | 223 | 21.5 | 223 | 21.5 | 110 | 140 | 11.3 | 170 | 14.7 | 193 | 17.6 | 216 | 20.8 | 223 | 21.5 | 223 | 21.5 | 223 | 21.5 | 115 | 140 | 12.5 | 170 | 16.4 | 193 | 21.7 | 193 | 21.7 | 193 | 21.7 | 193 | 21.8 | | | |
| 115 | 192 | 21.7 | 192 | 21.7 | 193 | 21.7 | 193 | 21.7 | 193 | 21.8 | 194 | 21.8 | 194 | 21.8 | 115 | 140 | 12.5 | 170 | 16.4 | 193 | 21.7 | 193 | 21.7 | 193 | 21.7 | 193 | 21.8 | 194 | 21.8 | 118 | 140 | 13.3 | 167 | 18.4 | 168 | 18.4 | 168 | 18.4 | 168 | 18.4 | 168 | 18.5 | | | |
| 118 | 167 | 18.3 | 167 | 18.4 | 168 | 18.4 | 168 | 18.4 | 168 | 18.4 | 168 | 18.4 | 168 | 18.5 | 122 | 133 | 13.9 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 | 134 | 13.9 | | |
| 122 | 133 | 13.9 | 134 | 13.9 | 134 | 14.0 | 134 | 14.0 | 135 | 14.0 | 135 | 14.0 | 135 | 14.0 | 23 | 125 | 4.29 | 152 | 5.19 | 172 | 5.91 | 192 | 6.65 | 212 | 7.43 | 226 | 7.96 | 246 | 8.77 | 30 | 125 | 4.41 | 152 | 5.34 | 172 | 6.08 | 192 | 6.86 | 212 | 7.66 | 226 | 8.21 | 246 | 9.06 | |
| 120 | 23 | 187 | 6.66 | 227 | 8.28 | 258 | 9.56 | 288 | 10.9 | 318 | 12.2 | 329 | 12.4 | 335 | 12.1 | 30 | 125 | 4.41 | 152 | 5.34 | 172 | 6.08 | 192 | 6.86 | 212 | 7.66 | 226 | 8.21 | 246 | 9.06 | 40 | 125 | 4.59 | 152 | 5.57 | 172 | 6.36 | 192 | 7.18 | 212 | 8.03 | 226 | 8.61 | 246 | 9.50 |
| | 30 | 187 | 6.97 | 227 | 8.68 | 258 | 10.0 | 288 | 11.4 | 314 | 12.5 | 318 | 12.3 | 324 | 11.9 | 50 | 125 | 4.78 | 152 | 5.83 | 172 | 6.67 | 192 | 7.54 | 212 | 8.44 | 226 | 9.05 | 246 | 9.99 | 54 | 125 | 4.87 | 152 | 5.94 | 172 | 6.80 | 192 | 7.69 | 212 | 8.61 | 226 | 9.24 | 246 | 10.2 |
| | 40 | 187 | 7.31 | 227 | 9.13 | 258 | 10.5 | 288 | 12.0 | 303 | 12.4 | 307 | 12.1 | 313 | 11.7 | 58 | 125 | 5.15 | 152 | 6.06 | 172 | 6.94 | 192 | 7.85 | 212 | 8.79 | 226 | 9.44 | 246 | 10.4 | 62 | 125 | 5.06 | 152 | 6.18 | 172 | 7.08 | 192 | 8.01 | 212 | 8.98 | 226 | 9.64 | 246 | 10.6 |
| | 54 | 187 | 7.46 | 227 | 9.32 | 258 | 10.8 | 288 | 12.2 | 299 | 12.3 | 303 | 12.0 | 309 | 11.6 | 66 | 125 | 5.15 | 152 | 6.31 | 172 | 7.23 | 192 | 8.19 | 212 | 9.18 | 226 | 9.85 | 246 | 11.0 | 70 | 125 | 5.25 | 152 | 6.44 | 172 | 7.39 | 192 | 8.37 | 212 | 9.20 | 226 | 10.5 | 246 | 11.9 |
| | 58 | 187 | 7.61 | 227 | 9.51 | 258 | 11.0 | 288 | 12.5 | 295 | 12.2 | 29 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |

RXYQ264PBTJ

| Combination | Outdoor air temp. | Indoor air temp. °FWB | | | | | | | | | | | | | | | | | | | | | | | | Combination | Outdoor air temp. | Indoor air temp. °FWB | | | | | | | | | | | | | | | | | | | | | | | |
|-------------|-------------------|-----------------------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|-------------|-------------------|-----------------------|------|------|------|------|------|--|--|--|--|--|--|--|--|--|--|--|--|--|--|--|--|--|--|
| | | 57 | | 61 | | 64 | | 67 | | 70 | | 72 | | 75 | | 57 | | 61 | | 64 | | 67 | | 70 | | | | 72 | | 75 | | | | | | | | | | | | | | | | | | | | | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | | | TC | PI | TC | PI | | | | | | | | | | | | | | | | | | | | |
| 130 | 23 | 223 | 7.37 | 271 | 9.19 | 307 | 10.6 | 343 | 12.1 | 371 | 13.1 | 376 | 12.8 | 383 | 12.4 | 23 | 154 | 5.03 | 188 | 6.13 | 213 | 7.01 | 238 | 7.92 | 263 | 8.87 | 279 | 9.52 | 304 | 10.5 | | | | | | | | | | | | | | | | | | | | | |
| | 120 | 23 | 223 | 7.37 | 271 | 9.19 | 307 | 10.6 | 343 | 12.1 | 371 | 13.1 | 376 | 12.8 | 383 | 12.4 | 23 | 154 | 5.03 | 188 | 6.13 | 213 | 7.01 | 238 | 7.92 | 263 | 8.87 | 279 | 9.52 | 304 | 10.5 | | | | | | | | | | | | | | | | | | | | |
| | | 110 | 23 | 188 | 6.35 | 229 | 7.86 | 260 | 9.05 | 290 | 10.3 | 321 | 11.5 | 341 | 12.4 | 362 | 13.0 | 23 | 120 | 4.08 | 146 | 4.90 | 165 | 5.54 | 185 | 6.22 | 204 | 6.92 | 217 | 7.40 | 237 | 8.14 | | | | | | | | | | | | | | | | | | | |
| | | | 100 | 23 | 171 | 5.58 | 208 | 6.86 | 236 | 7.87 | 264 | 8.92 | 292 | 10.0 | 310 | 10.7 | 338 | 11.9 | 23 | 103 | 3.50 | 125 | 4.13 | 142 | 4.64 | 158 | 5.16 | 175 | 5.71 | 186 | 6.08 | 203 | 6.86 | | | | | | | | | | | | | | | | | | |

TC: Total capacity ; MBH
 PI: Power Input ; kW (Comp.+Outdoor fan motor)
 Note1: [Grey Box] is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

RXYQ288PBTJ

Main capacity table with columns for Outdoor air temp., Indoor air temp. °FWB, and Capacity (TC, PI, MBH, kW) for various combinations and air temperatures.

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)

Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

RXYQ312PBTJ

Large table with columns for Combination, Outdoor air temp., Indoor air temp. °FWB, and Capacity (TC, PI) for various conditions across different models (130, 120, 110, 100).

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

RXYQ336PBTJ

Large table with columns for Combination, Outdoor air temp., Indoor air temp. °FWB, and various capacity metrics (MBH, kW, PI, TC) for different conditions. The table is organized into multiple sections based on capacity ranges (130, 120, 110, 100) and outdoor air temperatures (57, 61, 64, 67, 70, 72, 75).

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

RXYQ360PBTJ

Table with columns: Combina-tion, Outdoor air temp., Indoor air temp. °FWB (57, 61, 64, 67, 70, 72, 75), and kW/MBH. Rows include values for 130, 120, 110, and 100.

Table with columns: Combina-tion, Outdoor air temp., Indoor air temp. °FWB (57, 61, 64, 67, 70, 72, 75), and kW/MBH. Rows include values for 90, 80, 70, and 60.

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

7.2 Heating Capacity (RXYQ-PBTJ)

RXYQ72PBTJ

| Combination | Outdoor air temp. | Indoor air temp. °FDB | | | | | | | | | | | | | | | | | | | | | | | | |
|-------------|-------------------|-----------------------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| | | 61 | | | | 65 | | | | 68 | | | | 70 | | | | 72 | | | | 75 | | | | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC |
| % | *FDB | *FWB | MBH | kW | MBH | kW | MBH | kW | MBH | kW | MBH | kW | MBH | kW | MBH | kW | MBH | kW | MBH | kW | MBH | kW | MBH | kW | MBH | kW |
| 130 | -3.64 | -4.0 | 57.8 | 4.82 | 57.6 | 5.16 | 57.4 | 5.42 | 57.3 | 5.59 | 57.2 | 5.76 | 57.0 | 6.02 | 56.8 | 6.35 | 56.6 | 6.73 | 56.5 | 6.90 | 56.4 | 7.02 | 56.3 | 7.14 | 56.2 | 7.32 |
| | -1.84 | -2.2 | 59.5 | 4.98 | 59.3 | 5.32 | 59.2 | 5.57 | 59.0 | 5.74 | 58.9 | 5.90 | 58.8 | 6.15 | 58.5 | 6.50 | 58.3 | 6.84 | 58.2 | 7.01 | 58.1 | 7.13 | 58.0 | 7.24 | 57.9 | 7.42 |
| | 5.5 | 5.0 | 66.4 | 5.57 | 66.0 | 6.09 | 65.9 | 6.24 | 65.8 | 6.39 | 65.6 | 6.61 | 65.4 | 6.81 | 65.1 | 7.16 | 64.9 | 7.50 | 64.8 | 7.65 | 64.7 | 7.78 | 64.6 | 7.91 | 64.5 | 8.04 |
| | 9.5 | 8.5 | 69.8 | 5.81 | 69.5 | 6.09 | 69.4 | 6.31 | 69.3 | 6.45 | 69.2 | 6.59 | 69.0 | 6.80 | 68.7 | 7.16 | 68.5 | 7.50 | 68.4 | 7.65 | 68.3 | 7.78 | 68.2 | 7.91 | 68.1 | 8.04 |
| | 13.0 | 12.0 | 73.1 | 6.03 | 72.9 | 6.30 | 72.7 | 6.50 | 72.6 | 6.64 | 72.5 | 6.77 | 72.3 | 6.98 | 72.0 | 7.33 | 71.8 | 7.67 | 71.7 | 7.82 | 71.6 | 7.95 | 71.5 | 8.08 | 71.4 | 8.21 |
| | 15.0 | 14.0 | 75.0 | 6.15 | 74.8 | 6.41 | 74.6 | 6.61 | 74.4 | 6.74 | 74.4 | 6.87 | 74.2 | 7.07 | 73.9 | 7.42 | 73.7 | 7.76 | 73.6 | 7.91 | 73.5 | 8.04 | 73.4 | 8.17 | 73.3 | 8.30 |
| | 17.0 | 15.5 | 76.5 | 6.23 | 76.2 | 6.49 | 76.1 | 6.68 | 76.0 | 6.81 | 75.8 | 6.94 | 75.7 | 7.13 | 75.4 | 7.48 | 75.2 | 7.82 | 75.1 | 7.97 | 75.0 | 8.10 | 74.9 | 8.23 | 74.8 | 8.36 |
| | 19.0 | 18.0 | 78.8 | 6.36 | 78.6 | 6.61 | 78.5 | 6.80 | 78.3 | 6.92 | 78.2 | 7.05 | 78.1 | 7.24 | 77.8 | 7.59 | 77.6 | 7.93 | 77.5 | 8.08 | 77.4 | 8.21 | 77.3 | 8.34 | 77.2 | 8.47 |
| | 22.0 | 20.0 | 80.6 | 6.46 | 80.5 | 6.71 | 80.4 | 6.89 | 80.2 | 7.01 | 80.1 | 7.13 | 80.0 | 7.32 | 79.7 | 7.67 | 79.5 | 8.01 | 79.4 | 8.16 | 79.3 | 8.29 | 79.2 | 8.42 | 79.1 | 8.55 |
| | 26.0 | 24.0 | 84.6 | 6.65 | 84.4 | 6.88 | 84.2 | 7.06 | 84.1 | 7.17 | 84.0 | 7.29 | 83.8 | 7.46 | 83.5 | 7.81 | 83.3 | 8.15 | 83.2 | 8.30 | 83.1 | 8.43 | 83.0 | 8.56 | 82.9 | 8.69 |
| | 30.0 | 28.0 | 88.4 | 6.82 | 88.2 | 7.04 | 88.0 | 7.21 | 87.9 | 7.32 | 87.8 | 7.43 | 87.6 | 7.60 | 87.3 | 7.95 | 87.1 | 8.29 | 87.0 | 8.44 | 86.9 | 8.57 | 86.8 | 8.70 | 86.7 | 8.83 |
| | 35.0 | 32.0 | 92.2 | 6.98 | 92.0 | 7.19 | 91.8 | 7.35 | 91.7 | 7.46 | 91.6 | 7.56 | 91.4 | 7.72 | 91.1 | 8.07 | 90.9 | 8.41 | 90.8 | 8.56 | 90.7 | 8.69 | 90.6 | 8.82 | 90.5 | 8.95 |
| | 39.0 | 36.0 | 96.0 | 7.12 | 95.8 | 7.33 | 95.6 | 7.48 | 95.5 | 7.58 | 95.4 | 7.68 | 95.3 | 7.84 | 95.0 | 8.19 | 94.8 | 8.53 | 94.7 | 8.68 | 94.6 | 8.81 | 94.5 | 8.94 | 94.4 | 9.07 |
| | 44.0 | 40.0 | 99.9 | 7.26 | 99.6 | 7.45 | 99.5 | 7.60 | 99.4 | 7.70 | 99.2 | 7.80 | 99.0 | 7.95 | 98.7 | 8.30 | 98.5 | 8.64 | 98.4 | 8.79 | 98.3 | 8.92 | 98.2 | 9.05 | 98.1 | 9.18 |
| | 47.0 | 43.0 | 103 | 7.35 | 102 | 7.54 | 102 | 7.68 | 102 | 7.78 | 101 | 7.89 | 101 | 7.99 | 100 | 8.34 | 99.8 | 8.68 | 99.7 | 8.83 | 99.6 | 8.96 | 99.5 | 9.09 | 99.4 | 9.22 |
| | 51.0 | 47.0 | 107 | 7.47 | 106 | 7.65 | 106 | 7.79 | 105 | 7.89 | 105 | 7.99 | 104 | 8.09 | 103 | 8.44 | 102 | 8.78 | 102 | 8.93 | 101 | 9.06 | 101 | 9.19 | 100 | 9.32 |
| | 54.0 | 50.0 | 109 | 7.55 | 109 | 7.73 | 109 | 7.86 | 109 | 7.95 | 109 | 8.04 | 108 | 8.14 | 107 | 8.49 | 106 | 8.83 | 106 | 8.98 | 105 | 9.11 | 105 | 9.24 | 104 | 9.37 |
| 57.0 | 53.0 | 112 | 7.63 | 112 | 7.80 | 109 | 7.93 | 105 | 7.99 | 101 | 8.09 | 95.6 | 6.47 | 91.4 | 6.80 | 91.2 | 7.14 | 91.0 | 7.29 | 90.9 | 7.42 | 90.8 | 7.55 | 90.7 | 7.68 | |
| 60.0 | 56.0 | 115 | 7.71 | 115 | 7.88 | 109 | 7.63 | 105 | 7.06 | 101 | 6.94 | 95.6 | 6.27 | 91.4 | 6.57 | 91.2 | 6.91 | 91.0 | 7.06 | 90.9 | 7.19 | 90.8 | 7.32 | 90.7 | 7.45 | |

TC: Total capacity ; MBH
 PI: Power Input ; kW (Comp.+Outdoor fan motor)
 Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

RXYQ96PBTJ

Capacity tables for RXYQ96PBTJ heat pump. The table is organized into four main sections based on indoor air temperature (°FDB) and outdoor air temperature (°FDB and °FWB). Each section contains a grid of TC (Total Capacity) and PI (Power Input) values for various combinations of indoor and outdoor temperatures. The indoor air temperature ranges from 61°F to 75°F, and the outdoor air temperature ranges from -3.64°F to 60°F. The table is divided into four quadrants: 130, 120, 110, and 100, representing different capacity levels.

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

RXYQ120PBTJ

Capacity tables for RXYQ120PBTJ heat pump, showing TC (Total capacity) and PI (Power Input) for various outdoor air temperatures and indoor air conditions. The tables are organized by combination (90, 100, 110, 120) and include sub-tables for different indoor air temperatures (61, 65, 68, 70, 72, 75).

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

RXYQ144PBTJ

| Combination | Outdoor air temp. | Indoor air temp. °FDB | | | | | | | | | | | | | | | |
|-------------|-------------------|-----------------------|------|------|------|-------|------|------|------|------|------|-------|------|------|----|-----|----|
| | | 61 | | 65 | | 68 | | 70 | | 72 | | 75 | | | | | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | | | | |
| 130 | % | FDB | FWB | MBH | kW | MBH | kW | MBH | kW | MBH | kW | MBH | kW | MBH | kW | MBH | kW |
| | -3.64 | -4.0 | 93.8 | 5.49 | 93.4 | 6.25 | 93.1 | 6.82 | 92.8 | 7.20 | 92.6 | 7.58 | 92.3 | 8.15 | | | |
| | -1.84 | -2.2 | 95.5 | 5.71 | 95.0 | 6.46 | 94.7 | 7.02 | 94.4 | 7.39 | 94.2 | 7.76 | 93.9 | 8.32 | | | |
| | 9.5 | 5.0 | 103 | 6.64 | 103 | 7.52 | 102 | 8.4 | 102 | 8.18 | 102 | 8.53 | 101 | 9.04 | | | |
| | 13.0 | 12.0 | 112 | 7.57 | 112 | 8.20 | 111 | 8.67 | 111 | 8.99 | 111 | 9.30 | 110 | 9.77 | | | |
| | 15.0 | 14.0 | 115 | 7.84 | 114 | 8.45 | 114 | 8.91 | 114 | 9.22 | 114 | 9.52 | 113 | 9.98 | | | |
| | 17.0 | 15.5 | 117 | 8.04 | 117 | 8.64 | 116 | 9.09 | 116 | 9.39 | 116 | 9.69 | 116 | 10.1 | | | |
| | 19.0 | 18.0 | 121 | 8.37 | 121 | 8.94 | 120 | 9.38 | 120 | 9.67 | 120 | 9.96 | 120 | 10.4 | | | |
| | 22.0 | 20.0 | 124 | 8.62 | 124 | 9.19 | 124 | 9.61 | 123 | 9.89 | 123 | 10.2 | 123 | 10.6 | | | |
| | 30.0 | 24.0 | 131 | 9.13 | 131 | 9.66 | 131 | 10.1 | 130 | 10.3 | 130 | 10.6 | 130 | 11.0 | | | |
| | 35.0 | 32.0 | 147 | 10.1 | 147 | 10.5 | 146 | 10.9 | 146 | 11.1 | 146 | 11.4 | 146 | 11.7 | | | |
| | 39.0 | 36.0 | 156 | 10.5 | 155 | 11.0 | 155 | 11.3 | 155 | 11.5 | 155 | 11.7 | 154 | 12.1 | | | |
| 44.0 | 40.0 | 165 | 10.9 | 165 | 11.3 | 164 | 11.6 | 164 | 11.9 | 164 | 12.1 | 163 | 12.4 | | | | |
| 47.0 | 43.0 | 172 | 11.2 | 172 | 11.6 | 172 | 11.9 | 171 | 12.1 | 171 | 12.3 | 171 | 12.6 | | | | |
| 51.0 | 47.0 | 183 | 11.6 | 182 | 12.0 | 182 | 12.2 | 182 | 12.4 | 181 | 12.6 | 181 | 12.9 | | | | |
| 54.0 | 50.0 | 191 | 11.8 | 190 | 12.2 | 190 | 12.5 | 190 | 12.7 | 189 | 12.8 | 189 | 13.1 | | | | |
| 57.0 | 53.0 | 199 | 12.1 | 198 | 12.4 | 198 | 12.7 | 198 | 12.9 | 198 | 13.0 | 191 | 12.6 | | | | |
| 60.0 | 56.0 | 207 | 12.3 | 207 | 12.7 | 207 | 12.9 | 206 | 13.1 | 203 | 12.9 | 191 | 12.7 | | | | |
| 120 | % | FDB | FWB | MBH | kW | MBH | kW | MBH | kW | MBH | kW | MBH | kW | MBH | kW | MBH | kW |
| | -3.64 | -4.0 | 93.3 | 6.41 | 92.9 | 7.11 | 92.6 | 7.64 | 92.4 | 7.99 | 92.2 | 8.34 | 91.9 | 8.87 | | | |
| | -1.84 | -2.2 | 94.9 | 6.61 | 94.5 | 7.30 | 94.2 | 7.82 | 94.0 | 8.16 | 93.8 | 8.51 | 93.5 | 9.02 | | | |
| | 9.5 | 5.0 | 102 | 7.47 | 102 | 8.10 | 102 | 8.58 | 102 | 8.90 | 101 | 9.22 | 101 | 9.69 | | | |
| | 13.0 | 12.0 | 111 | 8.33 | 111 | 8.91 | 111 | 9.35 | 111 | 9.64 | 110 | 9.93 | 110 | 10.4 | | | |
| | 15.0 | 14.0 | 114 | 8.58 | 114 | 9.15 | 114 | 9.57 | 113 | 9.85 | 113 | 10.1 | 113 | 10.6 | | | |
| | 17.0 | 15.5 | 117 | 8.76 | 116 | 9.32 | 116 | 9.73 | 116 | 10.0 | 115 | 10.3 | 115 | 10.7 | | | |
| | 19.0 | 18.0 | 121 | 9.07 | 120 | 9.60 | 120 | 10.0 | 120 | 10.3 | 119 | 10.5 | 119 | 10.9 | | | |
| | 22.0 | 20.0 | 124 | 9.31 | 123 | 9.82 | 123 | 10.2 | 123 | 10.5 | 123 | 10.7 | 122 | 11.1 | | | |
| | 30.0 | 24.0 | 131 | 9.77 | 130 | 10.3 | 130 | 10.6 | 130 | 10.9 | 130 | 11.1 | 129 | 11.5 | | | |
| | 35.0 | 32.0 | 147 | 10.6 | 146 | 11.1 | 146 | 11.4 | 145 | 11.6 | 145 | 11.8 | 145 | 12.2 | | | |
| | 39.0 | 36.0 | 155 | 11.0 | 155 | 11.5 | 155 | 11.8 | 154 | 12.0 | 154 | 12.2 | 154 | 12.5 | | | |
| 44.0 | 40.0 | 164 | 11.4 | 164 | 11.8 | 164 | 12.1 | 164 | 12.3 | 163 | 12.5 | 162 | 12.8 | | | | |
| 47.0 | 43.0 | 172 | 11.7 | 171 | 12.1 | 171 | 12.3 | 171 | 12.5 | 171 | 12.7 | 170 | 13.0 | | | | |
| 51.0 | 47.0 | 182 | 12.0 | 182 | 12.4 | 181 | 12.6 | 181 | 12.8 | 181 | 13.0 | 176 | 12.8 | | | | |
| 54.0 | 50.0 | 190 | 12.3 | 190 | 12.6 | 189 | 12.9 | 189 | 13.0 | 187 | 13.0 | 176 | 12.1 | | | | |
| 57.0 | 53.0 | 198 | 12.5 | 198 | 12.8 | 198 | 13.1 | 194 | 12.9 | 187 | 12.3 | 176 | 11.5 | | | | |
| 60.0 | 56.0 | 207 | 12.7 | 207 | 13.0 | 202 | 12.8 | 194 | 12.3 | 187 | 11.7 | 176 | 10.9 | | | | |
| 110 | % | FDB | FWB | MBH | kW | MBH | kW | MBH | kW | MBH | kW | MBH | kW | MBH | kW | MBH | kW |
| | -3.64 | -4.0 | 92.8 | 7.33 | 92.4 | 7.98 | 92.1 | 8.46 | 91.9 | 8.78 | 91.7 | 9.10 | 91.4 | 9.58 | | | |
| | -1.84 | -2.2 | 94.4 | 7.52 | 94.0 | 8.15 | 93.7 | 8.62 | 93.5 | 8.94 | 93.3 | 9.25 | 93.0 | 9.73 | | | |
| | 9.5 | 5.0 | 102 | 8.30 | 102 | 8.88 | 101 | 9.32 | 101 | 9.61 | 101 | 9.90 | 101 | 10.3 | | | |
| | 13.0 | 12.0 | 111 | 9.16 | 111 | 9.63 | 110 | 10.0 | 110 | 10.3 | 110 | 10.6 | 110 | 11.0 | | | |
| | 15.0 | 14.0 | 114 | 9.32 | 113 | 9.84 | 113 | 10.2 | 113 | 10.5 | 113 | 10.7 | 112 | 11.1 | | | |
| | 17.0 | 15.5 | 116 | 9.49 | 116 | 10.00 | 115 | 10.4 | 115 | 10.6 | 115 | 10.9 | 115 | 11.3 | | | |
| | 19.0 | 18.0 | 120 | 9.77 | 120 | 10.3 | 119 | 10.6 | 119 | 10.9 | 119 | 11.1 | 119 | 11.5 | | | |
| | 22.0 | 20.0 | 123 | 9.99 | 123 | 10.5 | 123 | 10.8 | 122 | 11.1 | 122 | 11.3 | 122 | 11.7 | | | |
| | 30.0 | 24.0 | 130 | 10.4 | 130 | 10.9 | 130 | 11.2 | 129 | 11.4 | 129 | 11.6 | 129 | 12.0 | | | |
| | 35.0 | 32.0 | 146 | 11.2 | 146 | 11.6 | 145 | 11.9 | 145 | 12.1 | 145 | 12.3 | 145 | 12.6 | | | |
| | 39.0 | 36.0 | 155 | 11.6 | 154 | 12.0 | 154 | 12.2 | 154 | 12.4 | 154 | 12.6 | 153 | 12.9 | | | |
| 44.0 | 40.0 | 164 | 11.9 | 164 | 12.3 | 163 | 12.6 | 163 | 12.7 | 163 | 12.9 | 162 | 13.1 | | | | |
| 47.0 | 43.0 | 171 | 12.2 | 171 | 12.5 | 171 | 12.8 | 170 | 12.9 | 170 | 13.1 | 162 | 12.4 | | | | |
| 51.0 | 47.0 | 181 | 12.5 | 181 | 12.8 | 181 | 13.1 | 178 | 12.9 | 172 | 12.4 | 162 | 11.5 | | | | |
| 54.0 | 50.0 | 189 | 12.7 | 189 | 13.0 | 185 | 12.8 | 178 | 12.3 | 172 | 11.7 | 162 | 10.9 | | | | |
| 57.0 | 53.0 | 198 | 12.9 | 195 | 12.9 | 185 | 12.8 | 178 | 11.6 | 172 | 11.1 | 162 | 10.4 | | | | |
| 60.0 | 56.0 | 206 | 13.1 | 195 | 12.3 | 185 | 11.5 | 178 | 11.1 | 172 | 10.6 | 162 | 9.89 | | | | |
| 100 | % | FDB | FWB | MBH | kW | MBH | kW | MBH | kW | MBH | kW | MBH | kW | MBH | kW | MBH | kW |
| | -3.64 | -4.0 | 92.2 | 8.25 | 91.9 | 8.84 | 91.6 | 9.28 | 91.4 | 9.57 | 91.3 | 9.86 | 91.0 | 10.3 | | | |
| | -1.84 | -2.2 | 93.8 | 8.42 | 93.5 | 9.00 | 93.2 | 9.43 | 93.0 | 9.71 | 92.9 | 10.00 | 92.6 | 10.4 | | | |
| | 9.5 | 5.0 | 101 | 9.14 | 101 | 9.67 | 101 | 10.1 | 101 | 10.3 | 100 | 10.6 | 100 | 11.0 | | | |
| | 13.0 | 12.0 | 110 | 9.86 | 110 | 10.3 | 110 | 10.7 | 110 | 10.9 | 109 | 11.2 | 109 | 11.6 | | | |
| | 15.0 | 14.0 | 113 | 10.1 | 113 | 10.5 | 113 | 10.9 | 113 | 11.1 | 112 | 11.4 | 112 | 11.7 | | | |
| | 17.0 | 15.5 | 116 | 10.2 | 115 | 10.7 | 115 | 11.0 | 115 | 11.3 | 115 | 11.5 | 114 | 11.8 | | | |
| | 19.0 | 18.0 | 119 | 10.5 | 119 | 10.9 | 119 | 11.2 | 119 | 11.5 | 119 | 11.7 | 118 | 12.0 | | | |
| | 22.0 | 20.0 | 123 | 10.7 | 122 | 11.1 | 122 | 11.4 | 122 | 11.6 | 122 | 11.9 | 122 | 12.2 | | | |
| | 30.0 | 24.0 | 130 | 11.1 | 129 | 11.5 | 129 | 11.8 | 129 | 12.0 | 129 | 12.2 | 129 | 12.5 | | | |
| | 35.0 | 32.0 | 146 | 11.8 | 145 | 12.1 | 145 | 12.4 | 145 | 12.6 | 145 | 12.8 | 144 | 13.1 | | | |
| | 39.0 | 36.0 | 154 | 12.1 | 154 | 12.5 | 154 | 12.7 | 153 | 12.9 | 153 | 13.1 | 147 | 12.5 | | | |
| 44.0 | 40.0 | 163 | 12.4 | 163 | 12.8 | 163 | 13.0 | 162 | 13.1 | 156 | 12.5 | 147 | 11.7 | | | | |
| 47.0 | 43.0 | 171 | 12.7 | 170 | 13.0 | 168 | 12.9 | 162 | 12.4 | 156 | 11.9 | 147 | 11.1 | | | | |
| 51.0 | 47.0 | 181 | 13.0 | 177 | 12.8 | 168 | 12.1 | 162 | 11.5 | 156 | 11.0 | 147 | 10.3 | | | | |
| 54.0 | 50.0 | 189 | 13.2 | 177 | 12.6 | 168 | 11.4 | 162 | 11.0 | 156 | 10.5 | 147 | 9.80 | | | | |
| 57.0 | 53.0 | 189 | 12.5 | 177 | 11.5 | 168 | 10.9 | 162 | 10.4 | 156 | 9.98 | 147 | 9.33 | | | | |
| 60.0 | 56.0 | 189 | 11.8 | 177 | 11.0 | 168 | 10.3 | 162 | 9.91 | 156 | 9.49 | 147 | 8.88 | | | | |

TC: Total capacity ; MBH
 PI: Power Input ; kW (Comp.+Outdoor fan motor)
 Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

RXYQ168PBTJ

Capacity tables for RXYQ168PBTJ heat pump. The table is divided into four main sections based on indoor air temperature (61, 65, 70, 72, 75 °FDB) and outdoor air temperature (-3.64 to 60.0 °FDB). Each section contains columns for Combi-nation, Outdoor air temp., and Capacity (TC) and Power Input (PI) in MBH and kW. The data is presented in a grid format with rows for different capacity levels and columns for different conditions.

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

RXYQ192PBTJ

Capacity tables for RXYQ192PBTJ heat pump. The table is organized into four main sections based on indoor air temperature (°FDB) and outdoor air temperature. Each section contains a grid of TC (Total Capacity) and PI (Power Input) values for various combinations of indoor and outdoor temperatures. The indoor air temperature ranges from 61°F to 75°F, and the outdoor air temperature ranges from -3.64°F to 60°F. The table is divided into four quadrants: 130, 120, 110, and 100, representing different capacity levels.

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

RXYQ240PBTJ

Capacity tables for RXYQ240PBTJ heat pump. The table is organized into four main sections based on indoor air temperature (61, 65, 68, 70, 72, 75) and outdoor air temperature (-3.64 to 60.0). Each section contains sub-tables for Total Capacity (TC) and Power Input (PI) in MBH and kW. The data is presented in a grid format with rows for outdoor air temperature and columns for indoor air temperature and capacity units.

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

RXYQ264PBTJ

| Combi- nation | Outdoor air temp. | Indoor air temp. °FDB | | | | | | | | | | | | | | | | |
|------------------|----------------------|-----------------------|------|------|------|------|------|------|------|------|------|------|------|------|----|-----|----|--|
| | | 61 | | 65 | | 68 | | 70 | | 72 | | 75 | | | | | | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | | | | | |
| % | *FDB *FWB | MBH | KW | MBH | KW | MBH | KW | MBH | KW | MBH | KW | MBH | KW | MBH | KW | MBH | KW | |
| 130 | -3.64 | -4.0 | 201 | 17.0 | 200 | 18.3 | 200 | 19.2 | 199 | 19.9 | 199 | 20.5 | 199 | 21.4 | | | | |
| | -1.84 | -2.2 | 205 | 17.4 | 204 | 18.6 | 203 | 19.5 | 203 | 20.2 | 203 | 20.8 | 202 | 21.7 | | | | |
| | 5.5 | 5.0 | 221 | 18.9 | 220 | 20.1 | 220 | 20.8 | 219 | 21.5 | 219 | 22.1 | 218 | 22.9 | | | | |
| | 9.5 | 8.5 | 230 | 19.7 | 230 | 20.9 | 229 | 21.6 | 229 | 22.2 | 228 | 22.7 | 228 | 23.5 | | | | |
| | 13.0 | 12.0 | 241 | 20.5 | 240 | 21.5 | 239 | 22.3 | 239 | 22.8 | 239 | 23.4 | 238 | 24.2 | | | | |
| | 15.0 | 14.0 | 247 | 20.9 | 246 | 21.9 | 246 | 22.7 | 245 | 23.2 | 245 | 23.7 | 244 | 24.5 | | | | |
| | 17.0 | 15.5 | 252 | 21.3 | 251 | 22.3 | 251 | 23.0 | 250 | 23.5 | 250 | 24.0 | 249 | 24.8 | | | | |
| | 19.0 | 18.0 | 261 | 21.8 | 260 | 22.8 | 259 | 23.5 | 259 | 24.0 | 258 | 24.5 | 258 | 25.2 | | | | |
| | 22.0 | 20.0 | 268 | 22.2 | 267 | 23.2 | 266 | 23.9 | 266 | 24.4 | 266 | 24.8 | 265 | 25.5 | | | | |
| | 30.0 | 24.0 | 283 | 23.1 | 282 | 24.0 | 282 | 24.6 | 281 | 25.1 | 281 | 25.5 | 280 | 26.2 | | | | |
| | 35.0 | 32.0 | 317 | 24.7 | 316 | 25.4 | 316 | 26.0 | 315 | 26.4 | 315 | 26.8 | 314 | 27.4 | | | | |
| | 39.0 | 36.0 | 336 | 25.4 | 335 | 26.1 | 335 | 26.7 | 334 | 27.1 | 334 | 27.4 | 333 | 28.0 | | | | |
| | 44.0 | 40.0 | 356 | 26.1 | 355 | 26.8 | 355 | 27.3 | 354 | 27.7 | 354 | 28.0 | 350 | 28.1 | | | | |
| 47.0 | 43.0 | 372 | 26.6 | 371 | 27.2 | 371 | 27.7 | 370 | 28.1 | 370 | 28.4 | 350 | 28.6 | | | | | |
| 51.0 | 47.0 | 394 | 27.2 | 393 | 27.8 | 393 | 28.3 | 386 | 27.9 | 372 | 26.6 | 350 | 24.7 | | | | | |
| 54.0 | 50.0 | 412 | 27.6 | 411 | 28.2 | 400 | 27.6 | 386 | 26.4 | 372 | 25.2 | 350 | 23.4 | | | | | |
| 57.0 | 53.0 | 430 | 28.0 | 422 | 27.9 | 400 | 26.1 | 386 | 25.0 | 372 | 23.8 | 350 | 22.2 | | | | | |
| 60.0 | 56.0 | 449 | 28.4 | 422 | 26.4 | 400 | 24.7 | 386 | 23.7 | 372 | 22.6 | 350 | 21.1 | | | | | |
| 120 | -3.64 | -4.0 | 200 | 18.5 | 200 | 19.7 | 199 | 20.6 | 199 | 21.2 | 198 | 21.8 | 198 | 22.6 | | | | |
| | -1.84 | -2.2 | 204 | 18.9 | 203 | 20.0 | 203 | 20.9 | 202 | 21.5 | 202 | 22.0 | 201 | 22.9 | | | | |
| | 5.5 | 5.0 | 220 | 20.3 | 219 | 21.4 | 219 | 22.2 | 219 | 22.7 | 218 | 23.2 | 218 | 24.0 | | | | |
| | 9.5 | 8.5 | 230 | 21.0 | 229 | 22.0 | 228 | 22.8 | 228 | 23.3 | 228 | 23.8 | 227 | 24.6 | | | | |
| | 13.0 | 12.0 | 240 | 21.8 | 239 | 22.7 | 239 | 23.4 | 238 | 23.9 | 238 | 24.4 | 237 | 25.1 | | | | |
| | 15.0 | 14.0 | 246 | 22.2 | 245 | 23.1 | 245 | 23.8 | 244 | 24.3 | 244 | 24.8 | 244 | 25.5 | | | | |
| | 17.0 | 15.5 | 251 | 22.5 | 250 | 23.4 | 250 | 24.1 | 249 | 24.6 | 249 | 25.0 | 249 | 25.7 | | | | |
| | 19.0 | 18.0 | 260 | 23.0 | 259 | 23.9 | 258 | 24.5 | 258 | 25.0 | 258 | 25.4 | 257 | 26.1 | | | | |
| | 22.0 | 20.0 | 267 | 23.4 | 266 | 24.2 | 266 | 24.9 | 265 | 25.3 | 265 | 25.8 | 264 | 26.4 | | | | |
| | 30.0 | 24.0 | 282 | 24.2 | 281 | 25.0 | 281 | 25.6 | 280 | 26.0 | 280 | 26.4 | 280 | 27.0 | | | | |
| | 35.0 | 32.0 | 299 | 24.9 | 298 | 25.7 | 297 | 26.3 | 297 | 26.6 | 297 | 27.0 | 296 | 27.6 | | | | |
| | 39.0 | 36.0 | 316 | 25.6 | 316 | 26.3 | 315 | 26.9 | 315 | 27.3 | 314 | 27.6 | 314 | 28.2 | | | | |
| | 39.0 | 36.0 | 335 | 26.3 | 334 | 27.0 | 334 | 27.5 | 334 | 27.8 | 333 | 28.2 | 323 | 27.4 | | | | |
| 44.0 | 40.0 | 355 | 26.9 | 355 | 27.6 | 354 | 28.1 | 354 | 28.4 | 343 | 27.4 | 323 | 25.5 | | | | | |
| 47.0 | 43.0 | 371 | 27.4 | 370 | 28.0 | 370 | 28.4 | 366 | 27.2 | 343 | 25.9 | 323 | 24.1 | | | | | |
| 51.0 | 47.0 | 393 | 28.0 | 389 | 28.2 | 370 | 26.4 | 356 | 25.2 | 343 | 24.1 | 323 | 22.4 | | | | | |
| 54.0 | 50.0 | 411 | 28.4 | 389 | 26.6 | 370 | 25.0 | 356 | 23.9 | 343 | 22.8 | 323 | 21.3 | | | | | |
| 57.0 | 53.0 | 416 | 27.4 | 389 | 25.2 | 370 | 23.7 | 356 | 22.6 | 343 | 21.6 | 323 | 20.2 | | | | | |
| 60.0 | 56.0 | 416 | 25.9 | 389 | 23.9 | 370 | 22.4 | 356 | 21.5 | 343 | 20.5 | 323 | 19.2 | | | | | |
| 110 | -3.64 | -4.0 | 199 | 20.1 | 199 | 21.1 | 198 | 22.0 | 198 | 22.5 | 198 | 23.0 | 197 | 23.8 | | | | |
| | -1.84 | -2.2 | 203 | 20.4 | 202 | 21.4 | 202 | 22.2 | 201 | 22.8 | 201 | 23.3 | 201 | 24.1 | | | | |
| | 5.5 | 5.0 | 219 | 21.7 | 219 | 22.7 | 218 | 23.4 | 218 | 23.9 | 217 | 24.4 | 217 | 25.1 | | | | |
| | 9.5 | 8.5 | 229 | 22.4 | 228 | 23.3 | 227 | 24.0 | 227 | 24.5 | 227 | 24.9 | 226 | 25.6 | | | | |
| | 13.0 | 12.0 | 239 | 23.0 | 238 | 23.9 | 238 | 24.6 | 237 | 25.0 | 237 | 25.5 | 237 | 26.1 | | | | |
| | 15.0 | 14.0 | 245 | 23.4 | 245 | 24.3 | 244 | 24.9 | 244 | 25.4 | 243 | 25.8 | 243 | 26.4 | | | | |
| | 17.0 | 15.5 | 250 | 23.7 | 249 | 24.5 | 249 | 25.2 | 249 | 25.6 | 248 | 26.0 | 248 | 26.7 | | | | |
| | 19.0 | 18.0 | 259 | 24.2 | 258 | 25.0 | 258 | 25.6 | 257 | 26.0 | 257 | 26.4 | 256 | 27.0 | | | | |
| | 22.0 | 20.0 | 266 | 24.5 | 265 | 25.3 | 265 | 25.9 | 264 | 26.3 | 264 | 26.7 | 264 | 27.3 | | | | |
| | 30.0 | 24.0 | 281 | 25.2 | 280 | 26.0 | 280 | 26.5 | 280 | 26.9 | 279 | 27.3 | 279 | 27.9 | | | | |
| | 35.0 | 32.0 | 298 | 25.9 | 297 | 26.6 | 296 | 27.2 | 296 | 27.5 | 296 | 27.9 | 295 | 28.4 | | | | |
| | 39.0 | 36.0 | 315 | 26.6 | 315 | 27.2 | 314 | 27.7 | 314 | 28.1 | 313 | 28.4 | 296 | 26.5 | | | | |
| | 39.0 | 36.0 | 334 | 27.2 | 334 | 27.8 | 333 | 28.3 | 327 | 27.8 | 315 | 26.5 | 296 | 24.6 | | | | |
| 44.0 | 40.0 | 354 | 27.8 | 354 | 28.4 | 359 | 27.0 | 327 | 25.8 | 315 | 24.6 | 296 | 22.9 | | | | | |
| 47.0 | 43.0 | 370 | 28.2 | 357 | 27.2 | 339 | 25.5 | 327 | 24.4 | 315 | 23.3 | 296 | 21.7 | | | | | |
| 51.0 | 47.0 | 381 | 27.4 | 357 | 25.3 | 339 | 23.7 | 327 | 22.7 | 315 | 21.7 | 296 | 20.2 | | | | | |
| 54.0 | 50.0 | 381 | 25.9 | 357 | 23.9 | 339 | 22.5 | 327 | 21.5 | 315 | 20.6 | 296 | 19.2 | | | | | |
| 57.0 | 53.0 | 381 | 24.6 | 357 | 22.7 | 339 | 21.3 | 327 | 20.4 | 315 | 19.5 | 296 | 18.2 | | | | | |
| 60.0 | 56.0 | 381 | 23.3 | 357 | 21.5 | 339 | 20.2 | 327 | 19.4 | 315 | 18.6 | 296 | 17.3 | | | | | |
| 100 | -3.64 | -4.0 | 198 | 21.6 | 198 | 22.6 | 197 | 23.3 | 197 | 23.8 | 197 | 24.3 | 196 | 25.0 | | | | |
| | -1.84 | -2.2 | 202 | 21.9 | 201 | 22.9 | 201 | 23.6 | 201 | 24.0 | 200 | 24.5 | 200 | 25.2 | | | | |
| | 5.5 | 5.0 | 218 | 23.1 | 218 | 24.0 | 217 | 24.6 | 217 | 25.1 | 217 | 25.5 | 216 | 26.2 | | | | |
| | 9.5 | 8.5 | 228 | 23.7 | 227 | 24.5 | 227 | 25.2 | 226 | 25.6 | 226 | 26.0 | 226 | 26.7 | | | | |
| | 13.0 | 12.0 | 238 | 24.3 | 237 | 25.1 | 237 | 25.7 | 237 | 26.1 | 236 | 26.5 | 236 | 27.1 | | | | |
| | 15.0 | 14.0 | 244 | 24.6 | 244 | 25.4 | 243 | 26.0 | 243 | 26.4 | 243 | 26.8 | 242 | 27.4 | | | | |
| | 17.0 | 15.5 | 249 | 24.9 | 249 | 25.7 | 248 | 26.2 | 248 | 26.6 | 247 | 27.0 | 247 | 27.6 | | | | |
| | 19.0 | 18.0 | 258 | 25.3 | 257 | 26.1 | 257 | 26.6 | 256 | 27.0 | 256 | 27.4 | 256 | 27.9 | | | | |
| | 22.0 | 20.0 | 265 | 25.7 | 264 | 26.4 | 264 | 26.9 | 264 | 27.3 | 263 | 27.6 | 263 | 28.2 | | | | |
| | 30.0 | 24.0 | 280 | 26.3 | 280 | 27.0 | 279 | 27.5 | 279 | 27.8 | 279 | 28.2 | 270 | 27.3 | | | | |
| | 35.0 | 32.0 | 297 | 26.9 | 296 | 27.6 | 296 | 28.1 | 295 | 28.4 | 286 | 27.3 | 270 | 25.4 | | | | |
| | 39.0 | 36.0 | 314 | 27.5 | 314 | 28.1 | 308 | 27.8 | 297 | 26.6 | 286 | 25.4 | 270 | 23.6 | | | | |
| | 39.0 | 36.0 | 333 | 28.1 | 324 | 27.5 | 308 | 25.8 | 297 | 24.7 | 286 | 23.6 | 270 | 21.9 | | | | |
| 44.0 | 40.0 | 346 | 27.7 | 324 | 25.6 | 308 | 24.0 | 297 | 22.9 | 286 | 21.9 | 270 | 20.4 | | | | | |
| 47.0 | 43.0 | 346 | 26.2 | 324 | 24.2 | 308 | 22.7 | 297 | 21.7 | 286 | 20.8 | 270 | 19.4 | | | | | |
| 51.0 | 47.0 | 346 | 24.4 | 324 | 22.5 | 308 | 21.1 | 297 | 20.3 | 286 | 19.4 | 270 | 18.1 | | | | | |
| 54.0 | 50.0 | 346 | 23.1 | 324 | 21.3 | 308 | 20.1 | 297 | 19.2 | 286 | 18.4 | 270 | 17.2 | | | | | |
| 57.0 | 53.0 | 346 | 21.9 | 324 | 20.3 | 308 | 19.1 | 297 | 18.3 | 286 | 17.5 | 270 | 16.4 | | | | | |
| 60.0 | 56.0 | 346 | 20.8 | 324 | 19.2 | 308 | 18.1 | 297 | 17.4 | 286 | 16.7 | 270 | 15.6 | | | | | |

TC: Total capacity ; MBH
 PI: Power Input ; kW (Comp.+Outdoor fan motor)
 Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

RXYQ288PBTJ

Table with columns: Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75). Rows include capacity (TC) and power input (PI) for various conditions.

Table with columns: Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75). Rows include capacity (TC) and power input (PI) for various conditions.

TC: Total capacity ; MBH
PI: Power Input ; kW (Comp.+Outdoor fan motor)
Note1: is shown as reference.

Note2: The above table shows the average value of conditions which may occur.

RXYQ312PBTJ

| Combi- nation | Outdoor air temp. | Indoor air temp. °FDB | | | | | | | | | | | | | | | | | | | |
|------------------|----------------------|-----------------------|------|------|------|------|------|------|------|------|------|------|------|------|-----|----|----|----|--|--|--|
| | | 61 | | | | 65 | | | | 68 | | | | 72 | | | | 75 | | | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | | | | |
| % | *FDB | *FWB | MBH | kW | MBH | kW | MBH | kW | MBH | kW | MBH | kW | MBH | kW | MBH | kW | | | | | |
| 130 | -3.64 | -4.0 | 222 | 16.6 | 221 | 18.1 | 220 | 19.3 | 220 | 20.0 | 219 | 20.8 | 218 | 22.0 | | | | | | | |
| | -1.84 | -2.2 | 226 | 17.1 | 225 | 18.6 | 224 | 19.7 | 223 | 20.4 | 223 | 21.2 | 222 | 22.3 | | | | | | | |
| | 5.5 | 5.0 | 244 | 18.9 | 243 | 20.3 | 242 | 21.3 | 241 | 22.0 | 241 | 22.7 | 240 | 23.7 | | | | | | | |
| | 9.5 | 8.5 | 254 | 19.9 | 253 | 21.2 | 252 | 22.2 | 252 | 22.8 | 251 | 23.5 | 251 | 24.5 | | | | | | | |
| | 13.0 | 12.0 | 265 | 20.8 | 264 | 22.1 | 263 | 23.0 | 263 | 23.6 | 263 | 24.3 | 262 | 25.2 | | | | | | | |
| | 15.0 | 14.0 | 272 | 21.3 | 271 | 22.6 | 270 | 23.5 | 270 | 24.1 | 269 | 24.7 | 269 | 25.6 | | | | | | | |
| | 17.0 | 15.5 | 277 | 21.7 | 276 | 22.9 | 276 | 23.8 | 275 | 24.4 | 275 | 25.0 | 274 | 25.9 | | | | | | | |
| | 19.0 | 18.0 | 287 | 22.4 | 286 | 23.6 | 285 | 24.4 | 285 | 25.0 | 284 | 25.6 | 284 | 26.5 | | | | | | | |
| | 22.0 | 20.0 | 295 | 23.9 | 294 | 24.0 | 293 | 24.9 | 293 | 25.4 | 292 | 26.0 | 291 | 26.9 | | | | | | | |
| | 30.0 | 24.0 | 311 | 23.9 | 311 | 25.0 | 310 | 25.8 | 309 | 26.3 | 309 | 26.8 | 308 | 27.6 | | | | | | | |
| | 35.0 | 32.0 | 349 | 25.8 | 348 | 26.8 | 347 | 27.5 | 347 | 27.9 | 346 | 28.4 | 346 | 29.1 | | | | | | | |
| 39.0 | 36.0 | 370 | 26.7 | 369 | 27.6 | 368 | 28.2 | 368 | 28.7 | 367 | 29.1 | 366 | 29.8 | | | | | | | | |
| 44.0 | 40.0 | 392 | 27.5 | 391 | 28.4 | 390 | 29.0 | 390 | 29.4 | 389 | 29.8 | 388 | 30.5 | | | | | | | | |
| 47.0 | 43.0 | 409 | 28.1 | 408 | 28.9 | 407 | 29.5 | 407 | 29.9 | 407 | 30.3 | 406 | 30.9 | | | | | | | | |
| 51.0 | 47.0 | 433 | 28.8 | 432 | 29.6 | 432 | 30.2 | 431 | 30.5 | 431 | 30.9 | 414 | 29.7 | | | | | | | | |
| 54.0 | 50.0 | 452 | 29.4 | 452 | 30.1 | 451 | 30.6 | 450 | 31.0 | 439 | 30.2 | 414 | 28.1 | | | | | | | | |
| 57.0 | 53.0 | 472 | 29.9 | 471 | 30.6 | 471 | 31.1 | 456 | 30.0 | 439 | 28.6 | 414 | 26.6 | | | | | | | | |
| 60.0 | 56.0 | 493 | 30.3 | 492 | 31.0 | 473 | 29.7 | 456 | 28.4 | 439 | 27.1 | 414 | 25.3 | | | | | | | | |
| -3.64 | -4.0 | 221 | 18.5 | 220 | 19.9 | 219 | 20.9 | 219 | 21.6 | 218 | 22.3 | 218 | 23.4 | | | | | | | | |
| -1.84 | -2.2 | 224 | 18.9 | 224 | 20.3 | 223 | 21.3 | 223 | 22.0 | 222 | 22.7 | 221 | 23.7 | | | | | | | | |
| 5.5 | 5.0 | 242 | 20.6 | 242 | 21.9 | 241 | 22.8 | 240 | 23.5 | 240 | 24.1 | 239 | 25.0 | | | | | | | | |
| 9.5 | 8.5 | 253 | 21.5 | 252 | 22.7 | 251 | 23.6 | 251 | 24.2 | 250 | 24.8 | 250 | 25.7 | | | | | | | | |
| 13.0 | 12.0 | 264 | 22.3 | 263 | 23.5 | 262 | 24.4 | 262 | 24.9 | 262 | 25.5 | 261 | 26.4 | | | | | | | | |
| 15.0 | 14.0 | 271 | 22.8 | 270 | 24.0 | 269 | 24.8 | 269 | 25.4 | 269 | 25.9 | 268 | 26.8 | | | | | | | | |
| 17.0 | 15.5 | 276 | 23.2 | 275 | 24.3 | 275 | 25.1 | 274 | 25.7 | 274 | 26.2 | 273 | 27.1 | | | | | | | | |
| 19.0 | 18.0 | 286 | 23.8 | 285 | 24.9 | 284 | 25.7 | 284 | 26.2 | 283 | 26.7 | 283 | 27.5 | | | | | | | | |
| 22.0 | 20.0 | 294 | 24.3 | 293 | 25.3 | 292 | 26.1 | 292 | 26.6 | 291 | 27.1 | 291 | 27.9 | | | | | | | | |
| 30.0 | 24.0 | 310 | 25.2 | 309 | 26.2 | 309 | 26.9 | 308 | 27.4 | 308 | 27.9 | 307 | 28.6 | | | | | | | | |
| 35.0 | 32.0 | 328 | 26.1 | 328 | 27.0 | 327 | 27.7 | 326 | 28.2 | 326 | 28.7 | 325 | 29.3 | | | | | | | | |
| 39.0 | 36.0 | 348 | 27.0 | 347 | 27.8 | 346 | 28.5 | 346 | 28.9 | 345 | 29.4 | 345 | 30.0 | | | | | | | | |
| 44.0 | 40.0 | 369 | 27.8 | 368 | 28.6 | 367 | 29.2 | 367 | 29.6 | 366 | 30.0 | 366 | 30.6 | | | | | | | | |
| 47.0 | 43.0 | 388 | 28.5 | 387 | 29.3 | 387 | 29.9 | 386 | 30.3 | 386 | 30.7 | 382 | 28.9 | | | | | | | | |
| 51.0 | 47.0 | 407 | 29.1 | 407 | 29.8 | 406 | 30.4 | 406 | 30.7 | 406 | 31.1 | 382 | 28.9 | | | | | | | | |
| 54.0 | 50.0 | 432 | 29.8 | 431 | 30.5 | 431 | 31.0 | 421 | 30.3 | 406 | 28.9 | 382 | 26.9 | | | | | | | | |
| 57.0 | 53.0 | 451 | 30.2 | 451 | 30.9 | 437 | 30.0 | 421 | 28.7 | 406 | 27.4 | 382 | 25.5 | | | | | | | | |
| 60.0 | 56.0 | 471 | 30.7 | 460 | 30.3 | 437 | 28.4 | 421 | 27.2 | 406 | 26.0 | 382 | 24.0 | | | | | | | | |
| -3.64 | -4.0 | 219 | 20.3 | 219 | 21.6 | 218 | 22.6 | 218 | 23.2 | 217 | 23.9 | 217 | 24.8 | | | | | | | | |
| -1.84 | -2.2 | 223 | 20.7 | 223 | 21.9 | 222 | 22.9 | 222 | 23.5 | 221 | 24.2 | 221 | 25.1 | | | | | | | | |
| 5.5 | 5.0 | 241 | 22.3 | 241 | 23.4 | 240 | 24.3 | 240 | 24.9 | 239 | 25.5 | 239 | 26.3 | | | | | | | | |
| 9.5 | 8.5 | 252 | 23.1 | 251 | 24.2 | 250 | 25.0 | 250 | 25.6 | 249 | 26.1 | 249 | 27.0 | | | | | | | | |
| 13.0 | 12.0 | 263 | 23.9 | 262 | 24.9 | 261 | 25.7 | 261 | 26.3 | 261 | 26.8 | 260 | 27.6 | | | | | | | | |
| 15.0 | 14.0 | 270 | 24.3 | 269 | 25.3 | 268 | 26.1 | 268 | 26.6 | 268 | 27.2 | 267 | 27.9 | | | | | | | | |
| 17.0 | 15.5 | 275 | 24.6 | 274 | 25.7 | 274 | 26.4 | 273 | 26.9 | 273 | 27.4 | 272 | 28.2 | | | | | | | | |
| 19.0 | 18.0 | 285 | 25.2 | 284 | 26.2 | 283 | 26.9 | 283 | 27.4 | 282 | 27.9 | 282 | 28.6 | | | | | | | | |
| 22.0 | 20.0 | 292 | 25.6 | 292 | 26.6 | 291 | 27.3 | 291 | 27.8 | 290 | 28.3 | 290 | 29.7 | | | | | | | | |
| 30.0 | 24.0 | 309 | 26.5 | 308 | 27.4 | 308 | 28.1 | 307 | 28.5 | 307 | 29.0 | 306 | 29.7 | | | | | | | | |
| 35.0 | 32.0 | 327 | 27.3 | 326 | 28.2 | 326 | 28.8 | 326 | 29.2 | 325 | 29.7 | 325 | 30.3 | | | | | | | | |
| 39.0 | 36.0 | 347 | 28.1 | 346 | 28.9 | 345 | 29.5 | 345 | 29.9 | 345 | 30.3 | 344 | 30.9 | | | | | | | | |
| 44.0 | 40.0 | 367 | 28.8 | 366 | 29.6 | 366 | 30.2 | 366 | 30.5 | 365 | 30.9 | 350 | 29.6 | | | | | | | | |
| 47.0 | 43.0 | 389 | 29.6 | 389 | 30.3 | 388 | 30.8 | 386 | 30.9 | 372 | 29.5 | 350 | 27.5 | | | | | | | | |
| 51.0 | 47.0 | 411 | 30.1 | 406 | 30.7 | 400 | 30.6 | 389 | 29.9 | 372 | 28.0 | 350 | 26.0 | | | | | | | | |
| 54.0 | 50.0 | 450 | 31.1 | 422 | 28.7 | 400 | 27.0 | 386 | 25.8 | 372 | 24.7 | 350 | 23.0 | | | | | | | | |
| 57.0 | 53.0 | 450 | 29.5 | 422 | 27.2 | 400 | 25.6 | 386 | 24.5 | 372 | 23.4 | 350 | 21.9 | | | | | | | | |
| 60.0 | 56.0 | 450 | 28.0 | 422 | 25.8 | 400 | 24.2 | 386 | 23.3 | 372 | 22.3 | 350 | 20.8 | | | | | | | | |
| -3.64 | -4.0 | 218 | 22.2 | 218 | 23.3 | 217 | 24.2 | 217 | 24.8 | 216 | 25.4 | 216 | 26.3 | | | | | | | | |
| -1.84 | -2.2 | 222 | 22.5 | 221 | 23.6 | 221 | 24.5 | 221 | 25.1 | 220 | 25.7 | 220 | 26.5 | | | | | | | | |
| 5.5 | 5.0 | 240 | 23.9 | 239 | 25.0 | 239 | 25.8 | 239 | 26.3 | 238 | 26.8 | 238 | 27.6 | | | | | | | | |
| 9.5 | 8.5 | 250 | 24.7 | 250 | 25.7 | 249 | 26.4 | 249 | 26.9 | 248 | 27.4 | 248 | 28.2 | | | | | | | | |
| 13.0 | 12.0 | 262 | 25.4 | 261 | 26.4 | 260 | 27.1 | 260 | 27.6 | 260 | 28.0 | 259 | 28.8 | | | | | | | | |
| 15.0 | 14.0 | 269 | 25.8 | 268 | 26.7 | 267 | 27.4 | 267 | 27.9 | 267 | 28.4 | 266 | 29.1 | | | | | | | | |
| 17.0 | 15.5 | 274 | 26.1 | 273 | 27.0 | 273 | 27.7 | 272 | 28.2 | 272 | 28.6 | 272 | 29.3 | | | | | | | | |
| 19.0 | 18.0 | 283 | 26.6 | 283 | 27.5 | 282 | 28.2 | 282 | 28.6 | 281 | 29.1 | 281 | 29.7 | | | | | | | | |
| 22.0 | 20.0 | 291 | 27.0 | 291 | 27.9 | 290 | 28.5 | 290 | 29.0 | 289 | 29.4 | 289 | 30.0 | | | | | | | | |
| 30.0 | 24.0 | 308 | 27.8 | 307 | 28.6 | 307 | 29.2 | 306 | 29.6 | 306 | 30.0 | 306 | 30.7 | | | | | | | | |
| 35.0 | 32.0 | 326 | 28.5 | 325 | 29.3 | 325 | 29.9 | 325 | 30.3 | 324 | 30.7 | 319 | 30.5 | | | | | | | | |
| 39.0 | 36.0 | 346 | 29.3 | 345 | 30.0 | 344 | 30.5 | 344 | 30.9 | 338 | 30.5 | 319 | 28.3 | | | | | | | | |
| 44.0 | 40.0 | 366 | 29.9 | 366 | 30.6 | 364 | 31.0 | 351 | 29.6 | 338 | 28.3 | 319 | 26.3 | | | | | | | | |
| 47.0 | 43.0 | 388 | 30.6 | 383 | 30.7 | 364 | 28.8 | 351 | 27.5 | 338 | 26.3 | 319 | 24.5 | | | | | | | | |
| 51.0 | 47.0 | 406 | 31.0 | 383 | 29.0 | 364 | 27.3 | 351 | 26.1 | 338 | 25.0 | 319 | 23.3 | | | | | | | | |
| 54.0 | 50.0 | 409 | 29.3 | 383 | 27.0 | 364 | 25.4 | 351 | 24.3 | 338 | 23.3 | 319 | 21.7 | | | | | | | | |
| 57.0 | 53.0 | 409 | 27.7 | 383 | 25.6 | 364 | 24.1 | 351 | 23.1 | 338 | 22.1 | 319 | 20.6 | | | | | | | | |
| 60.0 | 56.0 | 409 | 26.3 | 383 | 24.3 | 364 | 22.9 | 351 | 21.9 | 338 | 21.0 | 319 | 19.6 | | | | | | | | |
| -3.64 | -4.0 | 219 | 20.3 | 219 | 21.6 | 218 | 22.6 | 218 | 23.2 | 217 | 23.9 | 217 | 24.8 | | | | | | | | |
| -1.84 | -2.2 | 223 | 20.7 | 223 | 21.9 | 222 | 22.9 | 222 | 23.5 | 221 | 24.2 | 221 | 25.1 | | | | | | | | |
| 5.5 | 5.0 | 241 | 22.3 | 241 | 23.4 | 240 | 24.3 | 240 | 24.9 | 239 | 25.5 | 239 | 26.3 | | | | | | | | |
| 9.5 | 8.5 | 253 | 23.1 | 252 | 24.2 | 250 | 25.0 | 250 | 25.6 | 249 | 26.1 | 249 | 27.0 | | | | | | | | |
| 13.0 | 12.0 | 264 | 23.9 | 263 | 24.9 | 262 | 25.7 | 261 | 26.3 | 261 | 26.8 | 260 | 27.6 | | | | | | | | |
| 15.0 | 14.0 | 271 | 24.3 | 270 | 25.3 | 268 | 26.1 | 268 | 26.6 | 268 | 27.2 | 267 | 27.9 | | | | | | | | |
| 17.0 | 15.5 | 275 | 24.6 | 274 | 25.7 | 274 | 26.4 | 273 | 26.9 | 273 | 27.4 | 272 | 28.2 | | | | | | | | |
| 19.0 | 18.0 | 285 | 25.2 | 284 | 26.2 | 283 | 26.9 | 283 | 27.4 | 282 | 27.9 | 282 | 28.6 | | | | | | | | |
| 22.0 | 20.0 | 292 | 25.6 | 292 | 26.6 | 291 | 27.3 | 291 | 27.8 | 290 | 28.3 | 290 | 29.7 | | | | | | | | |
| 30.0 | 24.0 | 309 | 26.5 | 308 | 27.4 | 308 | 28.1 | 307 | 28.5 | 307 | 29.0 | 306 | 29.7 | | | | | | | | |
| 35.0 | 32.0 | 327 | 27.3 | 326 | 28.2 | 326 | 28.8 | 326 | 29.2 | 325 | 29.7 | 325 | 30.3 | | | | | | | | |
| 39.0 | 36.0 | 347 | 28.1 | 346 | 28.9 | 345 | 29.5 | 345 | 29.9 | 345 | 30.3 | 344 | 30.9 | | | | | | | | |
| 44.0 | 40.0 | 367 | 28.8 | 366 | 29.6 | 366 | 30.2 | 366 | 30.5 | 365 | 30.9 | 350 | 29.6 | | | | | | | | |
| 47.0 | 43.0 | 389 | 29.6 | 389 | 30.3 | 388 | 30.8 | 386 | 30.9 | 372 | 29.5 | 350 | 27.5 | | | | | | | | |
| 51.0 | 47.0 | 411 | 30.1 | 407 | 30.7 | 400 | 30.6 | 389 | | | | | | | | | | | | | |

RXYQ336PBTJ

| Combi- nation | Outdoor air temp. | | Indoor air temp. °FDB | | | | | | | | | | | | Combi- nation | Outdoor air temp. | | Indoor air temp. °FDB | | | | | | | | | | | |
|------------------|----------------------|------|-----------------------|------|------|------|------|------|------|------|------|------|------|------|------------------|----------------------|------|-----------------------|------|------|------|--------|------|------|------|------|------|------|----|
| | | | 61 | | 65 | | 68 | | 70 | | 72 | | 75 | | | | | 61 | | 65 | | 68 | | 70 | | 72 | | 75 | |
| | | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | | | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 130 | % | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | |
| | -3.64 | -4.0 | 239 | 18.0 | 238 | 19.6 | 237 | 20.8 | 237 | 21.7 | 236 | 22.5 | 236 | 23.7 | -3.64 | -4.0 | 234 | 25.9 | 234 | 27.0 | 233 | 27.9 | 233 | 28.5 | 232 | 29.0 | 232 | 29.9 | |
| | -1.84 | -2.2 | 243 | 18.4 | 242 | 20.0 | 241 | 21.3 | 241 | 22.1 | 240 | 22.9 | 240 | 24.1 | -1.84 | -2.2 | 238 | 26.2 | 238 | 27.4 | 237 | 28.2 | 237 | 28.8 | 236 | 29.3 | 236 | 30.1 | |
| | 5.5 | 5.0 | 263 | 20.4 | 262 | 21.9 | 261 | 23.0 | 260 | 23.8 | 260 | 24.5 | 259 | 25.6 | 5.5 | 5.0 | 258 | 27.6 | 257 | 28.7 | 257 | 29.4 | 256 | 29.8 | 256 | 30.5 | 255 | 31.2 | |
| | 9.5 | 8.5 | 274 | 21.4 | 273 | 22.9 | 272 | 23.9 | 271 | 24.6 | 271 | 25.4 | 270 | 26.4 | 9.5 | 8.5 | 269 | 28.3 | 268 | 29.3 | 268 | 30.1 | 267 | 30.6 | 267 | 31.0 | 266 | 31.8 | |
| | 13.0 | 12.0 | 286 | 22.5 | 285 | 23.8 | 284 | 24.8 | 284 | 25.5 | 283 | 26.2 | 282 | 27.2 | 13.0 | 12.0 | 281 | 29.0 | 280 | 30.0 | 280 | 30.7 | 279 | 31.2 | 279 | 31.6 | 279 | 32.3 | |
| | 15.0 | 14.0 | 293 | 23.0 | 292 | 24.4 | 292 | 25.3 | 291 | 26.0 | 291 | 26.7 | 290 | 27.7 | 15.0 | 14.0 | 288 | 29.4 | 288 | 30.4 | 287 | 31.0 | 287 | 31.5 | 287 | 32.0 | 286 | 32.6 | |
| | 17.0 | 15.5 | 299 | 23.5 | 298 | 24.8 | 297 | 25.7 | 297 | 26.4 | 296 | 27.0 | 296 | 28.0 | 17.0 | 15.5 | 294 | 29.7 | 294 | 30.6 | 293 | 31.3 | 293 | 31.8 | 292 | 32.2 | 292 | 32.9 | |
| | 19.0 | 18.0 | 309 | 24.2 | 308 | 25.4 | 307 | 26.4 | 307 | 27.0 | 306 | 27.6 | 306 | 28.5 | 19.0 | 18.0 | 304 | 30.2 | 304 | 31.1 | 303 | 31.7 | 303 | 32.2 | 302 | 32.6 | 302 | 33.3 | |
| | 22.0 | 20.0 | 318 | 24.7 | 317 | 25.9 | 316 | 26.9 | 315 | 27.5 | 315 | 28.1 | 314 | 29.0 | 22.0 | 20.0 | 313 | 30.6 | 312 | 31.5 | 312 | 32.1 | 311 | 32.5 | 311 | 32.9 | 309 | 33.3 | |
| | 26.0 | 24.0 | 336 | 25.8 | 335 | 27.0 | 334 | 27.8 | 334 | 28.4 | 333 | 29.0 | 332 | 29.8 | 26.0 | 24.0 | 331 | 31.4 | 330 | 32.2 | 330 | 32.8 | 329 | 33.2 | 328 | 33.3 | 309 | 31.0 | |
| | 30.0 | 28.0 | 355 | 26.9 | 354 | 27.9 | 354 | 28.8 | 353 | 29.3 | 353 | 29.8 | 352 | 30.6 | 30.0 | 28.0 | 350 | 32.1 | 350 | 32.9 | 349 | 33.4 | 349 | 33.8 | 348 | 33.0 | 309 | 28.0 | |
| 35.0 | 32.0 | 376 | 27.9 | 375 | 28.9 | 374 | 29.6 | 374 | 30.2 | 373 | 30.7 | 373 | 31.4 | 35.0 | 32.0 | 371 | 32.8 | 371 | 33.5 | 370 | 34.0 | 370 | 34.2 | 369 | 33.2 | 309 | 26.0 | | |
| 39.0 | 36.0 | 399 | 28.8 | 398 | 29.8 | 397 | 30.5 | 396 | 31.0 | 396 | 31.4 | 395 | 32.2 | 39.0 | 36.0 | 394 | 33.5 | 394 | 34.2 | 393 | 34.5 | 393 | 34.7 | 392 | 33.9 | 309 | 25.0 | | |
| 44.0 | 40.0 | 422 | 29.7 | 421 | 30.6 | 421 | 31.3 | 420 | 31.7 | 420 | 32.2 | 419 | 32.9 | 44.0 | 40.0 | 417 | 34.1 | 417 | 34.8 | 416 | 35.1 | 416 | 35.3 | 415 | 34.5 | 309 | 23.4 | | |
| 47.0 | 43.0 | 441 | 30.3 | 440 | 31.2 | 439 | 31.8 | 439 | 32.3 | 438 | 32.7 | 438 | 33.4 | 47.0 | 43.0 | 436 | 34.5 | 436 | 35.2 | 435 | 35.5 | 435 | 35.7 | 434 | 34.9 | 309 | 22.2 | | |
| 51.0 | 47.0 | 467 | 31.1 | 466 | 31.9 | 466 | 32.6 | 465 | 33.0 | 465 | 33.4 | 464 | 34.1 | 51.0 | 47.0 | 462 | 35.3 | 462 | 36.0 | 461 | 36.3 | 461 | 36.5 | 460 | 35.7 | 309 | 20.8 | | |
| 54.0 | 50.0 | 488 | 31.7 | 487 | 32.5 | 486 | 33.1 | 486 | 33.4 | 485 | 33.8 | 484 | 34.5 | 54.0 | 50.0 | 483 | 36.0 | 483 | 36.7 | 482 | 37.0 | 482 | 37.2 | 481 | 36.4 | 309 | 19.8 | | |
| 57.0 | 53.0 | 509 | 32.2 | 508 | 33.0 | 508 | 33.5 | 507 | 33.9 | 507 | 34.3 | 506 | 35.0 | 57.0 | 53.0 | 504 | 37.2 | 504 | 37.9 | 503 | 38.2 | 503 | 38.4 | 502 | 37.6 | 309 | 18.8 | | |
| 60.0 | 56.0 | 531 | 32.7 | 530 | 33.5 | 530 | 34.0 | 529 | 34.4 | 529 | 34.8 | 528 | 35.5 | 60.0 | 56.0 | 526 | 39.2 | 526 | 39.9 | 525 | 40.2 | 525 | 40.4 | 524 | 39.8 | 309 | 17.9 | | |
| 120 | % | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | |
| | -3.64 | -4.0 | 238 | 20.0 | 237 | 21.5 | 236 | 22.6 | 236 | 23.4 | 235 | 24.1 | 235 | 25.2 | -3.64 | -4.0 | 233 | 27.9 | 233 | 29.2 | 232 | 29.7 | 232 | 30.2 | 231 | 30.7 | 231 | 31.4 | |
| | -1.84 | -2.2 | 242 | 20.4 | 241 | 21.9 | 240 | 23.0 | 240 | 23.7 | 239 | 24.5 | 239 | 25.6 | -1.84 | -2.2 | 237 | 28.2 | 237 | 29.2 | 236 | 29.9 | 236 | 30.4 | 235 | 30.9 | 235 | 31.7 | |
| | 5.5 | 5.0 | 261 | 22.2 | 260 | 23.6 | 260 | 24.6 | 259 | 25.3 | 259 | 26.0 | 258 | 27.0 | 5.5 | 5.0 | 257 | 29.4 | 257 | 30.3 | 256 | 31.0 | 255 | 31.5 | 255 | 31.9 | 254 | 32.6 | |
| | 9.5 | 8.5 | 272 | 23.2 | 272 | 24.5 | 271 | 25.5 | 270 | 26.1 | 270 | 26.8 | 269 | 27.8 | 9.5 | 8.5 | 268 | 30.1 | 267 | 30.9 | 267 | 31.6 | 266 | 32.0 | 266 | 32.5 | 265 | 33.1 | |
| | 13.0 | 12.0 | 285 | 24.1 | 284 | 25.4 | 283 | 26.3 | 283 | 26.9 | 282 | 27.6 | 281 | 28.5 | 13.0 | 12.0 | 280 | 30.7 | 279 | 31.5 | 279 | 32.1 | 278 | 32.6 | 278 | 33.0 | 277 | 33.7 | |
| | 15.0 | 14.0 | 292 | 24.6 | 291 | 25.9 | 290 | 26.8 | 290 | 27.4 | 289 | 28.0 | 289 | 28.9 | 15.0 | 14.0 | 287 | 31.0 | 287 | 31.9 | 286 | 32.5 | 286 | 32.9 | 286 | 33.3 | 285 | 34.0 | |
| | 17.0 | 15.5 | 298 | 25.0 | 297 | 26.2 | 296 | 27.1 | 296 | 27.7 | 295 | 28.3 | 295 | 29.2 | 17.0 | 15.5 | 293 | 31.3 | 292 | 32.1 | 292 | 32.7 | 292 | 33.1 | 291 | 33.5 | 291 | 34.2 | |
| | 19.0 | 18.0 | 308 | 25.7 | 307 | 26.8 | 306 | 27.7 | 306 | 28.3 | 305 | 28.9 | 305 | 29.7 | 19.0 | 18.0 | 303 | 31.7 | 303 | 32.5 | 302 | 33.1 | 302 | 33.5 | 301 | 33.9 | 301 | 34.6 | |
| | 22.0 | 20.0 | 316 | 26.2 | 316 | 27.3 | 315 | 28.2 | 314 | 28.7 | 314 | 29.3 | 313 | 30.1 | 22.0 | 20.0 | 312 | 32.1 | 311 | 32.8 | 311 | 33.4 | 310 | 33.8 | 310 | 34.2 | 309 | 34.9 | |
| | 26.0 | 24.0 | 335 | 27.2 | 334 | 28.3 | 333 | 29.1 | 332 | 29.6 | 332 | 30.1 | 331 | 30.9 | 26.0 | 24.0 | 330 | 32.8 | 329 | 33.5 | 329 | 34.1 | 328 | 34.5 | 328 | 34.9 | 327 | 35.6 | |
| | 30.0 | 28.0 | 354 | 28.2 | 353 | 29.2 | 352 | 29.9 | 352 | 30.4 | 352 | 30.9 | 351 | 31.7 | 30.0 | 28.0 | 349 | 33.4 | 349 | 34.1 | 348 | 34.7 | 348 | 35.1 | 347 | 35.5 | 347 | 36.2 | |
| 35.0 | 32.0 | 375 | 29.1 | 374 | 30.0 | 373 | 30.7 | 373 | 31.2 | 372 | 31.7 | 372 | 32.4 | 35.0 | 32.0 | 371 | 33.6 | 371 | 34.3 | 370 | 34.9 | 370 | 35.3 | 369 | 35.7 | 369 | 36.4 | | |
| 39.0 | 36.0 | 397 | 30.0 | 396 | 30.9 | 396 | 31.5 | 395 | 32.0 | 395 | 32.4 | 394 | 33.1 | 39.0 | 36.0 | 393 | 34.0 | 393 | 34.7 | 392 | 35.3 | 392 | 35.7 | 391 | 36.1 | 391 | 36.8 | | |
| 44.0 | 40.0 | 421 | 30.8 | 420 | 31.6 | 419 | 32.3 | 419 | 32.7 | 419 | 33.1 | 418 | 33.8 | 44.0 | 40.0 | 416 | 34.8 | 416 | 35.5 | 415 | 36.1 | 415 | 36.5 | 414 | 36.9 | 414 | 37.6 | | |
| 47.0 | 43.0 | 440 | 31.4 | 439 | 32.2 | 438 | 32.8 | 438 | 33.2 | 437 | 33.5 | 437 | 34.2 | 47.0 | 43.0 | 435 | 35.9 | 435 | 36.6 | 434 | 37.1 | 434 | 37.5 | 433 | 37.9 | 433 | 38.6 | | |
| 51.0 | 47.0 | 466 | 32.1 | 465 | 32.9 | 464 | 33.4 | 464 | 33.8 | 463 | 34.1 | 463 | 34.8 | 51.0 | 47.0 | 461 | 37.2 | 461 | 37.9 | 460 | 38.5 | 460 | 38.9 | 459 | 39.3 | 459 | 40.0 | | |
| 54.0 | 50.0 | 487 | 32.6 | 486 | 33.4 | 485 | 34.0 | 484 | 34.4 | 483 | 34.7 | 483 | 35.4 | 54.0 | 50.0 | 482 | 38.4 | 482 | 39.1 | 481 | 39.7 | 481 | 40.1 | 480 | 40.5 | 480 | 41.2 | | |
| 57.0 | 53.0 | 508 | 33.1 | 507 | 33.9 | 507 | 34.6 | 506 | 35.1 | 506 | 35.4 | 505 | 36.1 | 57.0 | 53.0 | 503 | 39.6 | 503 | 40.3 | 502 | 40.7 | 502 | 41.1 | 501 | 41.5 | 501 | 42.2 | | |
| 60.0 | 56.0 | 529 | 33.5 | 529 | 34.2 | 528 | 34.9 | 528 | 35.2 | 527 | 35.8 | 527 | 36.5 | 60.0 | 56.0 | 524 | 41.1 | 524 | 41.8 | 523 | 42.1 | 523 | 42.5 | 522 | 42.9 | 522 | 43.6 | | |
| 110 | % | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | *FDB | |
| | -3.64 | -4.0 | 237 | 21.9 | 236 | 23.3 | 235 | 24.4 | 235 | 25.1 | 234 | 25.8 | 234 | 26.8 | -3.64 | -4.0 | 232 | 29.9 | 231 | 30.8 | 231 | 31.4 | 231 | 31.9 | 230 | 32.3 | 230 | 33.0 | |
| | -1.84 | -2.2 | 241 | 22.3 | 240 | 23.7 | 239 | 24.7 | 239 | 25.4 | 238 | 26.1 | 238 | 27.1 | -1.84 | -2.2 | 236 | 30.1 | 235 | 31.0 | 235 | 31.7 | 235 | 32.1 | 234 | 32.5 | 234 | 33.2 | |
| | 5.5 | 5.0 | 260 | 24.0 | 259 | 25.3 | 259 | 26.2 | 258 | 26.9 | 258 | 27.5 | 257 | 28.4 | 5.5 | 5.0 | 255 | 31.2 | 255 | 32.0 | 254 | 32.6 | 254 | 33.0 | 254 | 33.4 | 253 | 34.1 | |
| | 9.5 | 8.5 | 271 | 24.9 | 270 | 26.1 | 270 | 27.0 | 269 | 27.6 | 269 | 28.2 | 268 | 29.1 | 9.5 | 8.5 | 266 | 31.8 | 266 | 32.5 | 265 | 33.1 | 265 | 33.4 | 265 | 33.9 | 264 | 34.6 | |
| | 13.0 | 12.0 | 283 | 25.6 | 283 | 26.9 | 282 | 27.8 | 281 | 28.3 | 281 | 28.9 | 280 | 29.8 | 13.0 | 12.0 | 279 | 32.3 | 278 | 33.1 | 278 | 33.8 | 277 | 34.2 | 277 | 34.6 | 276 | 35.3 | |
| | 15.0 | 14.0 | 291 | 26.2 | 290 | 27.4 | 289 | 28.2 | 289 | 28.8 | 289 | 29.3 | 288 | 30.2 | 15.0 | 14.0 | 286 | 32.8 | 285 | 33.4 | 285 | 34.1 | 285 | 34.5 | 285 | 34.9 | 284 | 35.6 | |
| | 17.0 | 15.5 | 297 | 26.6 | 296 | 27.7 | 295 | 28.5 | 295 | 29.1 | 294 | 29.6 | 294 | 30.4 | 17.0 | 15.5 | 292 | 32.9 | 292 | 33.6 | 291 | 34.2</ | | | | | | | |


RXYQ360PBTJ

| Combi- nation | Outdoor air temp. | | Indoor air temp. °FDB | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|------------------|----------------------|------|-----------------------|-------|------|-----|------|-----|------|-----|------|-----|------|-----|------|-----|------|-------|------|-----|------|-----|------|-----|------|-----|------|-----|------|-----|------|
| | | | 61 | | | | 65 | | | | 68 | | | | 70 | | | | 72 | | | | 75 | | | | | | | | |
| | | | TC | PI | MBH | kW | TC | PI | MBH | kW | TC | PI | MBH | kW | TC | PI | MBH | kW | TC | PI | MBH | kW | TC | PI | MBH | kW | | | | | |
| 130 | % | °FDB | °FDB | -3.64 | -4.0 | 248 | 17.8 | 248 | 19.5 | 247 | 20.9 | 247 | 21.7 | 246 | 22.6 | 246 | 24.0 | -3.64 | -4.0 | 244 | 26.3 | 243 | 27.6 | 243 | 28.5 | 242 | 29.1 | 242 | 29.7 | 242 | 30.6 |

TC: Total capacity ; MBH
 PI: Power Input ; kW (Comp.+Outdoor fan motor)
 Note1: [shaded] is shown as reference.
 Note2: The above table shows the average value of conditions which may occur.

7.3 Capacity Correction Factor

RXYQ72PBTJ

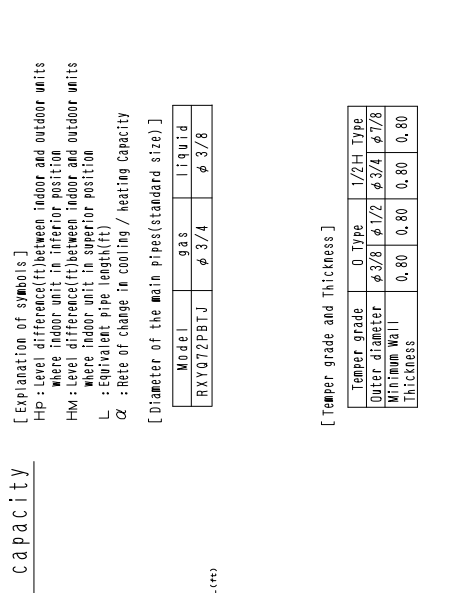

[Explanation of symbols]
 Hp : Level difference (between indoor and outdoor units where indoor unit is inferior position)
 Hm : Level difference (between indoor and outdoor units where indoor unit is superior position)
 L : Equivalent pipe length (ft)
 α : Rate of change in cooling / heating capacity
 [Diameter of the main pipes (standard size)]

| Model | gas | liquid |
|------------|-------|--------|
| RXYQ72PBTJ | φ 3/4 | φ 3/8 |

[Temper grade and Thickness]

| Temper grade | 0 Type | 1/2H Type |
|------------------------|--------|-----------|
| Outer diameter | φ 3/8 | φ 1/2 |
| Minimum Wall Thickness | 0.80 | 0.80 |

[Notes]
 1. These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
 2. With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
 3. Method of calculating A/C (cooling/heating) capacity:
 The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.
 Calculating A/C capacity of outdoor units
 • Condition: Indoor unit combination ratio does not exceed 100%.

$$\text{Maximum A/C capacity of outdoor units} = \text{A/C capacity of outdoor units obtained from capacity characteristic table at the 100\% combination}$$

$$\times \text{Capacity change rate due to piping length to the farthest indoor unit}$$
 • Condition: Indoor unit combination ratio exceeds 100%.


$$\text{Maximum A/C capacity of outdoor units} = \text{A/C capacity of outdoor units obtained from capacity characteristic table at the combination}$$

$$\times \text{Capacity change rate due to piping length to the farthest indoor unit}$$
 4. When overall equivalent pipe length is 295.3ft or more, the diameter of the main gas and liquid pipes (outdoor unit-branch sections) must be increased.
 When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.
 [Diameter of above case]

| Model | gas | liquid |
|------------|-------|--------|
| RXYQ72PBTJ | φ 7/8 | φ 1/2 |

5. Read cooling / heating capacity rate of change in the above figures based on the following equivalent length,
 Overall equivalent length = (Equivalent length to main pipe) × Correction factor + (Equivalent length after branching)
 Choose a correction factor from the following table.
 When cooling capacity is calculated: gas pipe size
 When heating capacity is calculated: liquid pipe size

| Rate of change (Object Piping) | Correction factor |
|--------------------------------|-----------------------------|
| Cooling (gas pipe) | Standard size Size increase |
| Heating (liquid pipe) | 1.0 0.5 0.2 |

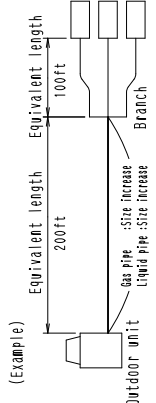


(Example)
 In the above case
 (Cooling) Overall equivalent length = 200ft × 0.5 + 100ft = 200ft
 (Heating) Overall equivalent length = 200ft × 0.2 + 100ft = 140ft
 The rate of change in cooling capacity when Hp=0ft is thus approximately 0.89
 heating capacity when Hp=0ft is thus approximately 1.0


C: 3D058623B

RXYQ96PBTJ

1. Rate of change in cooling capacity

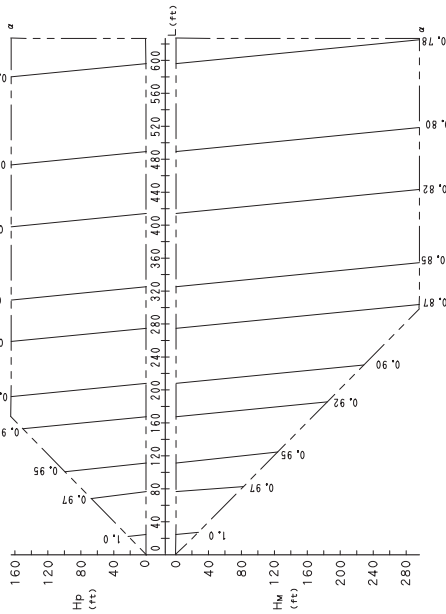

2. Rate of change in heating capacity

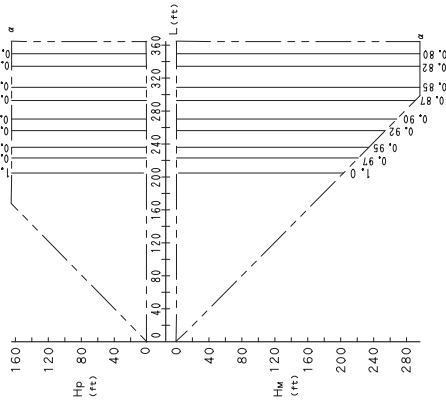

[Explanation of symbols]
 Hp : Level difference(ft) between indoor and outdoor units where indoor unit in inferior position
 Hm : Level difference(ft) between indoor and outdoor units where indoor unit in superior position
 L : Equivalent pipe length(ft)
 α : Rate of change in cooling / heating capacity
 [Diameter of the main pipes(standard size)]

| Model | gas | liquid |
|------------|-------|--------|
| RXYQ96PBTJ | φ 7/8 | φ 3/8 |

[Temper grade and Thickness]

| Temper grade | □ Type | 1/2H Type |
|------------------------|--------|------------------|
| Outer diameter | φ 3/8 | φ 1/2 |
| Minimum Wall Thickness | 0.80 | 0.80, 0.80, 0.88 |

[Notes]

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
- Method of calculating A/C (cooling/heating) capacity:
 The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.
 Calculating A/C capacity of outdoor units
 • Condition: Indoor unit combination ratio does not exceed 100%.
 [Maximum A/C capacity of outdoor units = A/C capacity of outdoor units obtained from capacity characteristic table at the 100% combination X Capacity change rate due to piping length to the farthest indoor unit]
 • Condition: Indoor unit combination ratio exceeds 100%.
 [Maximum A/C capacity of outdoor units = A/C capacity of outdoor units obtained from capacity characteristic table at the combination X Capacity change rate due to piping length to the farthest indoor unit]
 X Capacity change rate due to piping length to the farthest indoor unit
 X Capacity change rate due to piping length to the farthest indoor unit
- When overall equivalent pipe length is 295.3ft or more, the diameter of the main gas and liquid pipes (outdoor unit-branch sections) must be increased.
 When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.
 [Diameter of above case]


| Model | gas | liquid |
|------------|---------------|--------|
| RXYQ96PBTJ | not increased | φ 1/2 |

5. Read cooling / heating capacity rate of change in the above figures based on the following equivalent length.

Overall equivalent length = (Equivalent length to main pipe) X Correction factor + (Equivalent length after branching)

Choose a correction factor from the following table,
 [When cooling capacity is calculated: gas pipe size
 [When heating capacity is calculated: liquid pipe size

| Rate of change (object piping) | Correction factor |
|--------------------------------|--|
| Cooling (Gas pipe) | Standard size Size increase 1.0 0.5 |
| Heating (Liquid pipe) | 1.0 0.2 |

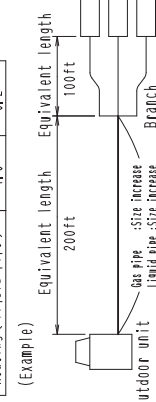


(Example)
 In the above case
 (Cooling) Overall equivalent length = 200ft X 0.5 + 100ft = 200ft
 (Heating) Overall equivalent length = 200ft X 0.2 + 100ft = 140ft
 The rate of change in cooling capacity when Hp=0ft is thus approximately 0.91
 heating capacity when Hp=0ft is thus approximately 1.00


C: 3D058624B

RXYQ120PBTJ / RXYQ144PBTJ / RXYQ240PBTJ / RXYQ360PBTJ

2. Rate of change in heating capacity

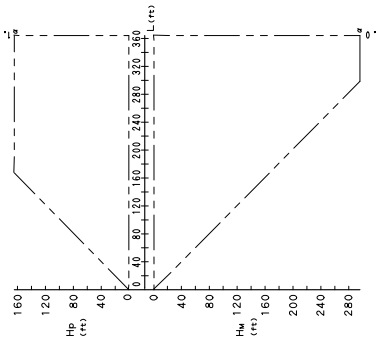

1. Rate of change in cooling capacity

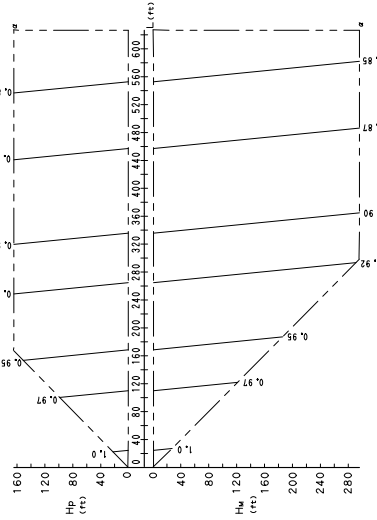

[Explanation of symbols]
 HP : Level difference (between indoor and outdoor units where indoor unit is inferior position)
 HM : Level difference (between indoor and outdoor units where indoor unit is superior position)
 L : Equivalent pipe length (ft)
 α : Rate of change in cooling / heating Capacity
 [Diameter of the main pipes (standard size)]

| Model | gas | liquid |
|-----------------|---------|--------|
| RXYQ120,144PBTJ | φ 1-1/8 | φ 1/2 |
| RXYQ240PBTJ | φ 1-3/8 | φ 5/8 |
| RXYQ360PBTJ | φ 1-5/8 | φ 3/4 |

[Temper grade and Thickness]

| Temper grade | □ Type | 1/2H Type |
|------------------------|---|-----------|
| Outer diameter | φ 1/2 φ 5/8 φ 3/4 φ 7/8 φ 1-1/8 φ 1-3/8 φ 1-5/8 | |
| Minimum Wall Thickness | 0.80 0.99 0.80 0.80 0.99 1.21 1.43 | |


5. Read cooling / heating capacity rate of change in the above figures based on the following equivalent length.

Overall equivalent length = (Equivalent length to main pipe) × Correction factor + (Equivalent length after branching)

Choose a correction factor from the following table.
 [When cooling capacity is calculated: gas pipe size
 When heating capacity is calculated: liquid pipe size]

| Rate of change (object piping) | Correction factor | |
|--------------------------------|-------------------|---------------------|
| | Standard size | Size increase |
| Cooling (Gas pipe) | 1.0 | 120 • 144 240 • 360 |
| Heating (Liquid pipe) | 1.0 | 0.3 0.4 |

(Example) In case of RXYQ240PVDW

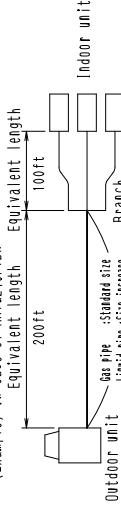

In the above case
 (Cooling) Overall equivalent length = 200ft × 1.0 + 100ft = 300ft
 (Heating) Overall equivalent length = 200ft × 0.4 + 100ft = 180ft
 The rate of change in cooling capacity when Hp=0ft is thus approximately 0.91
 heating capacity when Hp=0ft is thus approximately 1.0

[Notes]

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
- Method of calculating A/C (cooling/heating) capacity:
 The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.
 Calculating A/C capacity of outdoor units
 • Condition: Indoor unit combination ratio does not exceed 100%.


$$\text{Maximum A/C capacity of outdoor units} = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the 100\% combination}}{\text{X (Capacity change rate due to piping length to the farthest indoor unit)}} \times \text{Capacity change rate ratio exceeds 100\%}$$

$$\text{Maximum A/C capacity of outdoor units} = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the combination}}{\text{X (Capacity change rate due to piping length to the farthest indoor unit)}} \times \text{Capacity change rate ratio exceeds 100\%}$$
- When overall equivalent pipe length is 295.3ft or more, the diameter of the main gas and liquid pipes (outdoor unit-branch sections) must be increased.
 When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.
 [Diameter of above case]


| Model | gas | liquid |
|-----------------|---------------|--------|
| RXYQ120,144PBTJ | Not increased | φ 5/8 |
| RXYQ240PBTJ | Not increased | φ 3/4 |
| RXYQ360PBTJ | Not increased | φ 7/8 |

RXYQ168PBTJ / RXYQ264PBTJ / RXYQ288PBTJ

1. Rate of change in cooling capacity

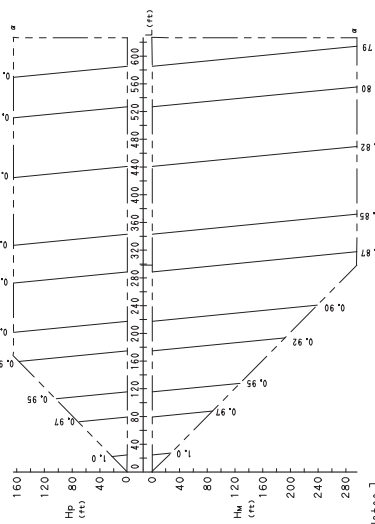

2. Rate of change in heating capacity

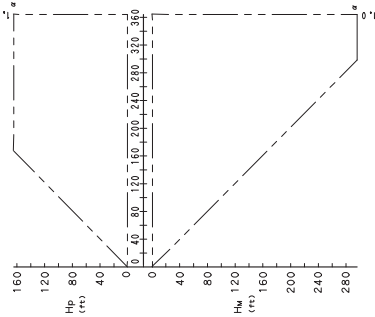

[Explanation of symbols]
 Hp: Level difference between indoor and outdoor units where indoor unit in inferior position
 Hm: Level difference between indoor and outdoor units where indoor unit in superior position
 L: Equivalent pipe length (ft)
 α: Rate of change in cooling / heating capacity
 φ: Diameter of the main pipes (standard size)

| Model | gas | liquid |
|-------------|---------|--------|
| RXYQ168PBTJ | φ 1-1/8 | φ 5/8 |
| RXYQ264PBTJ | φ 1-3/8 | φ 3/4 |
| RXYQ288PBTJ | φ 1-3/8 | φ 3/4 |

[Notes]

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
- Method of calculating A/C (cooling/heating) capacity:
 The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.
 Calculating A/C capacity of outdoor units
 •Condition: Indoor unit combination ratio does not exceed 100%.

$$\text{Maximum A/C capacity of outdoor units} = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the 100\% combination}}{\text{Capacity change rate due to piping length to the farthest indoor unit}}$$
 •Condition: Indoor unit combination ratio exceeds 100%.

$$\text{Maximum A/C capacity of outdoor units} = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the combination}}{\text{Capacity change rate due to piping length to the farthest indoor unit}}$$

- When overall equivalent pipe length is 295.3ft or more, the diameter of the main gas and liquid pipes (outdoor unit-branch sections) must be increased.
 When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.
 [Diameter of above case]

| Model | gas | liquid |
|-------------|---------------|--------|
| RXYQ168PBTJ | Not Increased | φ 3/4 |
| RXYQ264PBTJ | Not Increased | φ 7/8 |
| RXYQ288PBTJ | Not Increased | φ 7/8 |

[Temper grade and Thickness]

| Temper grade | φ Type | 1/2H Type |
|------------------------|--------|-----------|
| Outer diameter | φ 5/8 | φ 3/4 |
| Minimum Wall Thickness | 0.99 | 0.80 |
| | 0.80 | 0.99 |
| | 1.10 | 1.21 |
| | 1.10 | 1.32 |


- Read cooling / heating capacity rate of change in the above figures based on the following equivalent length.

Overall equivalent length = (Equivalent length to main pipe) × Correction factor + (Equivalent length after branching)

Choose a correction factor from the following table.
 When cooling capacity is calculated: gas pipe size
 When heating capacity is calculated: liquid pipe size

| Rate of change (object piping) | Correction factor |
|--------------------------------|-------------------|
| Cooling (gas pipe) | Standard size |
| Heating (liquid pipe) | Size increase |
| | 1.0 |
| | 0.5 |
| | 1.0 |
| | 0.4 |


(Example)

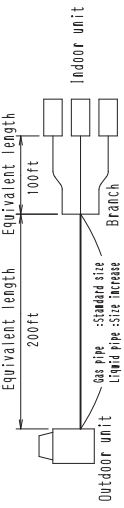


In the above case
 (Cooling) Overall equivalent length = 200ft × 1.0 + 100ft = 300ft
 (Heating) Overall equivalent length = 200ft × 0.4 + 100ft = 180ft
 The rate of change in cooling capacity when Hp = 0ft is thus approximately 0.87
 heating capacity when Hp = 0ft is thus approximately 1.0

RXYQ192PBTJ / RXYQ312PBTJ / RXYQ336PBTJ

2. Rate of change in heating capacity

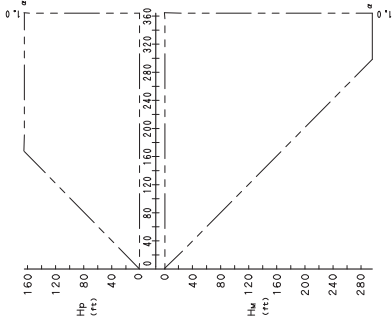

1. Rate of change in cooling capacity

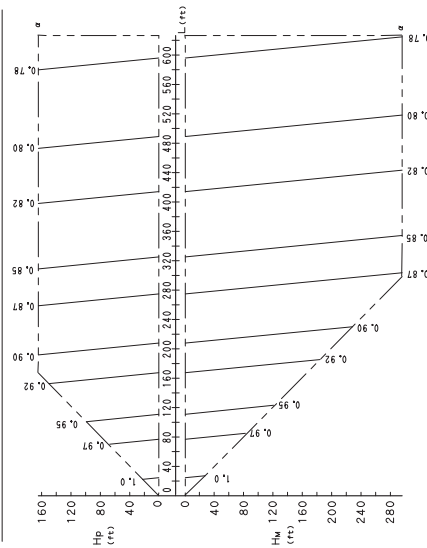

[Explanation of symbols]
 Hp : Level difference between indoor and outdoor units where indoor unit in inferior position
 Hm : Level difference between indoor and outdoor units where indoor unit in superior position
 L : Equivalent pipe length(m)
 α : Rate of change in cooling / heating Capacity [Diameter of the main pipes(standard size)]

| Model | gas | liquid |
|-------------|---------|--------|
| RXYQ192PBTJ | φ 1-1/8 | φ 5/8 |
| RXYQ312PBTJ | φ 1-3/8 | φ 3/4 |
| RXYQ336PBTJ | φ 1-3/8 | φ 3/4 |

[Temper grade and Thickness]

| Temper grade | □ Type | 1/2H Type |
|------------------------|--------|-----------|
| Outer diameter | φ5/8 | φ3/4 |
| Minimum Wall Thickness | 0.99 | 0.80 |
| | 0.80 | 0.80 |
| | 1.10 | 1.10 |
| | 1.21 | 1.21 |
| | 1.32 | 1.32 |


5. Read cooling / heating capacity rate of change in the above figures based on the following equivalent length.

Overall equivalent length= [Equivalent length to main pipe]×Correction factor+[Equivalent length after branching]

Choose a correction factor from the following table.
 When cooling capacity is calculated: gas pipe size
 When heating capacity is calculated: liquid pipe size

| Rate of change (Object piping) | Correction factor |
|--------------------------------|-------------------------------|
| Cooling (gas pipe) | Standard size 1.0 |
| Heating (liquid pipe) | Standard size increase 0.5 |
| | 1.0 |
| | 0.4 |

(Example)

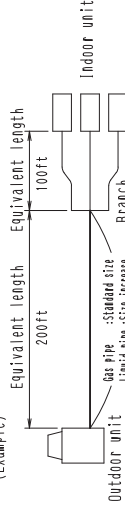

In the above case
 (Cooling) Overall equivalent length=200ft×1.0+100ft=300ft
 (Heating) Overall equivalent length=200ft×0.4+100ft=180ft
 The rate of change in cooling capacity when Hp=0ft is thus approximately 0.86 heating capacity when Hp=0ft is thus approximately 1.0

[Notes]

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
- Method of calculating A/C (cooling/heating) capacity:
 The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.
 Calculating A/C capacity of outdoor units
 • Condition: Indoor unit combination ratio does not exceed 100%.

$$\text{Maximum A/C capacity of outdoor units} = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the 100\% combination}}{\text{Indoor unit combination ratio}}$$

• Condition: Indoor unit combination ratio exceeds 100%.

$$\text{Maximum A/C capacity of outdoor units} = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the combination}}{\text{Indoor unit combination ratio}}$$

• Condition: Indoor unit combination ratio exceeds 100%.

$$\text{Maximum A/C capacity of outdoor units} = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the combination}}{\text{Indoor unit combination ratio}}$$

• Condition: Indoor unit combination ratio exceeds 100%.

$$\text{Maximum A/C capacity of outdoor units} = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the combination}}{\text{Indoor unit combination ratio}}$$


4. When overall equivalent pipe length is 295.3ft or more, the diameter of the main gas and liquid pipes (outdoor unit-branch sections) must be increased.
 When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.

[Diameter of above case]


| Model | gas | liquid |
|-------------|---------------|--------|
| RXYQ192PBTJ | Not increased | φ 3/4 |
| RXYQ312PBTJ | Not increased | φ 7/8 |
| RXYQ336PBTJ | Not increased | φ 7/8 |

RXYQ216PBTJ

2. Rate of change in heating capacity

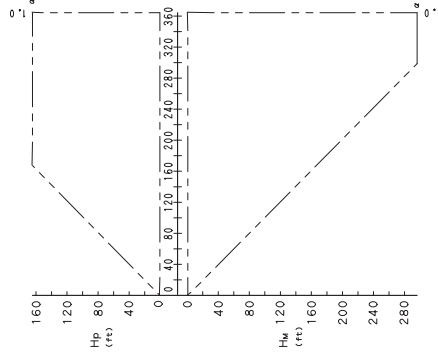

1. Rate of change in cooling capacity

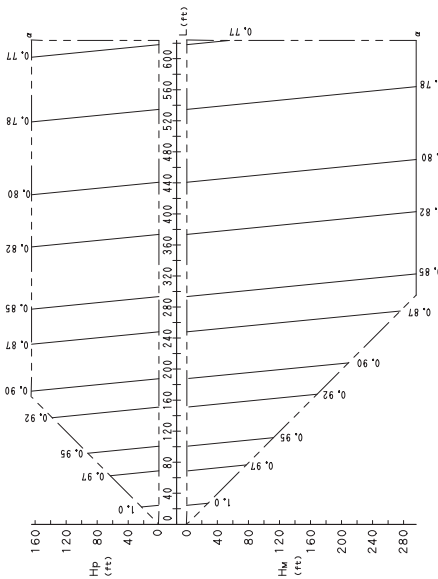

[Explanation of symbols]
 Hp : level difference (ft) between indoor and outdoor units where indoor unit is inferior position
 Hw : level difference (ft) between indoor and outdoor units where indoor unit is superior position
 L : Equivalent pipe length (ft)
 α : Rate of change in cooling / heating Capacity
 [Diameter of the main pipes (standard size)]

| Model | gas | liquid |
|-------------|---------|--------|
| RXYQ216PBTJ | φ 1-1/8 | φ 5/8 |

[Temper grade and Thickness]

| Temper grade | O Type | 1/2H Type |
|------------------------|--------|-----------|
| Outer diameter | φ 5/8 | φ 3/4 |
| Minimum Wall Thickness | 0.99 | 0.80 |
| | 0.99 | 1.10 |

[Notes]

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
- Method of calculating A/C (cooling/heating) capacity:
 The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.
 Calculating A/C capacity of outdoor units
 • Condition: Indoor unit combination ratio does not exceed 100%.

$$\text{Maximum A/C capacity of outdoor units} = \text{A/C capacity of outdoor units obtained from capacity characteristic table at the 100\% combination} \times \text{Capacity change rate due to piping length to the farthest indoor unit}$$
 • Condition: Indoor unit combination ratio exceeds 100%.

$$\text{Maximum A/C capacity of outdoor units} = \text{A/C capacity of outdoor units obtained from capacity characteristic table at the combination} \times \text{Capacity change rate due to piping length to the farthest indoor unit}$$


$$\text{Maximum A/C capacity of outdoor units} = \text{A/C capacity of outdoor units obtained from capacity characteristic table at the combination} \times \text{Capacity change rate due to piping length to the farthest indoor unit}$$
- When overall equivalent pipe length is 295.3ft or more, the diameter of the main gas and liquid pipes (outdoor unit-branch sections) must be increased.
 When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.
 [Diameter of above case]

| Model | gas | liquid |
|-------------|---------------|--------|
| RXYQ216PBTJ | Not increased | φ 3/4 |

5. Read cooling / heating capacity rate of change in the above figures based on the following equivalent length,
 Overall equivalent length = (Equivalent length to main pipe) × Correction factor + (Equivalent length after branching)

Choose a correction factor from the following table.
 [When cooling capacity is calculated: gas pipe size
 [When heating capacity is calculated: liquid pipe size

| Rate of change (Object piping) | Correction factor |
|--------------------------------|-------------------|
| Cooling (gas pipe) | Standard size |
| Heating (liquid pipe) | Size increase |
| | 1.0 |
| | 0.5 |
| | 1.0 |
| | 0.4 |

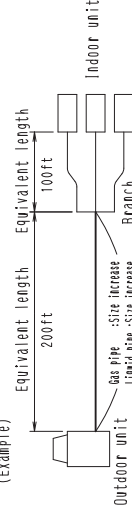


In the above case
 (Cooling) Overall equivalent length = 200ft × 0.5 + 100ft = 200ft
 (Heating) Overall equivalent length = 200ft × 0.4 + 100ft = 180ft
 The rate of change in cooling capacity when Hp=0ft is thus approximately 0.89
 heating capacity when Hp=0ft is thus approximately 1.0

C: 3D059678A

8. Sound Levels (Reference)

8.1 Overall

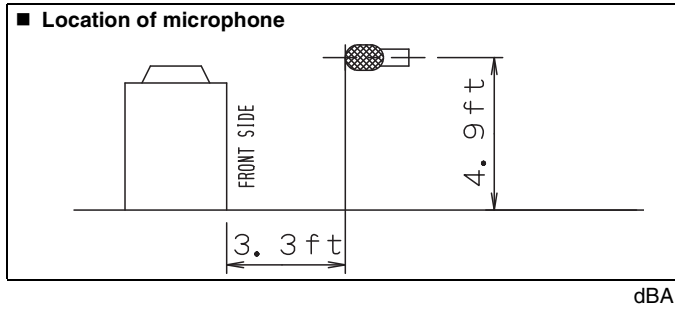

Notes:

1. The operating conditions are assumed to be standard (JIS conditions). Power source 208-230V, 60hz.
2. The operating values were obtained in an anechoic chamber (conversion values).
3. Sound levels will vary depending on a range of factors such as the construction (acoustic absorption coefficient) of the particular room in which the equipment is installed.



| Model | 60Hz / 208-230V |
|-------------|-----------------|
| RXYQ72PBTJ | 58 |
| RXYQ96PBTJ | 58 |
| RXYQ120PBTJ | 60 |
| RXYQ144PBTJ | 61 |
| RXYQ168PBTJ | 61 |
| RXYQ192PBTJ | 62 |
| RXYQ216PBTJ | 62 |
| RXYQ240PBTJ | 63 |

8.2 Octave Band Level

○ — ○ 208V-230V, 60Hz


RXYQ72PBYD

RXYQ96/120PBYD

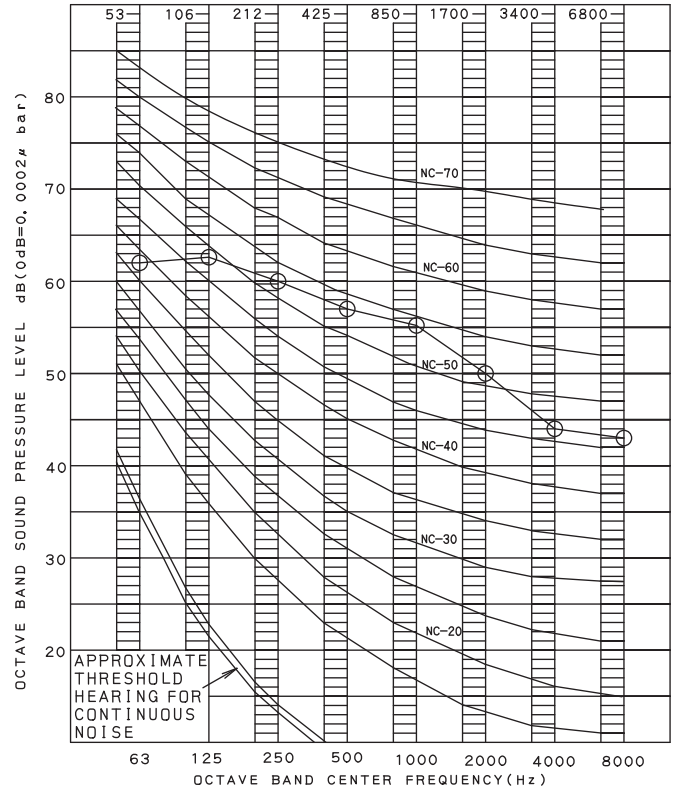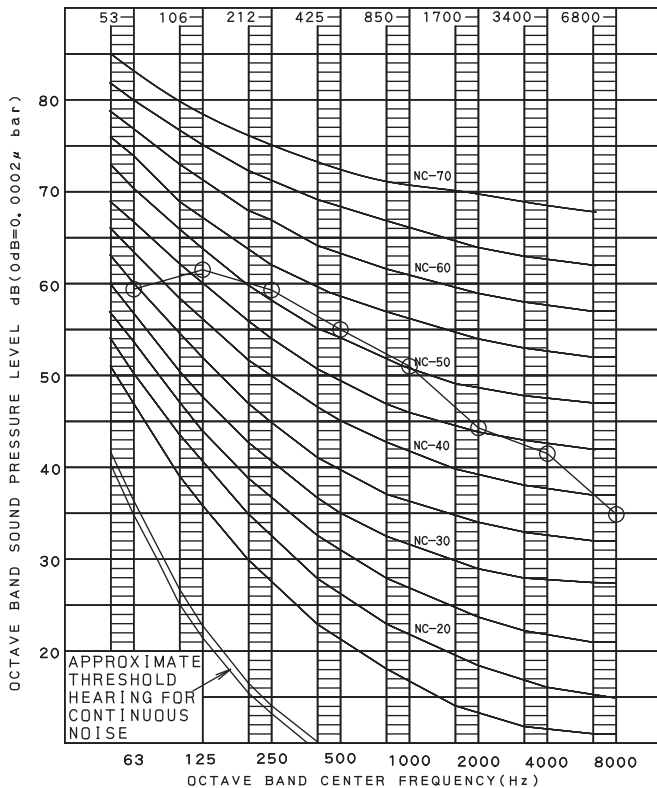

9. Operation Limits

RXYQ72PBTJ / RXYQ96PBTJ / RXYQ120PBTJ / RXYQ144PBTJ / RXYQ168PBTJ / RXYQ192PBTJ /
 RXYQ216PBTJ / RXYQ240PBTJ / RXYQ264PBTJ / RXYQ288PBTJ / RXYQ312PBTJ / RXYQ336PBTJ /
 RXYQ360PBTJ

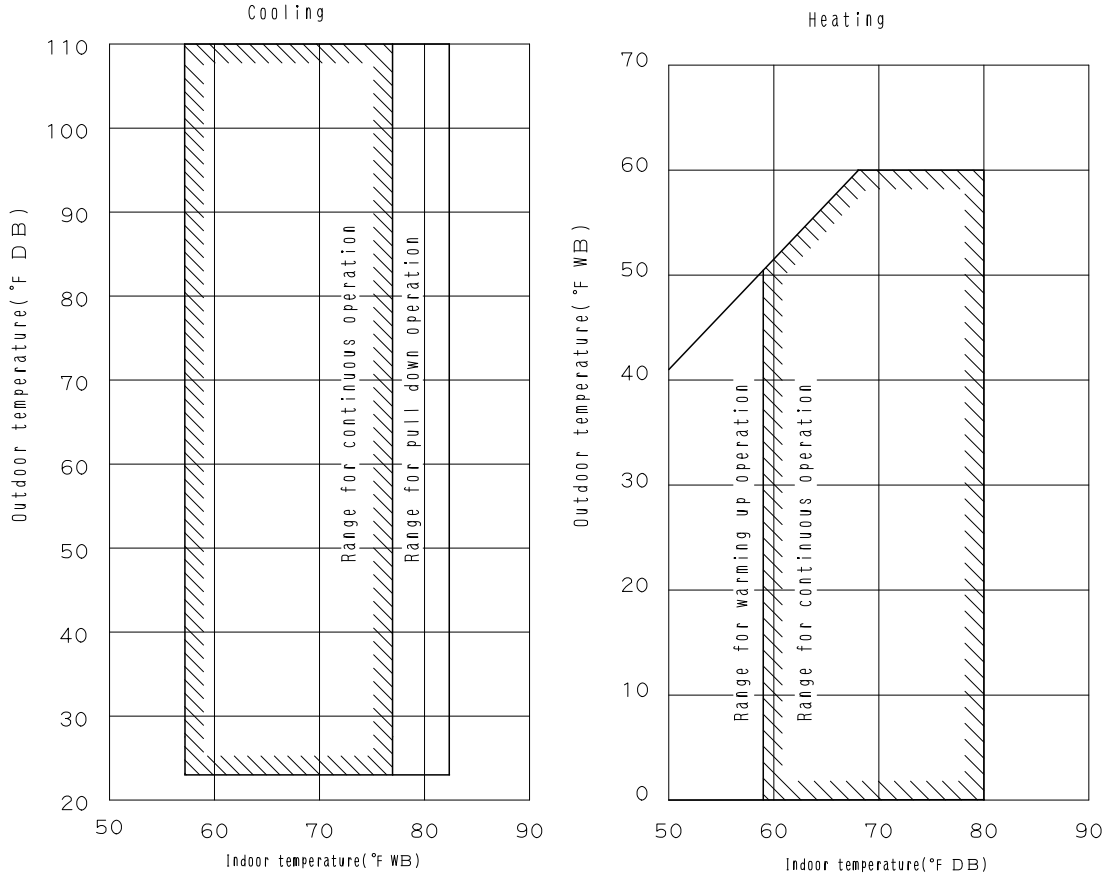

3D043026E







Note: These figures assume the following operating conditions:
 Indoor and outdoor units:
 Equivalent pipe length: 25ft
 Level difference: 0






NOTE: See capacity Tables for Reference Cooling Capacities above 110°F.

10. Accessories

Standard Accessories

RXYQ72PBTJ / RXYQ96PBTJ / RXYQ120PBTJ / RXYQ144PBTJ / RXYQ168PBTJ / RXYQ192PBTJ / RXYQ216PBTJ / RXYQ240PBTJ / RXYQ264PBTJ / RXYQ288PBTJ / RXYQ312PBTJ / RXYQ336PBTJ / RXYQ360PBTJ

| Name | Clamp(1) | Clamp(2) | Clamp(3) | Vinyl tube | Conduit mounting plate | | Manuals, etc. |
|----------|--|--|--|---|--|---|--|
| Quantity | 9 pcs. | 3 pcs. | 1 pc. | 4 pcs. | 2 pcs. | 2 pcs. | 1 pc. each |
| Shape |  (Small) |  (Large) |  (Large) |  |  |  | <ul style="list-style-type: none"> • Operation manual • Installation manual • "REQUEST FOR THE INDICATON" label (Installation records) • Add additional refrigerant charge label |

| Name | Liquid side accessory pipe (1) | Liquid side accessory pipe (2) | Gas side accessory pipe (1) | Gas side accessory pipe (2) | L type accessory joint |
|----------|---|---|---|---|--|
| Quantity | 1 pc. | 1 pc. | 1 pc. | 1 pc. | 1 pc. |
| Shape |  72~120P 144P |  72~120P 144P |  72~120P 144P |  |  144P only |

3P215731-10R

Optional Accessories (For Unit)

RXYQ72PBTJ / RXYQ96PBTJ / RXYQ120PBTJ / RXYQ144PBTJ / RXYQ168PBTJ / RXYQ192PBTJ / RXYQ216PBTJ / RXYQ240PBTJ / RXYQ264PBTJ / RXYQ288PBTJ / RXYQ312PBTJ / RXYQ336PBTJ / RXYQ360PBTJ

| Series | | VRV III | | | | |
|--|---------------|--------------------------|--|--|---|---|
| Models | | RXYQ72PBTJ RXYQ96PBTJ | RXYQ120PBTJ RXYQ144PBTJ | RXYQ168PBTJ | RXYQ192PBTJ RXYQ216PBTJ RXYQ240PBTJ | RXYQ264PBTJ RXYQ288PBTJ RXYQ312PBTJ RXYQ336PBTJ RXYQ360PBTJ |
| Optional accessories | | | | | | |
| Distributive piping | Refnet header | Model | KHRP26M22H (Max. 4 branch) KHRP26M33H (Max. 8 branch) | KHRP26M22H (Max. 4 branch) KHRP26M33H (Max. 8 branch) KHRP26M72H (Max. 8 branch) | KHRP26M22H (Max. 4 branch) KHRP26M33H (Max. 8 branch) KHRP26M72H (Max. 8 branch) KHRP26M73HU (Max. 8 branch) | |
| | | AS No. | AS3802560 | AS3802560 | AS3803567 | |
| | | Z No. | — | — | — | |
| | Refnet joint | Model | KHRP26M22T KHRP26M33T | KHRP26M22T KHRP26M33T KHRP26M72TU | KHRP26M22T KHRP26M33T KHRP26M72TU KHRP26M73TU | |
| | | AS No. | AS3802560 (KHRP26M22T, KHRP26M33T) | AS3803118 (KHRP26M72TU) | AS3803566 (KHRP26M73TU) | |
| | | Z No. | — | — | — | |
| Outdoor unit multi connection piping kit | Model | — | — | BHFP22P100U | BHFP22P151U | |
| | AS No. | — | — | — | — | |
| | Z No. | — | — | — | — | |

C: 3D060089D

Warning



Daikin Industries, Ltd.'s products are manufactured for export to numerous countries throughout the world. Daikin Industries, Ltd. does not have control over which products are exported to and used in a particular country. Prior to purchase, please therefore confirm with your local authorized importer, distributor and/or retailer whether this product conforms to the applicable standards, and is suitable for use, in the region where the product will be used. This statement does not purport to exclude, restrict or modify the application of any local legislation.

Ask a qualified installer or contractor to install this product. Do not try to install the product yourself. Improper installation can result in water or refrigerant leakage, electrical shock, fire, or explosion.

Use only those parts and accessories supplied or specified by Daikin. Ask a qualified installer or contractor to install those parts and accessories. Use of unauthorized parts and accessories or improper installation of parts and accessories can result in water or refrigerant leakage, electrical shock, fire, or explosion.

Read the User's Manual carefully before using this product. The User's Manual provides important safety instructions and warnings. Be sure to follow these instructions and warnings.

If you have any inquiries, please contact your local importer, distributor, or retailer.



©2010 Daikin Industries, Limited.

Daikin® AC Absolute Comfort®, and its design, VRV®, REFNET™, and Quaternity™ are registered trademarks of Daikin Industries, Limited. All rights reserved. LonWorks® and LON® are registered trademarks of Echelon Corporation. BACnet® is a Data Communication Protocol for Building Automation and Control Networks, developed under the auspices of the American Society of Heating, Refrigeration, and Air-Conditioning Engineers (ASHRAE).



JMI-0107



JQA-1452

About ISO 9001

ISO 9001 is a plant certification system defined by the International Organization for Standardization (ISO) relating to quality assurance. ISO 9001 certification covers quality assurance aspects related to the "design, development, manufacture, installation, and supplementary service" of products manufactured at the plant.



EC99J2044

About ISO 14001

ISO 14001 is the standard defined by the International Organization for Standardization (ISO) relating to environmental management systems. Our group has been acknowledged by an internationally accredited program of environmental protection procedures and activities to meet the requirements of ISO 14001.

Dealer

DAIKIN AC (AMERICAS), INC.
1645 Wallace Drive, Suite 110
Carrollton, TX 75006
info@daikinac.com
www.daikinac.com

©All rights reserved

•Specifications, designs and other content appearing in this brochure are current as of March 2011 but subject to change without notice.