

# **Submittal Data Sheet**

Project Name:		
Location:	Approval:	
Engineer:	Date:	
Submitted to:	Construction:	
Submitted by:	Unit #:	
Reference:	Drawing #:	
Dorformanco		

### **Performance**

Cooling Capacity (Btu/hr):	24000
Sensible Capacity (Btu/hr):	18000
Cooling Input Power (kW):	0.05
Heating Capacity (Btu/hr):	27000
Heating Input Power (kW):	0.06
Nominal Ext Static Pressure (inH2O):	0
Max Ext Static Pressure (inH2O):	0

#### **Indoor Unit Details**

macor ornic Details	
Power Supply (V/Hz/Ph:)	208-230/60/1ph
Power Supply Connections:	L1, L2, Ground
Min. Circuit Amps MCA (A):	0.6
Max. Fusible Amps MFA (A):	15
Dimensions (HxWxD):	11-3/8x41-3/8x9
Panel (HxWxD):	N/A
Net Weight (lbs):	31
Weight with Panel (lbs):	

Indoor Unit Type:	Wall Mounted
Cooling Nominal Conditions	Indoor: 80°F DB/67°F WB
	Outdoor: 95°F DB/75°F WB
Heating Nominal Conditions	Indoor: 70°F DB/60°F WB
	Outdoor: 47°F DB/43°F WB
Nominal Piping Length	25
Nominal Height Separation	0

Airflow Rate (CFM wet coil)	635//470
Moisture Removal (pt/h):	
Gas Pipe Connection (inch):	5/8
Liquid Pipe Connection (inch):	3/8
Condensate Connection (inch):	11/16
Sound Pressure Level (dBA):	47
Sound Power Level (dBA):	

### **Appearance - Indoor Unit**






### **Submittal Data Sheet**

Project Name:	
Location:	Approval:
Engineer:	Date:
Submitted to:	Construction:
Submitted by:	Unit #:
Reference:	Drawing #:

### **Dimensional Drawing - Indoor Unit**

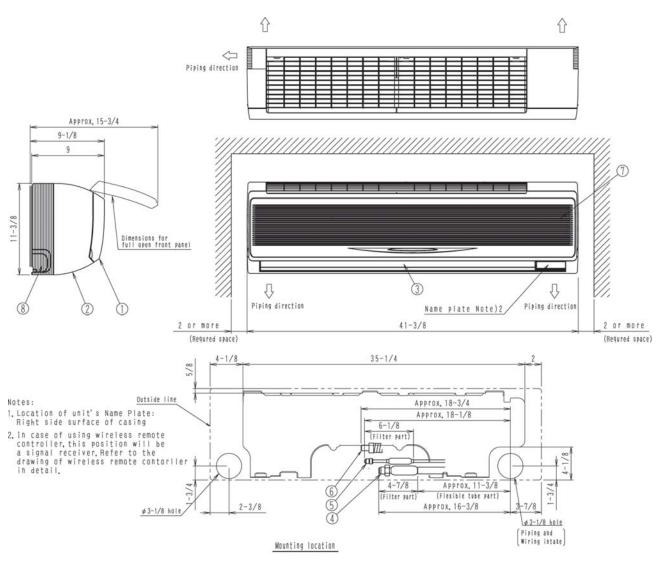



## **Submittal Data Sheet**

Approval:	
Date:	
Construction:	
Unit #:	
Drawing #:	
	Date: Construction: Unit #:

#### **Notes**

Std U.S. Warranty: 6yrs Compressor, 1yrs Parts, 1yr Limited Labor