

Submittal Data Sheet

Project Name:	
Location:	Approval:
Engineer:	Date:
Submitted to:	Construction:
Submitted by:	Unit #:
Reference:	Drawing #:

Performance

12000
8300
0.079
13500
0.079
0
0

Indoor Unit Details

maoor omit betans	
Power Supply (V/Hz/Ph:)	208-230/60/1ph
Power Supply Connections:	L1, L2, Ground
Min. Circuit Amps MCA (A):	0.5
Max. Fusible Amps MFA (A):	15
Dimensions (HxWxD):	24x42-1/8x8-5/8
Panel (HxWxD):	N/A
Net Weight (lbs):	51
Weight with Panel (lbs):	

Indoor Unit Type:	Floor Standing (Concealed)
Cooling Nominal Conditions	Indoor: 80°F DB/67°F WB
	Outdoor: 95°F DB/75°F WB
Heating Nominal Conditions	Indoor: 70°F DB/60°F WB
	Outdoor: 47°F DB/43°F WB
Nominal Piping Length	25
Nominal Height Separation	0

280//210	
1/2	
1/4	
53/64	
36	

Appearance - Indoor Unit






Submittal Data Sheet

Project Name:		
Location:	Approval:	
Engineer:	Date:	
Submitted to:	Construction:	
Submitted by:	Unit #:	
Reference:	Drawing #:	

Dimensional Drawing - Indoor Unit

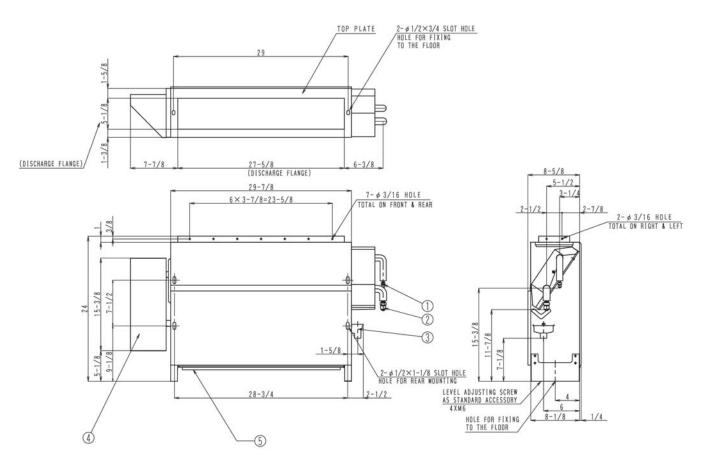



Submittal Data Sheet

Approval:	
Date:	
Construction:	
Unit #:	
Drawing #:	
	Date: Construction: Unit #:

Notes

Std U.S. Warranty: 6yrs Compressor, 1yrs Parts, 1yr Limited Labor