


| Project Name: | | | |
|---------------------------------------|---------------------|---------------------------------|--------------------------|
| Location: | | Approval: | |
| Engineer: | | Date: | |
| Submitted to: | | Construction: | |
| Submitted by: | | Unit #: | |
| Reference: | _ | Drawing #: | |
| TICICIONOC. | | Drawing #. | |
| Performance | | | |
| Indoor Unit Model No: | FHQ18PVJU | Indoor Unit Type: | Ceiling Suspended |
| Outdoor Unit Model No: | RZR18PVJU | Condensing Unit Type: | SkyAir Cool Only |
| | | Condensing officingle. | Indoor: 80°F DB/67°F WB |
| Rated Cooling Capacity (Btu/hr): | 18000 | Rated Cooling | Outdoor: 95°F DB/75°F WB |
| Sensible Capacity (Btu/hr): | 13300 | Conditions | Outdoor. 95 F DB/75 F WB |
| Max/Min Cooling Capacity (Btu/hr / kW | | | linda a w NI/A |
| Cooling Input Power (kW): | 1.57 | Rated Heating | Indoor: N/A |
| SEER: | 18 | Conditions | Outdoor: N/A |
| Rated Heating Capacity (Btu/hr): | N/A | Date d D'a're Land de (ff) | |
| Max/Min Heating Capacity (Btu/hr / kV | | Rated Piping Length(ft) | 25 |
| Heating Input Power (kW): | N/A | Rated Height Separation(ft) | 0 |
| Heating COP (Btu/hr / Btu/hr): | N/A | | |
| HSPF: | N/A | | |
| | | | |
| Indoor Unit Details | | | |
| Power Supply (V/Hz/Ph:) | 208-230/60/1ph | Airflow Rate (CFM wet coil) | 790//670 |
| Power Supply Connections: | L1, L2, Ground | Moisture Removal (pt/h): | |
| Min Circuit Amps MCA (A): | 1.3 | Gas Pipe Connection (inch): | 5/8 |
| Max Overcurrent Amps MFA (A): | 15 | Liquid Pipe Connection (inch): | |
| | 11/16x62-5/8x26-3/4 | Condensate Connection (inch, |): 1 |
| Panel (HxWxD): | N/A | Sound Pressure Level (dBA): | 45 |
| Net Weight (lbs): | 90 | Sound Power Level (dBA): | |
| Weight with Panel (lbs): | | Static Pressure Rated/Max (in | <i>Wg)</i> 0 / 0/0 |
| | | | |
| Condensing Unit Details | | | |
| Power Supply (V/Hz/Ph): | 208-230/60/1ph | Compressor Type: | Inverter |
| Power Supply Connections: | L1, L2, Ground | Capacity Control Range (%): | 35 - 100 |
| Min. Circuit Amps MCA (A): | 16.5 | Airflow Rate (CFM): | 1835 |
| Max. Overcurrent Amps MFA (A): | 20 | Gas Pipe Connection (inch): | 5/8 |
| Max. Starting Current MSC(A): | | Liquid Pipe Connection (inch): | 3/8 |
| Rated Load Amps RLA (A): | 7.1 | Sound Pressure Level (dBA): | 49 |
| | 5/16x35-7/16x12-5/8 | Sound Power Level (dBA): | |
| Net Weight (lbs): | 150 | | |
| | | | |
| System Details | | | |
| Refrigerant Type: | R-410A | Max. Pipe Length (Vertical ft): | 98 ft |
| Holding Refrigerant Charge (lbs): | 5.1 | Cooling Operation Range (%) | : 23 - 115 |
| Additional Charge (oz/ft): | 0.036lbs/ft | Cooling Range w/Baffle (°F): | 0 - 115 |
| Pre-charge Piping (Length ft): | - | Heating Operation Range (°F) | |
| Max. Pipe Length (Total ft): | 164 ft | Heating Range w/Baffle (°F): | N/A |
| | | | |



| Project Name: | | |
|---------------|---------------|--|
| Location: | Approval: | |
| Engineer: | Date: | |
| Submitted to: | Construction: | |
| Submitted by: | Unit #: | |
| Reference: | Drawing #: | |

Dimensional Drawing - Indoor Unit

FHQ18PVJU

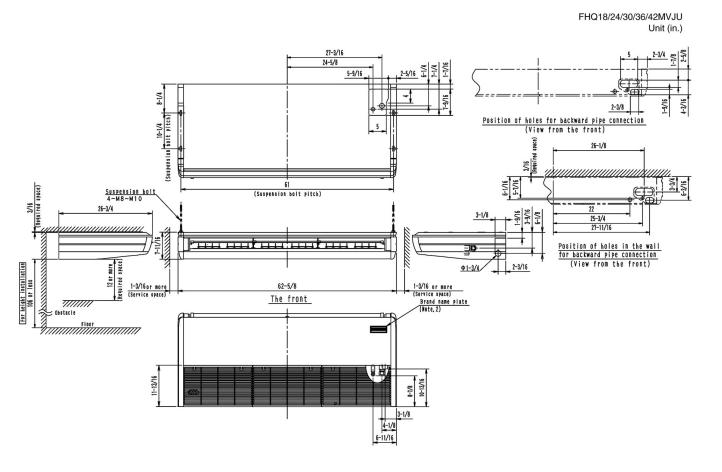




| Project Name: | |
|---------------|---------------|
| Location: | Approval: |
| Engineer: | Date: |
| Submitted to: | Construction: |
| Submitted by: | Unit #: |
| Reference: | Drawing #: |

Dimensional Drawing - Condensing Unit

RZR18PVJU

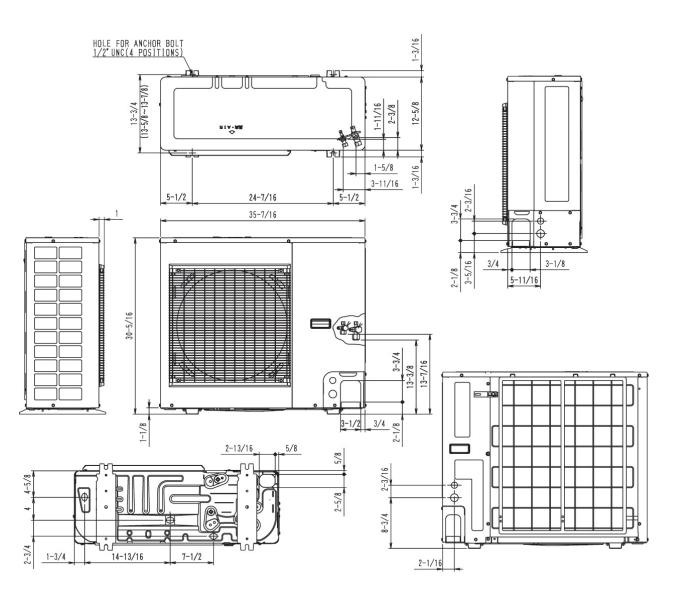



| Project Name: | | |
|---------------|---------------|--|
| Location: | Approval: | |
| Engineer: | Date: | |
| Submitted to: | Construction: | |
| Submitted by: | Unit #: | |
| Reference: | Drawing #: | |
| | | |





FHQ18PVJU

Std U.S. Warranty: 7yrs Compressor, 5yrs Parts

RZR18PVJU

Std U.S. Warranty: 7yrs Compressor, 5yrs Parts